


C:\Users\Smith\10\OneDrive - Jacobs\Engineering\Projects\Deliverables\Drawings\2 Current\321084AE-LAY-008A - Woodland 400kV Ring Configuration - Standard Rev A.dwg - 31/03/2020 18:39:45 - 6244-2054 - SMITH\N10

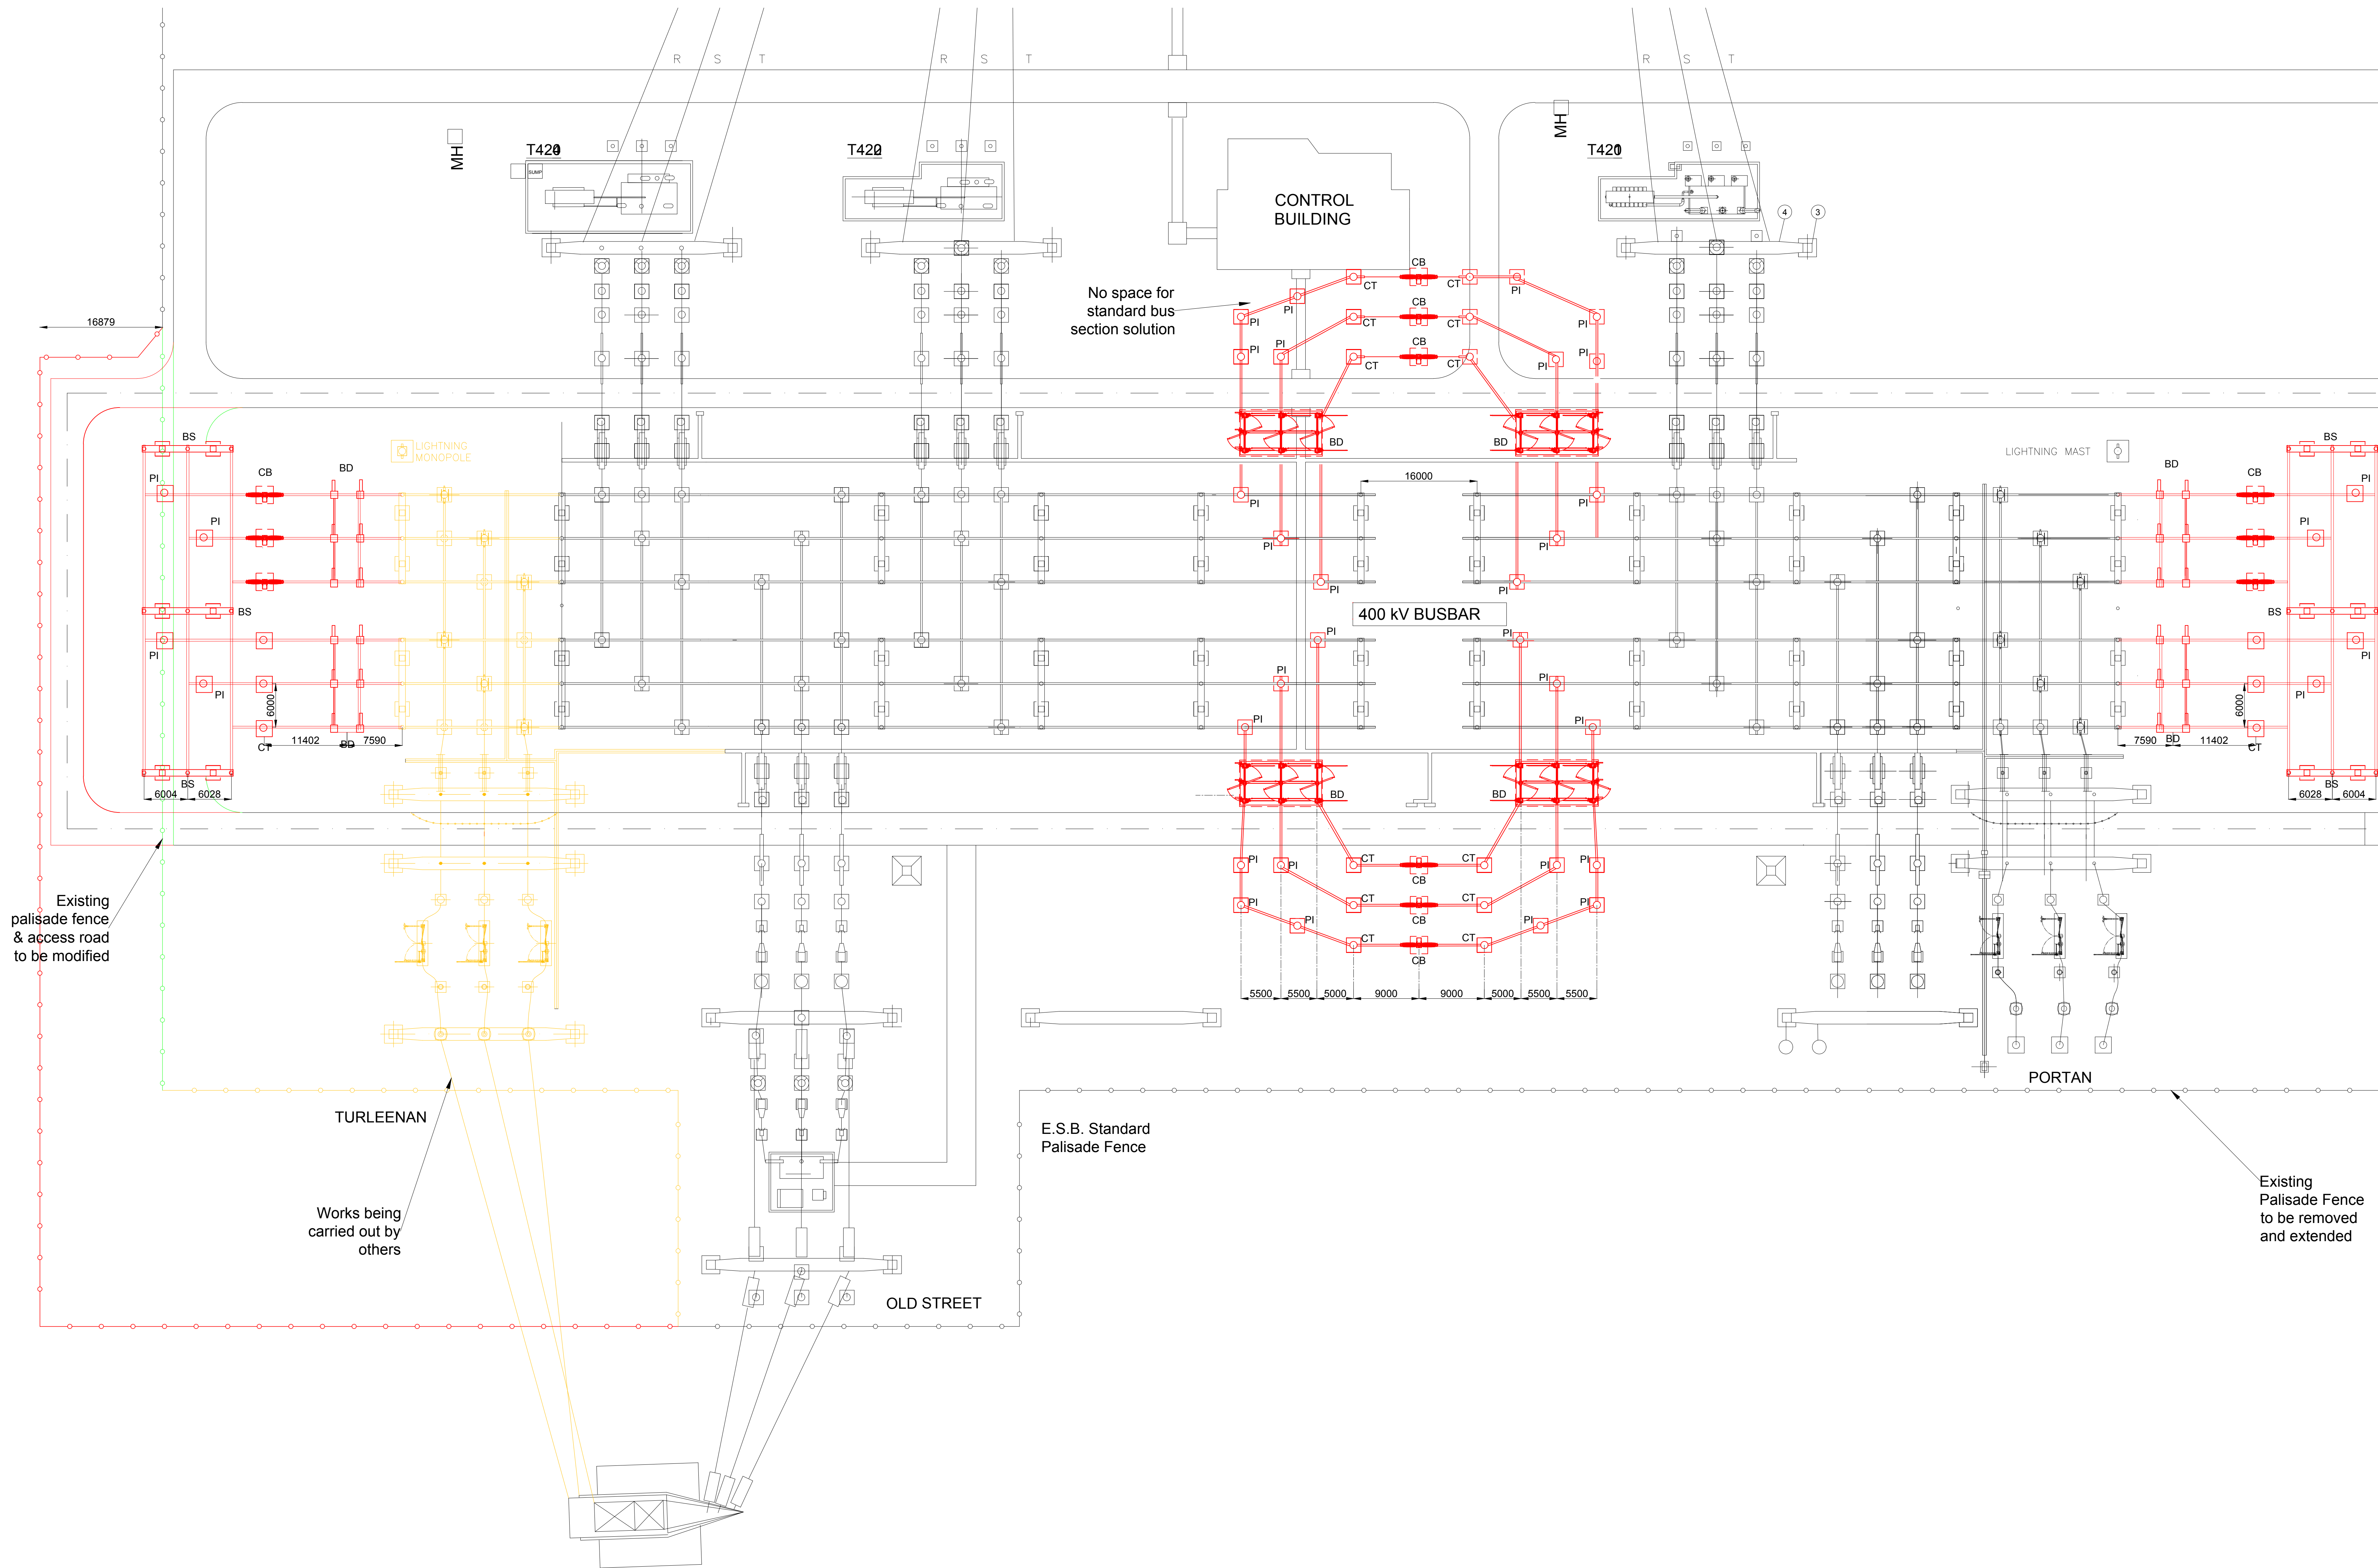

NOTES

1. This drawing is for development purposes.
2. The standard 400kV bus section cannot be accommodated without major substation reconfiguration.

LEGEND

- Existing
- New
- To be removed
- Work by others

DL/DE - Line Disconnector/Earth
VT - Voltage Transformer
CT - Current Transformer
PI - Post Insulator
BS - Busbar Support
SA - Surge Arrestor
CB - Circuit Breaker
BD - Bus Disconnector

REFERENCE DRAWINGS

Meath Study Area (MSA) Woodland 400kV Substation Site Layout Plan 6244-2054

Rev	Rev. Date	Purpose of revision	Drawn	Checked	Rev'd	Approv
A	09.01.20	Draft Issue	NS	SJ	SB	U

JACOBS

95 Rothwell St, Glasgow, G2 7HX
Tel: +44(0)141 243 8000 Fax: +44(0)141 226 9100
www.jacobs.com



EIRGRID CP966

Drawing title

**WOODLAND
400kV RING CONFIGURATION
(STANDARD BUS SECTION OPTION)**

Drawing status

PRELIMINARY

Scale 1:350 @ A0 DO NOT SCALE
Jacobs No 321084AE Rev A

Client no.

Drawing number
321084AE-LAY-008A