


Installed Wind Report – 31st Dec 2011

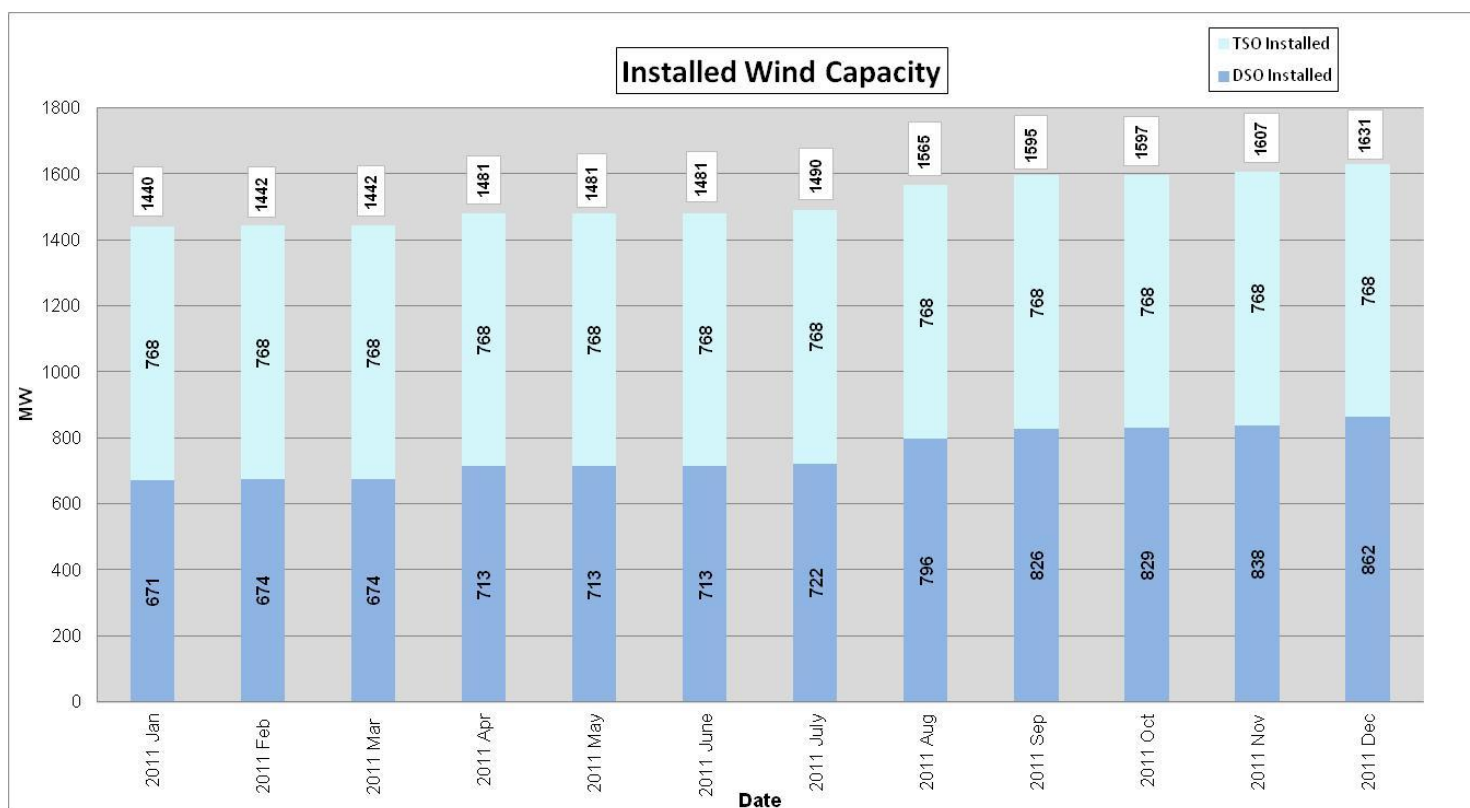

Installed Wind Capacity	DSO	TSO	Total
As of the 31 st Dec 2011	862.40	768.30	1630.70

Definitions:

- DSO: A wind farm is considered connected for its Installed Capacity when it is able to export i.e. where applicable G10 tests complete and passed, applicable EirGrid tests complete, Op cert., TSO Dynamic studies complete.
- TSO: A wind farm is considered connected when it has energised its transformer or where connecting into an existing transformer from installation of the 1st turbine of the extension; the MW value used is based on the Available Installed MW Capacity (number of turbines times the size of the turbine)
- The MW values are the farms Installed Capacities; these may be different to the farms contracted Maximum Export Capacity (MEC) or Available Capacity.

Note:

This report does not include DSO wind farms classed as Energised. A DSO wind farm is considered Energised when a generator turbine has electrical connection to the network i.e. construction complete, however, is not currently permitted to export. Please see the separate DSO Energised Wind Report for further information on these connections.

Transmission Connected Wind Farms (TSO)

For queries related to TSO wind farms please contact the EirGrid Customer Relations Team in EirGrid at 01 7026642 or email info@eirgrid.com,

Wind Farm	Phase	Ref Code	Installed Capacity (MW)	MEC (MW)	Gate	Nearest 110 kV Station	Notified Connection Date
Ballywater	1	TG13	42	31.5	Pre-Gate	Crane	2005 May
Ballywater	2	TG35	0	10.5	2	Crane	2007 Aug
Boggeragh	1	TG29	57	57	2	Boggeragh	2009 Dec
Booltiagh	1	TG07	19.5	19.45	Pre-Gate	Booltiagh	2005 Aug
Castledockrell	1	DG201	41.4	41.4	2	Lodgewood	2011 Jan
Clahane	1	TG12	40	37.8	1	Pallas	2008 Jun
Coomacheo	1	TG18	42.5	41.225	1	Garrow	2008 Mar
Coomacheo	2	DG187	18	18	2	Garrow	2009 Jul
Coomagearlahy	1	TG11	45	42.5	Pre-Gate	Coomagearlahy	2006 Mar
Coomagearlahy	2	TG50	32.5	30	2	Coomagearlahy	2009 Jun

Wind Farm	Phase	Ref Code	Installed Capacity (MW)	MEC (MW)	Gate	Nearest 110 kV Station	Notified Connection Date
Coomagearlahy	3	TG54	8.5	8.5	2	Coomagearlahy	2009 Mar
Derrybrien	1	P33	60.35	59.5	Pre-Gate	Derrybrien	2005 Oct
Dromada	1	DG141	28.5	28.5	2	Dromada	2009 Dec
Garvagh	1(a)	TG23a	48	48	2	Garvagh	2010 Jun
Glanlee	1	TG47	31.6	29.8	1	Glanlee	2007 Jul
Golagh	1	P25	15	15	Pre-Gate	Golagh	1997 Jul
Kingsmountain	1	P38A	25	23.75	Pre-Gate	Cunghill	2003 May
Kingsmountain	2	TG40	11.05	11.05	2	Cunghill	2010 Jun
Lisheen	1(a)	TG55	36	36	2	Lisheen	2009 Jul
Meentycat	1	P38BDF	72.4	70.96	Pre-Gate	Meentycat	2004 Oct
Meentycat	2	TG65	14	14	1	Meentycat	2009 Oct
Mountain Lodge	1	TG06	32	24.8	Pre-Gate	Ratrussan	2008 Apr
Mountain Lodge	3	TG52	0	5.82	2	Ratrussan	2009 Mar
Ratrussan/Bindoo	1	P38-1	48	48	Pre-Gate	Ratrussan	2009 Sep
			768.30	753.06			

Distribution Connected Wind Farms (DSO)

For queries related to DSO wind farms please contact ESB Networks at dsogenerators@esb.ie.

Wind Farm	Phase	Ref Code	Installed Capacity (MW)	MEC (MW)	Gate	Nearest 110 kV Station	Notified Connection Date
Altagowlan	1	DG945	7.65	7.65	Pre-Gate	Corderry	2005 Sep
Anarget	1	ZG937	1.98	1.98	Pre-Gate	Cathleens Fall	2000 Sep
Anarget	2	DG937	1.2	0.02	Pre-Gate	Cathleens Fall	2004 Dec
Arklow Banks	1	DG934	25.2	25.2	Pre-Gate	Arklow	2003 Nov
Ballincollig Hill	1	DG984	13.3	15	Pre-Gate	Tralee	2010 Jan
Ballinlough	1	DG949	2.55	2.55	Pre-Gate	Ikerrin	2006 Jan
Ballinveny	1	DG950	2.55	2.55	Pre-Gate	Ikerrin	2006 Jan
Ballymartin	1	DG130	6.9	6	2	Waterford	2011 Sep
Bawnmore	1	DG58	24	24	2	Macroom	2011 Dec
Beale	1	DG409	1.65	1.65	Pre-Gate	Trien	2000 Nov
Beale	2	DG925	2.55	2.55	Pre-Gate	Trien	2003 Aug
Beallough	1	DG910	1.7	1.7	Pre-Gate	Butlerstown	2008 Nov
Beam Hill	1	DG907	14	14	Pre-Gate	Trillick	2006 Aug
Beenageeha	1	DG954	3.96	3.96	Pre-Gate	Tralee	2000 Oct
Bellacorrick	1	DG955	6.45	6.45	Pre-Gate	Bellacorrick	1992 Oct
Black Banks	1	DG921X	3.4	3.4	Pre-Gate	Corderry	2005 Sep
Black Banks	2	DG921	6.8	6.8	Pre-Gate	Corderry	2005 Sep
Burtonport	1	DG957	0.66	0.66	Pre-Gate	Binbane	2003 Jul
Caranne Hill	1	DG908	3.4	3.4	Pre-Gate	Corderry	2006 Nov
Cark	1	DG42a	15	15	Pre-Gate	Letterkenny	1997 Dec
Carnsore	1	DG919	12	11.9	Pre-Gate	Wexford	2002 Aug
Carraigcannon	1	DG19	23	20	Pre-Gate	Boggeragh	2011 Sep
Carrig	1	DG12	2.55	2.55	Pre-Gate	Dallow	2006 Apr
Carrons	1	DG113	2.5	2.5	2	Rathkeale	2011 Jan
Carrons	2	DG164	2.3	2.49	2	Rathkeale	2011 Jan
Coomatallin	1	DG939	5.95	5.95	Pre-Gate	Dunmanway	2005 Jan
Corkermore	1	DG43	15	15	1	Binbane	2011 Aug
Corneen	1	DG960	3	3	Pre-Gate	Gortawee	2001 Aug
Corrie Mountain	1	DG961	4.8	4.8	Pre-Gate	Arigna	1997 Mar
County Crest	1	DG569	0.8	0.5	Non GPA	Glasmore	2011 Apr
Crocane	1	DG167	1.6	1.7	2	Midleton	2011 Jan
Crockahenny	1	DG962	5	5	Pre-Gate	Trillick	1998 Apr
Cronalocht	1	DG974	4.98	4.98	Pre-Gate	Letterkenny	1997 Jul

Wind Farm	Phase	Ref Code	Installed Capacity (MW)	MEC (MW)	Gate	Nearest 110 kV Station	Notified Connection Date
Cronelea	1	DG45	6	4.99	1	Carlow	2005 Sep
Cronelea	2	DG63	4	4.5	2	Carlow	2009 Jul
Cronelea Upper	1	DG944	2.55	2.55	Pre-Gate	Carlow	2005 Jul
Cronelea Upper	2	DG180	1.7	1.7	2	Carlow	2008 Aug
Cuillalea	1	DG931	3.4	3.4	Pre-Gate	Castlebar	2004 Apr
Cuillalea	2	DG906	1.7	1.59	2	Castlebar	2010 Sep
Culliagh	1	DG963	11.88	11.88	Pre-Gate	Letterkenny	2000 Oct
Curabwee	1	DG964	4.62	4.62	Pre-Gate	Dunmanway	1999 Nov
Curraghgraique	1	DG936	2.55	2.55	Pre-Gate	Nenagh	2004 Jan
Curraghgraique	2	DG100	2.55	2.44	2	Nenagh	2011 Oct
Donaghmede Fr Collins Park	1	DG481	0.25	0.25	Non GPA	Grange	2009 May
Dromdeeven	1	DG911	10.5	10.5	2	Glenlara	2011 Aug
Dromdeeven	2	DG79	16.5	16.5	Pre-Gate	Glenlara	2011 Aug
Drumlough Hill	1	DG920	4.8	4.8	Pre-Gate	Trillick	1997 Aug
Drumlough Hill	2	DG173	10.8	9.99	Pre-Gate	Trillick	2011 Apr
Dundalk IT	1	DG86	0.85	0.5	Pre-Gate	Dundalk	2006 Jan
Dunmore	1	DG62	1.7	1.7	1	Drybridge	2006 Jul
Dunmore	2	DG246	2.5	2.5	2	Drybridge	2009 May
Flughland	2	DG60	9.2	9.2	2	Sorne Hill	2010 Jul
Gartnaneane	1	DG938	10.5	10	Pre-Gate	Meath Hill	2004 Nov
Gartnaneane	2	DG905	5	5	Pre-Gate	Meath Hill	2004 Nov
Geevagh	1	DG40	5.1	4.95	Pre-Gate	Corderry	2006 Jan
Glackmore	1	DG51	0.6	0.6	1	Sorne Hill	2009 Apr
Glackmore	2	DG228	0	0.3	1	Sorne Hill	2009 Apr
Glackmore	3	DG225	2.3	1.4	2	Sorne Hill	2009 Apr
Glanta Commons	1	DG14	20	19.55	Pre-Gate	Ballylickey	2008 Jul
Glanta Commons	2	DG48	8.4	8.4	2	Ballylickey	2009 Apr
Glenough	1	DG68	32.5	33	Pre-Gate	Cauteen	2011 Aug
Gneeves	1	DG947	9.35	9.35	Pre-Gate	Knockeragh	2005 Sep
Gortahile	1	DG69	20	21	2	Carlow	2010 Jul
Grouse Lodge	1	DG78	15	15	2	Rathkeale	2011 Apr
Inis Meain	1	DG969	0.675	0.66	Pre-Gate	Galway	2002 Jul
Inverin (Knock South)	1	DG923	3.3	3.3	Pre-Gate	Galway	1999 Jan
Inverin (Knock South)	2	DG923x	0.66	0.66	Pre-Gate	Galway	1999 Jan
Kealkil	1	DG05	8.5	8.5	Pre-Gate	Ballylickey	2005 May
Kilbranish (Greenoge)	1	DG942	5.2	4.9	Pre-Gate	Crane	2005 Apr
Killybegs	1	DG61	2.55	2.55	1	Binbane	2007 Dec
Kilronan	1	DG970	5	5	Pre-Gate	Arigna	1997 Dec
Kilvinane	1	DG16	4.85	4.5	Pre-Gate	Bandon	2006 Aug
Knockastanna	1	DG912	7.5	7.5	Pre-Gate	Ardnacrusha	2009 Mar
Knockawarriga	1	DG35	22.5	22.5	1	Trien	2008 Jul
Lackan	1	DG52	6.6	6	1	Moy	2007 May
Lahanaght Hill	1	DG21	4.25	4.25	Pre-Gate	Dunmanway	2006 Jan
Largan Hill	1	DG971	5.94	5.94	Pre-Gate	Tonroe	2000 Nov
Lenanavea	2	DG162	2.55	2.55	2	Castlebar	2011 Feb
Lenanavea / Burren	1	DG956	2	2.1	1	Castlebar	2001 Apr
Lios na Carraige	1	DG634	0.017	0.02	Non GPA	Meath Hill	2008 Oct
Loughderryduff	1	DG46	7.65	7.65	1	Binbane	2008 Oct
Lurganboy	1	DG39	5	4.99	1	Letterkenny	2008 Jun
Mace Upper	1	DG206	2.55	2.55	2	Dalton	2009 Jun
Meenachullalan	1	DG38	11.9	11.9	1	Binbane	2008 Nov
Meenadreen	1	DG924	3.4	3.4	Pre-Gate	Cathleens Fall	2003 Apr
Meenakeeragh	1	DG99	4.2	4.2	2	Sorne Hill	2009 Mar
Meenanilta	1	DG928a	2.55	2.55	Pre-Gate	Letterkenny	2003 Sep
Meenanilta	2	DG928	2.55	2.45	Pre-Gate	Letterkenny	2004 Jul

Wind Farm	Phase	Ref Code	Installed Capacity (MW)	MEC (MW)	Gate	Nearest 110 kV Station	Notified Connection Date
Mienvee	1	DG932	0.85	0.66	Pre-Gate	Ardnacrusha	2004 Jan
Mienvee	2	DG270	0.85	0.19	Non GPA	Ardnacrusha	2008 Jan
Milane Hill	1	DG973	5.94	5.94	Pre-Gate	Dunmanway	2000 Sep
Moanmore	1	DG940	12.6	12.6	Pre-Gate	Tullabrack	2004 Dec
Moneenatieve	1	DG946	4.25	3.96	Pre-Gate	Corderry	2005 Sep
Moneenatieve	2	DG208	0.29	0.29	2	Corderry	2011 Oct
Mount Eagle	1	DG918	5.1	5.1	Pre-Gate	Tralee	2005 Mar
Mount Eagle	2	DG116	1.7	1.7	1	Tralee	2008 Nov
Mountain Lodge	1	DG981	4	3	Pre-Gate	Shankill	2008 Apr
Muingnaminne	1	DG25	14.8	15.3	1	Tralee	2008 Nov
Mullinanalt	1	DG36	7.5	7.5	1	Meath Hill	2008 Nov
Owenstown	1	DG739	0.015	0.018	Non GPA	Griffinrath	2010 Dec
Raheen Barr	1	DG927	18.7	18.7	0	Castlebar	2003 Nov
Raheen Barr	2	DG47	8.5	8.5	0	Castlebar	2009 Jun
Rahora	1	DG67	4.25	4.25	2	Great Island	2009 Apr
Rathcahill	1	DG17	12.5	12.5	Pre-Gate	Rathkeale	2011 Apr
Reenascreena	1	DG54	4.5	4.5	2	Dunmanway	2009 Apr
Richfield	1	DG08	27	20.25	Pre-Gate	Wexford	2006 Aug
Richfield	2	DG34	0	6.75	1	Wexford	2006 Aug
Seltanaveeny	1	DG53	4.6	4.6	2	Arigna	2011 Nov
Shannagh	1	DG142	2.55	2.55	2	Binbane	2009 Jun
Skehanagh	1	DG12a	4.25	4.25	Pre-Gate	Dallow	2006 Apr
Skrine	1	DG102	4.6	4.6	2	Lanesboro	2011 Nov
Slievareagh	1	DG117	3	3	2	Tipperary	2009 Mar
Sonnagh Old	1	DG933	7.65	7.65	Pre-Gate	Somerset	2004 May
Sorne Hill	1	DG909	32	31.5	Pre-Gate	Sorne Hill	2006 Jul
Sorne Hill	2	DG59	6.5	7.4	2	Sorne Hill	2009 Jun
Spion Kop	1	DG978	1.2	1.2	Pre-Gate	Arigna	1997 Dec
Taurbeg	1	DG26	25.3	26	Pre-Gate	Glenlara	2006 Jan
Tournafulla	1	DG18	7.5	7.5	Pre-Gate	Trien	2007 Jan
Tournafulla	2	DG03	17.2	17.5	1	Trien	2008 Apr
Tullow Mushroom Growers Ltd	1	DG780	0.15	0.133	Non GPA	Carlow	2010 Jan
Tullynamoyle	1	DG214	9	9	2	Corderry	2011 Jul
Tursillagh	1	DG941	15.18	15	Pre-Gate	Tralee	2000 Nov
Tursillagh	2	DG941a	6.8	6.8	Pre-Gate	Tralee	2004 Sep
WEDcross	1	DG226	4.5	4.5	2	Knockeragh	2009 Nov
			862.40	855.11			

Disclaimer:

All information provided in this official EirGrid site is provided for information purposes only and does not constitute a legal contract between EirGrid and any person or entity unless otherwise specified. Information on this official EirGrid web site is subject to change without prior notice. Although every reasonable effort is made to present current and accurate information, EirGrid makes no guarantees of any kind. Whilst EirGrid strives to ensure as high a level of accuracy as possible, EirGrid makes no warranties or representations of any kind with respect to the content, quality and accuracy of this Information. EirGrid does not accept liability for any loss or damage arising from the use of this Information or reliance on it.