

Enduring Connection Policy

2.2 Constraints Report for

Area J

Solar and Wind

Q4 2022

Version 1.1

Disclaimer

EirGrid has followed accepted industry practice in the collection and analysis of data available. While all reasonable care has been taken in the preparation of this data, EirGrid is not responsible for any loss that may be attributed to the use of this information. Prior to taking business decisions, interested parties are advised to seek separate and independent opinion in relation to the matters covered by this report and should not rely solely upon data and information contained herein. Information in this document does not amount to a recommendation in respect of any possible investment. This document does not purport to contain all the information that a prospective investor or participant in the Single Electricity Market may need.

For queries relating to the document or to request a copy contact:

info@eirgrid.com

Copyright Notice

All rights reserved. This entire publication is subject to the laws of copyright. This publication may not be reproduced or transmitted in any form or by any means, electronic or manual, including photocopying without the prior written permission of the TSOs.

©EirGrid Plc. 2022

The Oval, 160 Shelbourne Road, Ballsbridge, Dublin 4, D04 FW28, Ireland

Document History

Version	Date	Comment
1.0	21/12/2022	
1.1	23/03/2023	<p>Additional scenario included for maintenance sensitivity in Section 5.2 - with 2027 ECP + 4.4 GW Offshore study.</p> <p>Additional data table included with contingency hours in Appendix D for 2027 ECP + 4.4 GW Offshore study.</p> <p>Updated results as the Farranrory Wind Farm Generator is now moved from Kill Hill node in Area H1 to Ballyragget node in Area H2.</p>

Table of Contents

DOCUMENT STRUCTURE	7
IMPORTANT NOTE	8
1 INTRODUCTION	9
1.1 OBJECTIVE	9
1.2 BACKGROUND	9
1.2.1 <i>Generation</i>	9
1.2.2 <i>Demand</i>	10
1.2.3 <i>Interconnection</i>	10
1.2.4 <i>Network</i>	10
1.2.5 <i>Operational Limits</i>	10
1.3 DEFINITION OF OVER-SUPPLY, CURTAILMENT AND CONSTRAINT.....	10
1.3.1 <i>Over-Supply</i>	10
1.3.2 <i>Curtailement</i>	11
1.3.3 <i>Constraint</i>	11
2 STUDY OVERVIEW	12
2.1 STUDY AREAS	13
2.2 STUDY SCENARIOS	13
2.3 RENEWABLE GENERATION SCENARIOS.....	14
2.4 STUDY YEAR SCENARIOS	15
3 STUDY INPUT ASSUMPTIONS	16
3.1 VALID FOR THESE GENERATION ASSUMPTIONS	16
3.2 ALL-ISLAND MODEL.....	16
3.3 DATA FREEZE.....	16
3.4 TRANSMISSION NETWORK OUTAGE PROGRAMME	16
3.5 NETWORK REQUIREMENT FOR BATTERIES AND CONVENTIONAL GENERATORS	17
3.6 PRIORITY DISPATCH FOR RENEWABLE GENERATION CONNECTING AFTER JULY 2019	17
3.7 NETWORK.....	19
3.7.1 <i>Transmission Network</i>	19
3.7.2 <i>Distribution System</i>	22
3.7.3 <i>Ratings and Overload Ratings</i>	22
3.7.4 <i>Transmission Reinforcements</i>	22
3.8 DEMAND	22
3.9 INTERCONNECTION	23
3.9.1 <i>North-South Tie Line</i>	23
3.9.2 <i>Moyle Interconnector</i>	23
3.9.3 <i>East-West Interconnector (EWIC)</i>	23
3.9.4 <i>Greenlink Interconnector</i>	23
3.9.5 <i>Celtic Interconnector</i>	24
3.9.6 <i>Interconnector Capacities</i>	24
3.10 PRIORITY DISPATCH FOR WIND AND SOLAR GENERATION.....	24
3.11 GENERATION	25
3.11.1 <i>Conventional Generation</i>	25
3.11.2 <i>Conventional Generation Outages</i>	25
3.11.3 <i>Renewable Generation</i>	25
3.12 SYSTEM OPERATION	30
3.12.1 <i>Safe Operation (Security Constrained N-1)</i>	30
3.12.2 <i>Operational Constraint Rules</i>	30
4 STUDY METHODOLOGY	33
4.1 PRODUCTION COST MODELLING	33
4.2 THE SOFTWARE: PLEXOS INTEGRATED ENERGY MODEL.....	34
4.2.1 <i>Commitment and Dispatch</i>	34
4.2.2 <i>Generator, Demand and Network</i>	34
4.2.3 <i>DC Loadflow</i>	34
4.3 SYSTEM MODEL.....	34

4.4	SOFTWARE DETERMINATION OF OVER-SUPPLY, CURTAILMENT AND CONSTRAINT	35
4.5	APPORTIONING OF OVER-SUPPLY, CURTAILMENT AND CONSTRAINT	35
4.5.1	<i>Over-supply</i>	35
4.5.2	<i>Curtailement</i>	35
4.5.3	<i>Constraint</i>	35
5	RESULTS SUMMARY FOR IRELAND.....	36
5.1	RES PERCENTAGE	38
5.2	MAINTENANCE SENSITIVITY STUDY REPORT.....	39
6	RESULTS FOR AREA J.....	45
6.1	INTRODUCTION	45
6.2	STUDY NOTES.....	45
6.2.1	<i>Network Outages</i>	45
6.2.2	<i>Benefit of Capacity Factor</i>	45
6.2.3	<i>Notes on Over-supply, Curtailement and Constraint Modelling</i>	46
6.3	GENERATION OVERVIEW.....	47
6.4	NETWORK OVERVIEW	50
6.5	FUTURE GRID SENSITIVITY SCENARIO.....	51
6.6	AREA J – AVERAGE RESULTS.....	52
6.6.1	<i>Offshore Wind Sensitivity Studies</i>	54
6.6.2	<i>Impact of Article 12</i>	54
6.6.3	<i>Future Grid Sensitivity Study</i>	54
6.6.4	<i>Area Subgroups</i>	56
6.7	CONCLUSION – RESULTS FOR AREA J.....	64
	APPENDIX A - NETWORK REINFORCEMENT & MAINTENANCE	65
A.1	REINFORCEMENTS IN 2025	65
A.2	REINFORCEMENTS IN 2027	66
A.3	REINFORCEMENTS IN FUTURE GRID	67
A.4	MAINTENANCE WITHIN THE PLEXOS MODELLING	69
	APPENDIX B - GENERATOR.....	71
B.1	GENERATION TYPE FOR EACH GENERATOR SCENARIO.....	72
B.2	GENERATION TYPE BY AREA FOR EACH GENERATOR SCENARIO.....	72
B.3	GENERATION LIST BY TYPE, NODE AND NAME	74
	APPENDIX C AREA J NODE RESULTS	75
C.1.	ATHY	77
C.2.	BELCAMP 220kV	79
C.3.	BLAKE T.....	81
C.4.	BLUNDELSTOWN	83
C.5.	CARRICKMINES 220kV	85
C.6.	CLONFAD.....	87
C.7.	COOLNABACKY.....	89
C.8.	CUSHALING	91
C.9.	DERRYIRON	93
C.10.	DUNFIRTH.....	96
C.11.	FINGLAS	98
C.12.	GALLANSTOWN.....	100
C.13.	GLASMORE	102
C.14.	GRIFFINRATH.....	104
C.15.	HARRISTOWN	106
C.16.	KILTEEL	108
C.17.	MONREAD	110
C.18.	MOUNT LUCAS	112
C.19.	MULGEETH	115
C.20.	NEWBRIDGE	117
C.21.	PHILIPSTOWN	119
C.22.	POOLBEG NORTH 220kV	121
C.23.	POOLBEG SOUTH 220kV	123

C.24. PORTALOISE	125
C.25. STEPHENSTOWN.....	129
C.26. THORNSBERRY	131
C.27. TIMAHOE NORTH	134
C.28. TREASCON	136
APPENDIX D CONTINGENCIES AND LINES OVERLOADING	138
D.1. YEAR 2025	138
D.2. YEAR 2027	140
D.3. YEAR 2027 + 4.4 GW OFFSHORE STUDY	142
ABBREVIATION AND TERMS	144
REFERENCES.....	147

Document Structure

This document contains six main sections, and three Appendices with an Abbreviations and Terms section at the end.

The structure of the document is as listed below.

Much of this document describes study assumptions and methodology. For customers wishing to see the estimated Total Dispatch Down for Area J, please proceed to both Section 6 and Appendix C.

Section 1: Introduction: presents the purpose of the report and the definitions of over-supply, curtailment and constraint.

Section 2: Study Overview: introduces the study areas, the study years and the generation scenarios. Together, these comprise the study scenarios.

Section 3: Study Input Assumptions: describes the study assumptions as they relate to network, demand, interconnection, generation and system operational limits.

Section 4: Study Methodology: provides an overview of the software used and how the model is put together. A description of how Total Dispatch Down results are apportioned is also provided.

Section 5: Results Summary for Ireland: provides an overview of the reduction in renewable generation forecasted by this study at system level for Ireland.

Section 6: Results for Area J: outlines the area covered by this report. The section provides a network diagram of Area J and an overview of the results for Area J.

Appendix A: Network Reinforcements: lists the reinforcements that are included in the study for each study scenario. These reinforcements have a material impact on the resulting constraints. This section also lists the representative transmission outage scheduled included within the analysis.

Appendix B: Generator Details: provides an overview of the generation. It also provides a comprehensive list of the individual generators included in the study.

Appendix C: Area J Node Results: provides a table of results for every node in the area. This table documents the installed capacity, available energy, over-supply, curtailment and constraint for every node in Area J.

The **Abbreviations and Terms** provide a list of the abbreviations and terms used in the document.

Important Note

This ECP 2.2 constraints report presents an estimate of the reduction in available solar and wind generation based on the study assumptions described. The reduction in available generation has been split into three categories for the purposes of this study: over-supply, curtailment and constraint.

The treatment of renewable generation under these three categories of generation reduction will be determined by the implementation of Articles 12 and 13 of the EU Regulation 2019/943¹.

Following the SEMC decision on the 22nd of March 2022² (SEM-22-009 Decision Paper on Dispatch, Redispatch and Compensation Pursuant to Regulation EU 2019/943. The detailed design of Articles 12 and 13 implementation has yet to be determined and may differ from the pro-rata implementation for constraints used in this study. Therefore, an assumed interpretation has been included in this study, as detailed in this report.

This report uses the term “Total Dispatch Down” to refer to the total reduction in available solar and wind generation i.e. the sum of over-supply, curtailment and constraint and is considered as the key indicator for the results. However, it is important to note that the term “dispatch down” is more correctly applicable only to TSO instructions to reduce generation output from a market position as is the case for curtailment and constraint and is not necessarily applicable to a generator reducing its own output from its availability to a market position so that supply and demand are balanced, as is the case for over-supply.

The term “non-priority” and “not-priority” generators are used synonymously in the report.

The results presented in this report are based on the simulation and modelling assumptions described. The findings are indicative only and this report should in no way be read as a guarantee as to future levels of over-supply, curtailment and constraint.

¹ <https://eur-lex.europa.eu/legal-content/EN/TXT/PDF/?uri=CELEX:32019R0943&from=NL>

² <https://www.semcommittee.com/sites/semc/files/media-files/SEM-22-009%20Decision%20Paper%20on%20Dispatch%2C%20Redispatch%20and%20Compensation%20Pursuant%20to%20Regulation%20EU%202019943.pdf>

1 Introduction

1.1 Objective

It is a requirement of CRU’s ECP 2 decision, CRU/20/060³, that the Transmission System Operator (TSO) carry out system studies to inform applicants about possible generation constraint levels in Ireland. EirGrid will complete this requirement across twelve regional reports. The purpose of these reports is to provide generation developers with information on possible levels of generation output reduction for a range of scenarios.

The reports present results for a range of generation scenarios and indicate the levels of Total Dispatch Down that solar and wind generation might experience in the future, where Total Dispatch Down is defined as follows:

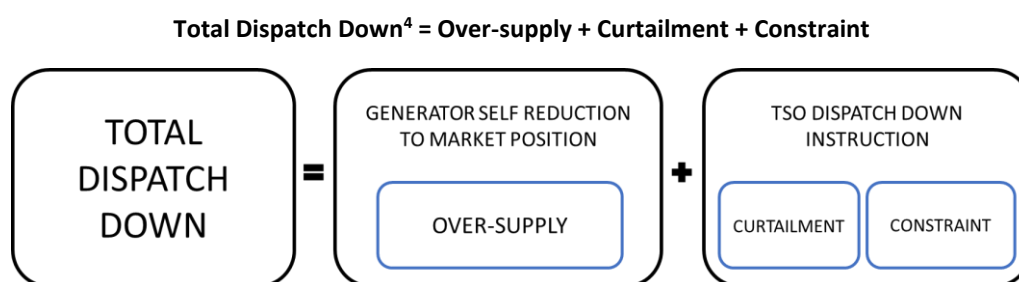


Figure 1-1 Total Dispatch Down Equation

The over-supply, curtailment and constraint results for Area J are included in Section 6 and in Appendix C.

1.2 Background

The core study years for this analysis are 2025 and 2027. A further sensitivity study considers a 2030 study year that aligns with the network assumptions used in the Shaping Our Electricity Future (SOEF) Roadmap⁵ published in November 2021. This 2030 scenario also includes additional reinforcements that have received capital approval since the release of the SOEF Roadmap.

The evaluation of Total Dispatch Down is impacted by a range of assumptions: generation, demand, interconnection, network and operational limits. A summary of each of these is provided below. More details of these study assumptions are provided in Section 3.

1.2.1 Generation

Since Gate 3, EirGrid and ESB Networks have issued an additional 2 GW of wind and solar connection offers under the Non-GPA (Non-Group Processing Approach) rule set CER/09/099. In line with government policy and CRU direction, another 1.8 GW of wind and solar connection offers have been issued under Enduring Connection Policy – Stage 1 (ECP 1). The CRU decision on the Enduring Connection Policy – Stage 2 (ECP 2) mandates that this stage of the connection policy will progress in three separate batches: ECP 2.1, ECP 2.2 and ECP 2.3. This report includes the 2.7 GW of generation, processed under the second of these three batches – ECP 2.2, as part of the model portfolio. These reports present the total dispatch down results for wind and solar generation only.

It is not clear at this stage which generators will be successful in future renewable support auctions or other funding mechanisms, therefore the timing and location of future generation connections is uncertain. For this

³ <https://www.cru.ie/wp-content/uploads/2020/06/CRU20060-ECP-2-Decision.pdf>

⁴ For the purposes of this report, the term “Total Dispatch Down” includes over-supply. Note however that “dispatch down” more correctly refers to dispatch away from a market position and as such, includes curtailment and constraint but not necessarily over-supply.

⁵ <https://www.eirgridgroup.com/the-grid/shaping-our-electricity-f/>

reason, results for various renewable generation scenarios are presented in this report.

1.2.2 Demand

Demand levels in Ireland have been increasing over the last number of years, which has led to a reduction in renewable generation dispatch down levels and in particular, curtailment levels associated with the operational metric SNSP (System Non-Synchronous Penetration), which is impacted by the demand.

The system demand forecast used in the 2025, 2027 and 2030 ECP 2.2 constraints analysis is the median demand forecast from the Generation Capacity Statement (GCS) 2022 - 2031⁶.

1.2.3 Interconnection

As well as the existing Moyle and East-West (EWIC) HVDC interconnectors, the following future HVDC interconnectors have been assumed:

- 500 MW Greenlink HVDC interconnector to Great Britain – has been assumed in service for all study years.
- 700 MW Celtic HVDC interconnector to France – has been assumed in service for the 2027 and 2030 study years.

In addition to the existing North-South HVAC interconnector between Louth and Tandragee, a second North-South HVAC interconnector between County Tyrone and County Meath has also been assumed in service for the 2027 and 2030 scenarios.

1.2.4 Network

The network reinforcement assumptions used for the core 2025 and 2027 scenarios are aligned with the current estimated delivery dates for existing reinforcement projects.

The network assumed for the 2030 study is aligned with the SOEF Roadmap network assumptions, additional reinforcements that have received capital approval since the release of the SOEF Roadmap have also been included.

1.2.5 Operational Limits

Under the SOEF Roadmap, the System Operation workstream sets out a plan for further developing our operation capability to facilitate increases in wind and solar generation levels. This includes evolution of the SNSP, Rate of Change of Frequency (RoCoF), inertia, minimum number of conventional units and system service provision from new, low carbon sources. The current System Operation roadmap assumptions are included in the assumptions for this report.

1.3 Definition of Over-Supply, Curtailment and Constraint

1.3.1 Over-Supply

The reduction of available renewable generation for over-supply reasons is necessary when the total available generation exceeds system demand plus interconnector export flows. In this study, generation reduction for over-supply is applied prior to curtailment and constraint.

Under the EU's Clean Energy Package, it has been mandated that priority dispatch of renewable generation will continue to apply only to generators which connected prior to July 4th 2019 (Article 12). This will create a new type of generator for consideration in the dispatch process – the non-priority dispatch renewable generator, connected post July 4th 2019.

For this study it has been decided to use the current operational interim arrangement, which is the same approach used within the ECP 2.1 constraints analysis, as the implementation of Article 12 post 2026 is yet to be

⁶ https://www.eirgridgroup.com/site-files/library/EirGrid/EirGrid_SONI_Ireland_Capacity_Outlook_2022-2031.pdf

finalised and will be determined through a separate workstream. This approach is summarised below.

During generation reduction for over-supply reasons, a distinction is made between the treatment of priority and non-priority renewable generators, and non-priority generators are reduced ahead of priority generators. Within these two categories of generation, over-supply is applied pro-rata across the all-island system for all generators in the category.

1.3.2 Curtailment

In order to operate a safe and secure electricity system, the TSO must operate the system within certain operational limits. These limits include:

- Maximum level of System Non-Synchronous Penetration (SNSP)
- Maximum Rate of Change of Frequency (RoCoF)
- Minimum level of system inertia
- Minimum number of conventional units for stability
- Minimum levels of reserve
- Conventional generator “must run” rules to ensure adequate system voltage and power flow control

Curtailment is applied to reduce the output of renewable generators in order to ensure that operational limits are not breached, and the system can remain secure and stable. Curtailment is applied to all renewable generators across the island on a pro-rata basis with no distinction made between the treatment of priority and non-priority generators.

1.3.3 Constraint

Generators may also need to be dispatched down due to transmission network limitations and, in particular, to ensure that the thermal overload limits of transmission circuits and transformers are not breached. Transmission equipment may become overloaded in an intact network or for network contingencies, where a line may become overloaded if another line were to trip. In order to avoid this, renewable generation may be dispatched down.

Changes in generator output for this reason are referred to as a ‘constraint’. The constraining of generation is location-specific and can be reduced, for example, by transmission network reinforcements. The model accounts for N-1 contingencies, this means that the system will be dispatched in such a way that any single contingency will not cause overloads.

Constraints are applied pro-rata across renewable generators which are effective in managing a particular network limitation, with no distinction made between the treatment of priority and non-priority generators.

2 Study Overview

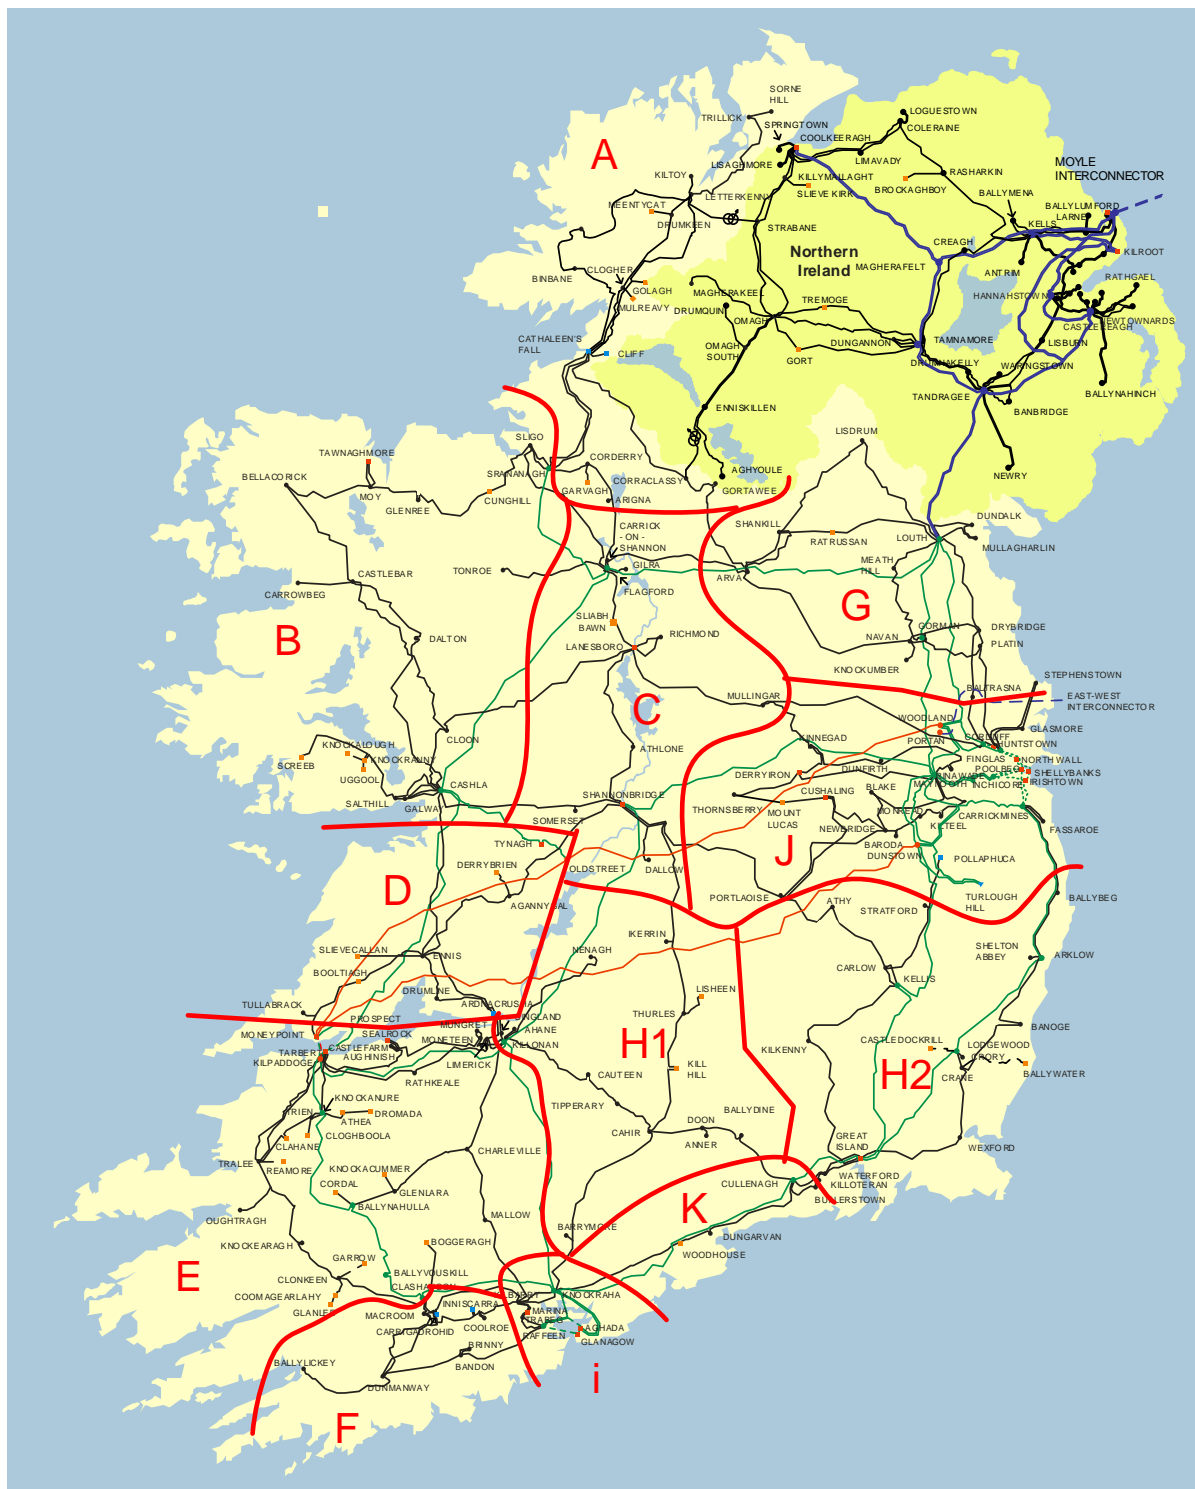


Figure 2-1 Areas Designated for Preparing Wind Energy Profiles, Generation Scenarios and Reporting Results

This section presents an overview of the over-supply, curtailment and constraints assessment. Descriptions of the study scenarios are provided which are a combination of generation scenarios and network study years.

An overview of the study areas is provided. These are fundamental to understanding the contents of the individual area reports. It also provides an overview of the demand, generation and network assumptions that are used in the study. Taken together this information provides an overview of this analysis.

2.1 Study Areas

The areas shown in Figure 2-1 are used for preparing wind energy profiles, for setting up generation scenarios and for reporting results. These areas are similar to those used for the ECP 1 and ECP 2.1 constraints analysis.

2.2 Study Scenarios

Studies were carried out for a number of study years with different network assumptions, and generation scenarios. An overview of the study scenarios can be seen in Figure 2-2.

The core ECP 2.2 study scenarios are highlighted and grouped in Figure 2-2 and cover the years 2025 and 2027. The core 2025 studies include the Greenlink interconnector while the core 2027 studies include both the Greenlink and Celtic interconnectors.

During the initial engagements with industry in advance of finalising assumptions, there were industry requests for a number of sensitivity studies to be carried out as part of the analysis in addition to the core study scenarios. As a result of this, several sensitivity scenarios were developed, these include:

- Sensitivity studies based upon the SOEF (Future Grid) network.
- Multiple sensitivities considering the impact of the connection of offshore wind.
- A sensitivity study to show the impact of the representative maintenance schedule.

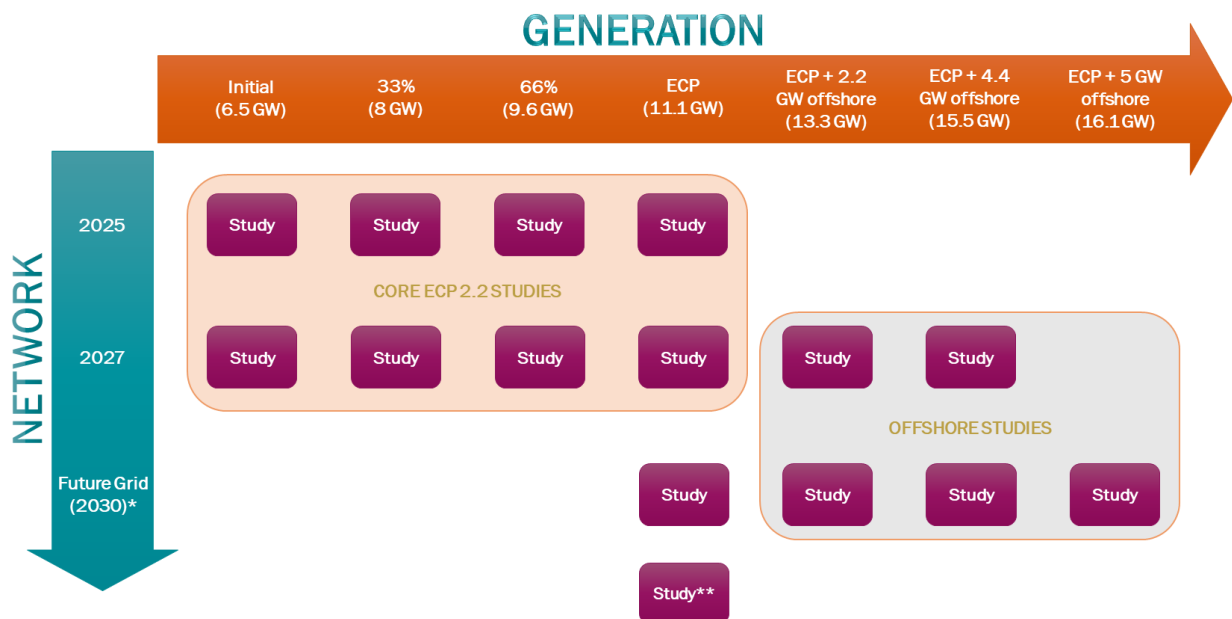


Figure 2-2 Study Scenarios: Matrix of Generation and Network Scenarios

*The Future Grid network is based upon the SOEF Roadmap network, however, network projects that have received capital approval since the publication of the SOEF Roadmap have also been included. **Additional maintenance sensitivity.

A description of the generation scenarios and study year scenarios are provided below in Section 2.3 and Section 2.4 respectively.

2.3 Renewable Generation Scenarios

The four core generation scenarios are summarised below:

- The “Initial” scenario includes all renewable generation currently connected plus all Gate 3, non-GPA, ECP 1 and ECP 2.1 renewable generation expected to connect before the end of 2024.
- The “33%” scenario includes the renewable generation in the “Initial” scenario plus 33% of the difference in renewable generation between the “Initial” and the “ECP” scenario.
- The “66%” scenario includes the renewable generation in the “Initial” scenario plus 66% of the difference in renewable generation between the “Initial” and the “ECP” scenario.
- The “ECP” scenario includes all renewable generation currently connected plus all Gate 3, non-GPA, ECP 1, ECP 2.1 and ECP 2.2 renewable generation.

During the consultations with industry in advance of this review, there was an industry request for further sensitivity studies considering the impact of offshore wind to be included in the study scope. As a result of this, three additional offshore generation scenarios were developed the: “ECP + 2.2 GW offshore”, “ECP + 4.4 GW offshore” and “ECP + 5 GW offshore”.

The three offshore generation scenarios are summarised below:

- The “ECP + 2.2 GW” offshore scenario includes all renewable generation in the “ECP” scenario plus an additional 2.2 GW of offshore wind.
- The “ECP + 4.4 GW” offshore scenario includes all renewable generation in the “ECP” scenario plus an additional 4.4 GW of offshore wind.
- The “ECP + 5 GW” offshore scenario includes all renewable generation in the “ECP” scenario plus an additional 5 GW of offshore wind.

A variety of renewable generation scenarios are included to take account of the possibility that not all generators will ultimately connect, and to give a view on the Total Dispatch Down seen under various renewable generation build out rates.

The results for each generation scenario are presented explicitly for each area in their respective area report. In this report the results for Area J are presented for each renewable generation scenario.

2.4 Study Year Scenarios

Network	TER (TWh)		
Year	Ireland	Northern Ireland	All – Island
2025	38.5	9.27	47.8
2027	41.3	9.74	51
Future Grid	45.1	10.17	55.2

Table 2-1 Total Electricity Requirement (TER) (TWh) from All-Island Generation Capacity Statement 2022-2031

The study years are chosen to capture expected progress over the short to medium term with regard to predicted operational limitation improvements, transmission reinforcements and forecast demand increase.

This is achieved by studying the years 2025 and 2027. For the years 2025 and 2027, the median demand forecast from EirGrid and SONI’s All-Island Generation Capacity Statement 2022-2031⁷ was used.

In consulting with industry in advance of this review, there was a request for an additional study showing the impact of the Shaping Our Electricity Future (SOEF) Roadmap. Hence, a Future Grid scenario has also been studied, which has the network and operational constraint assumptions that are aligned with the SOEF Roadmap study. The Future Grid study horizon also includes network reinforcements that have received capital approval since the publication of the SOEF Roadmap. The demand level for the Future Grid study is based on the All-Island Generation Capacity Statement 2022-2031 median demand scenario for the year 2030.

⁷ https://www.eirgridgroup.com/site-files/library/EirGrid/EirGrid_SONI_Ireland_Capacity_Outlook_2022-2031.pdf

3 Study Input Assumptions

This section provides an overview of the input assumptions for the over-supply, curtailment and constraint modelling.

3.1 Valid for these Generation Assumptions

The estimated over-supply, curtailment and constraint levels in this report are valid for the generation assumptions used in these studies.

3.2 All-Island Model

As ECP 2.2 is an Ireland connection process, this report provides estimates of over-supply, curtailment and constraint levels for Ireland and not for Northern Ireland. However, for this study, the all-island system including Ireland and Northern Ireland has been modelled in Plexos. This is necessary in order to provide a more accurate estimate of generation reduction levels, given that both over-supply and curtailment are all-island issues.

3.3 Data Freeze

The data freeze for the input assumptions for this analysis was July 2022 for the 2025 and 2027 study years and November 2022 for the Future Grid study year. As a result, there may be some recent developments within the electricity network that are not included.

3.4 Transmission Network Outage Programme

The previous ECP 2.1 constraints analysis included a representative transmission outage schedule. The outages within this schedule represented a geographical spread of circuits across the system and were each configured for a three-month period. This allowed a representation of outage impact in each geographical area to be included within the studies.

After consultation with industry, it was decided for the ECP 2.2 constraints analysis to increase the number of outages and reduce the duration from three-months to one-month. These higher frequency, shorter duration outages were also geographically distributed across the system to give a representation of a transmission outage programme – this schedule was formulated by working alongside the outage planning team within EirGrid. The transmission outage schedule used in this analysis is given in Appendix A Table A4.

This outage schedule was included in the ECP 2.2 analysis, as in reality a transmission outage programme will be implemented each year, resulting in outages of transmission circuits and other equipment for periods of time. Transmission outages may be due to scheduled maintenance, forced outages, to facilitate new connections or for reinforcement reasons (e.g. circuit/busbar upgrades).

3.5 Network Requirement for Batteries and Conventional Generators

For this analysis batteries have been modelled using the battery class within Plexos. They have been modelled using the general assumptions shown in Table 3-1.

General Battery Modelling Assumptions	
Max. State of Charge	95%
Min. State of Charge	5%
Charge Efficiency	90%
Discharge Efficiency	90%
Max Cycles per Day	1

Table 3-1 General Battery Modelling Assumptions

The battery capacity (MWh) and max power (MW) has also been entered into the model and were specific to each battery.

For this analysis, the shorter duration batteries (batteries with a storage duration of ≤ 2 hours), were modelled to supply reserve in the form of Primary Operating Reserve (POR), Secondary Operating Reserve (SOR), Tertiary Operating Reserve 1 (TOR1) & Tertiary Operating Reserve 2 (TOR2). The residual shorter duration batteries were also used for energy arbitrage when the reserve requirements were met. The reserve requirements used in the analysis is given in Section 3.12.2.4 (Table 3-9).

The longer duration batteries (batteries with a storage duration of > 2 hours) were used within the model for energy arbitrage. The cycling of these batteries was decided by the Plexos optimisation. Plexos identifies the optimal charge and discharge times to maximise returns.

This approach means that the longer duration batteries charge during times of high renewable generation when the system price is lower, therefore, integrating more solar and wind generation on the system. Note the batteries in the model are reacting to system wide prices and are not responding to local issues. In general, this approach means batteries do not export power to the system during times of high wind and solar generation.

For conventional generation, the dispatch is primarily economic in nature. As such, the software only runs the relatively expensive conventional generators infrequently in the simulation.

Hence, the model generally does not dispatch batteries and peaking generators at times of high solar and wind generation output. For this analysis, these assumptions are reasonable. However, in the future, if there was a need for concurrent output from batteries at the same time as wind and solar and/or if a future operation of the system required prolonged running of peaker generators, or that some network capacity be explicitly reserved for peaker generators, then this analysis method would need to be revised.

3.6 Priority Dispatch for Renewable Generation Connecting after July 2019

EU regulation 2019/943 published in June 2019 introduced a clause in relation to the treatment of priority dispatch for renewable generation which connected after the 4th July 2019.

The relevant clause (Article 12) is as follows:

REGULATION (EU) 2019/943 OF THE EUROPEAN PARLIAMENT AND OF THE COUNCIL of 5 June 2019 on the internal market for electricity⁸

Article 12 (6)

Without prejudice to contracts concluded before 4 July 2019, power-generating facilities that use renewable energy sources or high-efficiency cogeneration and were commissioned before 4 July 2019 and, when commissioned, were subject to priority dispatch under Article 15(5) of Directive 2012/27/EU or Article 16(2) of Directive 2009/28/EC of the European Parliament and of the Council (20) shall continue to benefit from priority dispatch. Priority dispatch shall no longer apply to such power-

⁸ <https://eur-lex.europa.eu/legal-content/EN/TXT/PDF/?uri=CELEX:32019R0943&from=EN>

generating facilities from the date on which the power-generating facility becomes subject to significant modifications, which shall be deemed to be the case at least where a new connection agreement is required or where the generation capacity of the power-generating facility is increased.

Under Article 12, renewable generation that connected before the 4th of July 2019 will still hold priority dispatch status, while generation connected after this date will not. This will create a new type of generator for consideration in the dispatch process – the non-priority dispatch renewable generator, connected post July 4th 2019.

The SEMC published a decision paper in relation to Article 12 and 13 of the EU 2019/943 on the 22nd of March 2022⁹ (SEM-22-009 Decision Paper on Dispatch, Redispatch and Compensation Pursuant to Regulation EU 2019/943). The detailed design of Articles 12 and 13 implementation has yet to be determined and may differ from the pro-rata implementation for constraints used in this study. Therefore, an assumed interpretation has been included in this study, this interpretation has been outlined below.

During generation reduction for over-supply reasons, a distinction is made between the treatment of priority and non-priority renewable generators, with non-priority generators being dispatched down ahead of priority generators. Within, these two categories of generation, over-supply is applied pro-rata across the all-island system for all generators in the category.

During curtailment or constraint of renewable generation, no distinction is made between priority and non-priority generators, and dispatch down is applied pro-rata across either the all-island system (in the case of curtailment), or across the relevant transmission nodes (in the case of constraint).

⁹ <https://www.semcommittee.com/sites/semc/files/media-files/SEM-22-009%20Decision%20Paper%20on%20Dispatch%2C%20Redispatch%20and%20Compensation%20Pursuant%20to%20Regulation%20EU%202019943.pdf>

3.7 Network

3.7.1 Transmission Network

This section details the modelling assumptions used in this study for the transmission network.

The transmission system in Ireland and Northern Ireland is a meshed network with voltage levels at 400 kV, 275 kV, 220 kV and 110 kV. The network is necessary to allow bulk power flows to be transported over long distances from power stations and renewable generation sites to the towns and cities in Ireland and Northern Ireland. A diagram of the Irish transmission system in 2021 can be seen in Figure 3-1. In addition to the current transmission network a number of network reinforcements are considered in each network scenario. A list of the network reinforcements used in the study is provided in Appendix A.

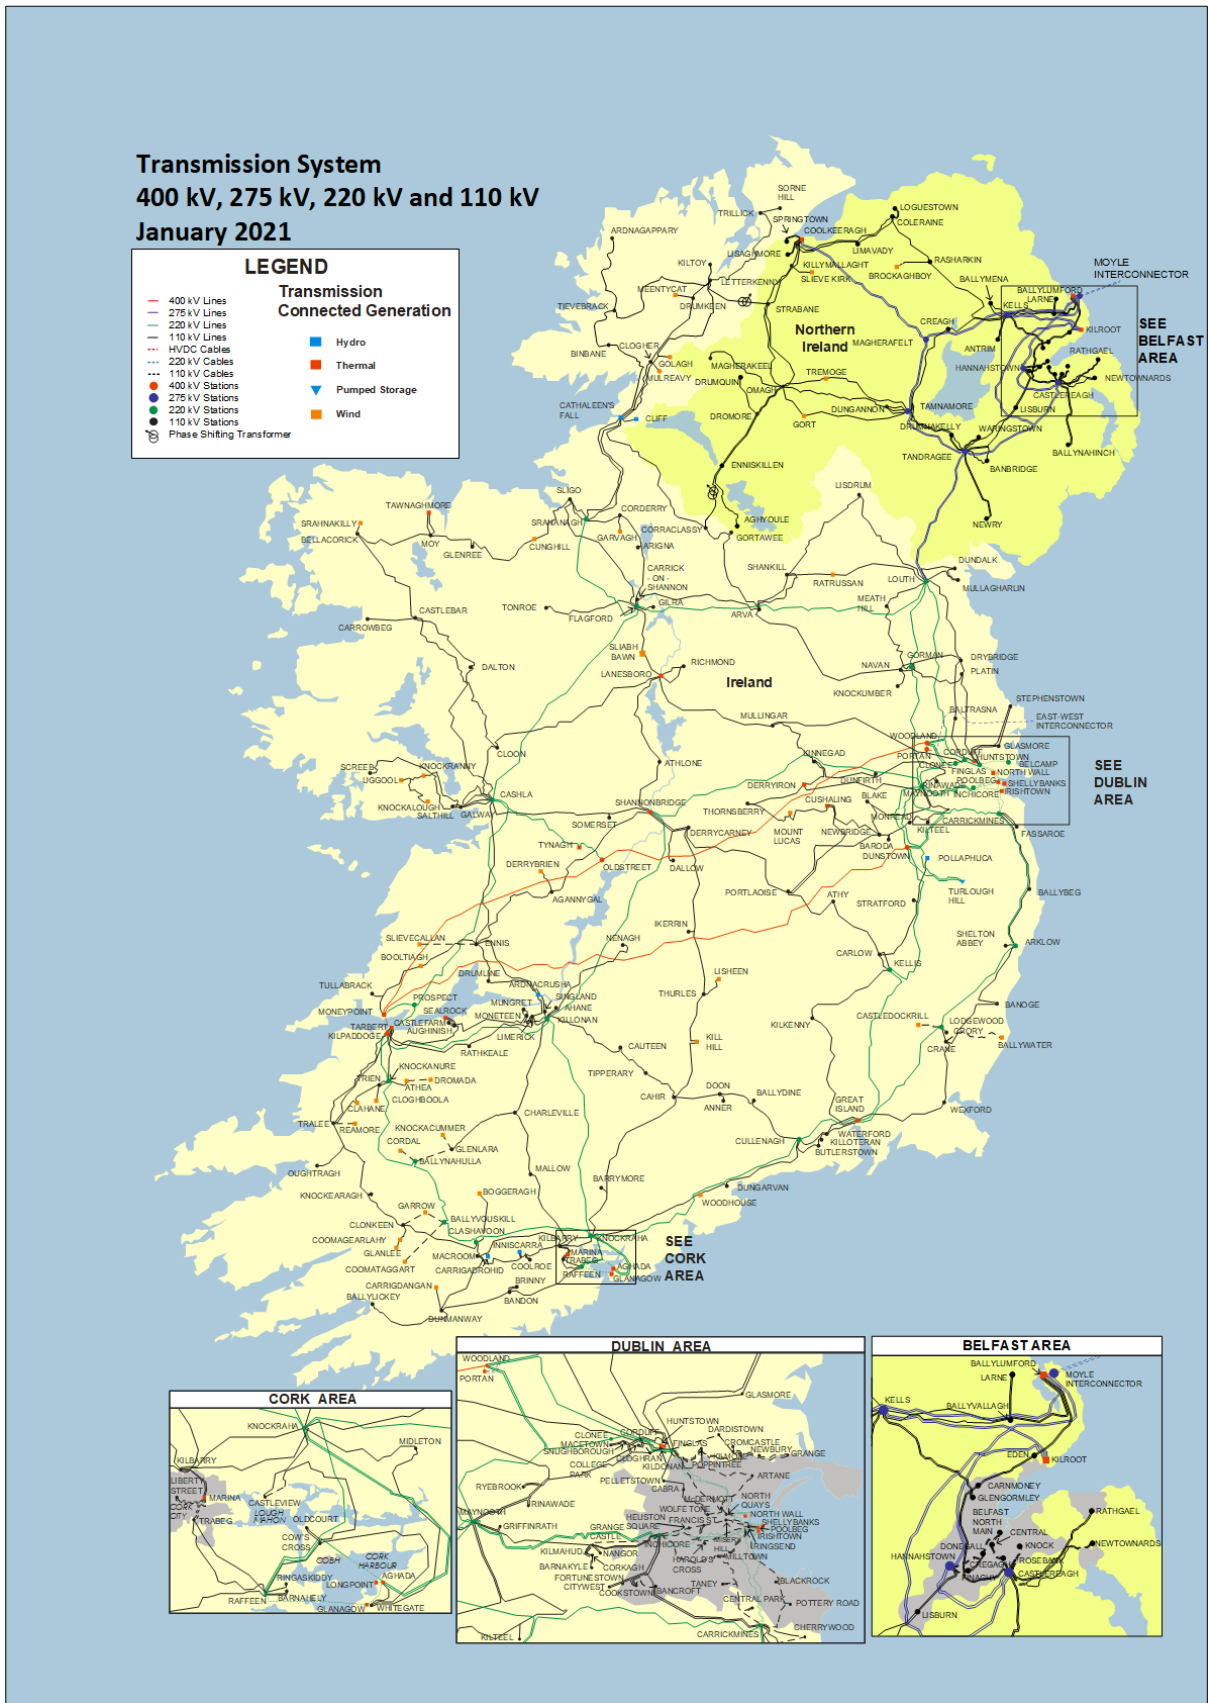


Figure 3-1 Ireland Transmission Network 2021

Figure 3-2 shows the Future Grid (2030) Ireland transmission network, this diagram shows the location of the large network projects that are included in the Future Grid scenario.

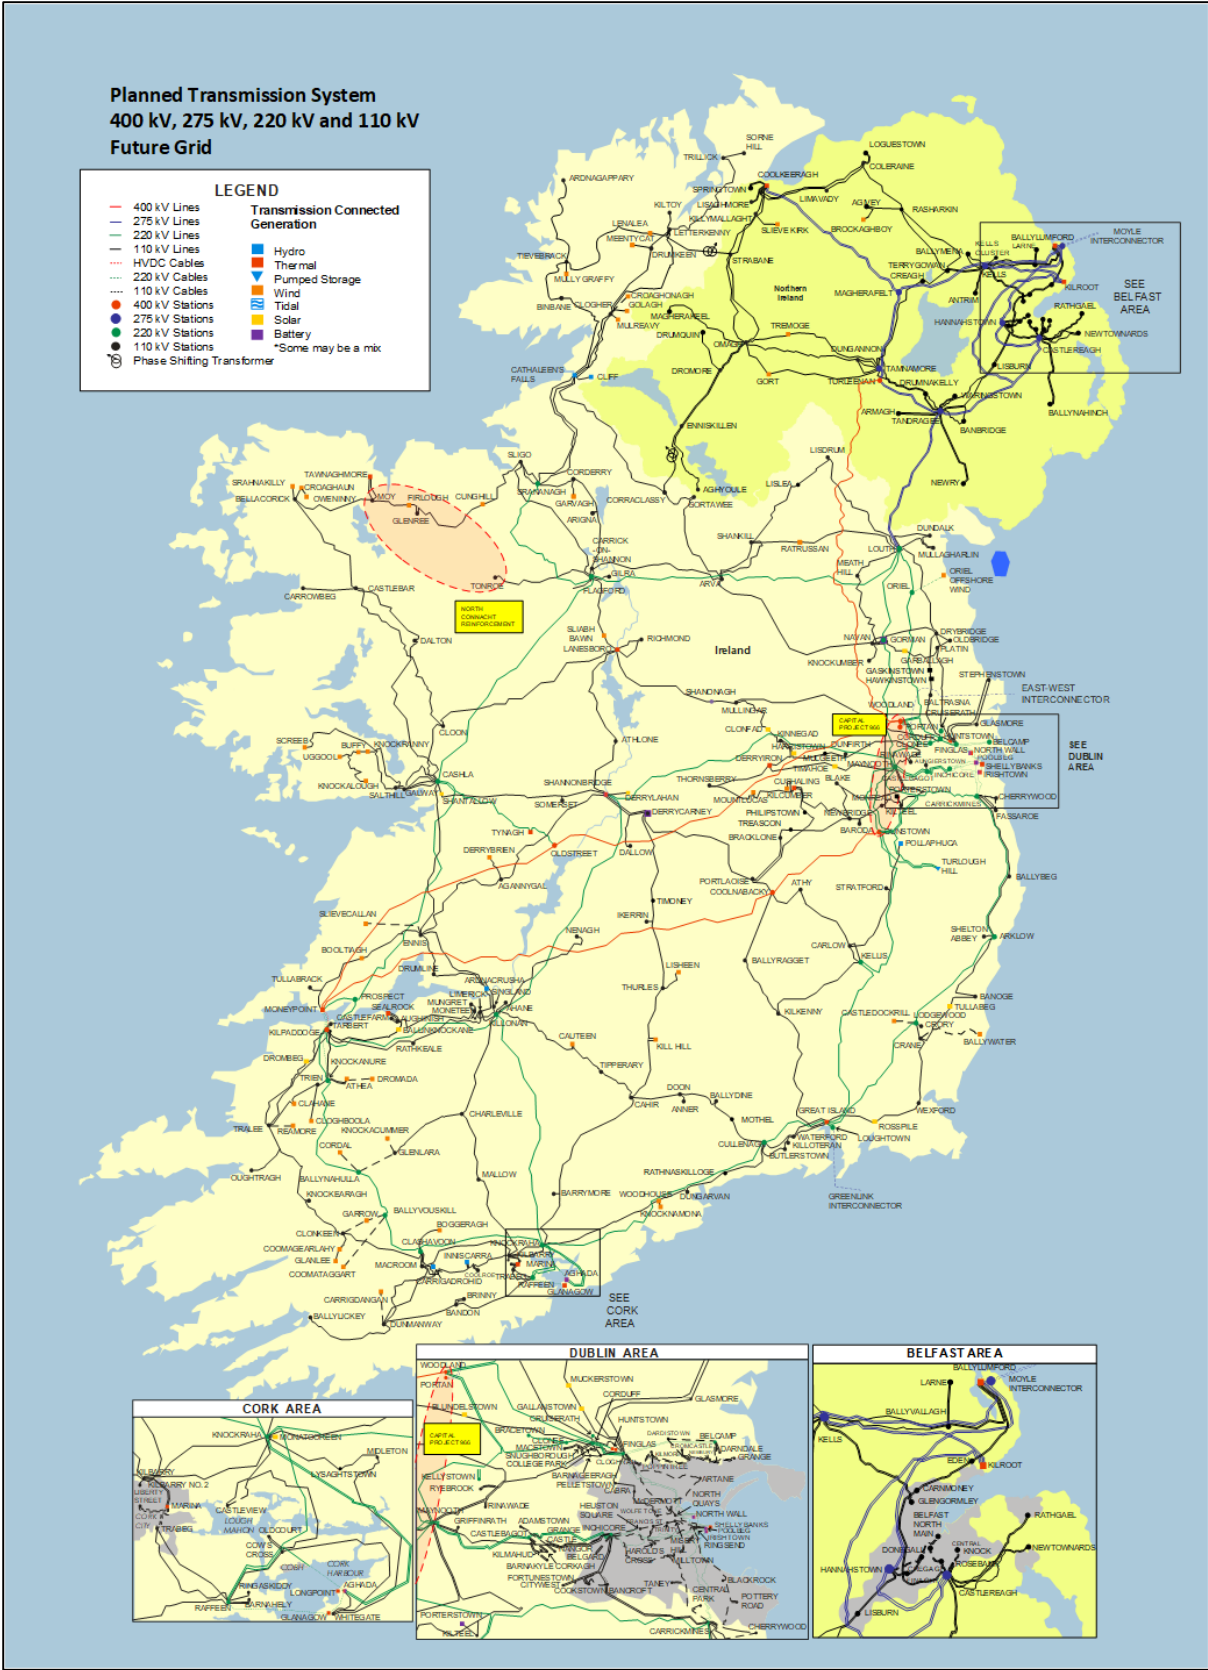


Figure 3-2 Ireland Transmission Network Showing Assumed Future Network Reinforcements

The indicative locations of new stations have been included in Figure 3-2.

3.7.2 Distribution System

For the purposes of the constraints modelling, a simplified representation of the distribution system is used whereby all load and generation is assumed to be aggregated to the nearest transmission node.

Hence, this report does not account for the impact of constraints (if any) on the distribution network.

3.7.3 Ratings and Overload Ratings

The Ireland transmission system is operated to safely accommodate a single transmission asset loss (N-1 contingency). While formulating an optimum dispatch, system operation takes account of potential overloads that could be caused as a result of certain N-1 contingencies on the transmission system. When determining if the post-contingency flows are within limits, the system operator uses the overload rating of the apparatus or plant (for N-1) as well as the normal rating (for N flows). Where available, the overload rating is typically higher than the normal rating but is only allowed in emergency conditions and for short periods of time. The overload rating is plant specific. The Plexos models used for ECP 2.2 constraint reporting include N-1 contingency monitoring and both ratings and overload ratings.

3.7.4 Transmission Reinforcements

For each study year (2025, 2027 and 2030 Future Grid) a number of transmission reinforcements are added to the model. These additional transmission reinforcements include overhead lines (OHL) and cable upratings as well as new build OHLs, cables and transformers.

A full list of the transmission reinforcements (new build and uprates) assumed in the constraints modelling is included in Appendix A.1 – A.3.

Customers should recognise that the reinforcements listed will be subject to a full analysis and optimisation process under EirGrid’s Framework for Grid Development before a decision is made to proceed with them. Inclusion of transmission reinforcement projects in this report is not confirmation that they will proceed, and other projects may be selected in their place. For the avoidance of doubt, any party making a decision based on this list should recognise that these are modelling assumptions only and should not be considered as a basis in fact. Additional information about reinforcements is available on the EirGrid website¹⁰.

3.8 Demand

An introduction to the demand used in this report is provided in Section 2.

The demand profile shapes for Ireland and Northern Ireland are based on their 2019 historical demand profiles. The historical profiles are adjusted to reflect a future winter peak (Transmission Winter Peak) and Total Energy Requirement (TER) based on the All-Island Generation Capacity Statement 2022 – 2031 median demand for the 2025, 2027 and 2030 (Future Grid) years. The values used are shown in Table 3-2.

Year	TER (TWh)			Transmission Winter Peak (GW)		
	Ireland	Northern Ireland	All-Island	Ireland	Northern Ireland	All-Island
2025	38.5	9.27	47.8	6.4	1.7	8.07
2027	41.3	9.74	51	6.57	1.77	8.3
Future Grid	45.1	10.17	55.2	6.87	1.83	8.67

Table 3-2 Forecast Demand and Peak for Study Years 2025, 2027 and Future Grid

The nodal distribution of the load used in the constraints modelling is consistent with the “All-Island Ten Year Transmission Forecast Statement 2021¹¹”.

¹⁰ <https://www.eirgridgroup.com/the-grid/projects/>

¹¹ <https://www.eirgridgroup.com/site-files/library/EirGrid/All-Island-Ten-Year-Transmission-Forecast->

3.9 Interconnection

Existing interconnection on the island consists of a tie line between Ireland and Northern Ireland plus two High Voltage Direct Current (HVDC) interconnectors to Great Britain (GB), referred to as the Moyle Interconnector and the East-West Interconnector (EWIC). This section describes the assumptions and modelling methodology used for interconnection in these studies.

3.9.1 North–South Tie Line

The connection of Ireland’s power system to Northern Ireland is achieved via a double circuit 275 kV line running from Louth to Tandragee. In addition to the main 275 kV double circuit, there are two 110 kV connections: one between Letterkenny in Co. Donegal and Strabane in Co. Tyrone, and the other between Corraclassy in Co. Cavan and Enniskillen in Co. Fermanagh.

The purpose of these 110 kV circuits is to provide support to either transmission system for certain conditions or in the event of an unexpected circuit outage. Phase shifting transformers in Strabane and Enniskillen are used to control the power flow under normal conditions.

It is assumed that the Letterkenny - Strabane and Corraclassy - Enniskillen 110 kV connections are not used to transfer power between the two control areas for the purposes of this modelling exercise.

EirGrid and SONI are also currently developing a 400 kV North-South Interconnector between Woodland in Ireland and Turleenan in Northern Ireland. The new North-South Interconnector is assumed to be in place for the 2027 and 2030 (Future Grid) scenarios.

Prior to the 400 kV North-South Interconnector being built, the existing Louth - Tandragee Interconnector is assumed to be limited. The assumption in this study is that flows are limited to 300 MW from South to North and 300 MW from North to South. When the 400 kV second North-South Interconnector is in place, this limitation will be effectively raised to 1000 MW inter-area flow.

3.9.2 Moyle Interconnector

The Moyle Interconnector, which went into commercial operation in 2002, connects the electricity grids of Northern Ireland and Great Britain between Ballycronan More (Islandmagee) and Auchencrosh (Ayrshire). It has a transfer capacity of 500 MW, however, due to constraints on the transmission networks at either end this capacity can be reduced.

For the purposes of this study the Moyle Interconnector is assumed to have a 400 MW export capacity and a 450 MW import capacity for all study years.

3.9.3 East–West Interconnector (EWIC)

The East-West Interconnector links the electricity grids of Ireland and Great Britain, from converter stations at Portan in Ireland to Shotton in Wales. It began commercial operation in December 2012.

The EWIC Interconnector is modelled for all study years with a maximum capacity of 500 MW.

3.9.4 Greenlink Interconnector

The Greenlink Interconnector is due to be commissioned in 2024 and will connect the electricity grids of Ireland and Wales between Great Island (Co. Wexford) and Pembroke (Co. Pembrokeshire). The Greenlink Interconnector is assumed to be connected for all study years with an import/export capacity of 500 MW.

3.9.5 Celtic Interconnector

The Celtic interconnector connecting Ireland with France is modelled in the 2027 and 2030 study years. This subsea HVDC (High Voltage Direct Current) cable is expected to be commissioned in 2026 and will have an import/export capacity of 700 MW.

An overview of the interconnector capacities can be seen in Table 3-3.

3.9.6 Interconnector Capacities

The interconnector rated capacities used in the model are shown in Table 3-3.

Interconnector Capacity	Export/Import	2025	2027	Future Grid
Moyle (MW)	Export	400	400	500
	Import	450	450	500
EWIC (MW)	Export	500	500	500
	Import	500	500	500
Greenlink (MW)	Export	500	500	500
	Import	500	500	500
Celtic (MW)	Export	-	700	700
	Import	-	700	700

Table 3-3 Interconnection Rated Capacities

It is a study assumption that interconnectors can be used to export renewable energy, with the provision that, when calculating an annual average behaviour, it would be optimistic to assume that maximum interconnector export will always be available when required.

Based on historical flow analysis, the interconnectors to GB are modelled to have a full export capacity for 65% of the time. As a result, the Moyle, EWIC and Greenlink interconnectors are modelled with an ability to export at full capacity for 63% of the time. While for 14% of the time all the three IC's to GB are considered to be available at 75% of their full capacity, and for 11% of the time they were available at 50%, and 5% of time with 25% of full capacity and remainder with 0% export capacity. Using this information, the capacity of these IC's were assigned for the year.

Additional interconnector analysis was undertaken using a modified Ten-Year Network Development Plan (TYNDP) model. This analysis suggested that during times of high wind (wind output > 3 GW) there would be considerable exports from Ireland to France through the Celtic interconnector.

Due to the lack of historical interconnector flow data, we assumed an export capacity of 560 MW (de-rated by 20%) for the Celtic interconnector. This has been assumed as there will be times when the market schedule will provide less export than theoretically possible. An example of this may include, when the receiving country may not be in a position to accept large trades. The use of full interconnection capacity may lead to the understating of dispatch down levels.

3.10 Priority Dispatch for Wind and Solar Generation

The priority dispatch status of renewable generation is only applicable for generators connected before the 4th July 2019.

For this study, when applying generation reduction for over-supply reasons, priority generators are given a negative offer price in the model to ensure their priority in the dispatch. During generation re-dispatch for curtailment and constraint reasons, the renewable generators are all given a zero-offer price without a distinction being made between priority and non-priority generators¹². As Plexos seeks to provide the most economical solution while satisfying all system constraints it consequently will run as much wind and solar generation as is possible.

¹² These generator price assumptions have been applied for the purposes of modelling in this study only. The design of the implementation of Articles 12 and 13 in EU Regulation 2019/943, has yet to be agreed by the relevant industry stakeholders and may differ from the implementation used in this study.

3.11 Generation

An introduction and overview of the generation in this study is provided in Section 2. Additional detail is now provided in this section.

3.11.1 Conventional Generation

The model includes a portfolio of the thermal conventional generation in both Ireland and Northern Ireland. The operating characteristics of the existing conventional generation employed in the modelling are principally based on the SEM Generator Dataset. In some instances, minor changes to the dataset are made due to additional information becoming available to the TSOs.

The technical dataset includes the following information:

1. Fuel type (e.g. gas, wind, coal etc.) including emissions rates;
2. Maximum and minimum operating output (MW);
3. Capacity state and heat rates (used to determine how much fuel is burnt to produce 1 MW of output power);
4. Ramp rates (important to determine how quickly a machine can change its power output);
5. Minimum up-time and downtime.

This technical data allows the Plexos software to calculate the cost of generating a megawatt of electrical energy for each generator in the model. Note that each generator has a different cost.

Other factors that influence the generation dispatch over an extended study horizon are:

- Generation commissioning and decommissioning;
- Generation outages;
- Generation emissions restrictions.

3.11.2 Conventional Generation Outages

Scheduled and forced conventional generator outages are modelled in Plexos using Scheduled Outage Durations (SODs) and Forced Outage Probabilities (FOPs).

For this study, the Forced Outage Probabilities are used. The FOPs employed are those used for the Dispatch Balancing Costs (DBC) 2020 – 2021 Forecast. Plexos generates forced outage patterns from the FOP and mean time to repair data. This provides a deterministic outage pattern against which the model dispatches generation against demand.

3.11.3 Renewable Generation

The amount of electrical energy output from renewable generation is generally described in terms of capacity factor. The capacity factor relates to the amount of energy that may be achieved from a renewable technology over the period of one calendar year. Generally solar PV has lower capacity factor than the wind generators. One factor in the energy yield difference is that solar PV does not produce electrical energy at night, but the wind can blow at any time of the day or night.

The values used in this study for solar and wind are listed in the following sections.

3.11.3.1 Solar

On average, solar profiles tend to have a fairly predictable shape. Figure 3-3 shows the average hourly energy output from solar PV over a one-year period. The capacity factor for solar PV is largely dependent on latitude – the closer to the equator the higher the annual capacity factor. The solar capacity factor for a country like Spain will have a value of around 20%, i.e. double the output of Ireland.

The surface plot of Figure 3-3 highlights the typical Ireland solar profile characteristic. The lowest intensity of solar electrical output is in the four winter months November through to February with hourly values on average

not exceeding 20% of the PV panels max output. As expected, the solar electrical energy output is highest in the summer months with average hourly solar electrical output peaking in the 50-60% range.

The main point is that the solar electrical available energy is fairly predictable and is typically there during times of increasing electrical demand such as the morning load demand rise. However, the winter peak demand will not be met by solar.

Additionally, solar energy output may be reduced if it is located on a part of the network that has constraint issues.

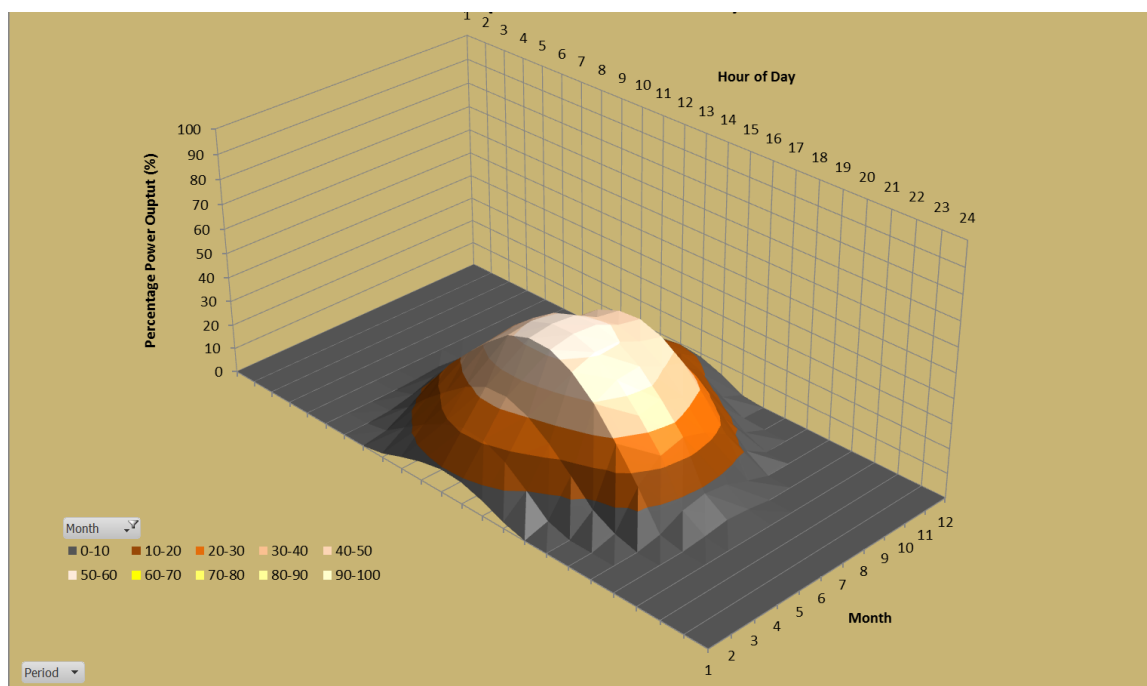


Figure 3-3 Representative Solar Energy Profile (Monthly Average – Hour of Day)

3.11.3.1.1 Solar Profiles

Solar generation is modelled in the analysis using an hourly solar power series at every transmission node where solar generation is connected.

For the previous ECP 2.1 analysis three solar profiles were used: solar north, solar middle and solar south. In the ECP 2.2 analysis the same approach is used, however, the solar profiles have been updated. The solar North data was obtained from the recorded data from solar plant in Northern Ireland (NI) for the year 2020. The solar Middle and solar South profiles were obtained by EirGrid through industry engagement. This 2020 solar data will ensure alignment with the 2020 wind profile.

This solar grouping approach captures the variations in solar energy when comparing solar farms in the north to solar farms in the south. Clearly, this approach does not consider hourly variations in solar power within each area, due to local cloud cover in that individual hour, etc. Since this study is focused on the over-supply, curtailment and constraint on the transmission system, it is reasonable to assume that these solar profiles capture the average behaviour of solar on the island.

The groupings used are shown in Figure 3-4. The capacity factors of the different profiles are shown in Table 3-4.

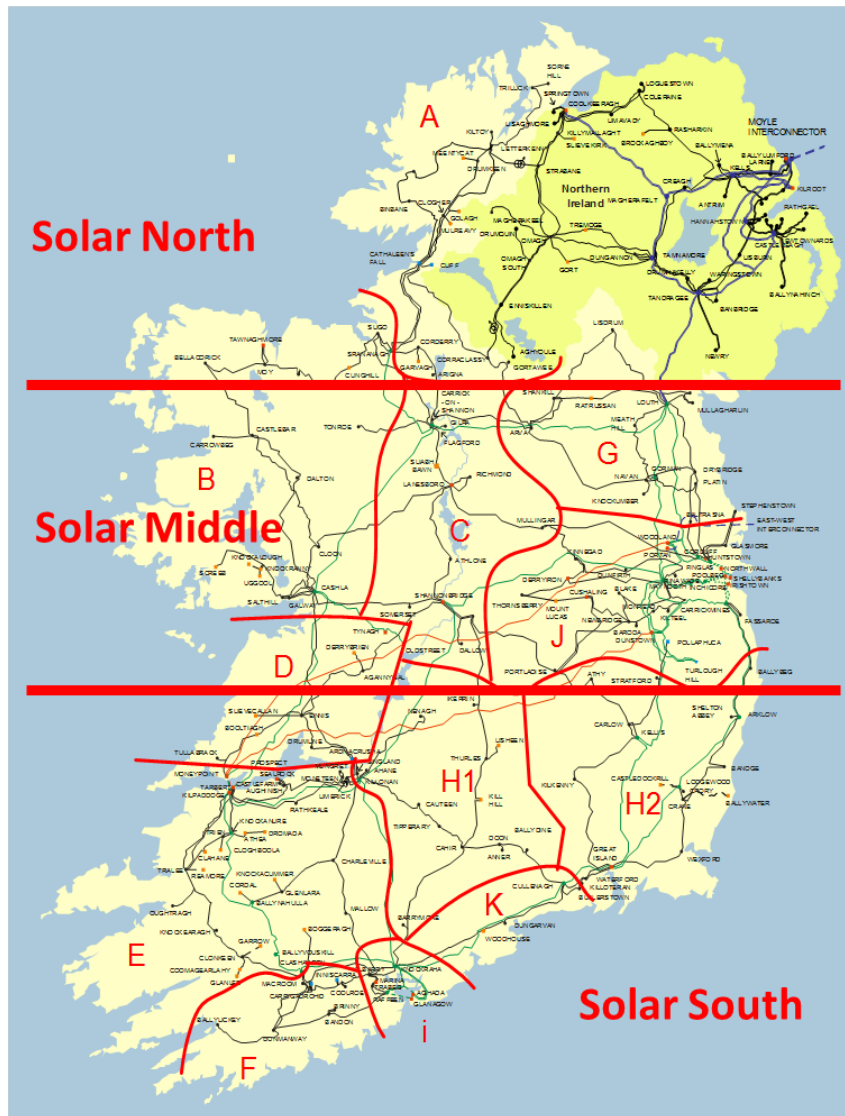


Figure 3-4 Groupings Used for Solar Profiles in Model

Solar	Capacity Factor
Solar North	11.9%
Solar Middle	12.1%
Solar South	12.7%

Table 3-4 Capacity Factor of Solar Profiles

3.11.3.1.2 Wind

This section details how wind generation on the island of Ireland is modelled in Plexos.

Wind generation is modelled using an hourly wind power series at every transmission node where wind generation is connected. To provide a representative wind series, wind profiles are used. In this study, wind profiles are used for all wind farms in an area, i.e. the same wind profiles are used for wind generators in a single area.

By using historical wind profiles, it is possible to account for the geographical variation of wind power across the island. The ECP 2.1 wind profiles were created using 2015 wind data. For ECP 2.2, 2020 wind data is used for the wind profiles. This 2020 wind data aligns with the 2020 solar data. The capacity factors of these wind profiles are shown in Figure 3-5 and in Table 3-5.

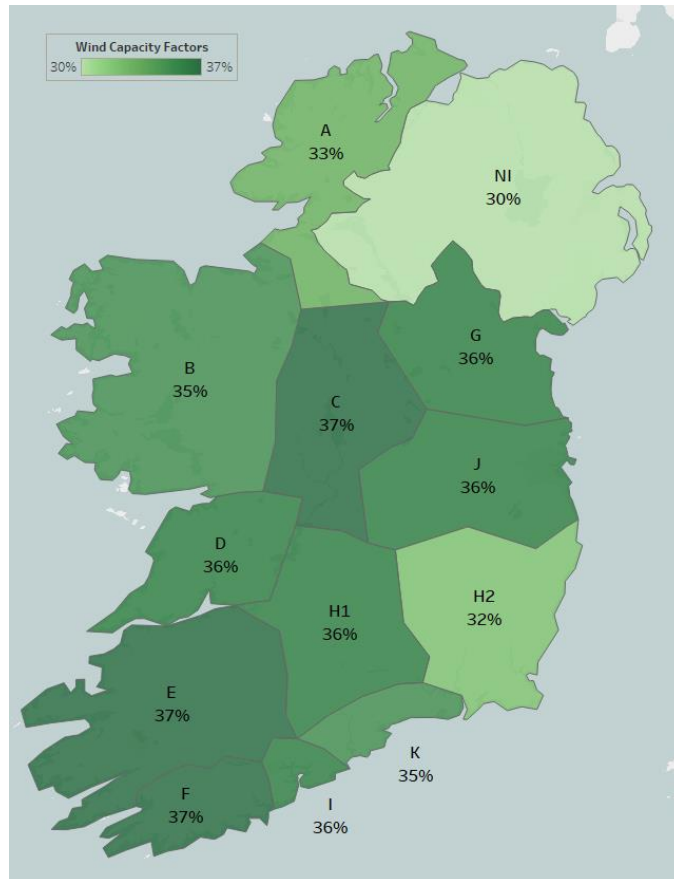


Figure 3-5 2020 Capacity Factor by Area for Wind

Wind Regions	2020 Capacity Factors
Ireland	
A	33%
B	35%
C	37%
D	36%
E	37%
F	37%
G	36%
H1	36%
H2	32%
I	36%
J	36%
K	35%
Offshore	45%
Northern Ireland	
NI	30%

Table 3-5 Capacity Factors for Future Wind

Similar to 2015 wind data, 2020 wind data has comparatively higher capacity factor (high wind year). This value is representative of a wind fleet that will include new onshore and offshore wind farms incorporating the latest available technology.

3.11.3.2 Installed Capacity

Section 2 describes the renewable generation scenarios that are considered as part of this analysis. Some further detail is provided here.

A variety of renewable generation scenarios are included to take account of the possibility that not all generators will ultimately connect, and to give a view on the Total Dispatch Down seen under various renewable generation build out rates. The levels of installed solar and wind generation included in each scenario are shown in Table 3-6.

The Initial scenario includes currently connected renewable generation plus all renewable generation expected to be connected by end of 2024. The “ECP” scenario includes all renewable generation up to and including ECP 2.2. The 33% and 66% scenarios were created by scaling the outputs of generators assumed to connect post-2024 by 33% and 66% respectively.

Gen Type (MW)	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Solar	1,389	2,442	3,496	4,549	4,549	4,549	4,549
Wind	5,072	5,581	6,090	6,599	6,599	6,599	6,599
Wind Offshore	-	-	-	-	2,197	4,394	4,994
Totals	6,461	8,023	9,586	11,148	13,345	15,542	16,142

Table 3-6 Connected and Contracted Solar and Wind Quantities in Ireland for the Study Scenarios

3.11.3.3 Generation Controllability

Historically smaller (and some older) wind farms and solar generators are not controllable. The study methodology takes into account all uncontrollable wind and solar generation and does not include these generators in any output reduction calculations.

Generally, apart from some older windfarms, it is assumed that all wind farms are controllable if their maximum export capacity (MEC) is greater than or equal to 5 MW (for generators which received a connection offer before 2015) or if their MEC is greater than or equal to 1 MW (after 2015). All solar farms with an MEC greater than or equal to 1 MW are assumed to be controllable.

3.11.3.4 Perfect Foresight – Wind Forecast

Building an economic power market model will always require input assumptions. One such assumption is that the climatic year will be from historical data. The use of historical data means that the power market model will create generation commitment and dispatch decisions based on the perfect foresight of wind and solar output. In real-time operation of the power system, this is not the case and there will be forecast errors associated with variable renewables and demand. Perfect foresight may mean that power market models show lower levels of curtailment since it may choose to de-commit units based on what it knows will happen. In reality, wind or demand forecast errors may mean that a different schedule of generators may be required than that modelled with perfect foresight.

3.12 System Operation

3.12.1 Safe Operation (Security Constrained N-1)

The basic principle of N-1 security in network planning states that if a component, such as a transformer or circuit, should fail in a network, then the network security must still be guaranteed and the remaining network resources must not be overloaded or exceed the short-term overload capability of the equipment. System voltage must also remain within permitted limits although Plexos, as a DC load flow analysis tool, does not monitor system voltage as part of this study.

EirGrid operates the Ireland transmission network to be N-1 secure. This Plexos study also monitors N-1 contingencies to ensure the results are valid for an N-1 secure network.

3.12.2 Operational Constraint Rules

This section presents the all-island operational constraints, which feed into the Plexos economic dispatch tool. The operational constraints cover System Non-Synchronous Penetration (SNSP), inertia, operating reserve requirements and minimum number of synchronous units required.

The purpose of this section is to define the set of operational constraints, and how these constraints may evolve over the proposed study horizons. Operational constraints are important as they define system limits that may require reductions in renewable generation, resulting in curtailment. In general, it is expected that certain operational constraints may be relaxed over time, as the system evolves.

3.12.2.1 System-Wide Operational Constraints

There are several system-wide operational constraints which ensure that the system operators can operate the system securely and within stability limits.

This study uses the operational constraints listed in Table 3-7. The RoCoF limit was not monitored in the Plexos study but is included in Table 3-7 for information.

Active System Wide Operational Constraints (SNSP, Inertia & Minimum Sets)		
Limit	Operational Constraint Rule	Limit Across the Study Years
Non-Synchronous Generation	There is a requirement to limit the instantaneous penetration of asynchronous generation connected to the All-Island system.	2025 – 85% 2027 – 85% 2030 – 95%
Operational Limit for RoCoF	There is a requirement to limit the RoCoF on the All-Island system.	2025 – 1 Hz/sec 2027 – 1 Hz/sec 2030 – 1 Hz/sec
Operational Limit for Inertia	There is a requirement to have a minimum level of inertia on the All-Island system.	2025 – 20,000 MWs 2027 – 17,500 MWs 2030 – 17,500 MWs
Minimum Sets (IE, NI)	There is a requirement to have a minimum number of conventional generators in Ireland and Northern Ireland.	2025 – 4, 2 2027 – 3, 2 2030 – 2, 2
Reserve (IE, NI)	The amount of spare capacity in the system to manage any system disturbance.	POR, SOR, TOR I, and TOR II

Table 3-7 Active System Wide Operational Constraints (SNSP, Inertia & Minimum Sets)

3.12.2.2 System Non-Synchronous Penetration (SNSP)

There is a system need to limit the amount of ‘non-synchronous’ generation at any point in time. The limit ensures that the power system operates within a stable zone.

A mathematical expression describing the SNSP rule is as follows:

$$\frac{\text{All Island Asynchronous Generation} + \text{Interconnector Imports}}{\text{All Island Demand} + \text{Interconnector Exports}} \leq \text{SNSP Limit}$$

An increase in the SNSP limit will allow more ‘non-synchronous’ generation to be accepted onto the system.

3.12.2.3 Minimum Number of Synchronous Generators

There is a requirement to have a minimum number of conventional generators synchronised at all times to provide inertia to the power system, ensure voltage stability, dynamic stability and to ensure that network limitations (line loading and system voltages) are respected. The minimum number of units in each study horizon is given in Table 3-7.

Changes to the rules are guided by operational and/or planning assumptions. Table 3-8 provides the current requirements for minimum number of conventional units required on the system.

Minimum Conventional Generation Assumptions
Ireland
A minimum of 2 large units in the Dublin region must be synchronised at all times.
A minimum of 5 large units in Ireland must be synchronised at all times.
Northern Ireland
A minimum of 3 large units in Northern Ireland must be synchronised at all times.

Table 3-8 Summary of Current Conventional Minimum Generation Assumptions

3.12.2.4 Operating Reserve

Operating reserve is surplus operating capacity that can instantly respond to a sudden increase in load or decrease in generation output. Operating reserve provides a safety margin that helps ensure reliable electricity supply despite variability in the load and generation. To provide reserve, some generators are part-loaded i.e. are operated below their maximum output capacity to provide a fast-acting source of reserve. Reserve can also be provided by non-conventional sources such as batteries, storage, interconnectors and demand response, in the future, it is expected that a greater share of reserve may be maintained by such non-conventional sources.

For the ECP 2.2 constraints analysis, batteries with a storage duration of less than and equal to 2-hours were modelled to provide reserve. Batteries with a storage duration greater than 2-hours were modelled to provide energy arbitrage only. Due to the large volume of batteries within the analysis with a storage capacity of less than and equal to 2 hours the majority of the operating reserve required in the analysis was supplied by batteries – this is expected to be the case in the future. The operating reserve requirements modelled in the analysis can be seen in Table 3-9.

Operating Reserve Requirements			
Limit	All-Island Requirement % of Largest In-Feed	Ireland Minimum (MW)	Northern Ireland Minimum (MW)
Primary Operating Reserve (POR)	75%	155	50
Regulating Sources of Primary Operating Reserve (POR*)	-	75	50
Secondary Operating Reserve (SOR)	75%	155	50
Tertiary Operating Reserve 1 (TOR1)	100%	155	50
Tertiary Operating Reserve 2 (TOR2)	100%	155	50

Table 3-9 Active Operating Reserve Requirements

*Regulating Sources of Primary Operating Reserve must be provided by conventional generation.

4 Study Methodology

This section provides an overview of the modelling methodology employed to determine the likely over-supply, curtailment and constraint levels for renewable generation in this study.

The methodology of production cost modelling is utilised to conduct the studies for this report. This section includes a detailed description of production cost modelling, and an overview of Plexos (the modelling tool employed) is also provided. In addition, there is a description of the over-supply, curtailment and constraint modelling methodology.

4.1 Production Cost Modelling

In general terms, production cost models utilise optimisation algorithms with the objective of minimising the cost of generating power to meet demand in a region while satisfying operational, security and environmental constraints. A production cost model minimises the combined fuel cost, CO₂ cost, variable operation, maintenance and start-up cost. In the model, wind and solar generation are variable sources with zero production cost. Hydro generation also has zero production cost but is energy limited. Chronological production cost models optimise generator commitment and dispatch scheduling for every hour of a study period (typically one-year duration).

Production cost models require:

- Specification of individual generator capabilities including capacity, start-up energy, annual forced outage rate, annual scheduled outage duration, reserve provision capabilities, emission rates and heat rates (fuel input requirement per unit output generation).
- Specification of the hourly demand profile for the region.
- Specification of the fuel price for each type of fuel.
- Specification of the transmission network (required for studies where transmission constraint information is the desired output).
- Specification of contingencies.
- System security constraints such as the requirement for reserve.
- Generator operational constraints such as maximum and minimum operational levels, ramp rates, minimum runtimes and downtimes etc.
- Environmental considerations such as the cost of CO₂.

The commercially available production cost modelling tool employed in this study is Plexos.

4.2 The Software: Plexos Integrated Energy Model

Plexos is a detailed generation and transmission analysis program that has been widely used in the electricity industry for many years. EirGrid has extensive experience in using this simulation tool to model the Irish power system. It is a production cost modelling simulation program, used to determine power system performance and cost. It is a complex and powerful tool for power system analysis, with separate commitment and dispatch algorithms.

4.2.1 Commitment and Dispatch

The commitment process refers to the selection of a number of generators, from the total generation portfolio, that are available to meet customer demand. The decision as to when these generators should be on or off-line is also part of the commitment process. For example, additional generation is committed on Monday mornings to meet the higher weekday demand compared to the lower weekend demand where less generation is required.

The dispatch process refers to the decisions taken on the loading of individual generation units. Thus, the contribution from each online or committed unit towards meeting customer demand is determined by the dispatch decision.

4.2.2 Generator, Demand and Network

Full technical performance characteristics and operational cost details of each generation unit on the system are specified. An hourly system demand profile is also required. Additionally, in this study, the transmission system is modelled.

The program output provides complete details of the operation of each generation unit. These are aggregated into system totals. Flows on transmission lines can be monitored and potential constraints on the system can be identified. A wide range of output reports are available, from system summaries to hour-by-hour information on individual generators.

4.2.3 DC Loadflow

Plexos is a DC loadflow simulation tool. Therefore, it only models real power flows and does not consider voltage. Transmission plant and line ratings are MVA rated and ratings vary with voltage. For the purposes of modelling the DC load flow MW ratings for the circuits, the model assumes a conversion factor of 0.9.

The conversion factor allows the necessary spare capacity for reactive power on the circuits and it allows for post-contingency low voltage. This 0.9 conversion factor gives a good performance for a wide range of pre-contingency and post-contingency conditions.

The Plexos model, as constructed, does not account for losses. However, losses are accounted for within the Total Electricity Requirement (TER) demand figures.

4.3 System Model

For this study, the system is modelled at generator level where each conventional generator is modelled in detail. Characteristics such as heat rates, ramp rates, minimum runtime and downtime, start-up energy, reserve provision capabilities, annual forced outage rate, annual scheduled outage duration and emission rates of each individual generator are specified.

Solar and wind powered generators are modelled at 110 kV node level. In other words, if several windfarms are fed from a 110 kV node, the model represents them as a single windfarm at that node. The same is true for solar farms. These generators use hourly generation profiles series. More detail on the modelling of solar and wind powered generation is provided in Section 3.11.3.

Ireland and Northern Ireland are treated as a single dispatch system in the production cost model for the purposes of producing an optimal minimum cost commitment and dispatch. Generators are dispatched based on their short-run marginal costs (which include the costs of fuel and CO₂ emissions) and in accordance with the dispatch assumptions outlined below.

4.4 Software Determination of Over-Supply, Curtailment and Constraint

For this report, wind and solar generators are assumed to be Grid Code compliant and it is assumed that controllable wind and solar generators can be instructed to reduce their output if required. It is worth noting that there are a small number of older wind turbine sites that are uncontrollable, as mentioned in Section 3.11.3.3.

The Plexos model is used to calculate over-supply, curtailment and constraint. A number of supplementary studies are also needed to properly apportion each of these three types of reduction in generator output.

In the simulation, generators are committed and dispatched in the most economical manner while satisfying operational and security constraints such as limitations on the instantaneous wind/solar penetration, operating reserve requirements, requirement for a minimum number of synchronised conventional generators, system inertia limits, as well as the limitations of the transmission network.

The simulation is a security constrained N-1 study. This means that the network flows are constantly monitored to be safe against the possible loss of any item of transmission equipment.

The total reduction in energy for each renewable generator is calculated by comparing the renewable energy output from the simulation with the available renewable energy.

4.5 Apportioning of Over-Supply, Curtailment and Constraint

4.5.1 Over-supply

Per Article 12 of the EU's Clean Energy Package, priority dispatch of renewable generation will continue to apply only to generators which connected prior to July 4th 2019.

For this study, during generation reduction for over-supply reasons, a distinction is made between the treatment of priority and non-priority renewable generators, and non-priority generators are dispatched down ahead of priority generators. Within, these two categories of generation, over-supply is applied pro-rata across the all-island system for all generators in this category.

4.5.2 Curtailment

For hours when it is necessary to curtail wind and solar generation output, a decision must be made as to which generators should have their output reduced. It is assumed in this study that, where possible, all controllable wind and solar generators share the reduction in output energy arising from curtailment in proportion to their available energy in that hour i.e. on a pro-rata basis.

4.5.3 Constraint

When a transmission constraint occurs, Plexos will attempt to alleviate the constraint in the most cost-effective manner.

If a transmission constraint causes wind or solar generation to be constrained down, Plexos' internal dispatch logic may choose one generator to constrain down out of several that have the same flow impact on the constraint (due to the fact that, in the constraints model, all wind and solar generators are modelled with zero cost of production).

This report studies the connection of very large amounts of generation to the transmission network. As such, there are some areas where the levels of transmission constraints are both large and frequent. There are also areas where there are, at times, several overlapping operational and transmission constraints. This makes it more difficult to apportion curtailment and constraints to individual nodes.

Post-processing of the results is required to ensure study results are more representative of the application of a constraint instruction. The process involves sharing the constraint volume proportionally between generators that have a similar impact on a constraint issue.

5 Results Summary for Ireland

This section provides a summary of the Total Dispatch Down levels estimated by this study at a system level for Ireland.

Results are shown for the core study scenarios consisting of:

- Study year scenarios 2025 and 2027.
- Renewable generation scenarios Initial, 33%, 66% and ECP.

Results are also shown for the sensitivity study scenarios that were developed in consultation with industry, and in response to industry feedback, consisting of:

- A Future Grid study based on 2030 demand levels and aligned with the network from the SOEF Roadmap.
- Five offshore wind scenarios: ECP + 2.2 GW offshore (2027), ECP + 4.4 GW offshore (2027), ECP + 2.2 GW offshore (2030), ECP + 4.4 GW offshore (2030) and ECP + 5 GW offshore (2030).

Figure 5-1, Figure 5-2 and Figure 5-3 provide an overview of:

- System Total Dispatch Down percentage levels; broken down by over-supply, curtailment and constraint.
- System Total Dispatch Down and wind and solar generated energy levels in TWh; broken down by over-supply, curtailment, constraint and generation levels.
- Total Dispatch Down percentage levels per area; broken down by solar not priority, wind not priority and wind priority.

In general, a reduction in Total Dispatch Down levels is seen in later study years due to the benefits of network reinforcements, future interconnection, relaxation of operational constraints and increased demand levels.

An increase in Total Dispatch Down levels is seen for the offshore sensitivity studies, which is largely driven by over-supply.

More detailed results for Area A can be seen in Section 6.

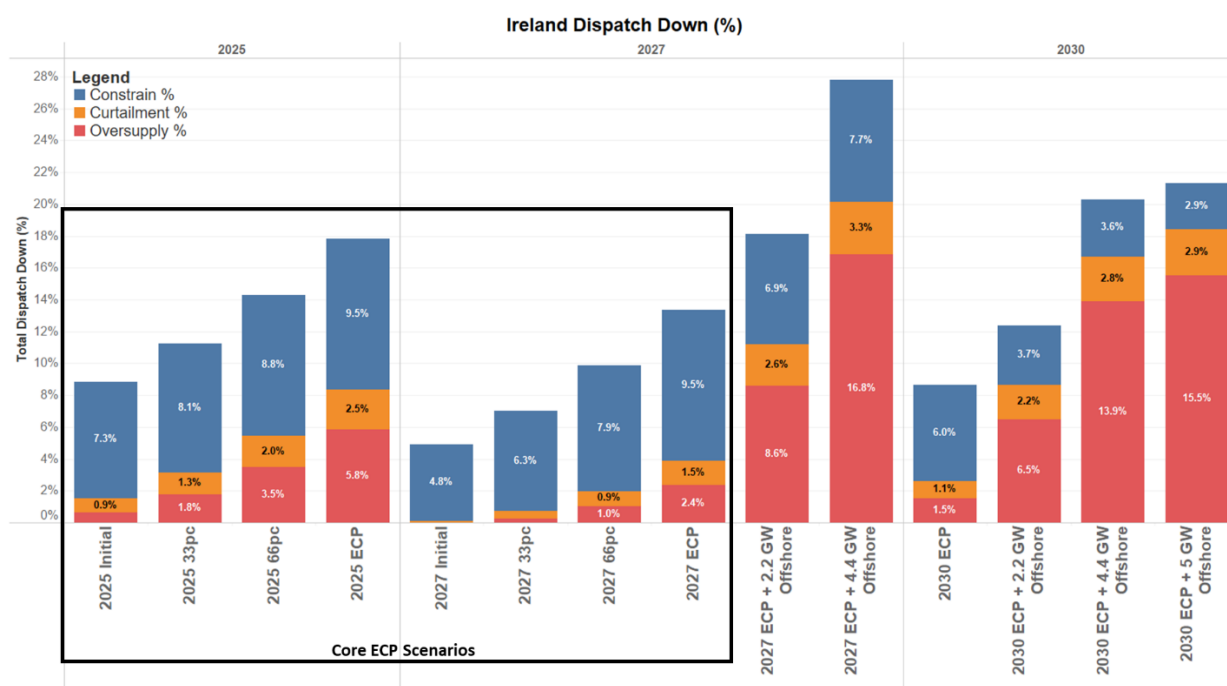


Figure 5-1 System Total Dispatch Down %

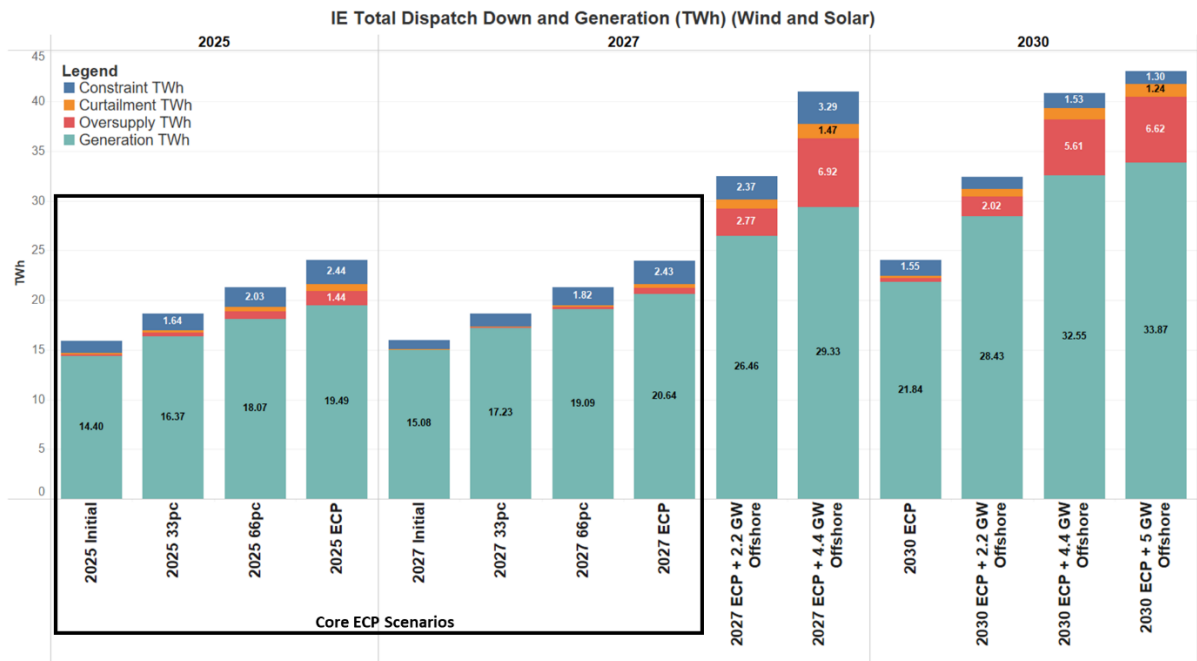


Figure 5-2 Total Dispatch Down and Generation (Wind and Solar) TWh

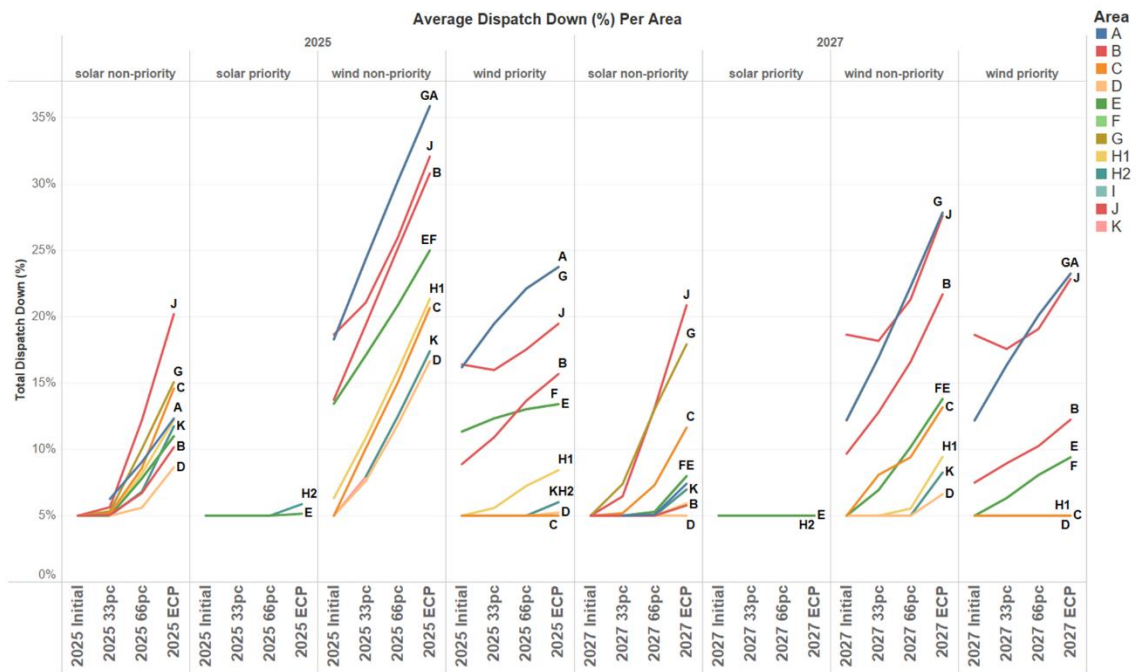


Figure 5-3 Total Dispatch Down % per Area

5.1 RES Percentage

Renewable Energy Source (RES) percentage is calculated using the base of the total load on the system, this represents the maximum utilization of RES to supply the demand in Ireland. The RES calculated below considers the wind, solar, hydro and wave generation and is given in Table 5-1 and Figure 5-4. System Total Dispatch Down % Figure 5-1. Small scale wind and solar generation (less than 0.5 MW) is not considered in this calculation.

$$RES \% = \frac{RES \text{ Generation (GWh)}}{Total \text{ Load (GWh)}} \times 100$$

Year	Initial	33%	66%	ECP	ECP + 2.2 GW Offshore	ECP + 4.4 GW Offshore	ECP + 5 GW Offshore
2025	41%	46%	51%	55%			
2027	40%	45%	50%	54%	68%	75%	
2030				52%	67%	76%	79%

Table 5-1 Ireland RES % in ECP 2.2 studies* (wind and solar)

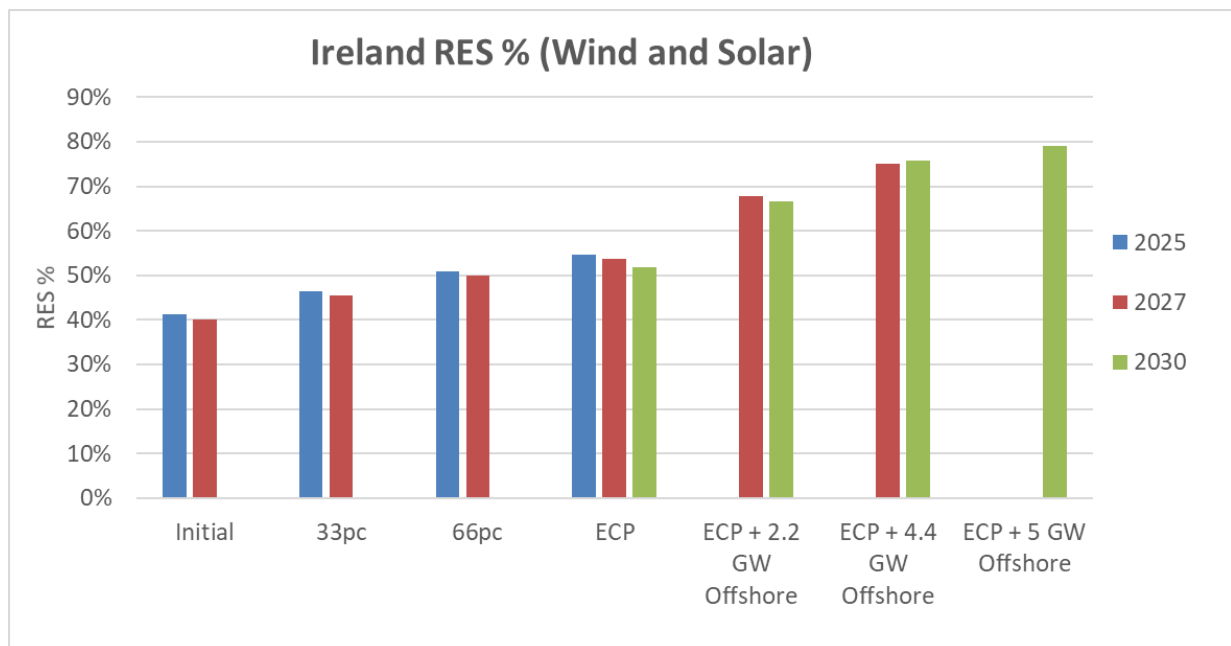


Figure 5-4 Ireland RES % in ECP 2.2 studies* (wind and solar)

*small scale generation, storage, peat and waste plants are not included in this calculation.

5.2 Maintenance Sensitivity Study Report

Following ECP 1.0, industry feedback suggested including a maintenance outage programme would be helpful. Hence, as part of ECP 2.1 a representative maintenance programme was included in the baseline models and further an addendum was published including a sensitivity to show the impact of this maintenance outage programme. Based on feedback from Industry ECP 2.2 follows the same methodology with an updated representative maintenance programme (given in Table A-5). The maintenance schedule was discussed with our internal operations team and it provides a reasonable representative outage programme for the network. However, every maintenance and outage season is different, and the results need to be interpreted with this in mind.

This section provides results of a sensitivity study performed to quantify the impact of the maintenance schedule used in the ECP 2.2. The studies selected for the sensitivity are the 2025 ECP (All) scenario, the 2027 ECP (All) scenario, 2027 ECP + 4.4 GW Offshore scenario and 2030 ECP + 4.4 GW Offshore scenario. All other study assumptions have remained the same as the ECP 2.2 Constraints Analysis, however, the maintenance schedule has been removed.

The area-wise/subgroup results are presented for the three studies 2025 ECP (All) scenario, the 2027 ECP (All) scenario, 2027 ECP + 4.4 GW Offshore scenario and 2030 ECP + 4.4 GW Offshore. The difference in constraints are reported as the difference between the study with maintenance and the study without maintenance (Maintenance Study Constraints – No Maintenance Study Constraints = Difference). The constraints calculated are pro-rata distributed in their respective area/subgroup. The details of subgroups selected in each area are given in section 6.6.4 of each area report. The percentage difference (Table 5-2 and Figure 5-5) is followed by the GWh difference tables (Table 5-3, Table 5-4 and Table 5-5, Table 5-6).

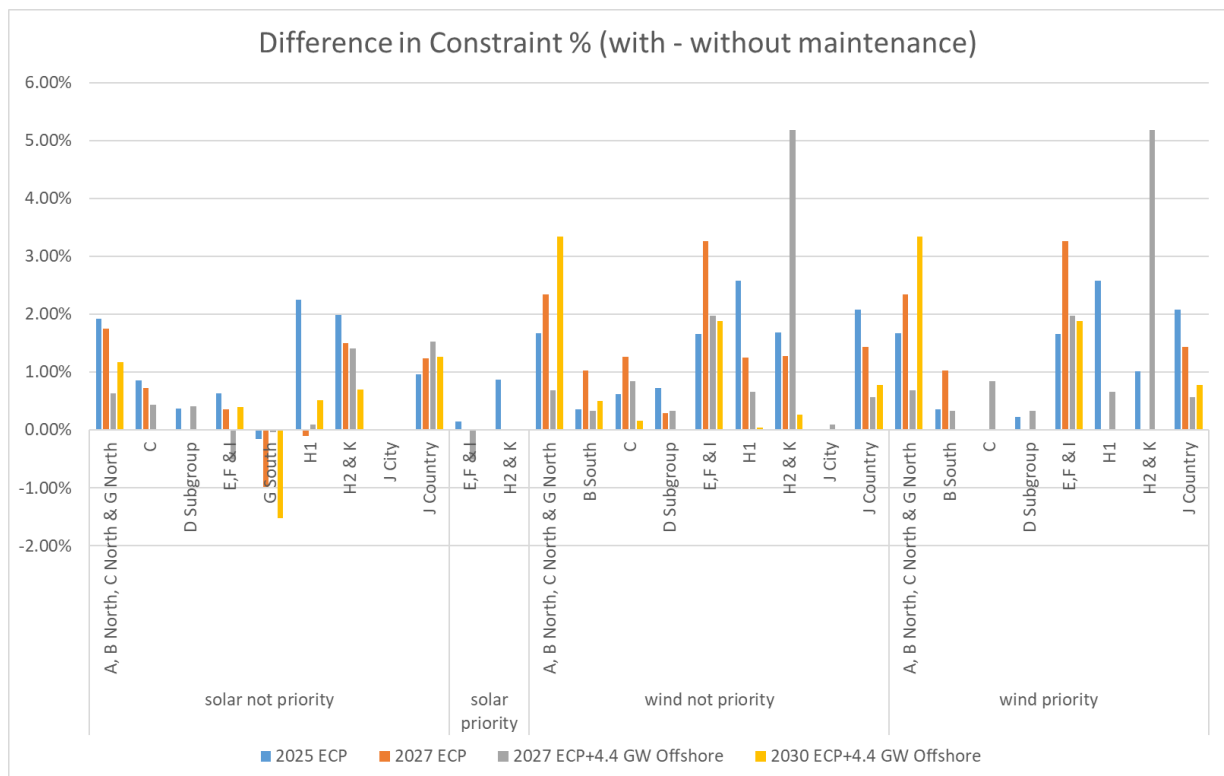


Figure 5-5 Difference in Constraint % (with - without maintenance)

Generation Category	Subgroup	2025 ECP	2027 ECP	2027 ECP+4.4 GW Offshore	2030 ECP+4.4 GW Offshore
solar not priority	A, B North, C North & G North	1.9%	1.8%	0.6%	1.2%
	C	0.9%	0.7%	0.4%	0.0%
	D Subgroup	0.4%	0.0%	0.4%	0.0%
	E, F & I	0.6%	0.4%	-0.5%	0.4%
	G South	-0.2%	-1.0%	0.0%	-1.5%
	H1	2.2%	-0.1%	0.1%	0.5%
	H2 & K	2.0%	1.5%	1.4%	0.7%
	J City	0.0%	0.0%	0.0%	0.0%
	J Country	1.0%	1.2%	1.5%	1.3%
solar priority	E,F & I	0.2%	0.0%	-0.5%	0.0%
	H2 & K	0.9%	0.0%	0.0%	0.0%
wind not priority	A, B North, C North & G North	1.7%	2.3%	0.7%	3.3%
	B South	0.4%	1.0%	0.3%	0.5%
	C	0.6%	1.3%	0.8%	0.2%
	D Subgroup	0.7%	0.3%	0.3%	0.0%
	E,F & I	1.7%	3.3%	2.0%	1.9%
	H1	2.6%	1.2%	0.7%	0.0%
	H2 & K	1.7%	1.3%	5.2%	0.3%
	J City	0.0%	0.0%	0.1%	0.0%
	J Country	2.1%	1.4%	0.6%	0.8%
wind priority	A, B North, C North & G North	1.7%	2.3%	0.7%	3.3%
	B South	0.4%	1.0%	0.3%	0.0%
	C	0.0%	0.0%	0.8%	0.0%
	D Subgroup	0.2%	0.0%	0.3%	0.0%
	E,F & I	1.7%	3.3%	2.0%	1.9%
	H1	2.6%	0.0%	0.7%	0.0%
	H2 & K	1.0%	0.0%	5.2%	0.0%
	J Country	2.1%	1.4%	0.6%	0.8%

Table 5-2 Difference in Constraint % (with - without maintenance)

Generation Category	Subgroup	Oversupply + Curtailment (GWh)	Constraint Without Maintenance (GWh)	Difference in Constraint with Maintenance (GWh)
solar not priority	A, B North, C North & G North	9	5	3
	C	38	3	3
	D Subgroup	4	0	1
	E,F & I	36	18	5
	G South	37	61	-1
	H1	35	7	8
	H2 & K	87	21	25
	J City	3	0	0
solar priority	J Country	112	126	9
	E,F & I	0	0	0
wind not priority	H2 & K	0	0	0
	A, B North, C North & G North	638	561	52
	B South	113	49	2
	C	141	10	5
	D Subgroup	23	4	3
	E,F & I	104	105	21
	H1	59	8	11
	H2 & K	55	5	9
wind priority	J Country	281	228	34
	A, B North, C North & G North	60	383	35
	B South	5	73	3
	C	6	4	0
	D Subgroup	1	9	1
	E,F & I	108	339	68
	H1	51	27	34
	H2 & K	43	13	8
J Country	42	37	6	

Table 5-3 Area subgroup GWh difference in constraint (with - without maintenance) for 2025 ECP

Generation Category	Subgroup	Oversupply + Curtailment (GWh)	Constraint Without Maintenance (GWh)	Difference in Constraint with Maintenance (GWh)
solar not priority	A, B North, C North & G North	4	3	3
	C	22	1	3
	D Subgroup	2	1	0
	E,F & I	18	26	3
	G South	20	135	-8
	H1	17	6	0
	H2 & K	42	14	19
	J City	4	0	0
solar priority	J Country	89	157	12
	E,F & I	0	0	0
wind not priority	H2 & K	0	0	0
	A, B North, C North & G North	196	578	72
	B South	31	23	7
	C	62	3	11
	D Subgroup	10	0	1
	E,F & I	48	54	41
	H1	22	5	5
	H2 & K	24	5	7
wind priority	J Country	149	321	24
	A, B North, C North & G North	14	392	48
	B South	5	34	10
	C	2	7	0
	D Subgroup	4	18	0
	E,F & I	86	175	134
	H1	12	38	0
	H2 & K	26	26	0
J Country	20	52	4	

Table 5-4 Area subgroup GWh difference in constraint (with - without maintenance) for 2027 ECP

Generation Category	Subgroup	Oversupply + Curtailment (GWh)	Constraint Without Maintenance (GWh)	Difference in Constraint with Maintenance (GWh)
solar not priority	A, B North, C North & G North	4	3	3
	C	22	1	3
	D Subgroup	2	1	0
	E,F & I	18	26	3
	G South	20	135	-8
	H1	17	6	0
	H2 & K	42	14	19
	J City	4	0	0
solar priority	J Country	89	157	12
	E,F & I	0	0	0
wind not priority	H2 & K	0	0	0
	A, B North, C North & G North	196	578	72
	B South	31	23	7
	C	62	3	11
	D Subgroup	10	0	1
	E,F & I	48	54	41
	H1	22	5	5
	H2 & K	24	5	7
wind priority	J Country	149	321	24
	A, B North, C North & G North	14	392	48
	B South	5	34	10
	C	2	7	0
	D Subgroup	4	18	0
	E,F & I	86	175	134
	H1	12	38	0
	H2 & K	26	26	0
J Country	20	52	4	

Table 5-5 Area subgroup GWh difference in constraint (with - without maintenance) for 2027 + 4.4 GW Offshore

Generation Category	Subgroup	Oversupply + Curtailment (GWh)	Constraint Without Maintenance (GWh)	Difference in Constraint with Maintenance (GWh)
solar not priority	A, B North, C North & G North	19	1	1
	C	65	0	0
	D Subgroup	15	1	0
	E,F & I	92	36	-4
	G South	85	41	-3
	H1	55	2	0
	H2 & K	170	6	5
	J City	2	0	0
solar priority	J Country	143	31	7
	E,F & I	1	1	0
wind not priority	H2 & K	1	0	0
	A, B North, C North & G North	1546	64	48
	B South	249	2	2
	C	321	3	8
	D Subgroup	95	3	0
	E,F & I	711	275	37
	H1	147	0	1
	H2 & K	1057	51	73
wind priority	J City	1110	294	21
	J Country	490	97	5
	A, B North, C North & G North	50	22	22
	B South	24	9	0
	C	17	2	0
	D Subgroup	26	5	0
	E,F & I	96	346	50
	H1	87	5	0
	H2 & K	58	4	16
	J Country	35	15	1

Table 5-6 Area subgroup GWh difference in constraint (with - without maintenance) for 2030 + 4.4 GW Offshore

6 Results for Area J

6.1 Introduction

This section provides the over-supply, curtailment and constraint results for Area J that are estimated by this analysis. There is a total of eight core ECP 2-2 studies and seven sensitivity studies (including without maintenance) presented in this report. The study scenarios and the associated assumptions can be found in Section 2 and Section 3. An overview and discussion of the results is provided in this Section. The over-supply, curtailment and constraint results for each node are provided in Appendix C.

6.2 Study Notes

A list of the major study assumptions is provided in Section 3. For Area J, there are a number of key assumptions which drive the results, including network outages and capacity factors. These are thus, reiterated here. Similarly, it is worth highlighting again the differences between the various components of total dispatch down.

6.2.1 Network Outages

The scenarios in this report are intended to give a view of average long-term levels of over-supply, curtailment and constraint, subject to installed generation, demand, interconnection, operational constraints and reinforcement delivery.

The previous ECP 1 constraints analysis assumed that the existing network was available at all times. In reality, a transmission outage programme will be implemented each year resulting in outages of transmission circuits and other equipment for periods of time. Outages may be due to scheduled maintenance, forced outages, to facilitate new connections or for reinforcement reasons (e.g. circuit/busbar upgrades).

In the ECP 2.1 constraint report a set of representative maintenance outages were included. As a result of additional interest from industry, an addendum was published as a sensitivity of the maintenance outage to see the effect it had on the constraints in different areas. Following from the industry feedback on the ECP 2.2 study assumptions, the ECP 2.2 constraint forecast analysis applies a larger number of representative maintenance transmission outages for a shorter duration. The outages included in this schedule represent a geographical spread of circuits across the system and are each configured for a one-month period. This allows a representation of outage impact in each geographical area to be included in the studies. This representative transmission outage schedule is given in Appendix A – Table A-5. However, at times longer duration outages which may be required for certain connections, reinforcement works or forced outages are not considered and may result in higher wind and solar constraints.

6.2.2 Benefit of Capacity Factor

In practice a specific windfarm may be located at a site with higher wind speeds or may have a better performing type of wind turbine; the result is a higher capacity factor than neighbouring windfarms. This report doesn't reflect this localised diversity between windfarm sites, however, in reality a windfarm with a higher capacity factor may see lower percentage over-supply, curtailment or constraint levels than an adjacent windfarm with a lower capacity factor. This is because at times of medium or low wind speed, the high capacity factor windfarm can generate power when the low capacity factor windfarm cannot.

6.2.3 Notes on Over-supply, Curtailment and Constraint Modelling

6.2.3.1 Over-supply

During generation reduction for over-supply, a distinction is made between the treatment of priority and non-priority renewable generators, with non-priority generators being dispatched down ahead of priority generators. Within these two categories of generation, over-supply is applied pro-rata across the all-island system for all renewable generators in the category.

For any hour of the study the over-supply level will depend on system demand and interconnector flow capacity. In general, over-supply is expected to increase with increasing installed renewable capacity.

6.2.3.2 Curtailment

In this report, for each hour of the study, the curtailment is shared pro-rata on a system wide basis with no distinction made between priority and non-priority generators. This means that both curtailment reductions and curtailment increases are shared system wide.

Solar generation has different reported levels of curtailment compared to wind due to different capacity factors and annual profile shapes.

The applied curtailment is broadly constant across the system. However, due to differences in wind and solar profiles and capacity factors between areas, the percentage average curtailment differs between areas.

6.2.3.3 Constraints

During the constraint of renewable generation, no distinction is made between priority and non-priority generators, the dispatch down is applied across the relevant transmission nodes.

In general, there is a tendency for renewable bulk power to flow towards the demand in Dublin and the interconnectors. These flow patterns are relevant when seeking to understand constraint apportionment in the simulation.

When presented as percentage values, the constraint results look different for solar and wind, as they have a low correlation due to different profile shapes driven by weather patterns.

6.3 Generation Overview

A detailed system level overview of the renewable generation scenarios used in these studies is given in Section 2. The distribution of generation in each scenario based on technology, area and node is given in Appendix B. The node level installed wind and solar generation for Area J in the “ECP” scenario is given in

Node	SO	Status	Solar	Wind
Athy	DSO	due to connect	9	
Belcamp 220 kV	TSO	due to connect		250
Belcamp 220 kV	TSO	due to connect		250
Blake T	DSO	due to connect	5	
Blundelstown	TSO	due to connect	60	
Carrickmines 220 kV	TSO	due to connect		412
Carrickmines 220 kV	TSO	due to connect		412
Clonfad	TSO	due to connect	100	
Coolnabacky	TSO	due to connect	80	
Cushaling	TSO	connected		100
Derryiron	TSO	due to connect	47	
Derryiron	TSO	due to connect		110
Dunfirth	DSO	due to connect	36	
Finglas	DSO	due to connect	8	
Gallanstown	TSO	due to connect	170	
Glasmore	DSO	due to connect	41	
Glasmore	TSO	due to connect	75	
Griffinrath	DSO	due to connect	66	
Harristown	TSO	due to connect	177	
Kilteel	DSO	due to connect	41	
Monread	DSO	due to connect	8	
Mount Lucas	TSO	due to connect		60
Mount Lucas	TSO	connected		79
Mulgeeth	TSO	due to connect		60
Newbridge	DSO	due to connect	16	
Philipstown	TSO	due to connect		50
Poolbeg North 220 kV	TSO	due to connect		450
Poolbeg South 22 kV	TSO	due to connect		500
Poolbeg South 220 kV	TSO	due to connect		500
Portlaoise	DSO	due to connect	4	
Portlaoise	DSO	due to connect		45
Portlaoise	DSO	connected		9
Stephenstown	DSO	due to connect	5	
Thornsberry	DSO	due to connect	24	
Thornsberry	DSO	due to connect		5
Timahoe North	TSO	due to connect	150	
Treascon	TSO	connected	40	
Total			1162	3292

Table 6-1.

Node	SO	Status	Solar	Wind
Athy	DSO	due to connect	9	
Belcamp 220 kV	TSO	due to connect		250
Belcamp 220 kV	TSO	due to connect		250
Blake T	DSO	due to connect	5	
Blundelstown	TSO	due to connect	60	

Carrickmines 220 kV	TSO	due to connect		412
Carrickmines 220 kV	TSO	due to connect		412
Clonfad	TSO	due to connect	100	
Coolnabacky	TSO	due to connect	80	
Cushaling	TSO	connected		100
Derryiron	TSO	due to connect	47	
Derryiron	TSO	due to connect		110
Dunfirth	DSO	due to connect	36	
Finglas	DSO	due to connect	8	
Gallanstown	TSO	due to connect	170	
Glasmore	DSO	due to connect	41	
Glasmore	TSO	due to connect	75	
Griffinrath	DSO	due to connect	66	
Harristown	TSO	due to connect	177	
Kilteel	DSO	due to connect	41	
Monread	DSO	due to connect	8	
Mount Lucas	TSO	due to connect		60
Mount Lucas	TSO	connected		79
Mulgeeth	TSO	due to connect		60
Newbridge	DSO	due to connect	16	
Philipstown	TSO	due to connect		50
Poolbeg North 220 kV	TSO	due to connect		450
Poolbeg South 22 kV	TSO	due to connect		500
Poolbeg South 220 kV	TSO	due to connect		500
Portlaoise	DSO	due to connect	4	
Portlaoise	DSO	due to connect		45
Portlaoise	DSO	connected		9
Stephenstown	DSO	due to connect	5	
Thornsberry	DSO	due to connect	24	
Thornsberry	DSO	due to connect		5
Timahoe North	TSO	due to connect	150	
Treascon	TSO	connected	40	
Total			1162	3292

Table 6-1 Wind and Solar Generation Summary in Area J for Generation Scenario "ECP"

	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Ireland (MW)	1389	2442	3496	4549	4549	4549	4549
Installed Area J (MW)	397	652	906	1161	1161	1161	1161
Installed Controllable Area J (MW)	397	652	906	1161	1161	1161	1161
Available Controllable Area J (GWh)	421	690	959	1229	1229	1229	1229

Table 6-2 and

	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Ireland (MW)	5072	5581	6090	6599	8796	10993	11593
Installed Area J (MW)	188	298	408	518	1905	3292	3292
Installed Controllable Area J (MW)	188	298	408	518	1905	3292	3292
Available Controllable Area J (GWh)	580	919	1259	1598	7051	12504	12504

Table 6-3 show installed solar and wind generation for Ireland and Area J, and the available solar and wind generation for Area J for each generation scenario.

Solar	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Ireland (MW)	1389	2442	3496	4549	4549	4549	4549
Installed Area J (MW)	397	652	906	1161	1161	1161	1161
Installed Controllable Area J (MW)	397	652	906	1161	1161	1161	1161
Available Controllable Area J (GWh)	421	690	959	1229	1229	1229	1229

Table 6-2 Installed MW and Available GWh for Area J – Solar

Wind	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Ireland (MW)	5072	5581	6090	6599	8796	10993	11593
Installed Area J (MW)	188	298	408	518	1905	3292	3292
Installed Controllable Area J (MW)	188	298	408	518	1905	3292	3292
Available Controllable Area J (GWh)	580	919	1259	1598	7051	12504	12504

Table 6-3 Installed MW and Available GWh for Area J – Wind

6.4 Network Overview

Area J, in the east of the country, includes a mix of wind and solar generation. A summary of this generation is given in

Node	SO	Status	Solar	Wind
Athy	DSO	due to connect	9	
Belcamp 220 kV	TSO	due to connect		250
Belcamp 220 kV	TSO	due to connect		250
Blake T	DSO	due to connect	5	
Blundelstown	TSO	due to connect	60	
Carrickmines 220 kV	TSO	due to connect		412
Carrickmines 220 kV	TSO	due to connect		412
Clonfad	TSO	due to connect	100	
Coolnabacky	TSO	due to connect	80	
Cushaling	TSO	connected		100
Derryiron	TSO	due to connect	47	
Derryiron	TSO	due to connect		110
Dunfirth	DSO	due to connect	36	
Finglas	DSO	due to connect	8	
Gallanstown	TSO	due to connect	170	
Glasmore	DSO	due to connect	41	
Glasmore	TSO	due to connect	75	
Griffinrath	DSO	due to connect	66	
Harristown	TSO	due to connect	177	
Kilteel	DSO	due to connect	41	
Monread	DSO	due to connect	8	
Mount Lucas	TSO	due to connect		60
Mount Lucas	TSO	connected		79
Mulgeeth	TSO	due to connect		60
Newbridge	DSO	due to connect	16	
Philipstown	TSO	due to connect		50
Poolbeg North 220 kV	TSO	due to connect		450
Poolbeg South 22 kV	TSO	due to connect		500
Poolbeg South 220 kV	TSO	due to connect		500
Portlaoise	DSO	due to connect	4	
Portlaoise	DSO	due to connect		45
Portlaoise	DSO	connected		9
Stephenstown	DSO	due to connect	5	
Thornsberry	DSO	due to connect	24	
Thornsberry	DSO	due to connect		5
Timahoe North	TSO	due to connect	150	
Treascon	TSO	connected	40	
Total			1162	3292

Table 6-1.

The transmission network in Area J and the surrounding areas is shown in Figure 6-1. The 400 kV circuits are shown in red, the 220 kV circuits in green and the 110 kV circuits in black. Possible future transmission stations and lines for the connection of new generation are also shown on the map below.



Figure 6-1 Network Map for Area J

Ireland’s largest load centre in the greater Dublin area is located in Area J. This includes the majority of Large Energy User (LEU) demand that has been assumed for the study. The EWIC interconnector is also located in Area J and tends to be exporting when renewable generation is high. In general, when renewable generation is high, power flows are predominantly towards Area J from the rest of the system to supply the demand and the EWIC flow.

Constraints in Area J can be caused both by local and wider system issues. Constraints in the model are optimised on a system-wide basis so, in theory, an increase in the installed generation in another area can increase constraints in Area J.

Area J has been split into two subgroups in this report; Area J City and Area J Country. Further detail on Area J subgroups can be found in Section 6.6.4. Additional solar and wind generation coming into Area J Country is constrained by thermal limitations on the local 110 kV network in the midlands in the 2025 and 2027 studies. These constraints are reduced in the Future Grid scenario as a result of network reinforcements which are assumed in the area in the Future Grid study, which alleviate these bottlenecks to reduce overall network constraints in the area.

6.5 Future Grid Sensitivity Scenario

In line with the ECP 2.1 studies and in response to feedback from industry, the Future Grid scenario is included in the analysis. All reasonable efforts have been made to align the network assumptions in the Future Grid scenario to the Shaping Our Electricity Future (SOEF) Roadmap published in November 2021. The network projects included in the study are given in Appendix A – Table A3. Additionally, any project that have progressed to step three of the six step process for developing the grid after the publication of the SOEF Roadmap, are also included in the Future Grid studies. Note however that the wind and solar generation portfolio in the ECP 2.2 Future Grid scenario differs from the wind and solar portfolio considered in SOEF, this is done to maintain compliance with the ECP 2.2 process. The ECP study includes all wind and solar projects which have applied through connection processes, whereas the SOEF study does not include the full set of wind and solar applicants.

The Future Grid study includes a base renewable generation scenario (ECP), along with three sensitivity generation scenarios (ECP + 2.2 GW offshore, ECP + 4.4 GW offshore, and ECP + 5 GW offshore). The latter three scenarios with additional offshore wind have been included to show the potential impact of increasing offshore wind on Total Dispatch Down levels.

The demand modelled for the Future Grid scenario is based on the medium demand scenario for 2030 as published in the All-Island Generation Capacity Statement 2022-2031.

This study is not intended as an assurance to individual generators that their Total Dispatch Down will change to the estimated levels. Rather, it is a consideration of the potential impact of the SOEF reinforcement portfolio on the dispatch down of wind and solar generators. This study is not intended to be exhaustive, and it is not intended to remove all transmission constraints.

6.6 Area J – Average Results

The Total Dispatch Down results for Area J are provided below in

Area J (J Country)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	257	437	617	796			
Installed Capacity (MW)	2027	257	437	617	796	796	796	
Installed Capacity (MW)	2030				796	796	796	796
Available Energy (GWh)	2025	272	463	653	843			
Available Energy (GWh)	2027	272	463	653	843	843	843	
Available Energy (GWh)	2030				843	843	843	843
Generation (GWh)	2025	259	435	564	649			
Generation (GWh)	2027	259	434	565	651	653	639	
Generation (GWh)	2030				723	723	700	692
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table 6-5 to Table 6-105 and Figure 6-2 to Figure 6-7. These include the breakdown between over-supply, curtailment and constraint. The Total Dispatch Down percentages are based on the total available energy. The Total Dispatch Down is the sum of over-supply, curtailment and constraint. The node level breakdown of over-supply, curtailment and constraint are given in Appendix C. The results show that the system level Total Dispatch Down increases with additional installed capacity with a significant increase in over-supply. However, the total dispatch down reduces when the 2027 studies are compared with 2025 and there is a further reduction in 2030 owing to increased demand, network reinforcement and relaxed system level operational constraints.

For each generation type in Area J (solar non-priority, wind non-priority and wind priority), the total installed capacity in MW and total available generation in GWh are given in

Area J (J Country)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	257	437	617	796			
Installed Capacity (MW)	2027	257	437	617	796	796	796	
Installed Capacity (MW)	2030				796	796	796	796
Available Energy (GWh)	2025	272	463	653	843			
Available Energy (GWh)	2027	272	463	653	843	843	843	
Available Energy (GWh)	2030				843	843	843	843
Generation (GWh)	2025	259	435	564	649			
Generation (GWh)	2027	259	434	565	651	653	639	
Generation (GWh)	2030				723	723	700	692

Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailment (%)	2025	0 %	1 %	1 %	2 %			
Curtailment (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailment (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table 6-5, Results Solar Not Priority in Area J (J Country)

Area J (J Country)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	100	210	320	430			
Installed Capacity (MW)	2027	100	210	320	430	430	430	
Installed Capacity (MW)	2030				430	430	430	430
Available Energy (GWh)	2025	308	648	987	1327			
Available Energy (GWh)	2027	308	648	987	1327	1327	1327	
Available Energy (GWh)	2030				1327	1327	1327	1327
Generation (GWh)	2025	251	511	731	901			
Generation (GWh)	2027	251	530	777	960	924	820	
Generation (GWh)	2030				1012	998	901	879
Over-supply (%)	2025	3 %	6 %	10 %	14 %			
Over-supply (%)	2027	0 %	1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025	1 %	1 %	2 %	2 %			
Curtailement (%)	2027	0 %	1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025	15 %	14 %	14 %	15 %			
Constraint (%)	2027	19 %	17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025	19 %	21 %	26 %	32 %			
Total Dispatch Down (%)	2027	19 %	18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table 6-6 and Table 6-105. The total generation in GWh, after dispatch down and corresponding percentage Total Dispatch Down are also included in the tables for each scenario. Details on the generation and network scenarios are given in Section 2.

6.6.1 Offshore Wind Sensitivity Studies

Results for the offshore wind-based sensitivity studies are also included, along with results for the core scenarios. A general trend is noted: increasing levels of offshore wind results in increasing Total Dispatch Down due to significant increases in available wind energy, which in turn leads to increase in levels of over-supply

6.6.2 Impact of Article 12

Higher Total Dispatch Down is observed for non-priority generators due to the impact of the implementation of Article 12 in the studies, which results in non-priority generators being reduced ahead of priority generators for over-supply reasons.

6.6.3 Future Grid Sensitivity Study

The results of the Future Grid scenario show a notable reduction in Total Dispatch Down over the core study years (2025 and 2027) due to the impact of the SOEF network reinforcements, increased demand levels in 2030 and the relaxation of operational constraints in 2030. However, increases in installed wind and solar generation, as seen in the offshore wind scenarios, result in rising over-supply levels, resulting in an increase in Total Dispatch Down. A detailed breakdown of the Total Dispatch Down components for Area J under the Future Grid scenario and associated sensitivity case is given in

Area J (J Country)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
--------------------	------	---------	-----	-----	-----	-----------------------------	-----------------------------	---------------------------

Installed Capacity (MW)	2025	257	437	617	796			
Installed Capacity (MW)	2027	257	437	617	796	796	796	
Installed Capacity (MW)	2030				796	796	796	796
Available Energy (GWh)	2025	272	463	653	843			
Available Energy (GWh)	2027	272	463	653	843	843	843	
Available Energy (GWh)	2030				843	843	843	843
Generation (GWh)	2025	259	435	564	649			
Generation (GWh)	2027	259	434	565	651	653	639	
Generation (GWh)	2030				723	723	700	692
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table 6-5, Results Solar Not Priority in Area J (J Country)

Area J (J Country)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	100	210	320	430			
Installed Capacity (MW)	2027	100	210	320	430	430	430	
Installed Capacity (MW)	2030				430	430	430	430
Available Energy (GWh)	2025	308	648	987	1327			
Available Energy (GWh)	2027	308	648	987	1327	1327	1327	
Available Energy (GWh)	2030				1327	1327	1327	1327
Generation (GWh)	2025	251	511	731	901			
Generation (GWh)	2027	251	530	777	960	924	820	
Generation (GWh)	2030				1012	998	901	879
Over-supply (%)	2025	3 %	6 %	10 %	14 %			
Over-supply (%)	2027	0 %	1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025	1 %	1 %	2 %	2 %			
Curtailement (%)	2027	0 %	1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025	15 %	14 %	14 %	15 %			
Constraint (%)	2027	19 %	17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025	19 %	21 %	26 %	32 %			
Total Dispatch Down (%)	2027	19 %	18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table 6-6 and Table 6-105. Further node level details can be viewed in Appendix C.

6.6.4 Area Subgroups

The constraint forecast study performed using Plexos software applies mathematical optimisation to find the lowest cost generator dispatch schedule to meet demand, subject to a number of system and transmission level constraints. To ensure the model is impartial, the assumptions on the cost of renewable generators remain the same, irrespective of technology or location, and are always less than that of conventional plant. This ensures renewable generators are given priority in the Plexos optimisation. However, due to network congestion caused by line limits and N-1 contingency security checks, the power flows in certain lines are limited causing dispatch down in RES generators which may affect one generator or multiple generators chosen by Plexos' internal logic. During various initial studies, it was observed that Plexos may repeatedly choose the same generator(s) to dispatch down to manage an issue in a region shared by multiple generators.

There is often a post-processing step between the Plexos simulation and this report to ensure a fair allocation of constraints among generators sharing the bottlenecks creating constraint subgroups within an area or spanning multiple different areas. The subgroups are selected based on an assessment of the raw Plexos results and based on our experience of dispatch down on the real system. The subgroups are chosen to group those generators into a constraint group that are expected to experience similar constraint levels. The subgroups are selected on the basis that they share a common transmission bottleneck, or they are electrically close to a congested area within the network.

Area J includes the major Dublin load centres. The power in the meshed 110 kV circuits in the midland (J-country) subgroup flows to the East, towards the 220 kV stations which feed the load centres (Figure 6-1). With increasing generation in the 110 kV network in the midlands, the power flow increases which causes bottlenecks in the circuits that have lower ratings. A loss of a circuit in the midlands area creates overloading in other circuits and therefore results in RES generation being dispatched down.

It was observed that the Plexos internal logic was constantly choosing the same set of generators to dispatch down with respect to multiple contingencies in the area, thus identifying a need to share the constraints. The

contingencies and overloaded lines associated with the area are included in Appendix D. Additionally, the loss of a 220 kV and 400 kV circuit exerts additional stress on the 110 kV circuits in the region.

The J City subgroup is located in the east of Dublin. This subgroup receives connections of future offshore wind which are also grouped in this constraint subgroup. The J City subgroup mostly consists of circuits with 220 kV cables and is connected to the J Country subgroup through 110 kV and 220 kV stations.

Analysis of Area J identified two constraint subgroups for solar and wind generation; Area J City and Area J Country. The subgroup nodes are given in Table 6-4. The constraints are shared on a pro-rata basis amongst the subgroup generators. The individual node level dispatch down is given in Appendix C.

Sub-Group	Generator Nodes
J City	Finglas
	Gallanstown
	Glasmore
	Griffinrath
	Stephenstown
J Country	Athy
	Blake
	Blundelstown
	Clonfad
	Coolnabacky
	Cushaling
	Derryiron
	Dunfirth
	Harristown
	Kilteel
	Monread
	Mount Lucas
	Mulgeeth
	Newbridge
	Philipstown
	Portlaoise
	Thornsberry
Timahoe North	
Treascon	

Table 6-4 Area J sub-groups and generator nodes within each subgroup

Area J (J Country)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	257	437	617	796			
Installed Capacity (MW)	2027	257	437	617	796	796	796	
Installed Capacity (MW)	2030				796	796	796	796
Available Energy (GWh)	2025	272	463	653	843			
Available Energy (GWh)	2027	272	463	653	843	843	843	
Available Energy (GWh)	2030				843	843	843	843
Generation (GWh)	2025	259	435	564	649			
Generation (GWh)	2027	259	434	565	651	653	639	
Generation (GWh)	2030				723	723	700	692
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailment (%)	2025	0 %	1 %	1 %	2 %			
Curtailment (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailment (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table 6-5 Over-supply, Curtailment and Constraint for Solar Not Priority in Area J (J Country)

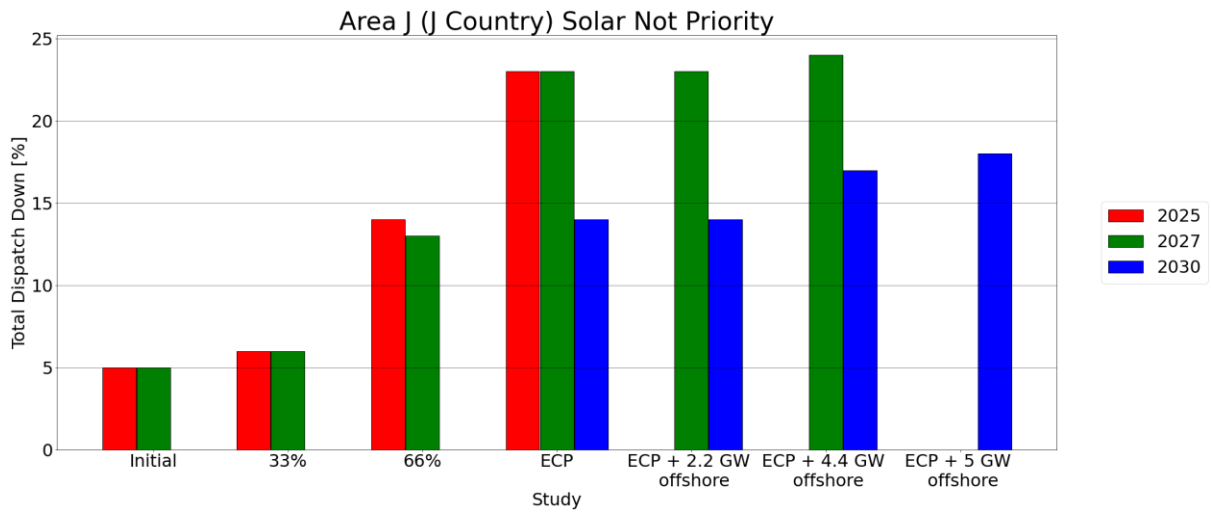


Figure 6-2 Results Solar Not Priority in Area J (J Country)

Area J (J Country)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	100	210	320	430			
Installed Capacity (MW)	2027	100	210	320	430	430	430	
Installed Capacity (MW)	2030				430	430	430	430
Available Energy (GWh)	2025	308	648	987	1327			
Available Energy (GWh)	2027	308	648	987	1327	1327	1327	
Available Energy (GWh)	2030				1327	1327	1327	1327
Generation (GWh)	2025	251	511	731	901			
Generation (GWh)	2027	251	530	777	960	924	820	
Generation (GWh)	2030				1012	998	901	879
Over-supply (%)	2025	3 %	6 %	10 %	14 %			
Over-supply (%)	2027	0 %	1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025	1 %	1 %	2 %	2 %			
Curtailement (%)	2027	0 %	1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025	15 %	14 %	14 %	15 %			
Constraint (%)	2027	19 %	17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025	19 %	21 %	26 %	32 %			
Total Dispatch Down (%)	2027	19 %	18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table 6-6 Over-supply, Curtailment and Constraint for Wind Not Priority in Area J (J Country)

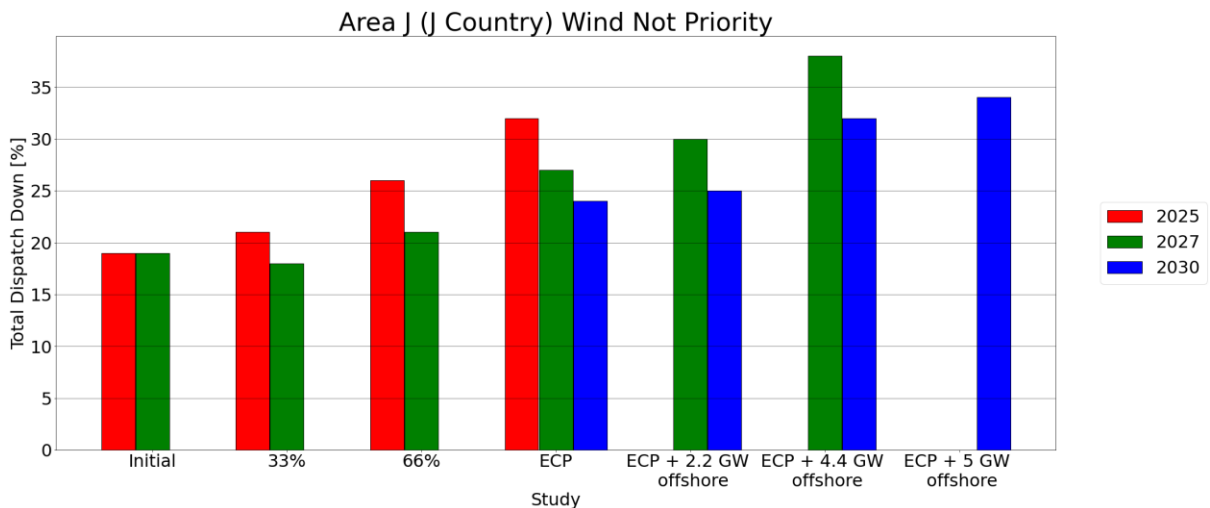


Figure 6-3 Results Wind Not Priority in Area J (J Country)

Area J (J Country)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	88	88	88	88			
Installed Capacity (MW)	2027	88	88	88	88	88	88	
Installed Capacity (MW)	2030				88	88	88	88
Available Energy (GWh)	2025	271	271	271	271			
Available Energy (GWh)	2027	271	271	271	271	271	271	
Available Energy (GWh)	2030				271	271	271	271
Generation (GWh)	2025	227	228	224	219			
Generation (GWh)	2027	221	224	220	209	230	238	
Generation (GWh)	2030				214	236	243	244
Over-supply (%)	2025	0 %	0 %	0 %	0 %			
Over-supply (%)	2027	0 %	0 %	0 %	0 %	0 %	0 %	
Over-supply (%)	2030				0 %	0 %	0 %	0 %
Curtailment (%)	2025	1 %	2 %	3 %	4 %			
Curtailment (%)	2027	0 %	1 %	1 %	2 %	4 %	5 %	
Curtailment (%)	2030				1 %	3 %	5 %	5 %
Constraint (%)	2025	15 %	14 %	15 %	16 %			
Constraint (%)	2027	19 %	17 %	18 %	21 %	11 %	7 %	
Constraint (%)	2030				20 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025	16 %	16 %	18 %	19 %			
Total Dispatch Down (%)	2027	19 %	18 %	19 %	23 %	15 %	12 %	
Total Dispatch Down (%)	2030				21 %	13 %	10 %	10 %

Table 6-7 Over-supply, Curtailment and Constraint for Wind Priority in Area J (J Country)

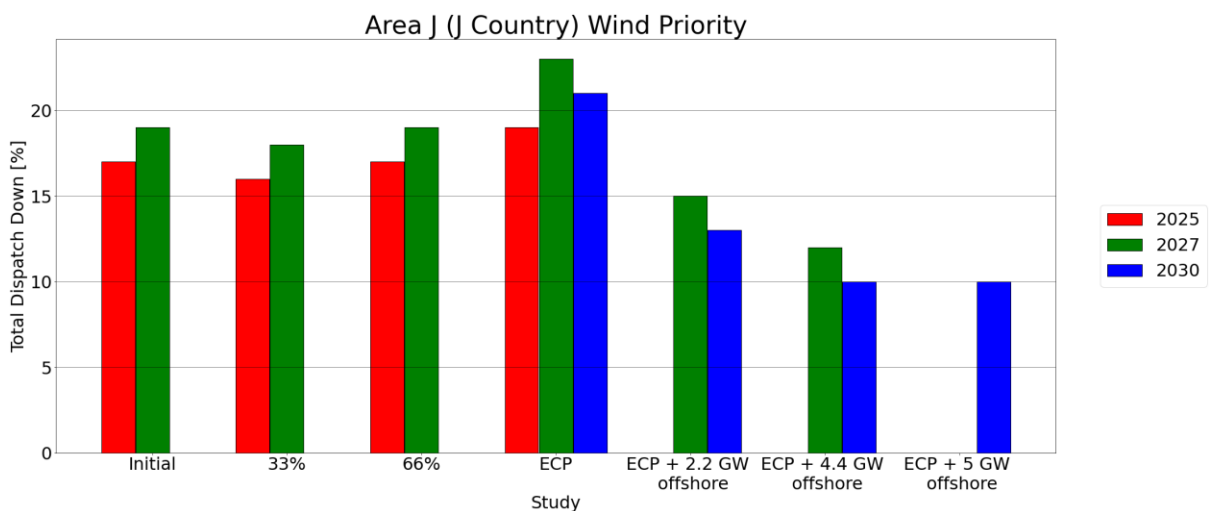


Figure 6-4 Results Wind Priority in Area J (J Country)

Area J (G South)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	124	179	235	290			
Installed Capacity (MW)	2027	124	179	235	290	290	290	
Installed Capacity (MW)	2030				290	290	290	290
Available Energy (GWh)	2025	131	190	249	308			
Available Energy (GWh)	2027	131	190	249	308	308	308	
Available Energy (GWh)	2030				308	308	308	308
Generation (GWh)	2025	125	180	223	260			
Generation (GWh)	2027	125	176	214	247	254	246	
Generation (GWh)	2030				252	261	254	251
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	5 %	7 %			
Constraint (%)	2027	5 %	7 %	11 %	15 %	8 %	5 %	
Constraint (%)	2030				14 %	7 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	5 %	10 %	16 %			
Total Dispatch Down (%)	2027	5 %	8 %	14 %	20 %	18 %	20 %	
Total Dispatch Down (%)	2030				18 %	15 %	17 %	18 %

Table 6-8 Over-supply, Curtailment and Constraint for Solar Not Priority in Area J (G South)

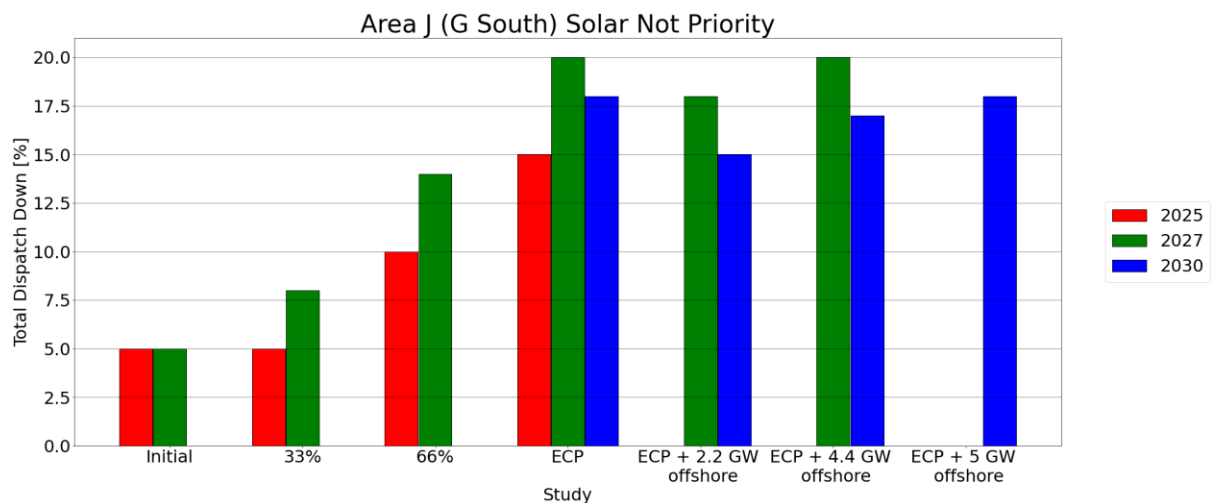


Figure 6-5 Results Solar Not Priority in Area J (G South)

Area J (J City)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	16	35	55	74			
Installed Capacity (MW)	2027	16	35	55	74	74	74	
Installed Capacity (MW)	2030				74	74	74	74
Available Energy (GWh)	2025	17	37	58	78			
Available Energy (GWh)	2027	17	37	58	78	78	78	
Available Energy (GWh)	2030				78	78	78	78
Generation (GWh)	2025	16	36	55	72			
Generation (GWh)	2027	16	36	55	74	71	67	
Generation (GWh)	2030				74	72	68	67
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	2 %	0 %	0 %			
Constraint (%)	2027	5 %	4 %	2 %	0 %	0 %	0 %	
Constraint (%)	2030				1 %	0 %	0 %	0 %
Total Dispatch Down (%)	2025	5 %	5 %	5 %	9 %			
Total Dispatch Down (%)	2027	5 %	5 %	5 %	5 %	10 %	15 %	
Total Dispatch Down (%)	2030				5 %	8 %	13 %	14 %

Table 6-9 Over-supply, Curtailment and Constraint for Solar Not Priority in Area J (J City)

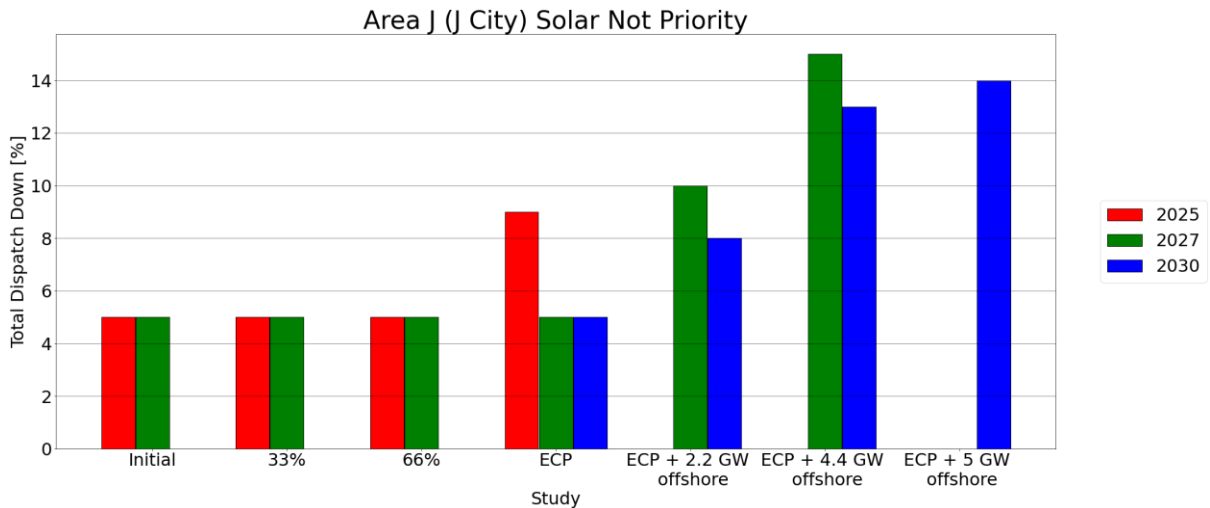


Figure 6-6 Results Solar Not Priority in Area J (J City)

Area J (J City)	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025							
Installed Capacity (MW)	2027					1387	2774	
Installed Capacity (MW)	2030					1387	2774	2774
Available Energy (GWh)	2025							
Available Energy (GWh)	2027					5453	10906	
Available Energy (GWh)	2030					5453	10906	10906
Generation (GWh)	2025							
Generation (GWh)	2027					4468	6858	
Generation (GWh)	2030					4789	8116	7898
Over-supply (%)	2025							
Over-supply (%)	2027					14 %	25 %	
Over-supply (%)	2030					10 %	20 %	22 %
Curtailement (%)	2025							
Curtailement (%)	2027					2 %	3 %	
Curtailement (%)	2030					2 %	3 %	3 %
Constraint (%)	2025							
Constraint (%)	2027					2 %	10 %	
Constraint (%)	2030					0 %	3 %	3 %
Total Dispatch Down (%)	2025							
Total Dispatch Down (%)	2027					18 %	37 %	
Total Dispatch Down (%)	2030					12 %	26 %	28 %

Table 6-105 Over-supply, Curtailment and Constraint for Wind Not Priority in Area J (J City)

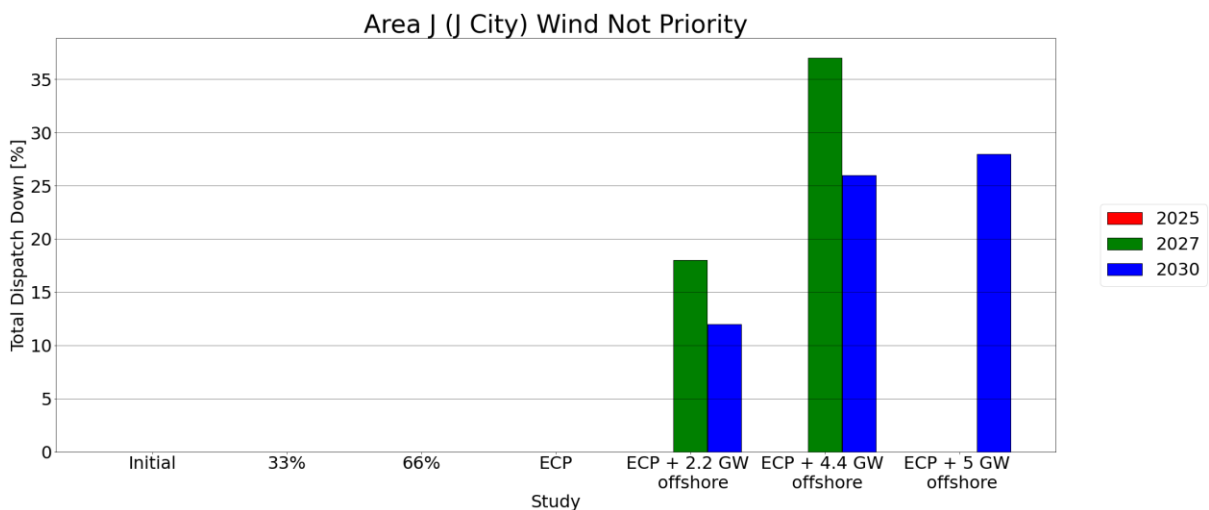


Figure 6-7 Results Wind Not Priority in Area J (J City)

6.7 Conclusion – Results for Area J

This section provides an overview of the estimated over-supply, curtailment and constraint values for Area J for a range of scenarios based on a number of installed generation assumptions (generation scenarios) and the study year (network and demand assumptions). The results highly depend on the study assumptions, which are described in this report.

Appendix C contains the detailed results consisting of energy (GWh), percentage over-supply, curtailment and constraint values for each node for both solar and wind in Area J.

Appendix A – Network Reinforcement & Maintenance

A.1 Reinforcements in 2025

The table below lists the reinforcements, additional to the current network, that are included in the 2025 study scenario.

Project Type	Project Name	Year
New Build	Laois Kilkenny (Coolnabacky) 400 kV Station - New Station & Associated Lines & Station Works	2025
Uprate	Corduff - Ryebrook 110 kV line uprate	2025
New Build	Kilpaddoge - Knockanure 220 kV cable	2025
Uprate	Clashavoon - Tarbert 220 kV line uprate	2025
Uprate	Castlebar 110 kV station busbar uprate	2025
Uprate	Flagford - Sliabh Bawn 110 kV circuit uprate	2025
Uprate	Arva - Carrick-on-Shannon 110 kV line uprate	2025
Uprate	Maynooth - Woodland 220 kV line uprate	2025
Uprate	Ballyvouskill Knockanure 220 kV Line Uprate	2025
Static Compensator	Thurles 110 kV Station - Starcom	2025
Static Compensator	Ballynahulla 220-110 kV Station - Statcom	2025
Static Compensator	Ballyvouskill 220-110 kV Station - Statcom	2025
Uprate	Great Island Kilkenny 110 kV Uprate	2025
New Build	Belcamp Shellybanks 220 kV Cable	2025
Uprate	Lanesboro - Mullingar 110 kV line LCA	2025
Uprate	Lanesboro – Sliabh Bawn Thermal Uprate	2025
Uprate	Binbane - Cathleen’s Fall 110 kV Circuit Thermal Capacity	2025
New Build	Greenlink Interconnector	2025
Uprate	Glenree - Moy 110 kV Line Uprate	2025
Uprate	Gorman - Platin 110 kV line uprate	2025
Uprate	Drybridge - Oldbridge - Platin 110 kV line uprate	2025
Uprate	Louth - Ratrussan 110 kV No 1 Line Uprate	2025
Uprate	Newbridge - Cushaling 110 kV line, Stations bay conductors and lead-in conductor uprate	2025
Synchronous Condenser	Moneypoint Synchronous Condenser	2025

Table A-1 Reinforcements included in the 2025 study

A.2 Reinforcements in 2027

The table below lists the network reinforcements included in the 2027 study scenario, additional to the network in the 2025 study scenario.

Project Type	Project Name	Year
New Build	North South 400 kV Interconnector	2027
Uprate	Coolnabacky - Portlaoise 110 kV line uprate	2027
Uprate	Castlebar-Cloon 110 kV Line Uprate-Refurb	2027
Series Capacitor	Moneypoint 400 kV Series Capacitor	2027
Series Capacitor	Dunstown 400 kV Series Capacitor	2027
Series Capacitor	Oldstreet-Woodland 400 kV Series Capacitor	2027
New Build	Cross Shannon 400 kV Cable	2027
Uprate	Kinnegad 110 kV station, Derryiron 110 kV bay conductor uprate	2027
uprate	Sligo 110 kV Station - Srananagh 1 & 2 Bay uprates	2027
Uprate	Cashla-Salthill 110 kV Thermal Uprate	2027
Uprate	Newbridge - Portlaoise 110 kV Partial Thermal Uprate	2027
Uprate	Crane - Wexford 110 kV Circuit Thermal Capacity	2027
Uprate	Derryiron - Thornsberry 110 kV Circuit Uprate	2027
New Build	North Connacht 110 kV Project	2027
Uprate	Dalton 110 kV Busbar	2027
Uprate	Bandon Dunmanway 110 kV circuit thermal capacity	2027

Table A-2 Reinforcements included in the 2027 study scenario, additional to 2025 study reinforcements

A.3 Reinforcements in Future Grid

The table below lists the reinforcements, additional to the current network, that are included in the Future Grid study scenario.

Project Type	Project	Year
Station	Aghada Station Busbar Reconfiguration	Future Grid
Upvoltage	Arklow - Ballybeg - Carrickmines 220 kV (circuit 1)	Future Grid
Uprate	Arva - Carrick On Shannon 110 kV uprate (circuit 1)	Future Grid
Uprate	Athlone - Lanesboro 110 kV uprate (circuit 1)	Future Grid
Uprate	Athy - Carlow 110 kV uprate (circuit 1)	Future Grid
Uprate	Ballylumford - Eden 110 kV uprate	Future Grid
Static Compensator	Ballynahulla Station - Statcom	Future Grid
Uprate	Ballyvouskill - Ballynahula - Knockanure 220 kV uprate	Future Grid
Static Compensator	Ballyvouskill 220/110 kV Station - Statcom	Future Grid
Uprate	Bandon - Dunmanway 110 kV uprate (circuit 1)	Future Grid
Uprate	Baroda - Monread 110 kV uprate (circuit 1)	Future Grid
DLR	Baroda - Newbridge 110 kV (circuit 1)	Future Grid
DLR	Bellacorrick - Castlebar 110 kV (circuit 1)	Future Grid
Uprate	Binbane - Cathaleen's Fall 110 kV uprate (circuit 1)	Future Grid
New Build	Binbane - Clogher - Cathaleen's Fall - 110 kV Clogher tie in	Future Grid
DLR	Cashla - Dalton 110 kV (circuit 1)	Future Grid
Uprate	Cashla - Salthill 110 kV uprate (circuit 1)	Future Grid
Uprate	Castlebar - Cloon 110 kV uprate (circuit 1)	Future Grid
Station	Castlebar 110 kV station busbar	Future Grid
DLR	Cathaleen's Fall - Coraclassy 110 kV (circuit 1)	Future Grid
New Build	Clashavoon - Macroom No. 1 & associated station works & 250 MVA transformer	Future Grid
Uprate	Clashavoon - Tarbert 220 kV uprate (circuit 1)	Future Grid
New Build	Clogher - Srananagh 220 kV (circuit 1)	Future Grid
Uprate	Coleraine - Coolkeeragh 110 kV uprate (circuit 1)	Future Grid
Uprate	Coolkeeragh - Killymallaght 110 kV uprate (circuit 1)	Future Grid
Uprate	Coolkeeragh - Limavady 110 kV uprate (circuit 1)	Future Grid
Uprate	Coolkeeragh - Magherafelt 275 kV Circuits Refurbishment	Future Grid
Uprate	Coolkeeragh - Strabane 110 kV uprate (circuit 1)	Future Grid
Uprate	Coolnabacky - Portlaoise 110 kV uprate (circuit 1)	Future Grid
Station	Coolnabacky Station 400 kV - new station and associated lines and station works	Future Grid
Uprate	Corderry - Srananagh 110 kV uprate (circuit 1)	Future Grid
Uprate	Crane - Wexford 110 kV uprate (circuit 1)	Future Grid
DLR	Cushaling - Newbridge 110 kV (circuit 1)	Future Grid
Station	Dalton busbar	Future Grid
Uprate	Derryiron - Kinnegad 110 kV uprate (circuit 1)	Future Grid
Reactive Support	Distributed Series Reactors Project (Nationwide)	Future Grid
Uprate	Drumkeen - Clogher 110 kV uprate (circuit 1)	Future Grid
Uprate	Drumnakelly - Tamnamore 110 kV uprate (circuit 1)	Future Grid
Uprate	Drumnakelly - Tamnamore 110 kV uprate (circuit 2)	Future Grid
Uprate	Drybridge - Louth 110 kV uprate (circuit 1)	Future Grid
Series Capacitor	Dunstown Series Capacitor	Future Grid
Uprate	Finglas - North Wall 220 kV uprate (circuit 1)	Future Grid
Uprate	Flagford - Sliabh Bawn 110 kV uprate (circuit 1)	Future Grid
Upvoltage	Flagford - Srananagh 110 kV (circuit 1)	Future Grid
Uprate	Galway - Salthill 110 kV uprate (circuit 1)	Future Grid
Station	Galway Station Redevelopment Project	Future Grid
Transformer	Gort second transformer	Future Grid
Uprate	Great Island - Kellis 220 kV uprate (circuit 1)	Future Grid
Uprate	Great Island - Kilkenny 110 kV uprate (circuit 1)	Future Grid

Transformer	Great Island 220/110 kV transformer No.3	Future Grid
New Build	Inchicore - Carrickmines 220 kV (circuit 1)	Future Grid
Station	Kilbarry GIS Station	Future Grid
New Build	Kildare - Meath 400 kV Grid Upgrade Project (Capital Project 966)	Future Grid
Uprate	Killoteran - Waterford 110 kV uprate (circuit 1)	Future Grid
New Build	Kilpaddoge - Knockanure 220 kV cable	Future Grid
New Build	Kilpaddoge - Moneypoint 400 kV Project (Cross Shannon)	Future Grid
Uprate	Kilteel - Maynooth 110 kV uprate (circuit 1)	Future Grid
Reactive Support	Knockanure Reactor	Future Grid
Uprate	Knockraha - Cahir 110 kV uprate (circuit 1)	Future Grid
Station	Knockraha Short Circuit Rating Mitigation	Future Grid
Station	Knockraha station installation of additional couplers	Future Grid
Uprate	Lanesboro - Mullingar 110 kV uprate (circuit 1)	Future Grid
Uprate	Lanesboro - Sliabh Bawn 110 kV uprate (circuit 1)	Future Grid
Station	Lanesboro Station Redevelopment Project	Future Grid
Station	Letterkenny busbar	Future Grid
Uprate	Louth - Oriel 220 kV uprate (circuit 1)	Future Grid
DLR	Magherakeel - Omagh (circuit 1)	Future Grid
Uprate	Maynooth - Rinawade 110 kV uprate (circuit 1)	Future Grid
Uprate	Maynooth - Timahoe 110 kV uprate (circuit 1)	Future Grid
Uprate	Derryiron - Timahoe 110 kV uprate (circuit 1)	Future Grid
New Build	Mid Antrim Upgrade	Future Grid
New Build	Mid-Tyrone Project	Future Grid
Series Capacitor	Moneypoint Series Capacitor	Future Grid
Uprate	Moy - Glenree 110 kV uprate (circuit 1)	Future Grid
Station	Moy 110 kV Station reconfiguration and busbar uprate	Future Grid
New Build	North Connacht 110 kV Reinforcement Project	Future Grid
New Build	North South 400 kV Interconnector - NI	Future Grid
New Build	North South 400 kV Interconnector - IE	Future Grid
Uprate	North Wall - Poolbeg 220 kV uprate (circuit 1)	Future Grid
New Build	North West of NI 110 kV reinforcement	Future Grid
Series Capacitor	Oldstreet Series Capacitor	Future Grid
Uprate	Omagh - Strabane 110 kV uprate (circuit 2)	Future Grid
Uprate	Omagh Main - Dromore Uprate	Future Grid
Uprate	Poolbeg - Carrickmines 220 kV uprate (circuit 1)	Future Grid
Uprate	Poolbeg South - Inchicore 220 kV uprate (circuit 1)	Future Grid
Uprate	Poolbeg South - Inchicore 220 kV uprate (circuit 2)	Future Grid
Uprate	Rinawade - Dunfirth Tee 110 kV uprate (circuit 1)	Future Grid
Uprate	Sligo - Srananagh 110 kV uprate (circuit 3)	Future Grid
Static Compensator	Thurles Station - Statcom	Future Grid
New Build	Woodland - Finglas 400 kV cable cct	Future Grid
Uprate	Woodland - Oriel 220 kV uprate (circuit 1)	Future Grid

Table A-3 Reinforcements included in the Future Grid study

Project Type	Project Name	Year
Uprate	Kinnegad 110 kV station, Derryiron 110 kV bay conductor uprate	Future Grid
Uprate	Newbridge - Cushaling 110 kV line, Stations bay conductors and lead-in conductor uprate	Future Grid
Uprate	Gorman - Platin 110 kV line uprate	Future Grid
Uprate	Drybridge - Oldbridge - Platin 110 kV line uprate	Future Grid
Uprate	Louth - Ratrussan 110 kV No 1 Line Uprate	Future Grid
Uprate	Sligo 110 kV Station - Srananagh 1 & 2 Bay uprates	Future Grid
Uprate	Newbridge - Portlaoise 110 kV Partial Thermal Uprate	Future Grid
uprate	Derryiron - Thornsberry 110 kV Circuit Uprate	Future Grid

Table A-4 Additional reinforcements included in the Future Grid study

A.4 Maintenance within the Plexos Modelling

The table below outlines the representative transmission outage schedule applied within the Plexos model for this study.

Child Object	Timeslice	Category
Ballylumford Kells 275 NI	M8	NI
Coleraine Coolkeeragh 110 NI	M8	NI
Kells_110_81520_KEL_275_1	M5	NI
Tandragee 110 275 ckt 2 NI	M7	NI
Aghada - Glanagow_220_1	M4	IE
Aghada - Raffeen_220_1	M6	IE
Arklow - Carrickmines_220_1	M3	IE
Arva - Carrick on Shannon_110_1	M8	IE
Arva - Navan_110_1	M5	IE
Arva - Shankill_110_1	M7	IE
Carlow - Kellis_110_1	M3	IE
Carrick on Shannon - Flagford_110_1	M9	IE
Carrickmines - Dunstown_220_1	M9	IE
Carrickmines - Irishtown_220_1	M10	IE
Carrickmines - Poolbeg_220_1	M5	IE
Carrigadrohid - Kilbarry_110_1	M11	IE
Cashla - Cloon_110_1	M3	IE
Cashla - Flagford_220_1	M11	IE
Cashla - Galway_110_1	M6	IE
Cashla - Prospect_220_1	M4	IE
Castlebagot - Maynooth_220_1	M10	IE
Castlebar - Cloon_110_1	M5	IE
Cathaleen's Fall - Srananagh_110_1	M10	IE
Clashavoon - Knockraha_220_1	M8	IE
Clashavoon - Macroom_110_1	M5	IE
Cloon - Lanesboro110_1	M4	IE
Coolnabacky - Moneypoint_380_1	M4	IE
Corduff - Cruiserath_220_1	M11	IE
Corduff - Ryebrook_110_1	M8	IE
Corduff - Woodland_220_1	M7	IE
Cullenagh - Great Island_220_1	M5	IE
Cullenagh - Knockraha_220_1	M9	IE
Cullenagh - Waterford_110_1	M3	IE
Cushaling - Portlaoise_110_1	M3	IE
Derryiron - Kinnegad_110_1	M4	IE
Drybridge - Gorman_110_1	M4	IE
Drybridge - Louth_110_1	M5	IE
Dunstown - Kellis_220_1	M8	IE
Dunstown - Maynooth_a_220_2	M9	IE
Flagford - Louth_220_1	M3	IE
Flagford - Sligo_110_1	M6	IE
Flagford - Srananagh_220_1	M4	IE
Glanagow - Raffeen_220_1	M7	IE
Gorman - Louth_220_1	M10	IE
Gorman - Maynooth_220_1	M4	IE
Gorman - Navan_110_1	M9	IE
Gorman - Platin_110_1	M6	IE
Great Island - Kellis_220_1	M6	IE
Great Island - Lodgewood_220_1	M7	IE
Great Island - Waterford_110_1	M9	IE
Inchicore - Poolbeg_220_1	M11	IE

Killonan - Kilpaddoge_220_1	M10	IE
Killonan - Knockraha_220_1	M11	IE
Killonan - Limerick_110_1	M4	IE
Killonan - Shannonbridge_220_1	M9	IE
Kilpaddoge - Tarbert_220_1	M3	IE
Kilpaddoge - Tralee_110_1	M11	IE
Knockraha - Raffeen_220_1	M8	IE
Maynooth - Blake-T_110_1	M5	IE
Maynooth - Shannonbridge_220_1	M10	IE
Newbridge - Portlaoise_110_1	M7	IE
Oldstreet - Woodland_380_1	M6	IE
Prospect - Tarbert_220_1	M3	IE
Raffeen - Trabeg_110_1	M7	IE
Sligo - Srananagh_110_1	M10	IE
Thurles - Ikerrin-T_110_1	M6	IE
Arklow T2102	M9	Transformer
Carrickmines T2101	M8	Transformer
Carrickmines T2102	M11	Transformer
Cashla T2101	M9	Transformer
Castlebagot T2101	M4	Transformer
Clashavoon T2102	M3	Transformer
Cullenagh T2101	M4	Transformer
Dunstown T4201	M5	Transformer
Dunstown T4202	M11	Transformer
Finglas T2101	M6	Transformer
Flagford T2101	M5	Transformer
Inchicore T2101	M7	Transformer
Killonan T2104	M8	Transformer
Kilpaddoge T2101	M7	Transformer
Knockraha T2101	M6	Transformer
Knockraha T2102	M10	Transformer
Louth T2101	M8	Transformer
Moneypoint T4202	M10	Transformer
Woodland T4201	M7	Transformer

Table A-5 Representative Transmission Outage Schedule

Appendix B – Generator

The following generator information is included in this Appendix:

- Generator Type for each Generation Scenario
- Generator Type by Area for each Generation Scenario

A full list of generators included in the study is published separately on the ECP 2.2 constraint forecast webpage¹³

Note: the tables in the following section include both Ireland and Northern Ireland generation.

¹³ <https://www.eirgridgroup.com/customer-and-industry/general-customer-information/ecp-2.2-constraints-repor/index.xml>

B.1 Generation Type for each Generator Scenario

The table below shows existing and expected wind, wind offshore, solar, wave, battery and other technologies (other technologies include: biomass, biogas, CHP, LFG and Anaerobic Digester (AD) plants) in both Ireland and Northern Ireland, which were included in this analysis.

Type	Initial (MW)	33% (MW)	66% (MW)	ECP (MW)	ECP+ 2.2 GW Offshore (MW)	ECP + 4.4 GW Offshore (MW)	ECP + 5 GW Offshore (MW)
battery	1,016	1253	1491	1729	1729	1729	1,729
offshore wind	-	0	0	0	2197	4394	4,994
solar	1,550	2603	3656	4710	4710	4710	4,710
wave	-	3	7	10	10	10	10
wind	6,481	7322	8163	9005	9005	9005	9,005
Other Technologies	36	36	36	36	36	36	36
Grand Total	9082	11218	13353	15489	9942	19883	20483

Table B-1 Total Generation per Generation Type

B.2 Generation Type by Area for each Generator Scenario

The table below shows existing and expected wind, wind offshore, solar, wave, battery and other technologies (other technologies include: biomass, biogas, CHP, LFG and AD plants) in both Ireland and Northern Ireland, which were included in this analysis.

Type and Area	Initial (MW)	33% (MW)	66% (MW)	ECP (MW)	ECP+ 2.2 GW offshore (MW)	ECP + 4.4 GW offshore (MW)	ECP+ 5 GW Offshore (MW)
battery	1016	1253	1491	1729	1729	1729	1729
B	11	15	19	23	23	23	23
C	263	268	274	279	279	279	279
E	7	7	7	7	7	7	7
G	110	180	250	319	319	319	319
H2	25	108	192	275	275	275	275
I	178	215	251	288	288	288	288
J	212	245	279	312	312	312	312
K	-	33	67	100	100	100	100
NI	210	215	221	226	226	226	226
offshore wind	-	-	-	-	2197	4394	4994
E	-	-	-	-	225	450	450
G	-	-	-	-	185	370	370
H2	-	-	-	-	400	800	1100
I	-	-	-	-	-	-	300
J	-	-	-	-	1387	2774	2774
solar	1550	2603	3656	4710	4710	4710	4710
A	-	15	30	45	45	45	45
B	43	103	162	222	222	222	222
C	134	174	215	256	256	256	256
D	-	42	83	125	125	125	125
E	158	242	327	411	411	411	411
F	9	22	35	48	48	48	48
G	262	376	489	603	603	603	603
H1	16	111	206	302	302	302	302
H2	213	429	645	862	862	862	862
I	35	109	183	258	258	258	258
J	397	652	906	1161	1161	1161	1161
K	122	167	213	258	258	258	258
NI	161	161	161	161	161	161	161

wave	-	3	7	10	10	10	10
B	-	3	7	10	10	10	10
wind	6481	7322	8163	9005	9005	9005	9005
A	811	888	966	1044	1044	1044	1044
B	781	876	972	1067	1067	1067	1067
C	132	238	344	451	451	451	451
D	311	316	320	325	325	325	325
E	1467	1500	1534	1567	1567	1567	1567
F	218	219	220	222	222	222	222
G	233	249	266	282	282	282	282
H1	540	567	594	621	621	621	621
H2	322	359	396	433	433	433	433
I	8	8	9	9	9	9	9
J	188	298	408	518	518	518	518
K	61	61	61	61	61	61	61
NI	1409	1741	2074	2406	2406	2406	2406
Other Technologies	36	36	36	36	36	36	36
B	2	2	2	2	2	2	2
E	3	3	3	3	3	3	3
F	5	5	5	5	5	5	5
G	17	17	17	17	17	17	17
J	8	8	8	8	8	8	8
K	2	2	2	2	2	2	2
Grand Total	9082	11218	13353	15489	9942	19883	20483

Table B-2 Generation Type by Area for each Generator Scenario

B.3 Generation List by Type, Node and Name

A full list of generators included in the study is published separately on the ECP 2.2 constraint forecast webpage¹⁴ which includes existing and expected wind, wind offshore, solar, wave, battery and other technologies (other technologies include: biomass, biogas, CHP, LFG and AD plants) sorted A to Z by name in Ireland which were included in this analysis.

Note that the year of connection is rounded from the build-out rate date or target connection date.

These are in addition to the new large generators, which are listed in EirGrid and SONI's All-Island Generation Capacity Statement 2022 - 2031.

¹⁴ <https://www.eirgridgroup.com/customer-and-industry/general-customer-information/ecp-2.2-constraints-repor/index.xml>

Appendix C Area J Node Results

This appendix presents the results of the modelling analysis for Area J. The levels of over-supply, curtailment and constraint that controllable solar and wind generators in Area J might expect to experience are reported on a nodal basis for the study scenarios. Details on the generation capacity at each node are also provided along with the assumed amount of controllable generation.

This appendix also presents a list for each node of those generators that are included in the study.



Figure C-0-1 Area J

C.1. Athy



Figure C-1 - Location of node Athy

Generator	SO	Capacity	Type	Status
Moatstown Solar	DSO	4.0	solar not priority	due to connect
Woodstock North Solar Farm	DSO	5.0	solar not priority	due to connect

Table C-1 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	4	6	7	9			
Installed Capacity (MW)	2027	4	6	7	9	9	9	
Installed Capacity (MW)	2030				9	9	9	9
Available Energy (GWh)	2025	4	6	8	10			
Available Energy (GWh)	2027	4	6	8	10	10	10	
Available Energy (GWh)	2030				10	10	10	10
Generation (GWh)	2025	4	6	7	7			
Generation (GWh)	2027	4	6	7	7	7	7	
Generation (GWh)	2030				8	8	8	8
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-2 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

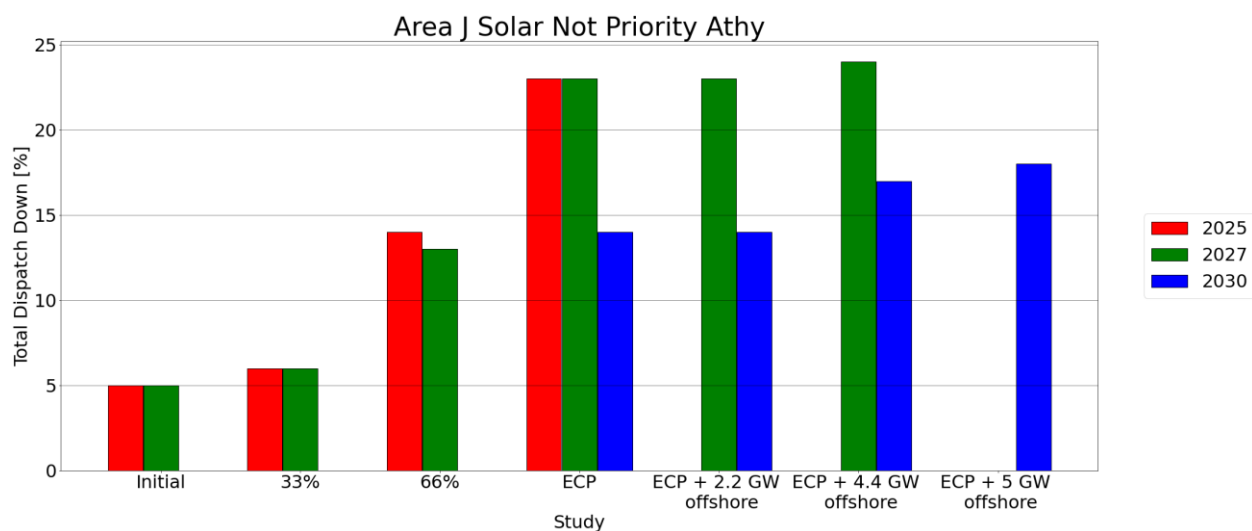


Figure C-2 - Total Dispatch Down for Solar not priority

C.2. Belcamp 220kV



Figure C-3 - Location of node Belcamp 220kv

Generator	SO	Capacity	Type	Status
North Irish Sea Array A	TSO	250.0	wind not priority	due to connect
North Irish Sea Array B	TSO	250.0	wind not priority	due to connect

Table C-3 - Generation Included in Study for Node

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025							
Installed Capacity (MW)	2027					250	500	
Installed Capacity (MW)	2030					250	500	500
Available Energy (GWh)	2025							
Available Energy (GWh)	2027					983	1966	
Available Energy (GWh)	2030					983	1966	1966
Generation (GWh)	2025							
Generation (GWh)	2027					806	1236	
Generation (GWh)	2030					863	1463	1424
Over-supply (%)	2025							
Over-supply (%)	2027					14 %	24 %	
Over-supply (%)	2030					10 %	20 %	22 %
Curtailement (%)	2025							
Curtailement (%)	2027					2 %	3 %	
Curtailement (%)	2030					2 %	3 %	3 %
Constraint (%)	2025							
Constraint (%)	2027					2 %	10 %	
Constraint (%)	2030					0 %	3 %	3 %
Total Dispatch Down (%)	2025							
Total Dispatch Down (%)	2027					18 %	37 %	
Total Dispatch Down (%)	2030					12 %	26 %	28 %

Table C-4 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

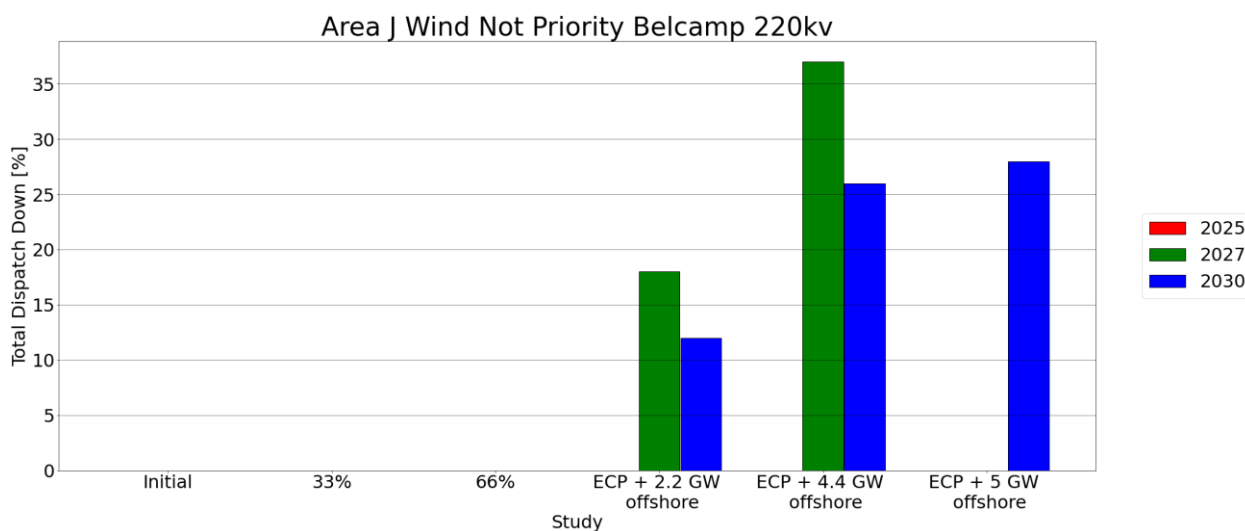


Figure C-4 - Total Dispatch Down for Wind not priority

C.3. Blake t

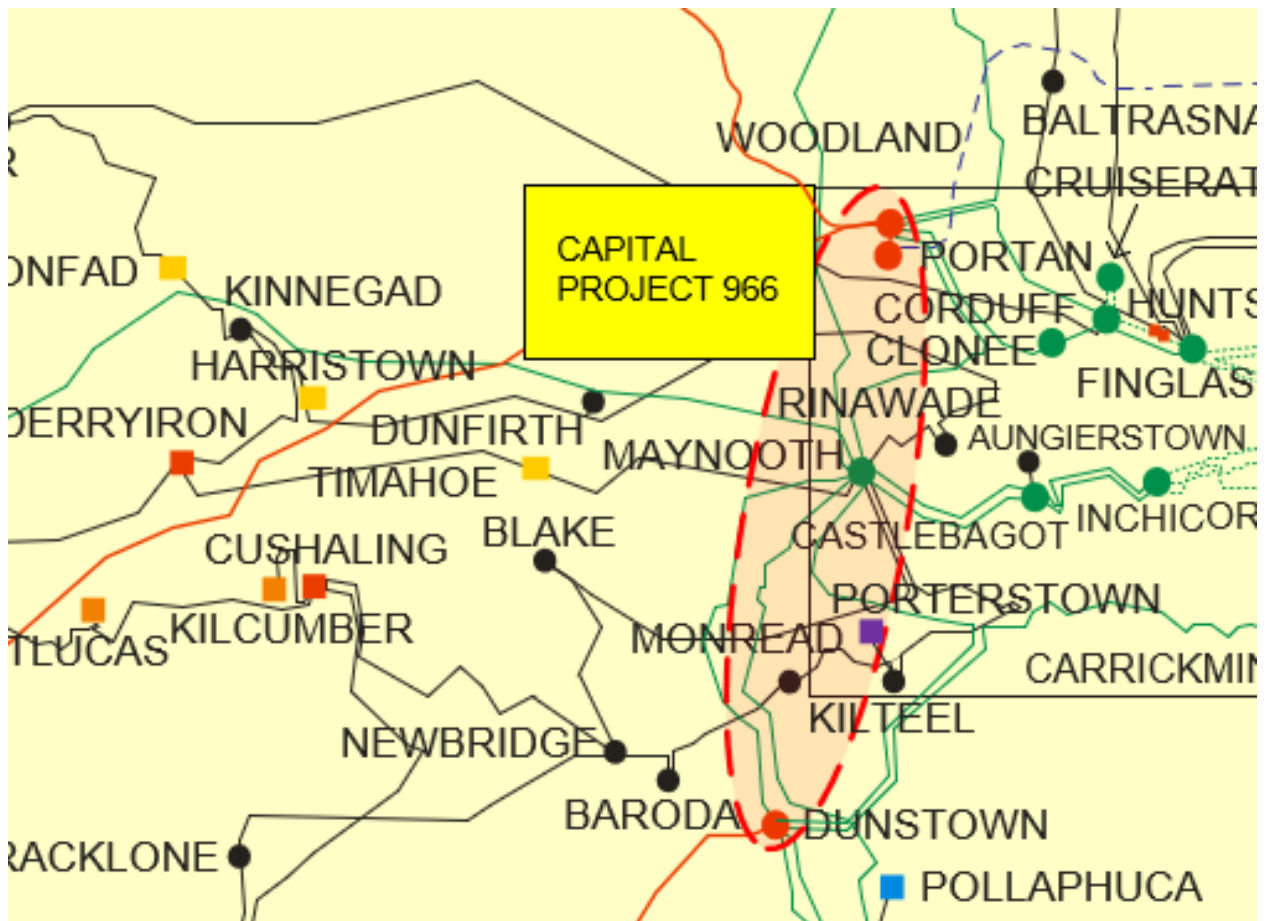


Figure C-5 - Location of node Blake t

Generator	SO	Capacity	Type	Status
Kishavanna Solar Farm	DSO	5.0	solar not priority	due to connect

Table C-5 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		2	3	5			
Installed Capacity (MW)	2027		2	3	5	5	5	
Installed Capacity (MW)	2030				5	5	5	5
Available Energy (GWh)	2025		2	4	5			
Available Energy (GWh)	2027		2	4	5	5	5	
Available Energy (GWh)	2030				5	5	5	5
Generation (GWh)	2025		2	3	4			
Generation (GWh)	2027		2	3	4	4	4	
Generation (GWh)	2030				5	5	4	4
Over-supply (%)	2025		2 %	4 %	7 %			
Over-supply (%)	2027		1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025		1 %	1 %	2 %			
Curtailement (%)	2027		0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025		3 %	8 %	14 %			
Constraint (%)	2027		5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025		6 %	14 %	23 %			
Total Dispatch Down (%)	2027		6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-6 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

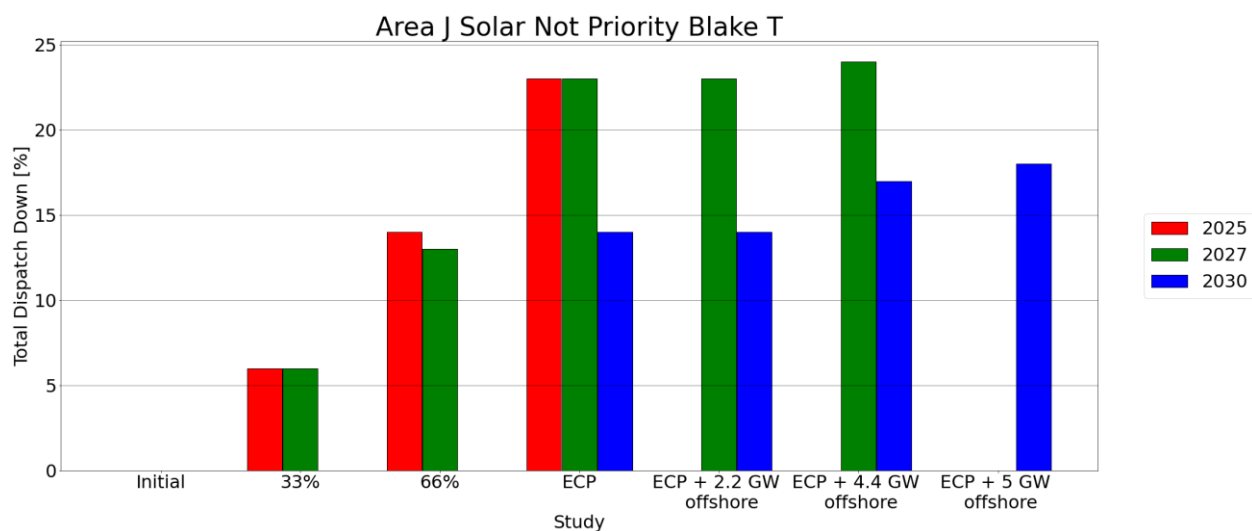


Figure C-6 - Total Dispatch Down for Solar not priority

C.4. Blundelstown

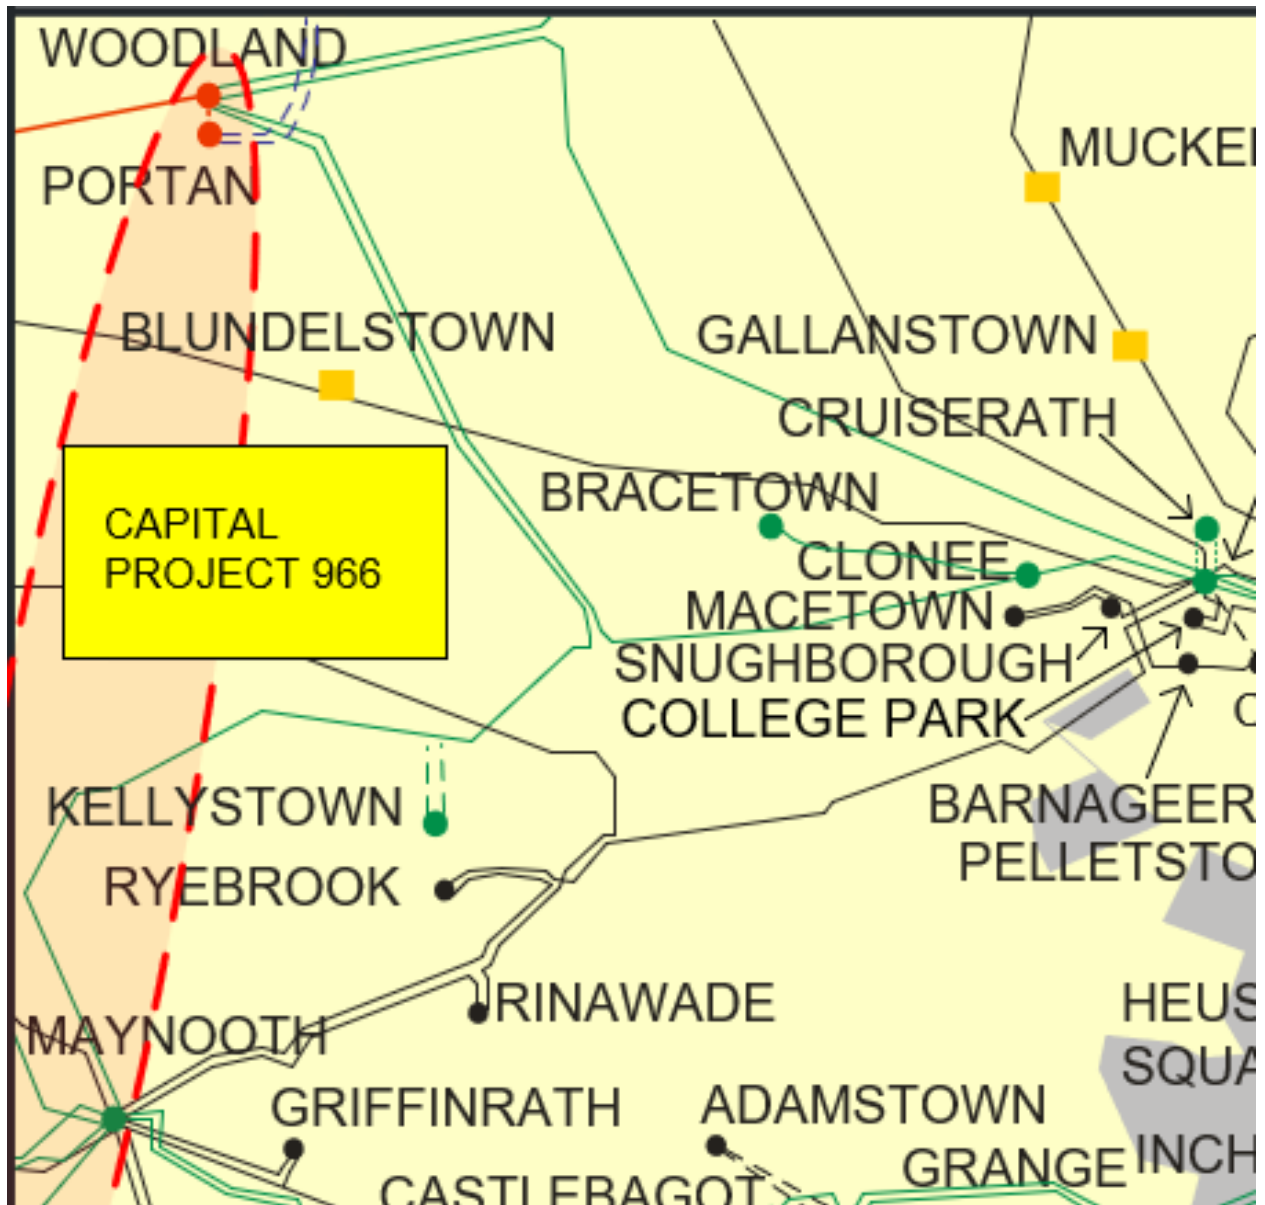


Figure C-7 - Location of node Blundelstown

Generator	SO	Capacity	Type	Status
Blundelstown	TSO	60.0	solar not priority	due to connect

Table C-7 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	60	60	60	60			
Installed Capacity (MW)	2027	60	60	60	60	60	60	
Installed Capacity (MW)	2030				60	60	60	60
Available Energy (GWh)	2025	64	64	64	64			
Available Energy (GWh)	2027	64	64	64	64	64	64	
Available Energy (GWh)	2030				64	64	64	64
Generation (GWh)	2025	60	60	55	49			
Generation (GWh)	2027	60	60	55	49	49	48	
Generation (GWh)	2030				54	54	53	52
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailment (%)	2025	0 %	1 %	1 %	2 %			
Curtailment (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailment (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-8 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

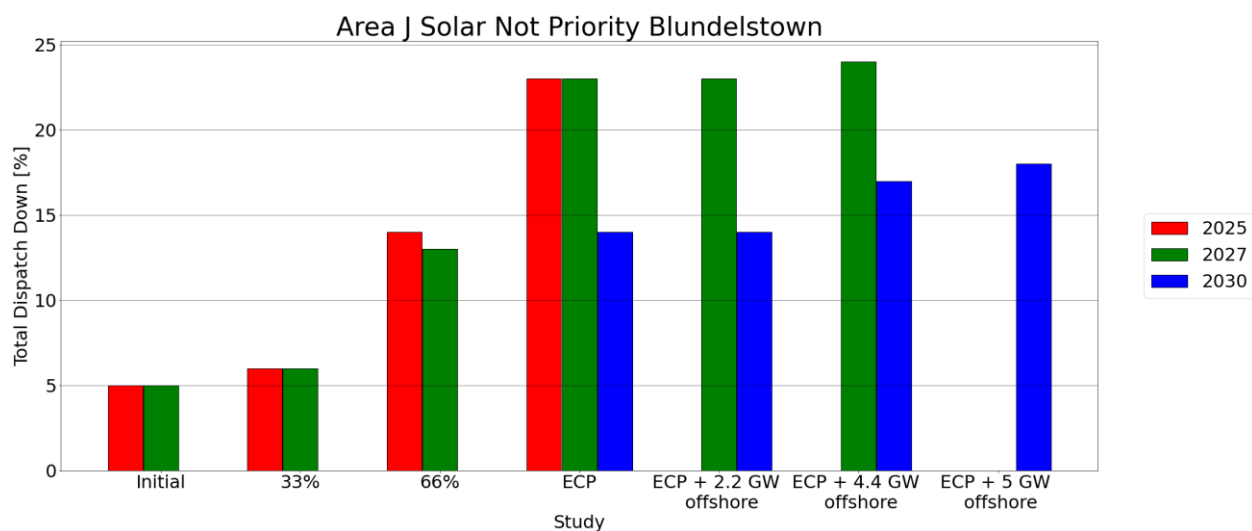


Figure C-8 - Total Dispatch Down for Solar not priority

C.5. Carrickmines 220kV



Figure C-9 - Location of node Carrickmines 220kv

Generator	SO	Capacity	Type	Status
Kish Bank (Dublin Array)	TSO	412.0	wind not priority	due to connect
Bray Bank (Dublin Array)	TSO	412.0	wind not priority	due to connect

Table C-9 - Generation Included in Study for Node

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025							
Installed Capacity (MW)	2027					412	824	
Installed Capacity (MW)	2030					412	824	824
Available Energy (GWh)	2025							
Available Energy (GWh)	2027					1619	3238	
Available Energy (GWh)	2030					1619	3238	3238
Generation (GWh)	2025							
Generation (GWh)	2027					1327	2036	
Generation (GWh)	2030					1422	2410	2345
Over-supply (%)	2025							
Over-supply (%)	2027					14 %	25 %	
Over-supply (%)	2030					10 %	21 %	23 %
Curtailment (%)	2025							
Curtailment (%)	2027					2 %	3 %	
Curtailment (%)	2030					2 %	3 %	3 %
Constraint (%)	2025							
Constraint (%)	2027					2 %	9 %	
Constraint (%)	2030					0 %	2 %	2 %
Total Dispatch Down (%)	2025							
Total Dispatch Down (%)	2027					18 %	37 %	
Total Dispatch Down (%)	2030					12 %	26 %	28 %

Table C-10 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

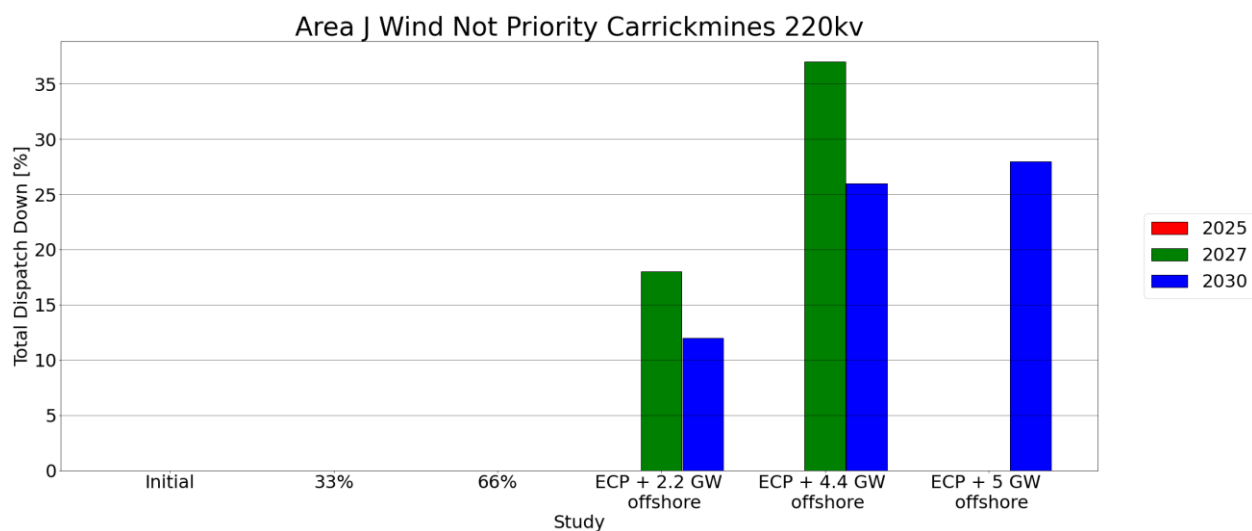


Figure C-10 - Total Dispatch Down for Wind not priority

C.6. Clonfad

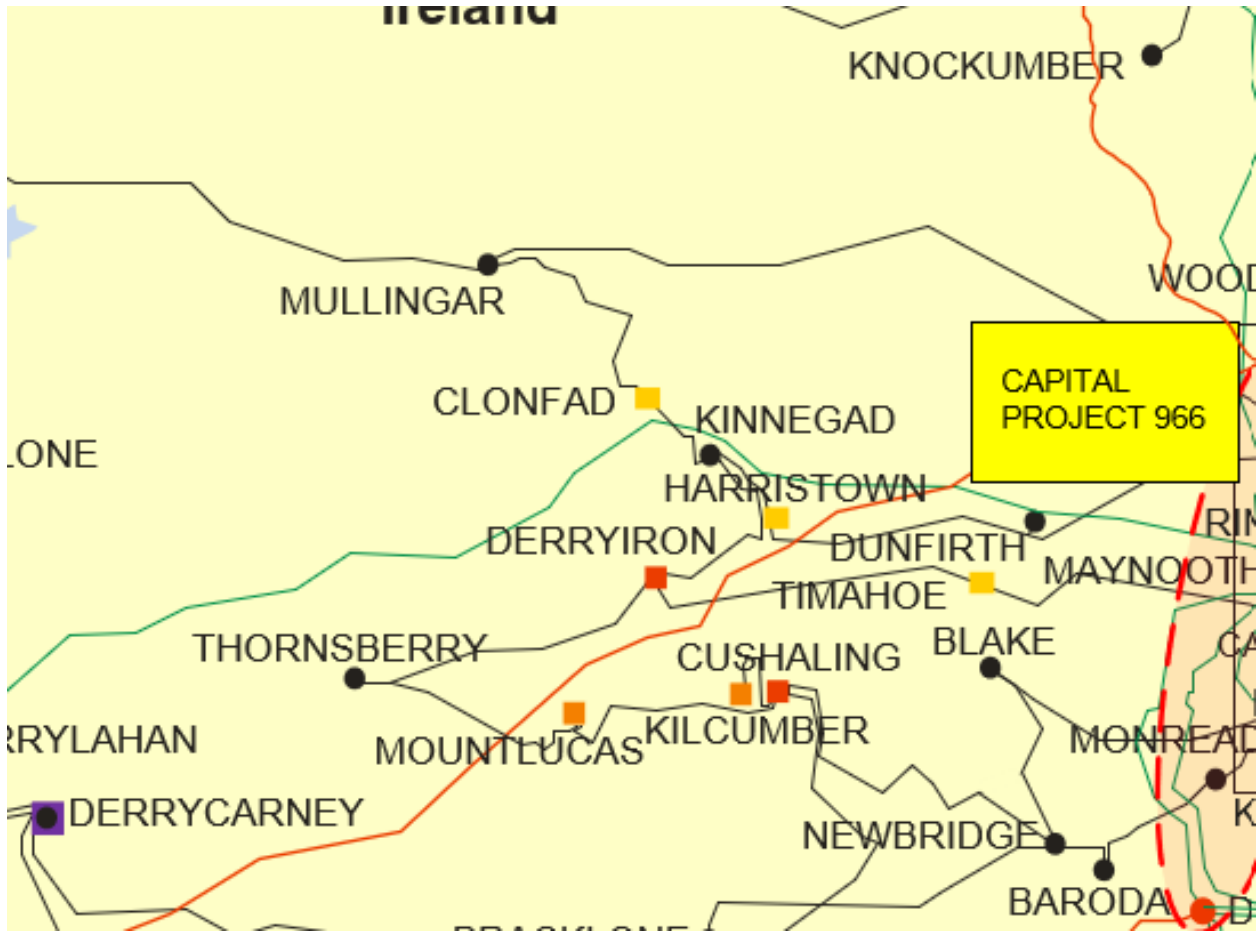


Figure C-11 - Location of node Clonfad

Generator	SO	Capacity	Type	Status
Clonfad Solar	TSO	100.0	solar not priority	due to connect

Table C-11 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		33	67	100			
Installed Capacity (MW)	2027		33	67	100	100	100	
Installed Capacity (MW)	2030				100	100	100	100
Available Energy (GWh)	2025		35	71	106			
Available Energy (GWh)	2027		35	71	106	106	106	
Available Energy (GWh)	2030				106	106	106	106
Generation (GWh)	2025		33	61	82			
Generation (GWh)	2027		33	61	82	82	80	
Generation (GWh)	2030				91	91	88	87
Over-supply (%)	2025		2 %	4 %	7 %			
Over-supply (%)	2027		1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025		1 %	1 %	2 %			
Curtailement (%)	2027		0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025		3 %	8 %	14 %			
Constraint (%)	2027		5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025		6 %	14 %	23 %			
Total Dispatch Down (%)	2027		6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-12 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

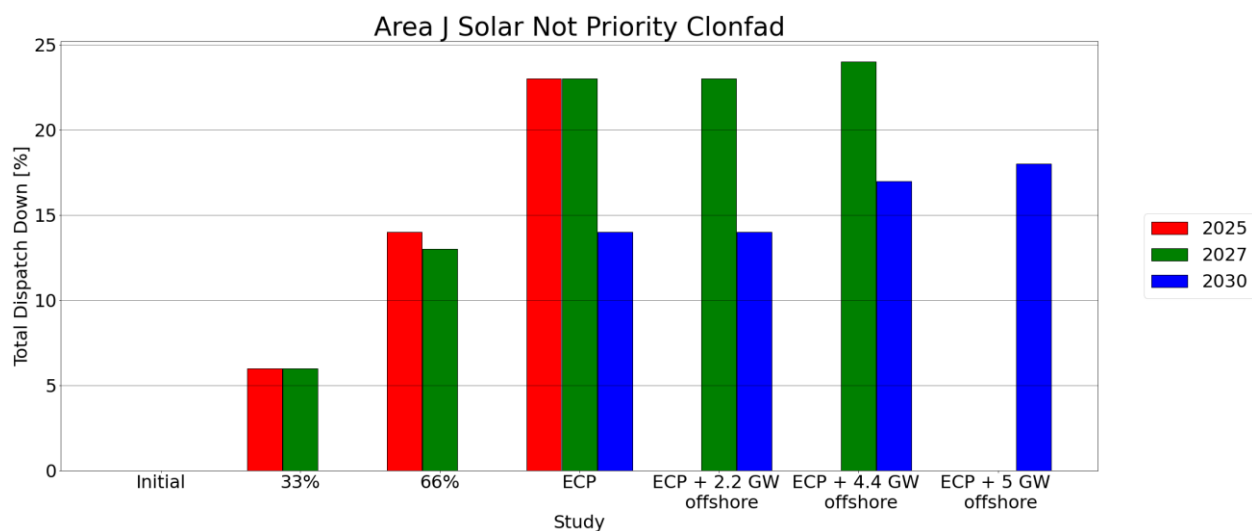


Figure C-12 - Total Dispatch Down for Solar not priority

C.7. Coolnabacky

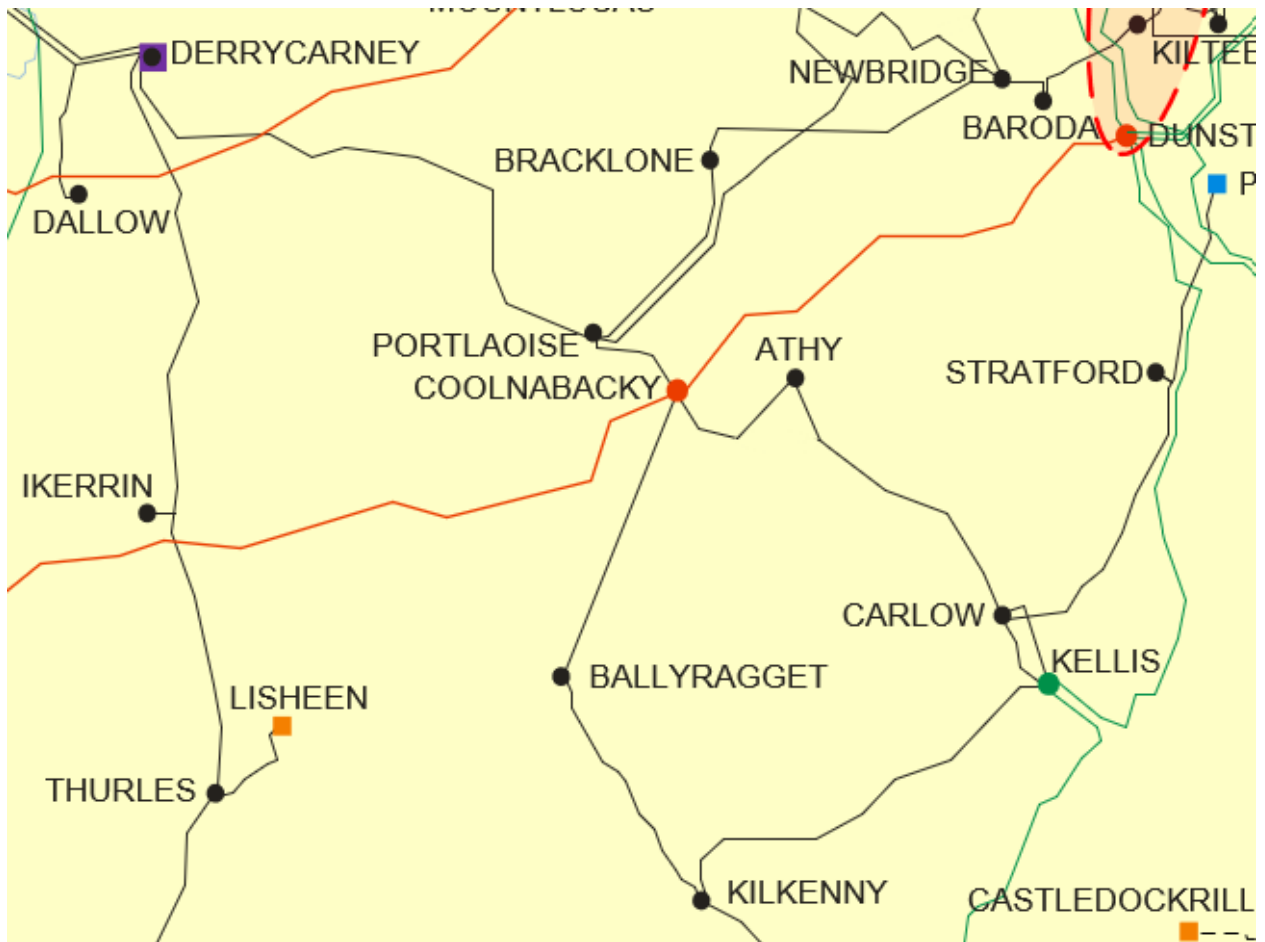


Figure C-13 - Location of node Coolnabacky

Generator	SO	Capacity	Type	Status
East Laois Solar Farm Extension	TSO	25.0	solar not priority	due to connect
Loughteague	TSO	55.0	solar not priority	due to connect

Table C-13 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		27	53	80			
Installed Capacity (MW)	2027		27	53	80	80	80	
Installed Capacity (MW)	2030				80	80	80	80
Available Energy (GWh)	2025		28	56	85			
Available Energy (GWh)	2027		28	56	85	85	85	
Available Energy (GWh)	2030				85	85	85	85
Generation (GWh)	2025		27	49	65			
Generation (GWh)	2027		27	49	65	66	64	
Generation (GWh)	2030				73	73	70	69
Over-supply (%)	2025		2 %	4 %	7 %			
Over-supply (%)	2027		1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025		1 %	1 %	2 %			
Curtailement (%)	2027		0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025		3 %	8 %	14 %			
Constraint (%)	2027		5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025		6 %	14 %	23 %			
Total Dispatch Down (%)	2027		6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-14 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

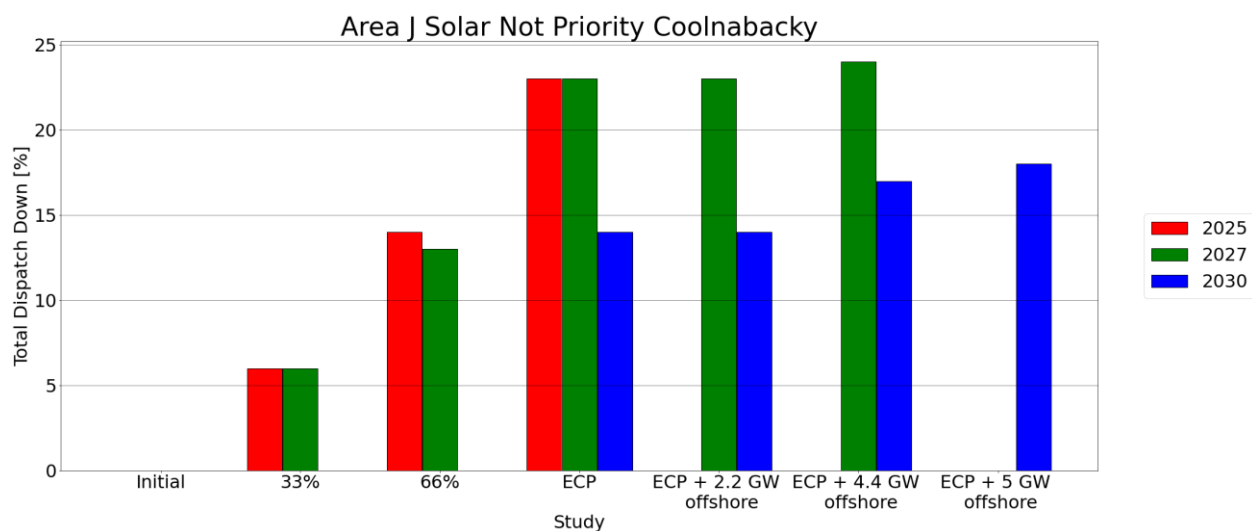


Figure C-14 - Total Dispatch Down for Solar not priority

C.8. Cushingling

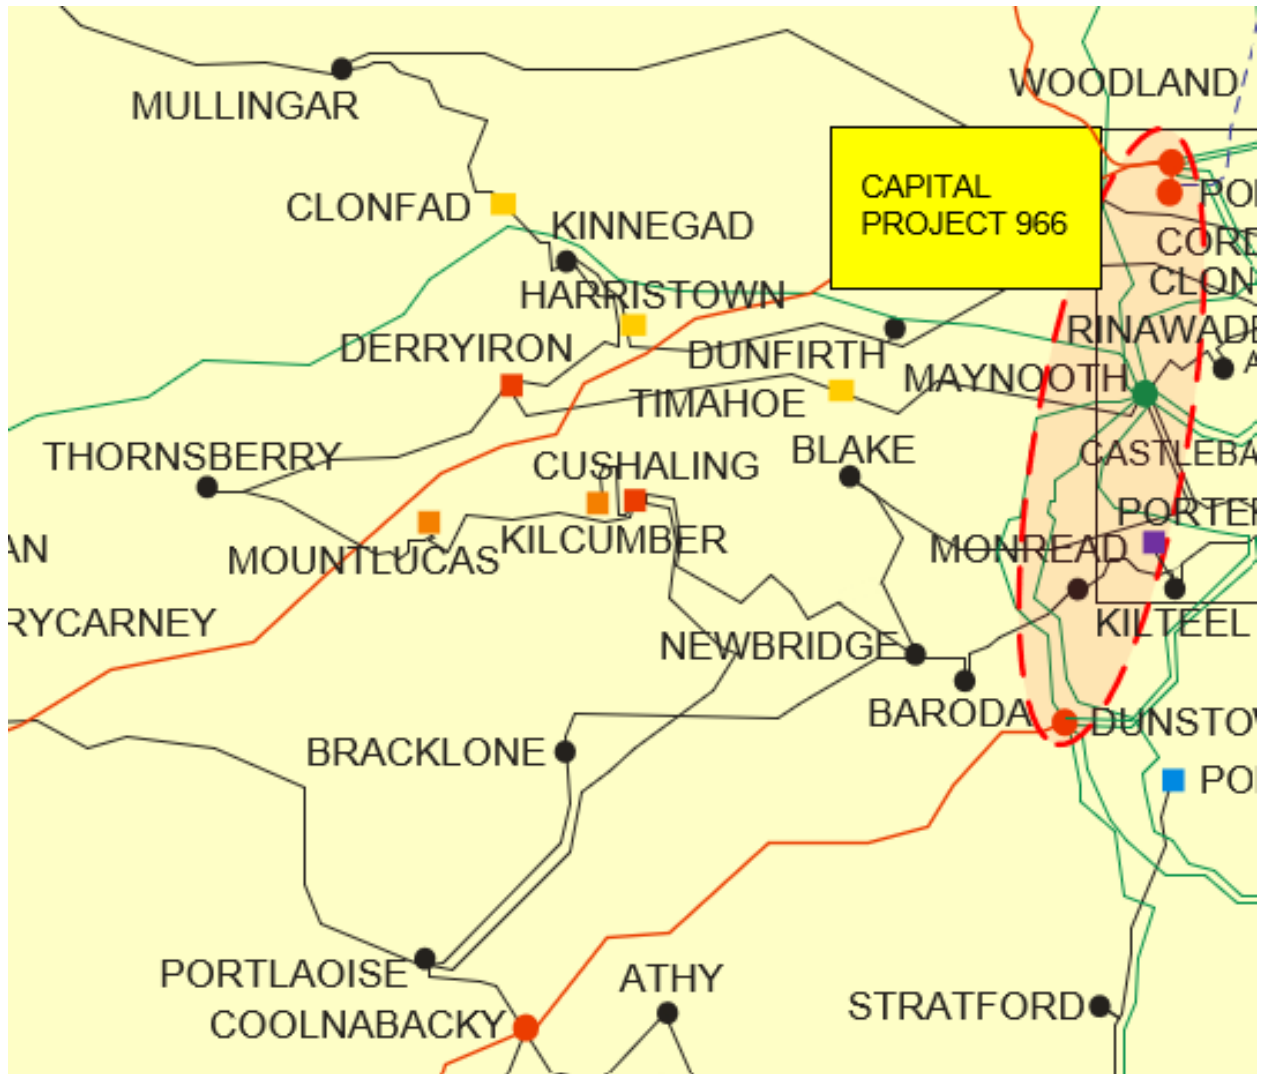


Figure C-15 - Location of node Cushingling

Generator	SO	Capacity	Type	Status
Clonreen Wind farm	TSO	100.0	wind not priority	connected

Table C-15 - Generation Included in Study for Node

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	100	100	100	100			
Installed Capacity (MW)	2027	100	100	100	100	100	100	
Installed Capacity (MW)	2030				100	100	100	100
Available Energy (GWh)	2025	308	308	308	308			
Available Energy (GWh)	2027	308	308	308	308	308	308	
Available Energy (GWh)	2030				308	308	308	308
Generation (GWh)	2025	251	243	228	209			
Generation (GWh)	2027	251	252	243	223	215	191	
Generation (GWh)	2030				235	232	209	204
Over-supply (%)	2025	3 %	6 %	10 %	14 %			
Over-supply (%)	2027	0 %	1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025	1 %	1 %	2 %	2 %			
Curtailement (%)	2027	0 %	1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025	15 %	14 %	14 %	15 %			
Constraint (%)	2027	19 %	17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025	19 %	21 %	26 %	32 %			
Total Dispatch Down (%)	2027	19 %	18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table C-16 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

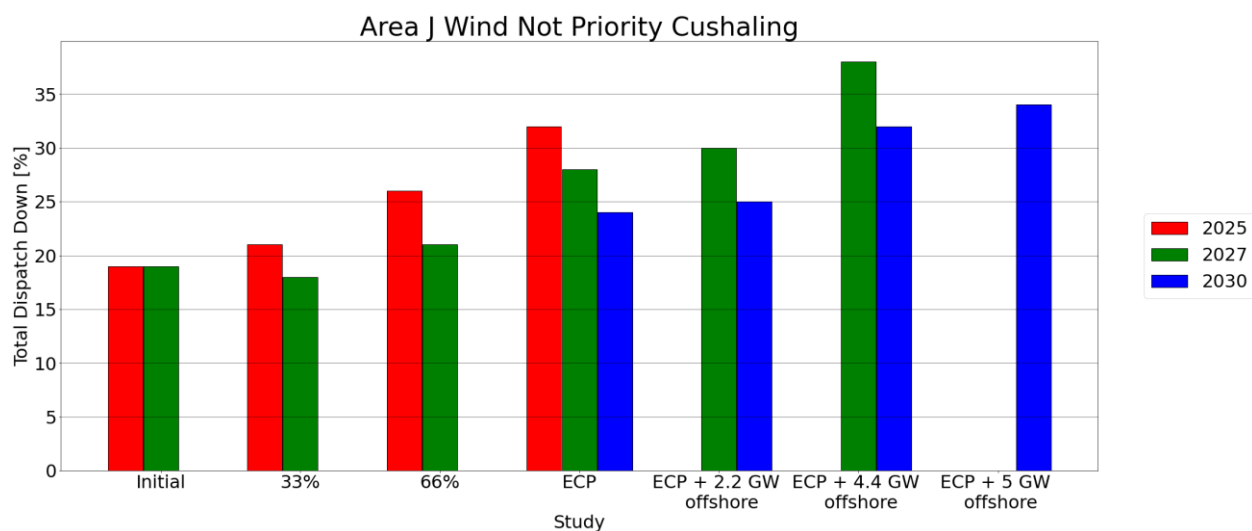


Figure C-16 - Total Dispatch Down for Wind not priority

C.9. Derryiron

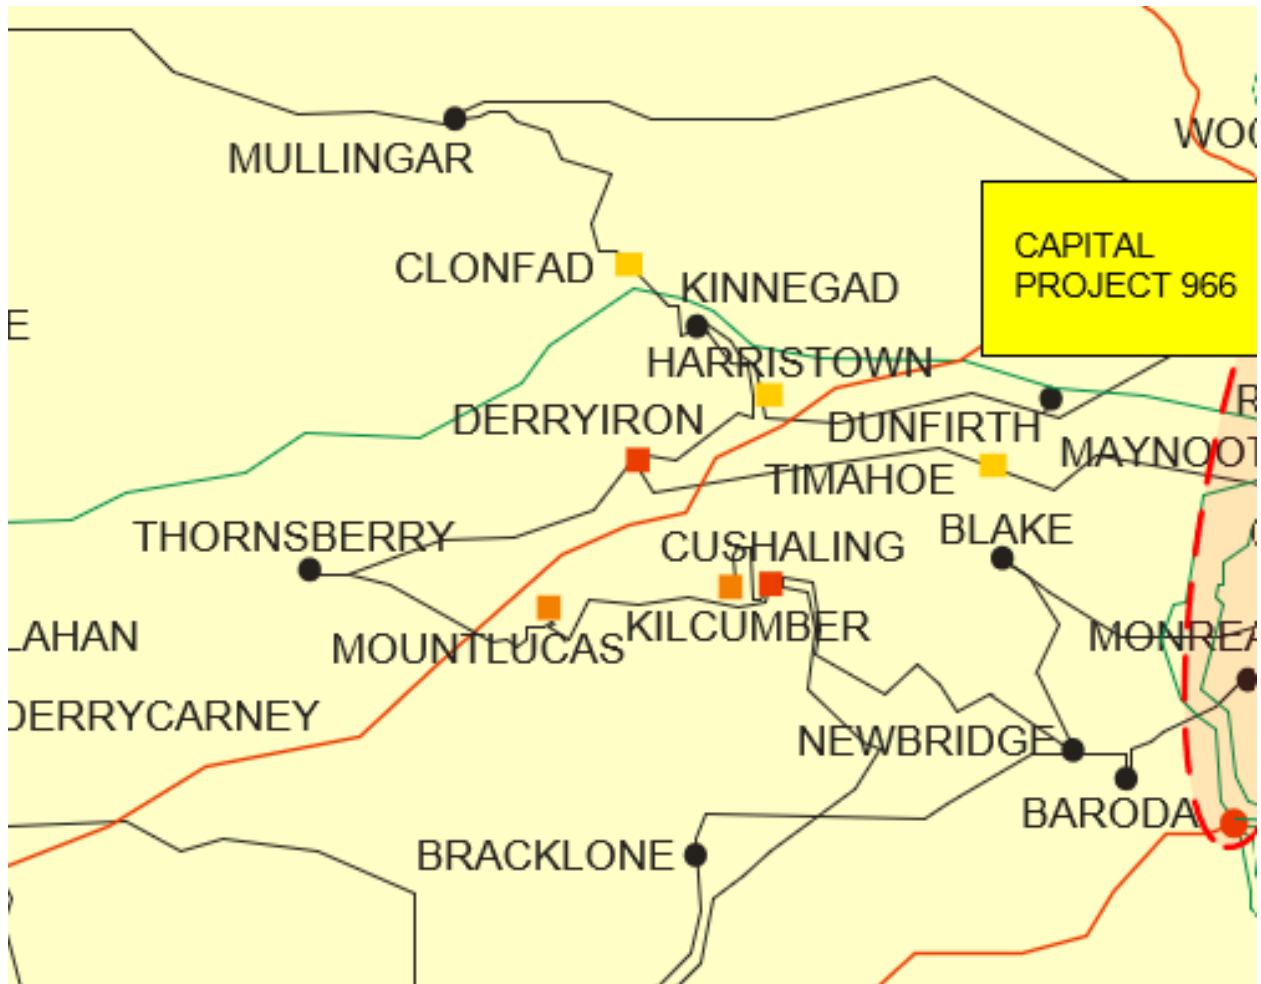


Figure C-17 - Location of node Derryiron

Generator	SO	Capacity	Type	Status
Clonin North solar	TSO	47.0	solar not priority	due to connect
Yellow River Wind Farm	TSO	110.2	wind not priority	due to connect

Table C-17 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		16	31	47			
Installed Capacity (MW)	2027		16	31	47	47	47	
Installed Capacity (MW)	2030				47	47	47	47
Available Energy (GWh)	2025		17	33	50			
Available Energy (GWh)	2027		17	33	50	50	50	
Available Energy (GWh)	2030				50	50	50	50
Generation (GWh)	2025		16	29	38			
Generation (GWh)	2027		16	29	38	39	38	
Generation (GWh)	2030				43	43	41	41
Over-supply (%)	2025		2 %	4 %	7 %			
Over-supply (%)	2027		1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailment (%)	2025		1 %	1 %	2 %			
Curtailment (%)	2027		0 %	1 %	1 %	2 %	2 %	
Curtailment (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025		3 %	8 %	14 %			
Constraint (%)	2027		5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025		6 %	14 %	23 %			
Total Dispatch Down (%)	2027		6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-18 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

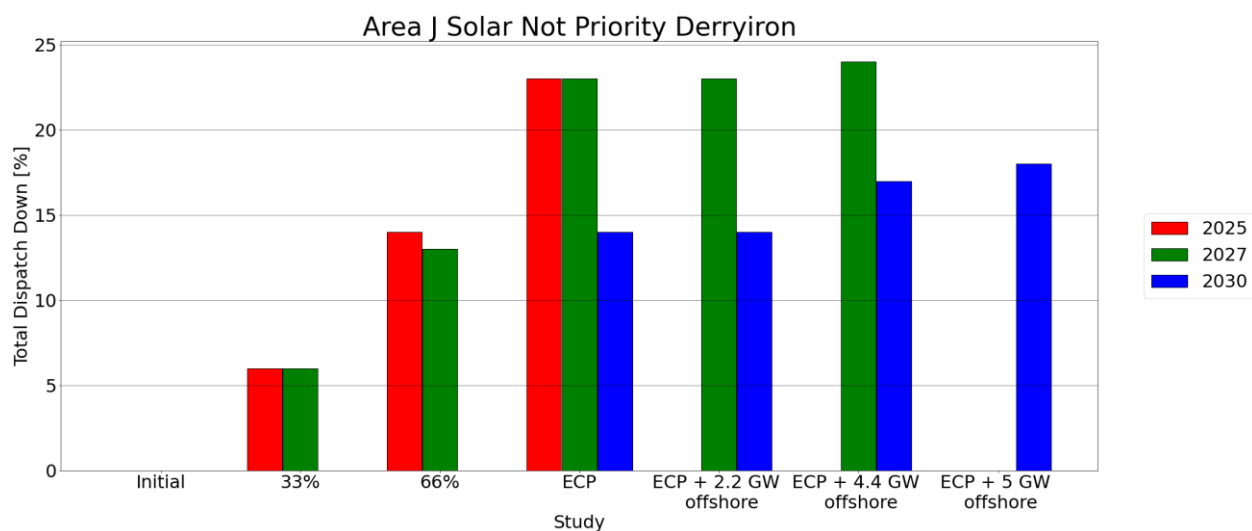


Figure C-18 - Total Dispatch Down for Solar not priority

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		37	73	110			
Installed Capacity (MW)	2027		37	73	110	110	110	
Installed Capacity (MW)	2030				110	110	110	110
Available Energy (GWh)	2025		113	227	340			
Available Energy (GWh)	2027		113	227	340	340	340	
Available Energy (GWh)	2030				340	340	340	340
Generation (GWh)	2025		89	168	231			
Generation (GWh)	2027		93	178	246	237	210	
Generation (GWh)	2030				259	256	231	225
Over-supply (%)	2025		6 %	10 %	14 %			
Over-supply (%)	2027		1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025		1 %	2 %	2 %			
Curtailement (%)	2027		1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025		14 %	14 %	15 %			
Constraint (%)	2027		17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025		21 %	26 %	32 %			
Total Dispatch Down (%)	2027		18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table C-19 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

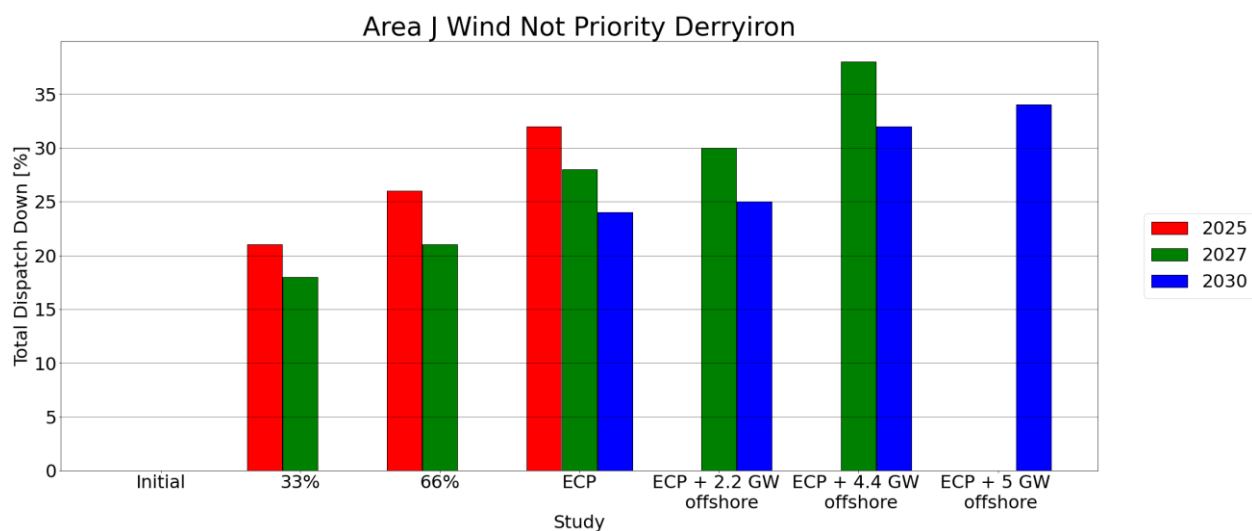


Figure C-19 - Total Dispatch Down for Wind not priority

C.10. Dunfirth

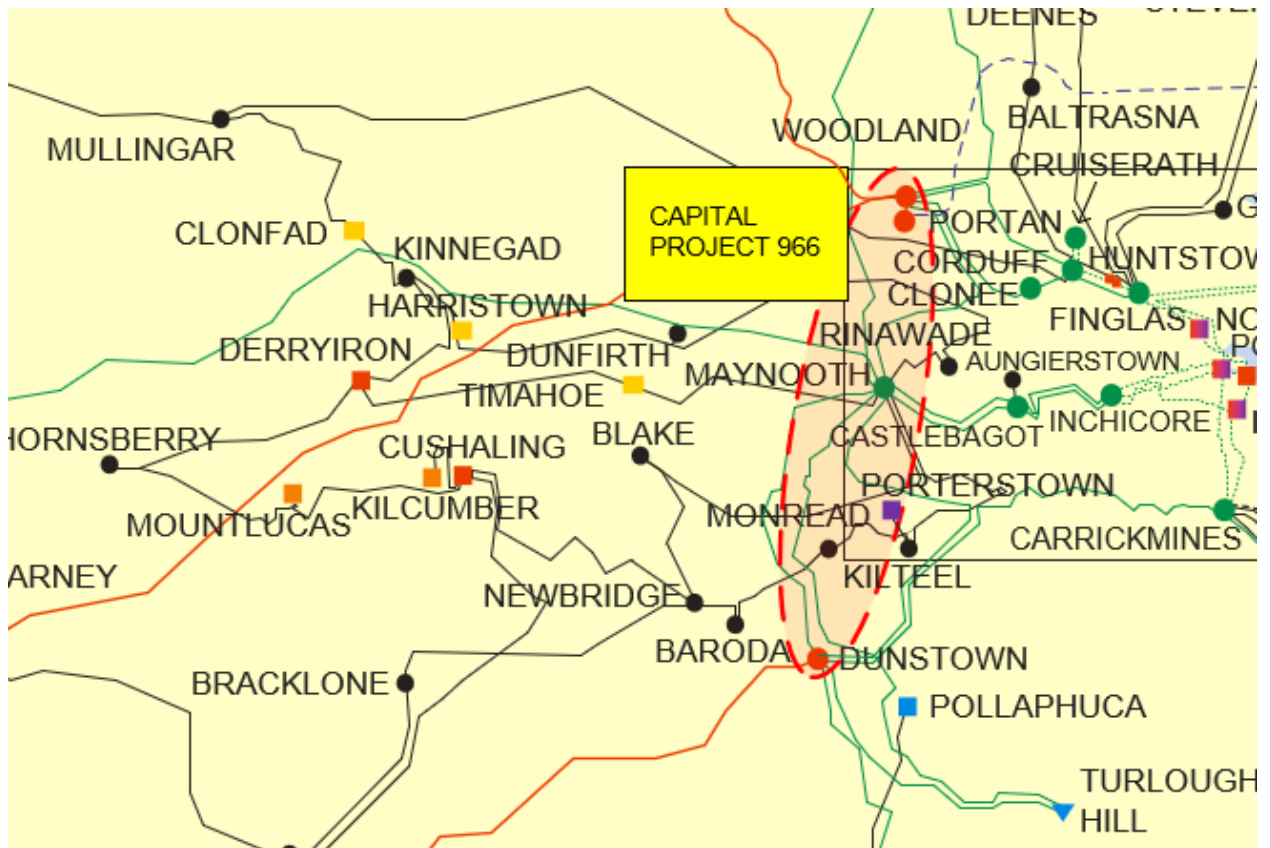


Figure C-20 - Location of node Dunfirth

Generator	SO	Capacity	Type	Status
Dysart PV	DSO	17.5	solar not priority	due to connect
Hortland PV (from merge Knockanally and Hortland)	DSO	14.0	solar not priority	due to connect
Ovidstown Solar	DSO	4.0	solar not priority	due to connect

Table C-20 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	18	24	30	36			
Installed Capacity (MW)	2027	18	24	30	36	36	36	
Installed Capacity (MW)	2030				36	36	36	36
Available Energy (GWh)	2025	19	25	31	38			
Available Energy (GWh)	2027	19	25	31	38	38	38	
Available Energy (GWh)	2030				38	38	38	38
Generation (GWh)	2025	18	24	27	29			
Generation (GWh)	2027	18	24	27	29	29	28	
Generation (GWh)	2030				32	32	31	31
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-21 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

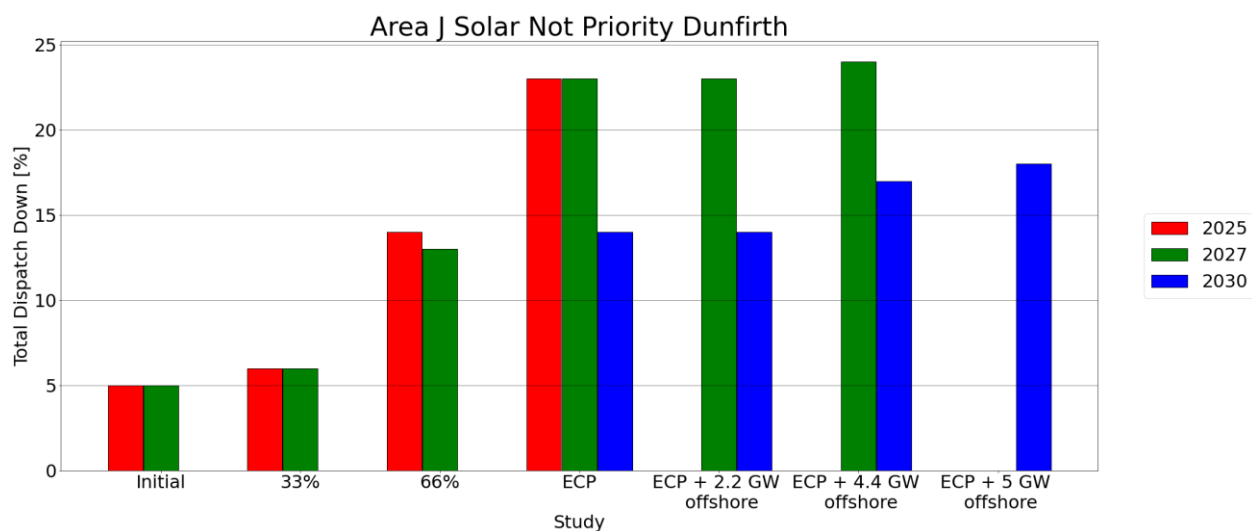


Figure C-21 - Total Dispatch Down for Solar not priority

C.11. Finglas

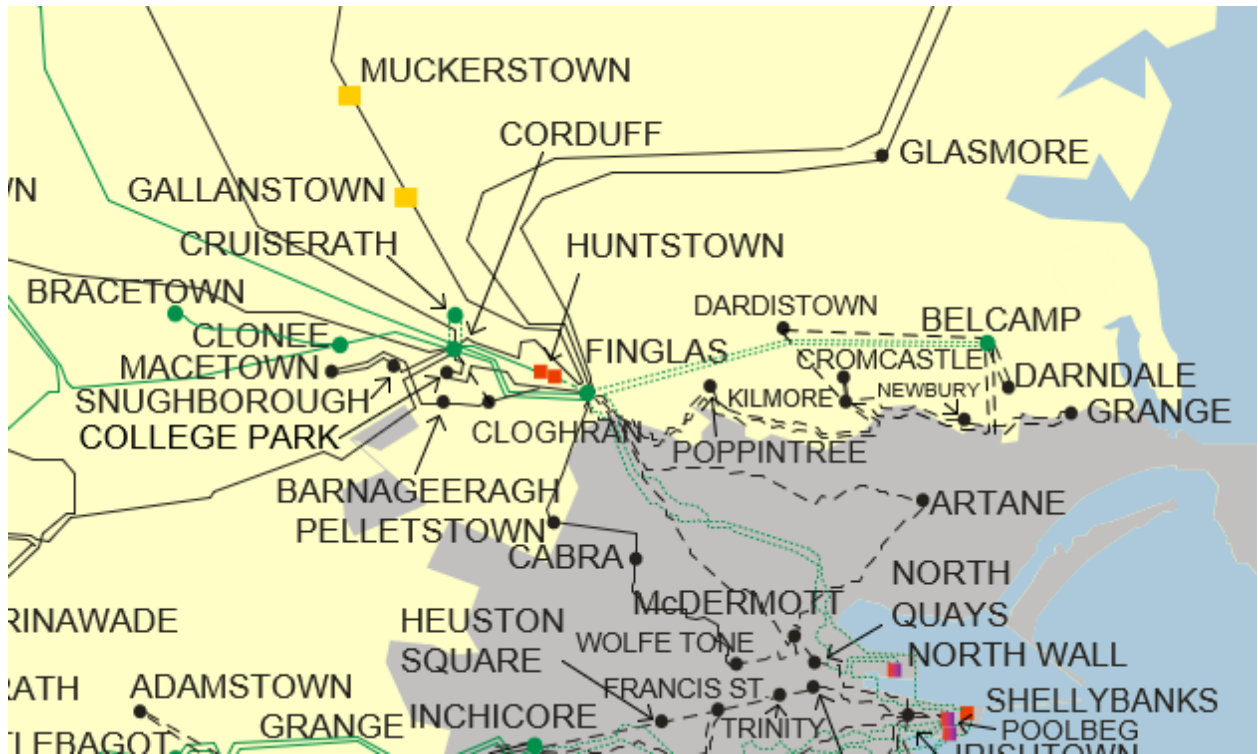


Figure C-22 - Location of node Finglas

Generator	SO	Capacity	Type	Status
Bullstown Solar Farm	DSO	8.0	solar not priority	due to connect

Table C-22 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		3	5	8			
Installed Capacity (MW)	2027		3	5	8	8	8	
Installed Capacity (MW)	2030				8	8	8	8
Available Energy (GWh)	2025		3	6	8			
Available Energy (GWh)	2027		3	6	8	8	8	
Available Energy (GWh)	2030				8	8	8	8
Generation (GWh)	2025		3	5	8			
Generation (GWh)	2027		3	5	8	8	7	
Generation (GWh)	2030				8	8	7	7
Over-supply (%)	2025		2 %	4 %	7 %			
Over-supply (%)	2027		1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025		1 %	1 %	2 %			
Curtailement (%)	2027		0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025		2 %	0 %	0 %			
Constraint (%)	2027		4 %	2 %	0 %	0 %	0 %	
Constraint (%)	2030				1 %	0 %	0 %	0 %
Total Dispatch Down (%)	2025		5 %	5 %	9 %			
Total Dispatch Down (%)	2027		5 %	5 %	5 %	10 %	15 %	
Total Dispatch Down (%)	2030				5 %	8 %	13 %	14 %

Table C-23 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

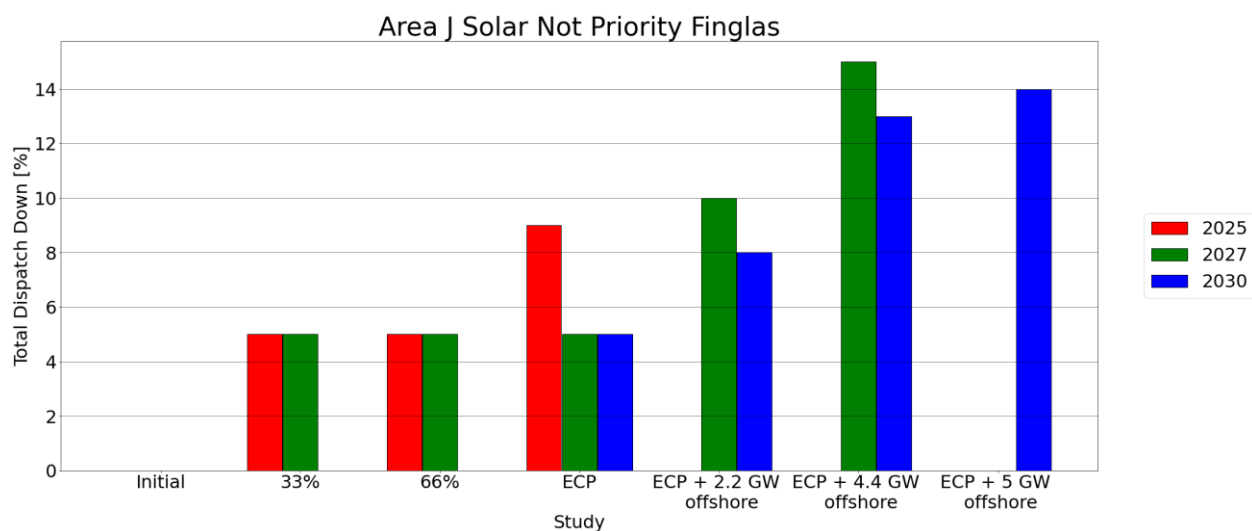


Figure C-23 - Total Dispatch Down for Solar not priority

C.12. Gallanstown



Figure C-24 - Location of node Gallanstown

Generator	SO	Capacity	Type	Status
Gallanstown Solar	TSO	119.0	solar not priority	due to connect
Harlockstown Solar (Gallanstown Solar Extension)	TSO	50.5	solar not priority	due to connect

Table C-24 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	119	136	153	170			
Installed Capacity (MW)	2027	119	136	153	170	170	170	
Installed Capacity (MW)	2030				170	170	170	170
Available Energy (GWh)	2025	126	144	162	179			
Available Energy (GWh)	2027	126	144	162	179	179	179	
Available Energy (GWh)	2030				179	179	179	179
Generation (GWh)	2025	120	136	145	152			
Generation (GWh)	2027	120	133	139	144	148	144	
Generation (GWh)	2030				147	153	148	146
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	5 %	7 %			
Constraint (%)	2027	5 %	7 %	11 %	15 %	8 %	5 %	
Constraint (%)	2030				14 %	7 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	5 %	10 %	16 %			
Total Dispatch Down (%)	2027	5 %	8 %	14 %	20 %	18 %	20 %	
Total Dispatch Down (%)	2030				18 %	15 %	17 %	18 %

Table C-25 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

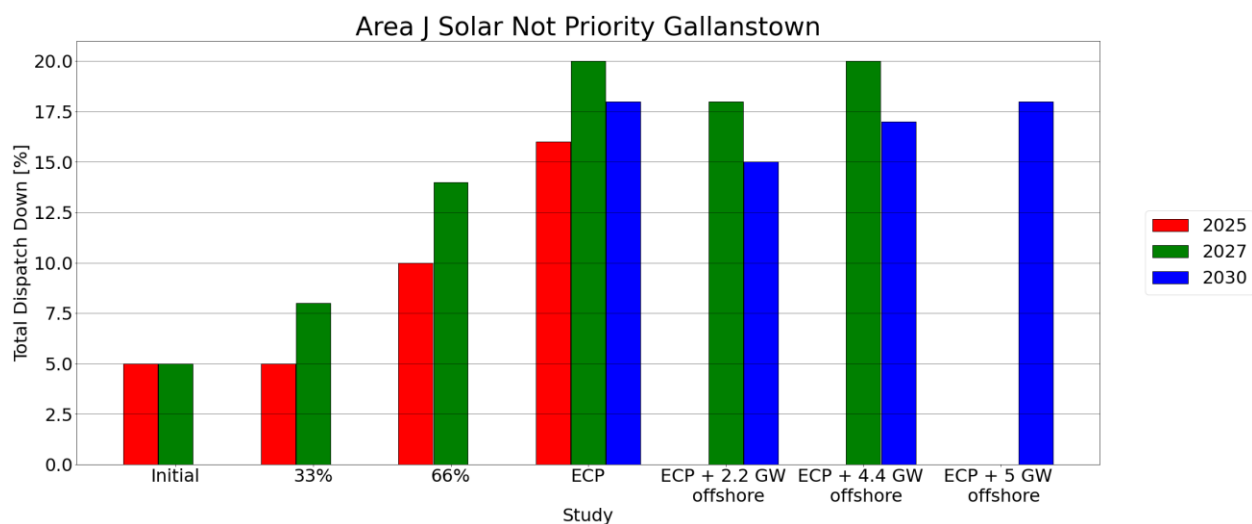


Figure C-25 - Total Dispatch Down for Solar not priority

C.13. Glasmore

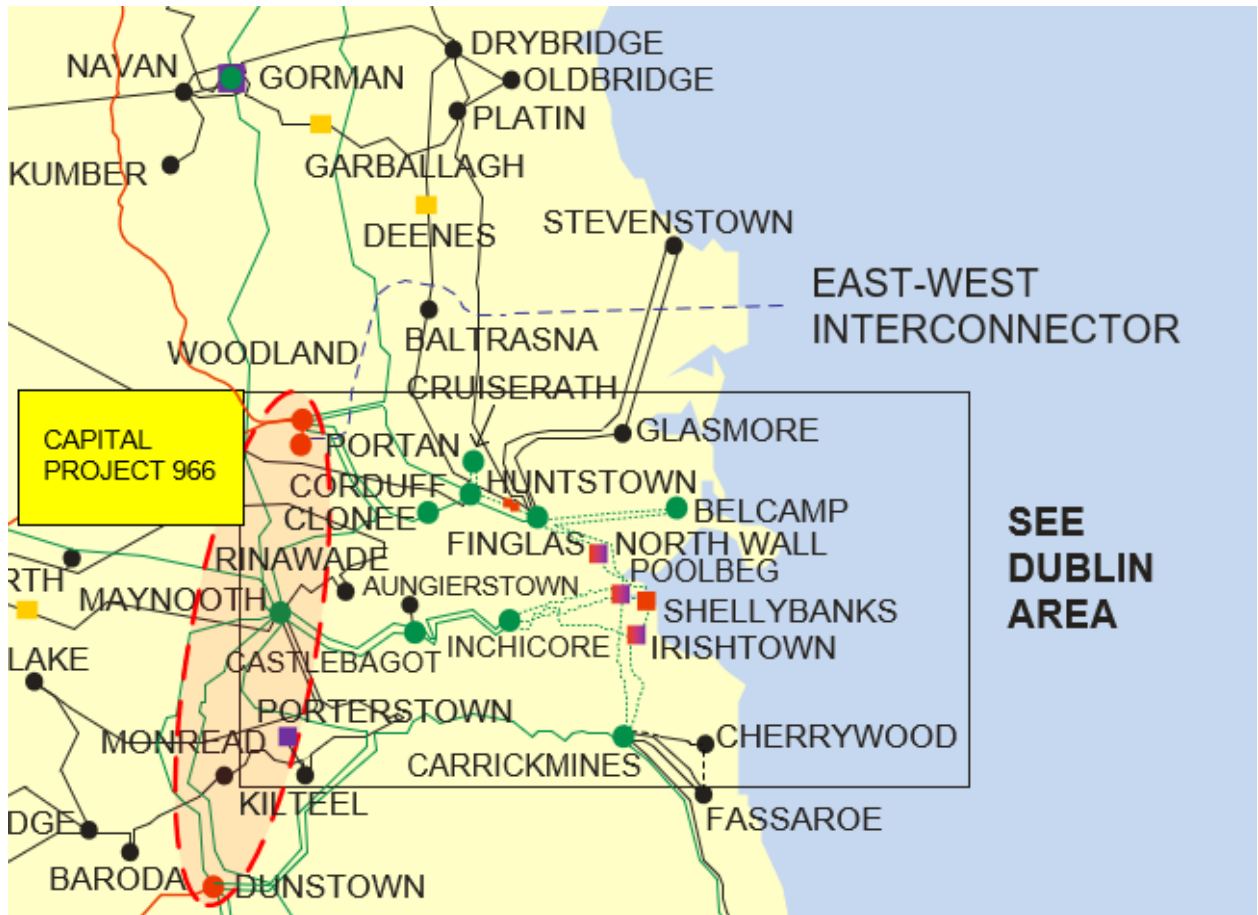


Figure C-26 - Location of node Glasmore

Generator	SO	Capacity	Type	Status
Ballykea Solar Farm	DSO	1.0	solar not priority	due to connect
Fieldstown Solar	TSO	75.0	solar not priority	due to connect
Mainscourt	DSO	40.0	solar not priority	due to connect

Table C-26 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		39	77	116			
Installed Capacity (MW)	2027		39	77	116	116	116	
Installed Capacity (MW)	2030				116	116	116	116
Available Energy (GWh)	2025		41	82	123			
Available Energy (GWh)	2027		41	82	123	123	123	
Available Energy (GWh)	2030				123	123	123	123
Generation (GWh)	2025		39	74	104			
Generation (GWh)	2027		38	70	99	101	98	
Generation (GWh)	2030				101	104	101	100
Over-supply (%)	2025		2 %	4 %	7 %			
Over-supply (%)	2027		1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailment (%)	2025		1 %	1 %	2 %			
Curtailment (%)	2027		0 %	1 %	1 %	2 %	2 %	
Curtailment (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025		3 %	5 %	7 %			
Constraint (%)	2027		7 %	11 %	15 %	8 %	5 %	
Constraint (%)	2030				14 %	7 %	4 %	4 %
Total Dispatch Down (%)	2025		5 %	10 %	16 %			
Total Dispatch Down (%)	2027		8 %	14 %	20 %	18 %	20 %	
Total Dispatch Down (%)	2030				18 %	15 %	17 %	18 %

Table C-27 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

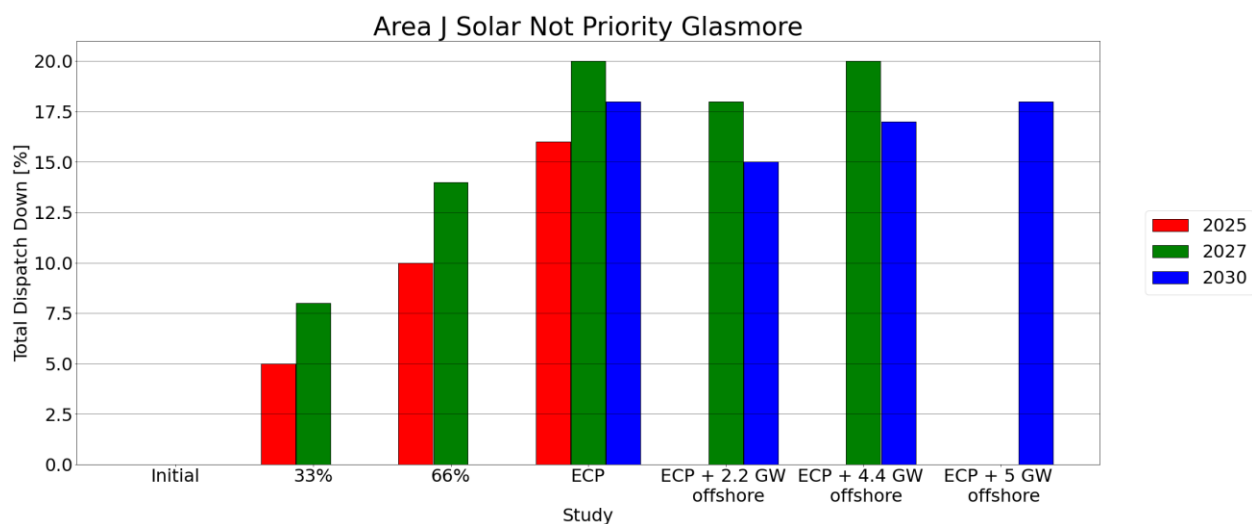


Figure C-27 - Total Dispatch Down for Solar not priority

C.14. Griffinrath

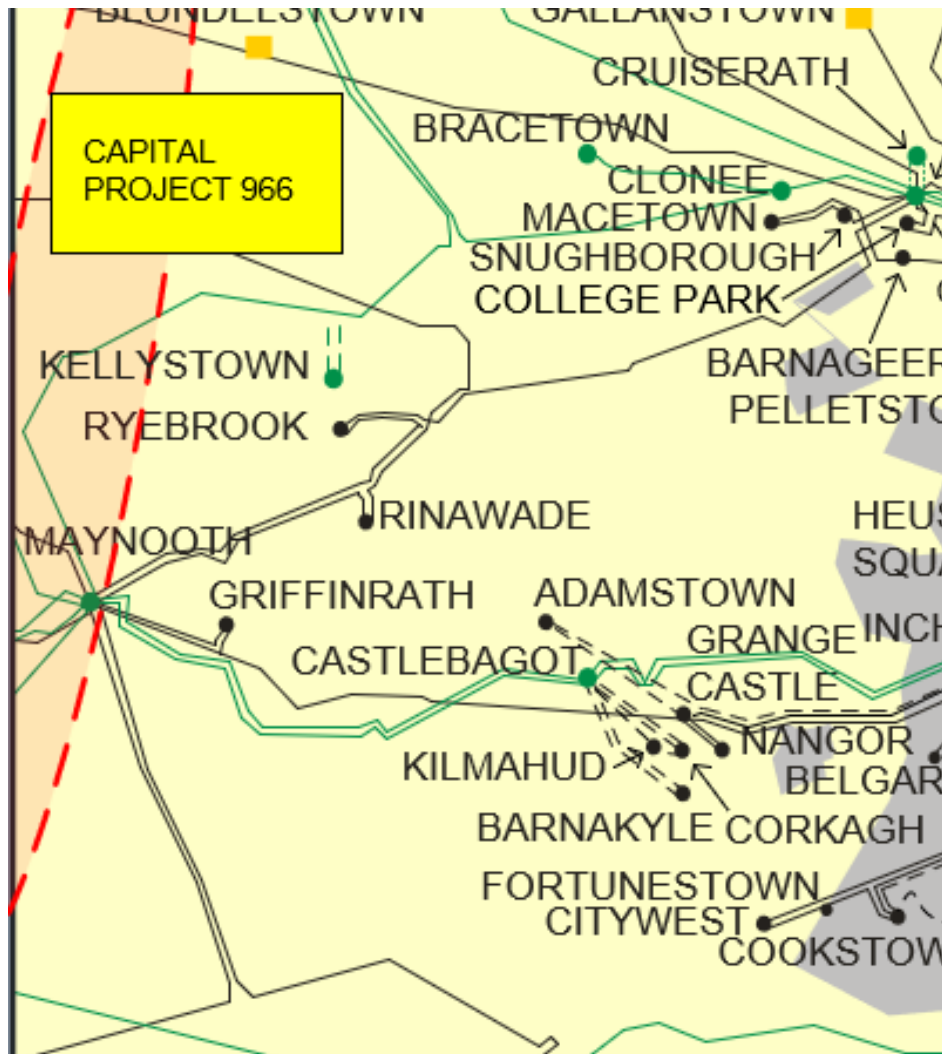


Figure C-28 - Location of node Griffinrath

Generator	SO	Capacity	Type	Status
Confey Solar Park	DSO	10.0	solar not priority	due to connect
Smithstown	DSO	25.0	solar not priority	due to connect
Taghadoe Solar Farm	DSO	25.0	solar not priority	due to connect
Tower Hill Solar Farm	DSO	6.0	solar not priority	due to connect

Table C-28 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	16	33	49	66			
Installed Capacity (MW)	2027	16	33	49	66	66	66	
Installed Capacity (MW)	2030				66	66	66	66
Available Energy (GWh)	2025	17	35	52	70			
Available Energy (GWh)	2027	17	35	52	70	70	70	
Available Energy (GWh)	2030				70	70	70	70
Generation (GWh)	2025	16	33	50	64			
Generation (GWh)	2027	16	33	50	66	63	60	
Generation (GWh)	2030				66	64	61	60
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailment (%)	2025	0 %	1 %	1 %	2 %			
Curtailment (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailment (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	2 %	0 %	0 %			
Constraint (%)	2027	5 %	4 %	2 %	0 %	0 %	0 %	
Constraint (%)	2030				1 %	0 %	0 %	0 %
Total Dispatch Down (%)	2025	5 %	5 %	5 %	9 %			
Total Dispatch Down (%)	2027	5 %	5 %	5 %	5 %	10 %	15 %	
Total Dispatch Down (%)	2030				5 %	8 %	13 %	14 %

Table C-29 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

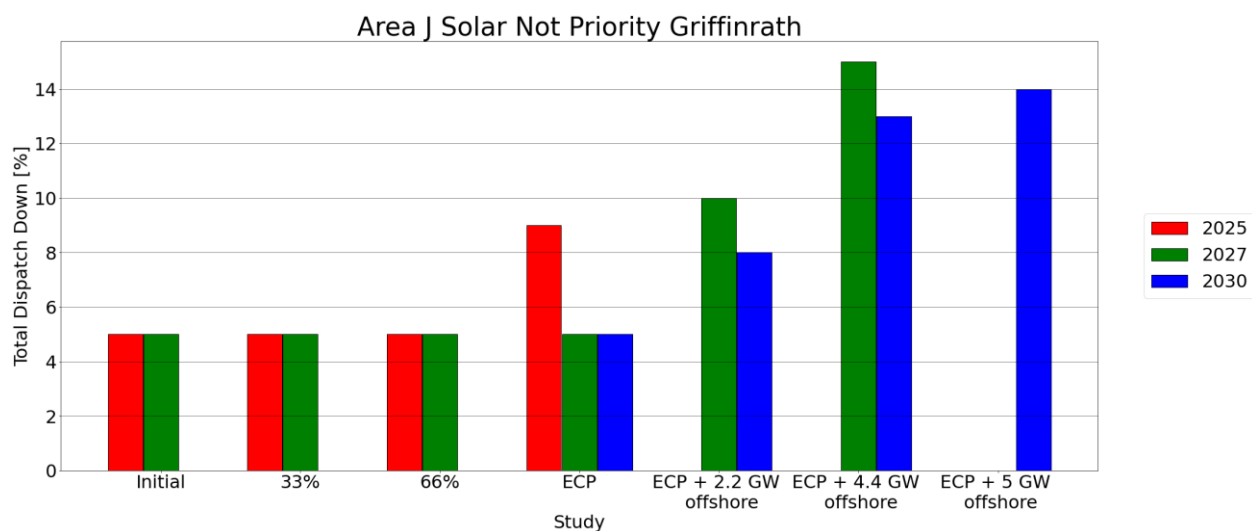


Figure C-29 - Total Dispatch Down for Solar not priority

C.15. Harristown

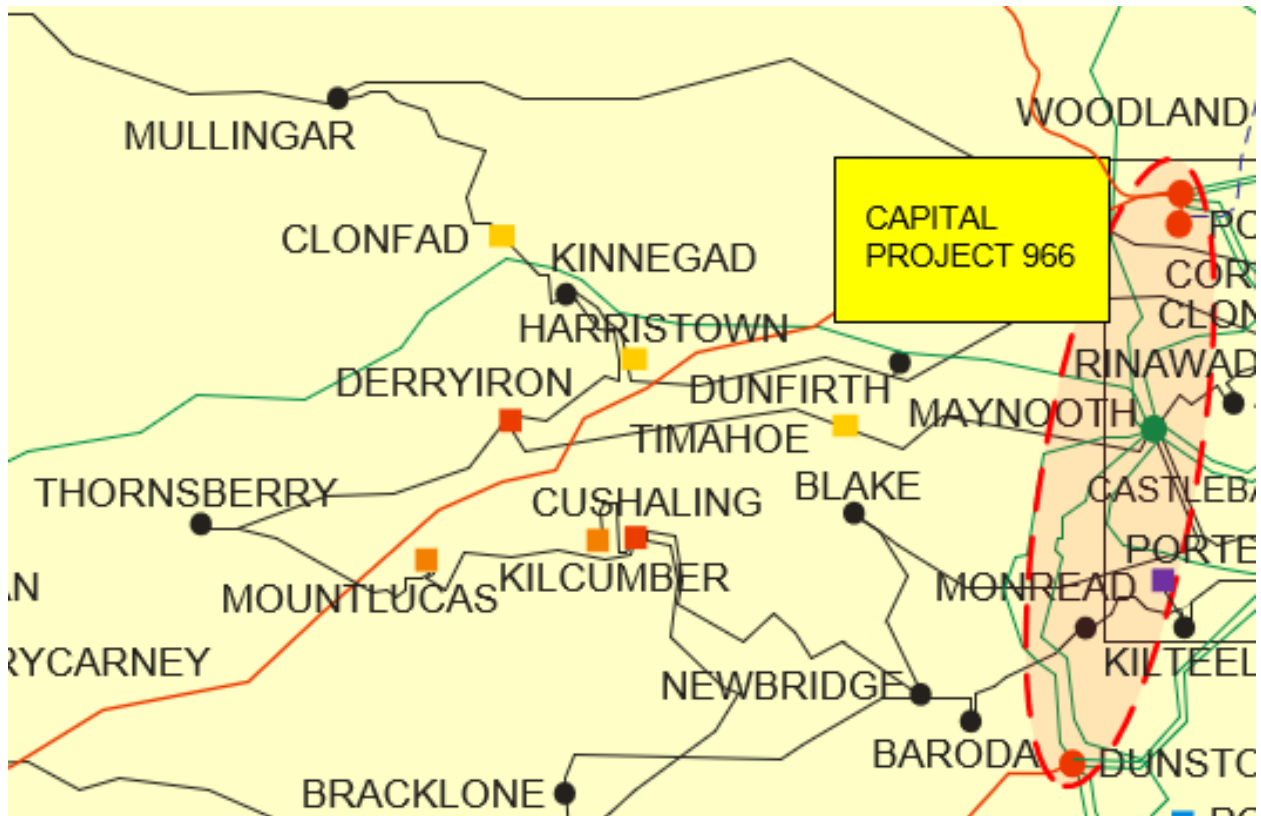


Figure C-30 - Location of node Harristown

Generator	SO	Capacity	Type	Status
Harristown Solar Extension	TSO	49.7	solar not priority	due to connect
Harristown Solar PV	TSO	42.3	solar not priority	due to connect
Garr Solar & Storage	TSO	85.0	solar not priority	due to connect

Table C-30 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	42	87	132	177			
Installed Capacity (MW)	2027	42	87	132	177	177	177	
Installed Capacity (MW)	2030				177	177	177	177
Available Energy (GWh)	2025	45	92	140	187			
Available Energy (GWh)	2027	45	92	140	187	187	187	
Available Energy (GWh)	2030				187	187	187	187
Generation (GWh)	2025	43	87	121	144			
Generation (GWh)	2027	43	87	121	145	145	142	
Generation (GWh)	2030				161	161	156	154
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-31 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

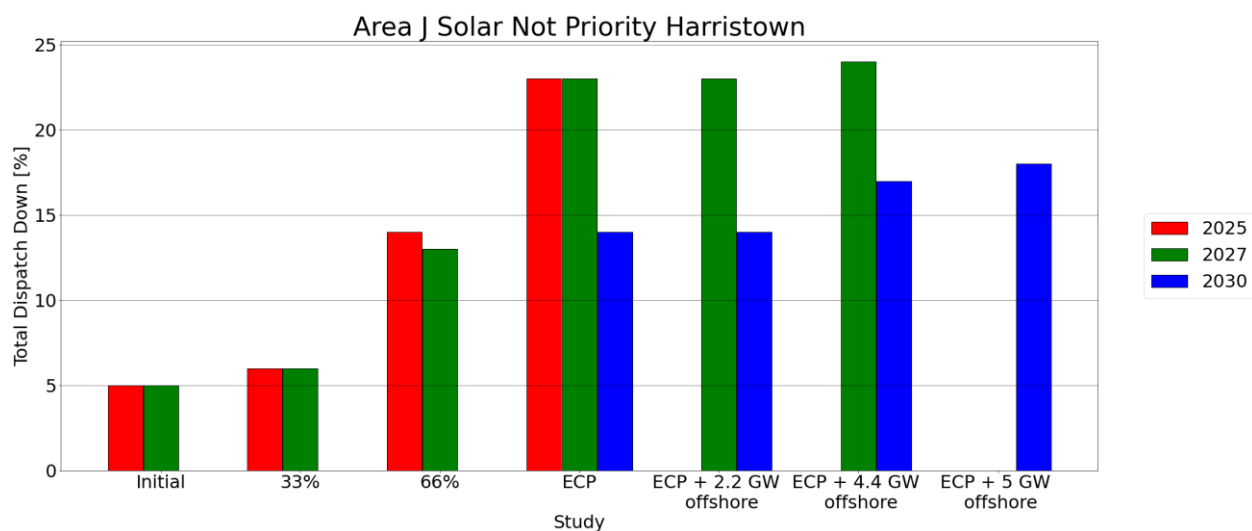


Figure C-31 - Total Dispatch Down for Solar not priority

C.16. Kilteel

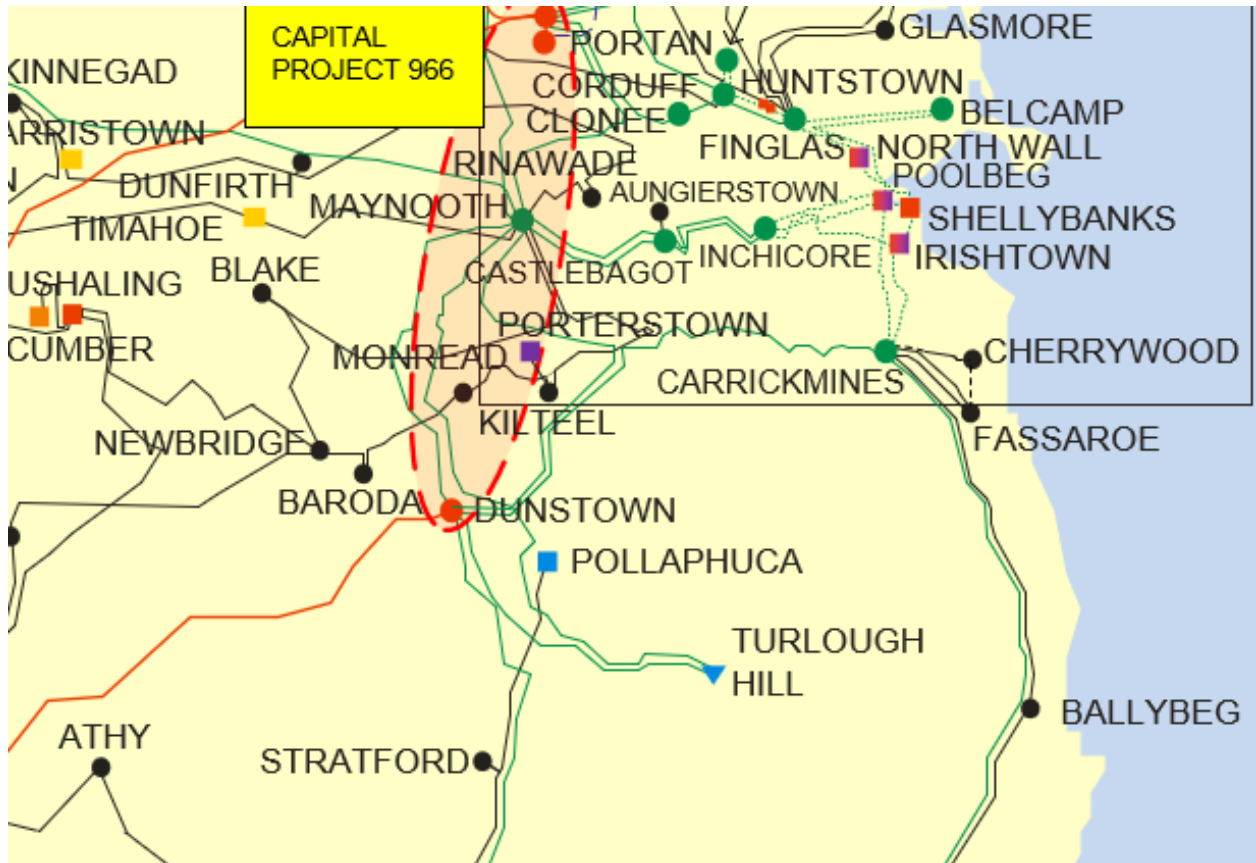


Figure C-32 - Location of node Kilteel

Generator	SO	Capacity	Type	Status
Furryhill Solar	DSO	26.0	solar not priority	due to connect
Threecastles Solar Farm	DSO	15.0	solar not priority	due to connect

Table C-32 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	15	24	32	41			
Installed Capacity (MW)	2027	15	24	32	41	41	41	
Installed Capacity (MW)	2030				41	41	41	41
Available Energy (GWh)	2025	16	25	34	43			
Available Energy (GWh)	2027	16	25	34	43	43	43	
Available Energy (GWh)	2030				43	43	43	43
Generation (GWh)	2025	15	24	30	33			
Generation (GWh)	2027	15	24	30	33	34	33	
Generation (GWh)	2030				37	37	36	36
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-33 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

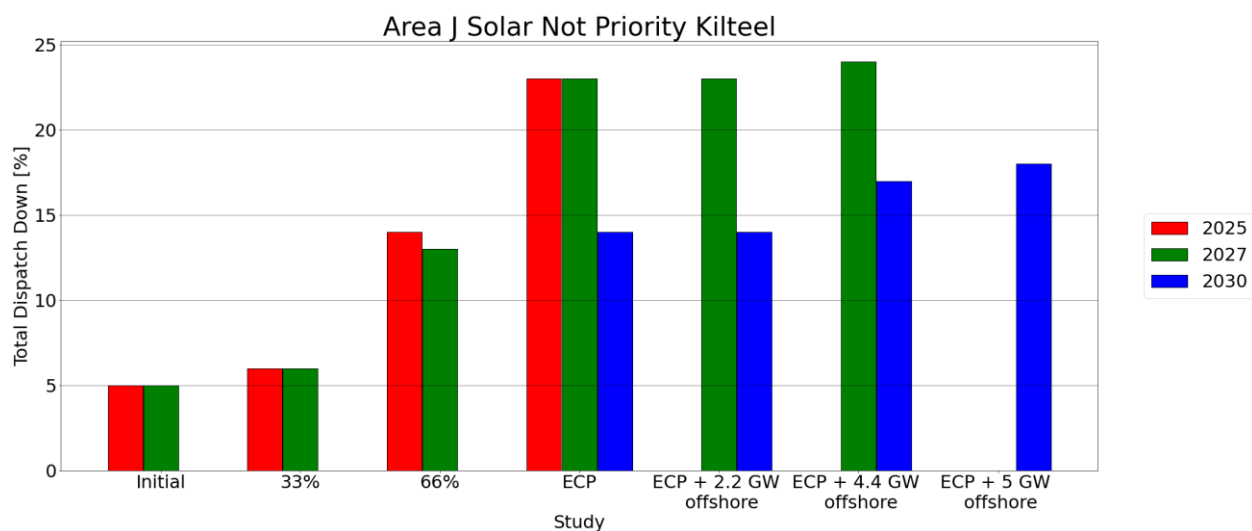


Figure C-33 - Total Dispatch Down for Solar not priority

C.17. Monread

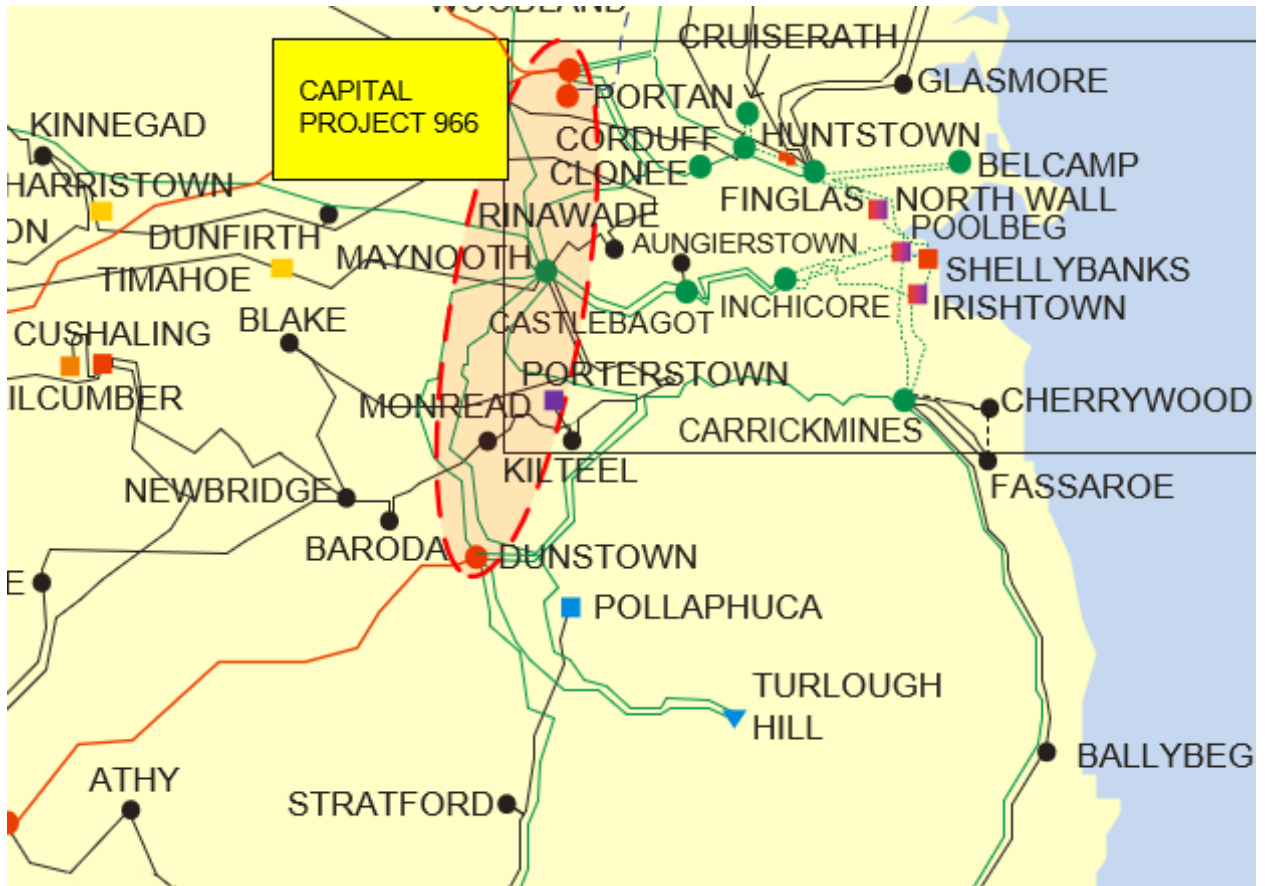


Figure C-34 - Location of node Monread

Generator	SO	Capacity	Type	Status
Bodenstown Solar Farm	DSO	4.0	solar not priority	due to connect
Kerdiffstown PV	DSO	4.0	solar not priority	due to connect

Table C-34 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		3	5	8			
Installed Capacity (MW)	2027		3	5	8	8	8	
Installed Capacity (MW)	2030				8	8	8	8
Available Energy (GWh)	2025		3	6	8			
Available Energy (GWh)	2027		3	6	8	8	8	
Available Energy (GWh)	2030				8	8	8	8
Generation (GWh)	2025		3	5	7			
Generation (GWh)	2027		3	5	7	7	6	
Generation (GWh)	2030				7	7	7	7
Over-supply (%)	2025		2 %	4 %	7 %			
Over-supply (%)	2027		1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailment (%)	2025		1 %	1 %	2 %			
Curtailment (%)	2027		0 %	1 %	1 %	2 %	2 %	
Curtailment (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025		3 %	8 %	14 %			
Constraint (%)	2027		5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025		6 %	14 %	23 %			
Total Dispatch Down (%)	2027		6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-35 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

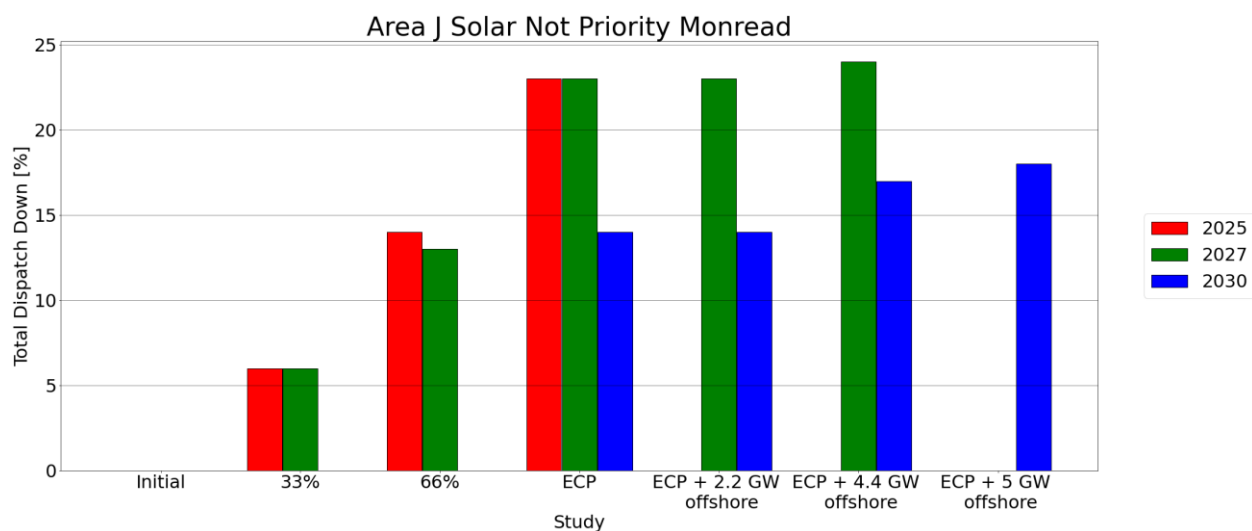


Figure C-35 - Total Dispatch Down for Solar not priority

C.18. Mount Lucas

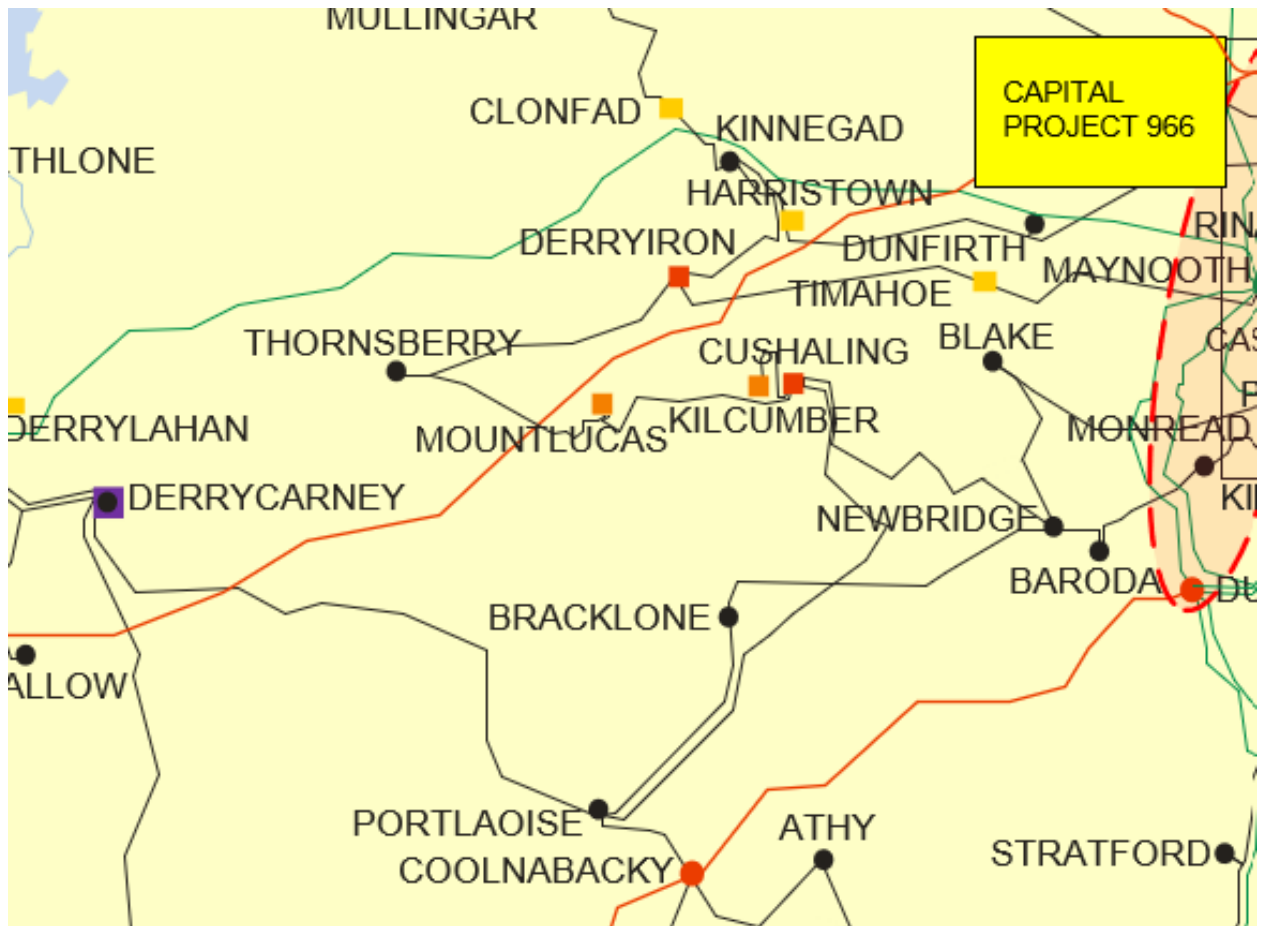


Figure C-36 - Location of node Mount lucas

Generator	SO	Capacity	Type	Status
Moanvane wind	TSO	60.0	wind not priority	due to connect
Mount Lucas (1)	TSO	79.0	wind priority	connected

Table C-36 - Generation Included in Study for Node

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		20	40	60			
Installed Capacity (MW)	2027		20	40	60	60	60	
Installed Capacity (MW)	2030				60	60	60	60
Available Energy (GWh)	2025		62	123	185			
Available Energy (GWh)	2027		62	123	185	185	185	
Available Energy (GWh)	2030				185	185	185	185
Generation (GWh)	2025		49	91	126			
Generation (GWh)	2027		50	97	134	129	114	
Generation (GWh)	2030				141	139	126	123
Over-supply (%)	2025		6 %	10 %	14 %			
Over-supply (%)	2027		1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025		1 %	2 %	2 %			
Curtailement (%)	2027		1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025		14 %	14 %	15 %			
Constraint (%)	2027		17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025		21 %	26 %	32 %			
Total Dispatch Down (%)	2027		18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table C-37 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

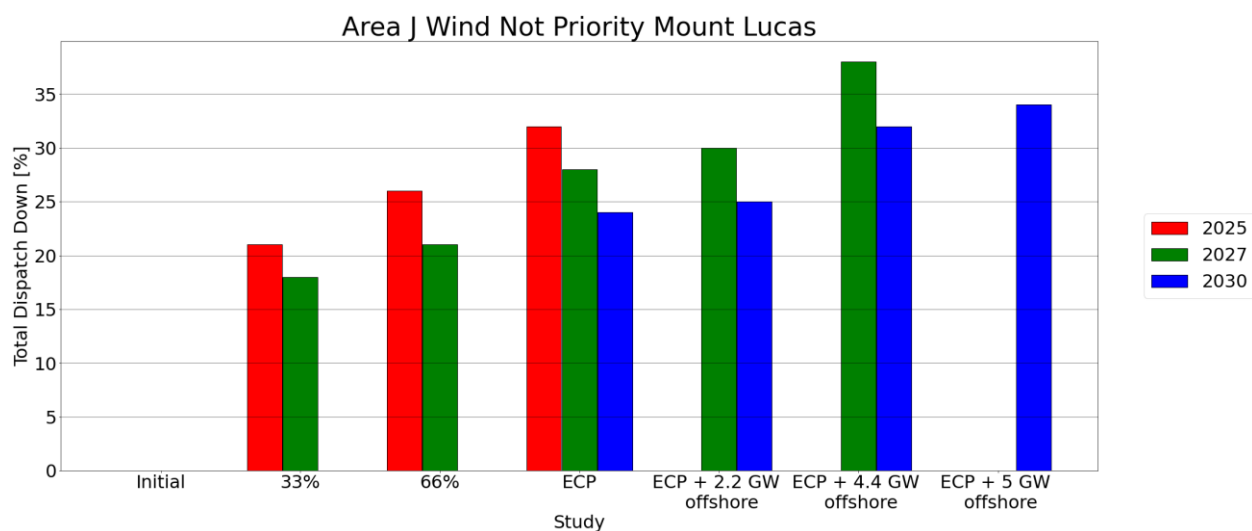


Figure C-37 - Total Dispatch Down for Wind not priority

The wind priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	79	79	79	79			
Installed Capacity (MW)	2027	79	79	79	79	79	79	
Installed Capacity (MW)	2030				79	79	79	79
Available Energy (GWh)	2025	244	244	244	244			
Available Energy (GWh)	2027	244	244	244	244	244	244	
Available Energy (GWh)	2030				244	244	244	244
Generation (GWh)	2025	204	205	201	196			
Generation (GWh)	2027	198	201	197	188	207	214	
Generation (GWh)	2030				192	211	218	219
Over-supply (%)	2025	0 %	0 %	0 %	0 %			
Over-supply (%)	2027	0 %	0 %	0 %	0 %	0 %	0 %	
Over-supply (%)	2030				0 %	0 %	0 %	0 %
Curtailement (%)	2025	1 %	2 %	3 %	4 %			
Curtailement (%)	2027	0 %	1 %	1 %	2 %	4 %	5 %	
Curtailement (%)	2030				1 %	3 %	5 %	5 %
Constraint (%)	2025	15 %	14 %	15 %	16 %			
Constraint (%)	2027	19 %	17 %	18 %	21 %	11 %	7 %	
Constraint (%)	2030				20 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025	16 %	16 %	18 %	19 %			
Total Dispatch Down (%)	2027	19 %	18 %	19 %	23 %	15 %	12 %	
Total Dispatch Down (%)	2030				21 %	13 %	10 %	10 %

Table C-38 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

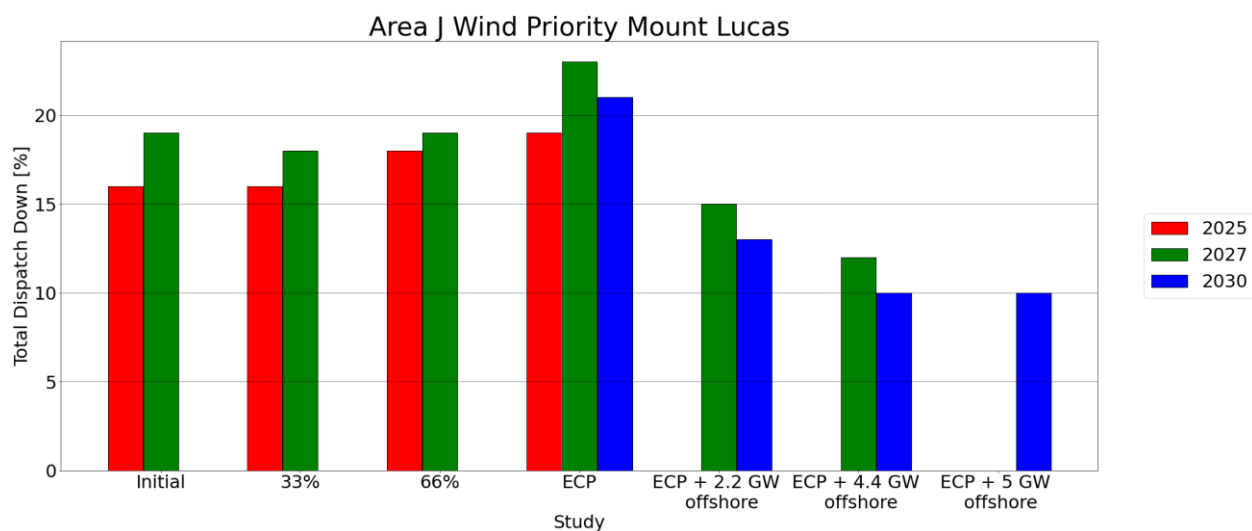


Figure C-38 - Total Dispatch Down for Wind priority

C.19. Mulgeeth

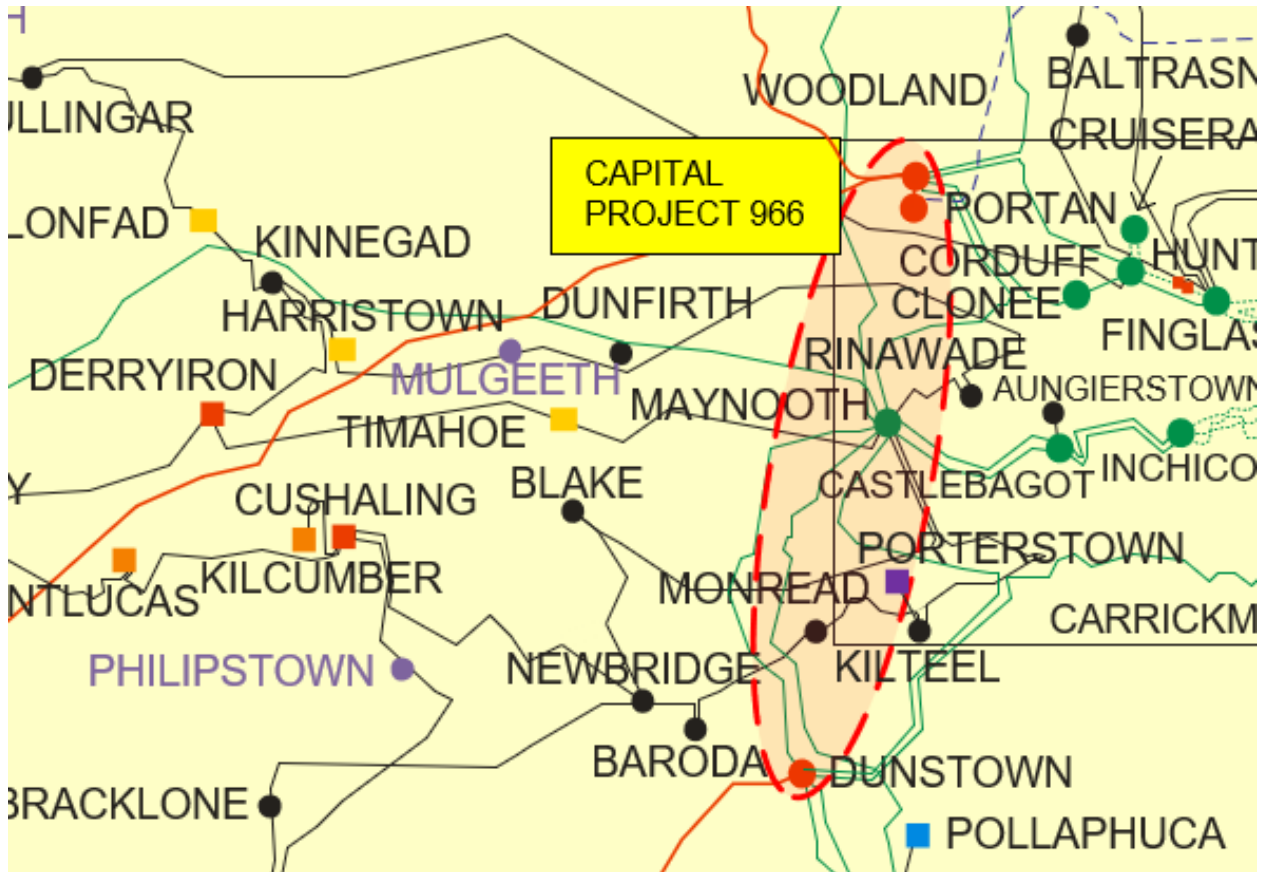


Figure C-39 - Location of node Mulgeeth

Generator	SO	Capacity	Type	Status
Drehid wind	TSO	60.0	wind not priority	due to connect

Table C-39 - Generation Included in Study for Node

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		20	40	60			
Installed Capacity (MW)	2027		20	40	60	60	60	
Installed Capacity (MW)	2030				60	60	60	60
Available Energy (GWh)	2025		62	123	185			
Available Energy (GWh)	2027		62	123	185	185	185	
Available Energy (GWh)	2030				185	185	185	185
Generation (GWh)	2025		49	91	126			
Generation (GWh)	2027		50	97	134	129	114	
Generation (GWh)	2030				141	139	126	123
Over-supply (%)	2025		6 %	10 %	14 %			
Over-supply (%)	2027		1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025		1 %	2 %	2 %			
Curtailement (%)	2027		1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025		14 %	14 %	15 %			
Constraint (%)	2027		17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025		21 %	26 %	32 %			
Total Dispatch Down (%)	2027		18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table C-40 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

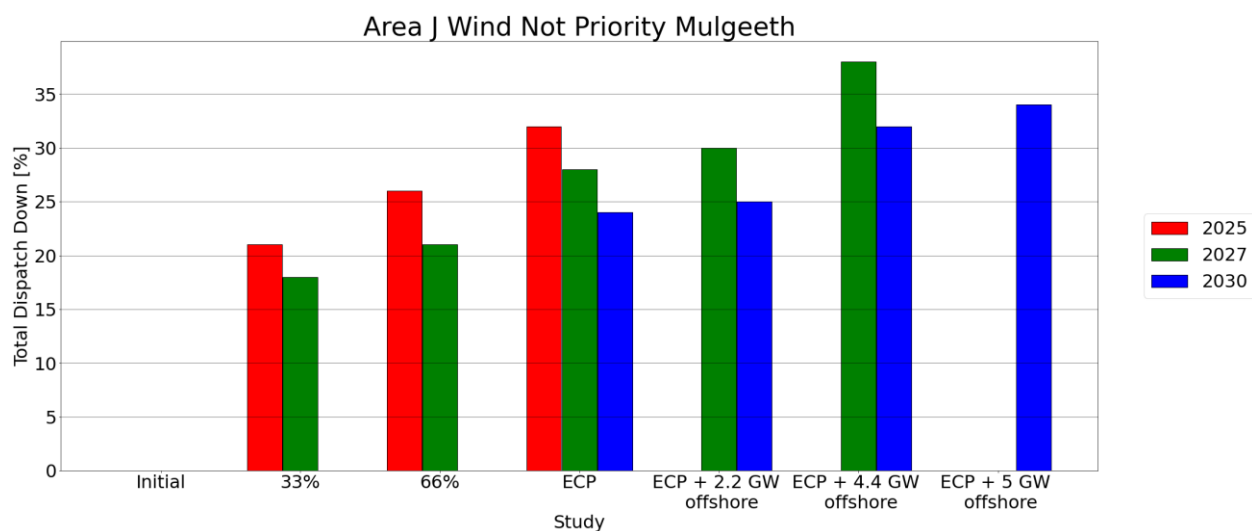


Figure C-40 - Total Dispatch Down for Wind not priority

C.20. Newbridge

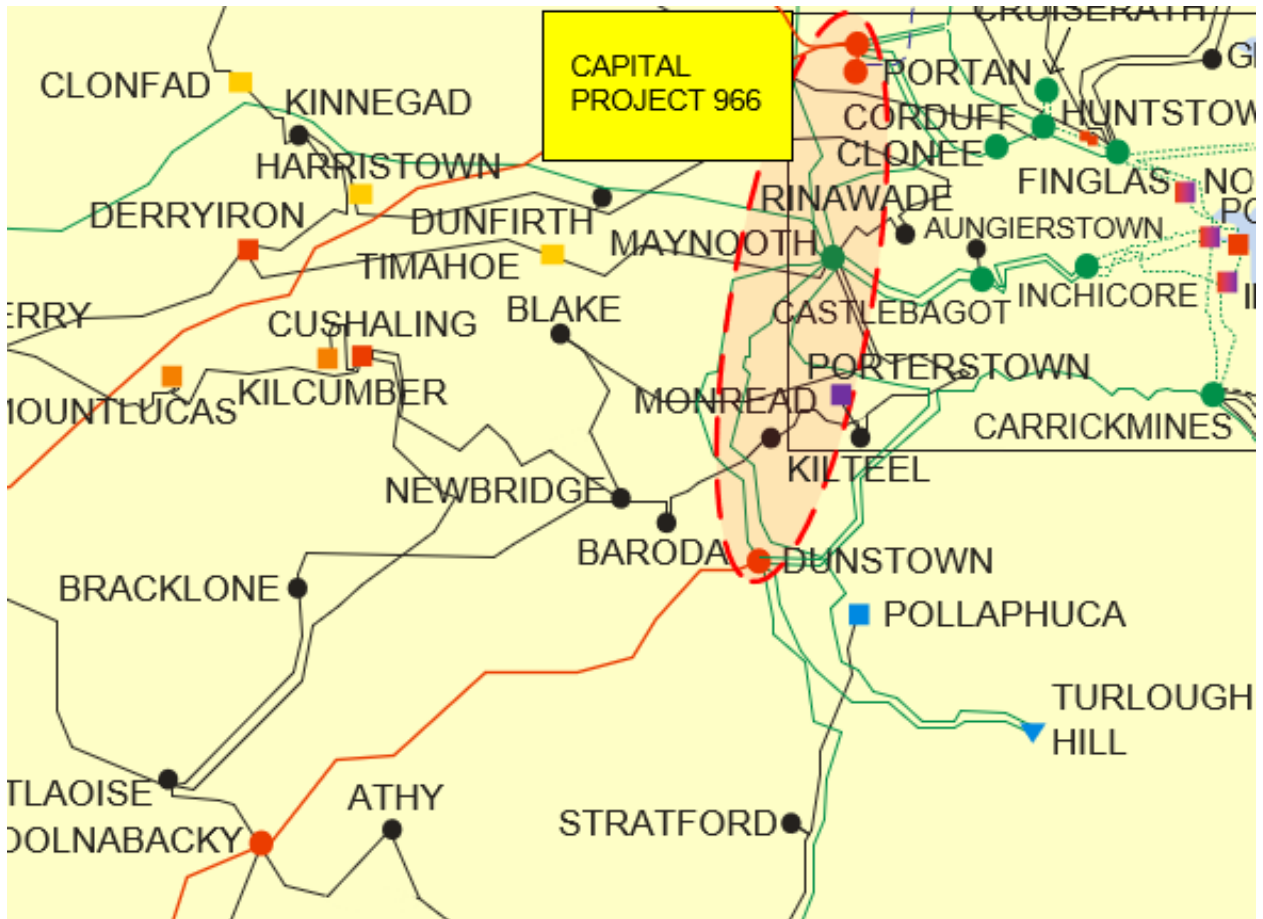


Figure C-41 - Location of node Newbridge

Generator	SO	Capacity	Type	Status
Dunmurry Springs PV	DSO	12.0	solar not priority	due to connect
Pollardstown PV	DSO	4.0	solar not priority	due to connect

Table C-41 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	4	8	12	16			
Installed Capacity (MW)	2027	4	8	12	16	16	16	
Installed Capacity (MW)	2030				16	16	16	16
Available Energy (GWh)	2025	4	8	13	17			
Available Energy (GWh)	2027	4	8	13	17	17	17	
Available Energy (GWh)	2030				17	17	17	17
Generation (GWh)	2025	4	8	11	13			
Generation (GWh)	2027	4	8	11	13	13	13	
Generation (GWh)	2030				15	15	14	14
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-42 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

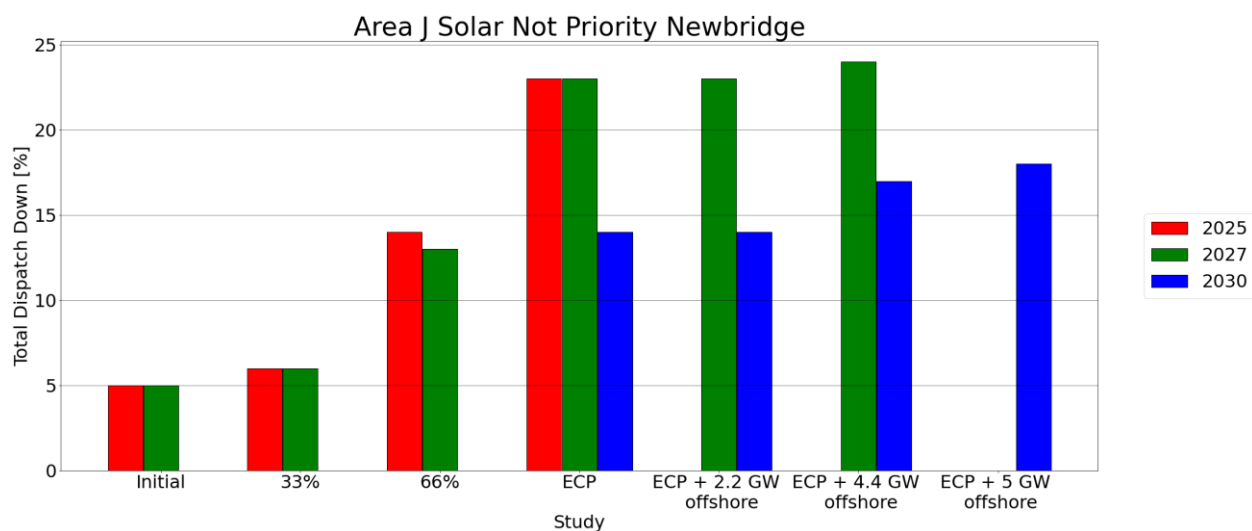


Figure C-42 - Total Dispatch Down for Solar not priority

C.21. Philipstown

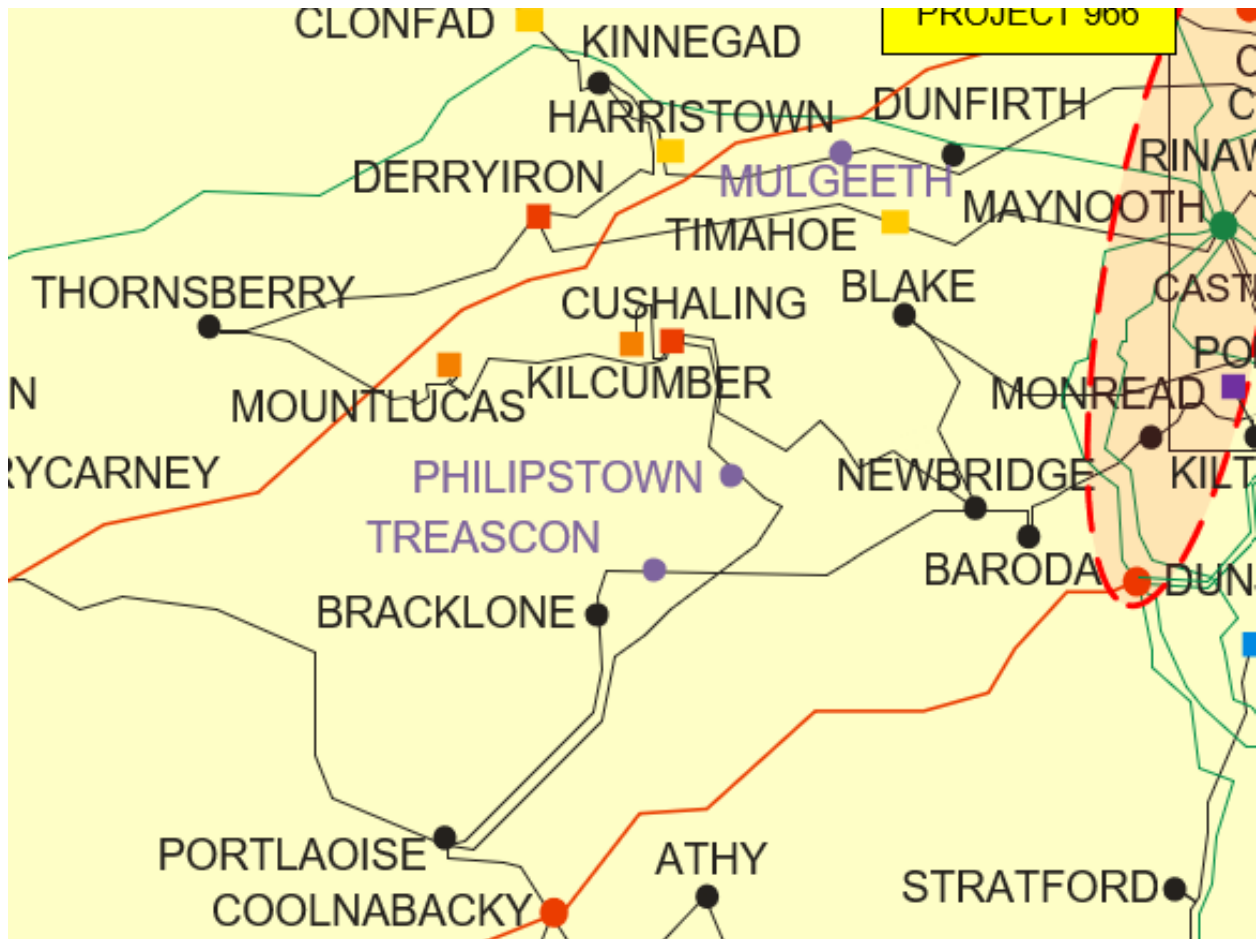


Figure C-43 - Location of node Philipstown

Generator	SO	Capacity	Type	Status
Cushaling wind (loop into Cushaling - Newbridge)	TSO	50.0	wind not priority	due to connect

Table C-43 - Generation Included in Study for Node

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		17	33	50			
Installed Capacity (MW)	2027		17	33	50	50	50	
Installed Capacity (MW)	2030				50	50	50	50
Available Energy (GWh)	2025		51	103	154			
Available Energy (GWh)	2027		51	103	154	154	154	
Available Energy (GWh)	2030				154	154	154	154
Generation (GWh)	2025		41	76	105			
Generation (GWh)	2027		42	81	112	107	95	
Generation (GWh)	2030				118	116	105	102
Over-supply (%)	2025		6 %	10 %	14 %			
Over-supply (%)	2027		1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025		1 %	2 %	2 %			
Curtailement (%)	2027		1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025		14 %	14 %	15 %			
Constraint (%)	2027		17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025		21 %	26 %	32 %			
Total Dispatch Down (%)	2027		18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table C-44 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

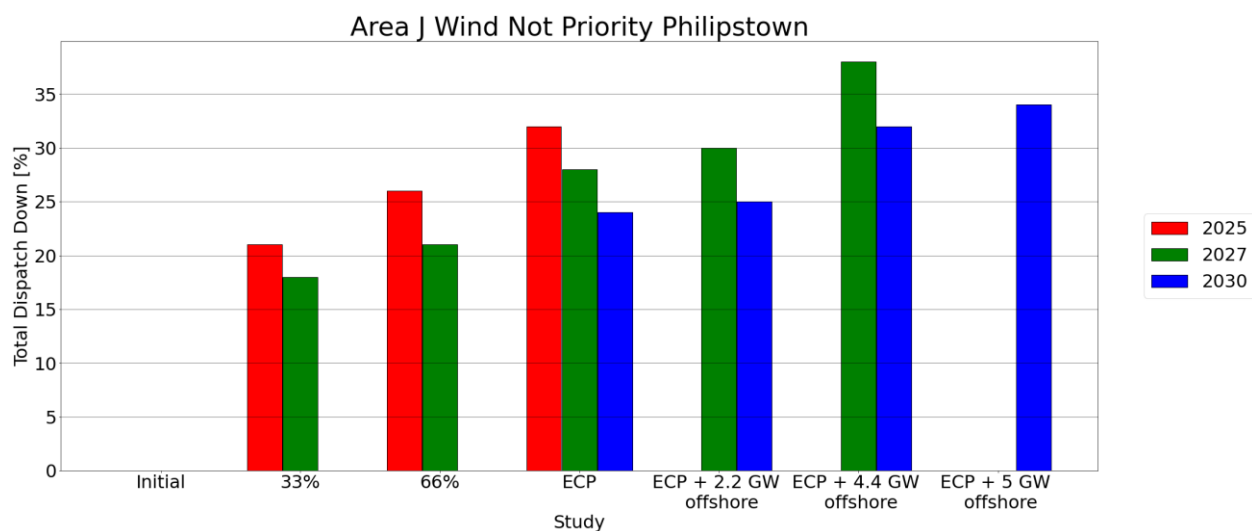


Figure C-44 - Total Dispatch Down for Wind not priority

C.22. Poolbeg north 220kv



Figure C-45 - Location of node Poolbeg north 220kv

Generator	SO	Capacity	Type	Status
Codling Offshore Wind A	TSO	450.0	wind not priority	due to connect

Table C-45 - Generation Included in Study for Node

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025							
Installed Capacity (MW)	2027					225	450	
Installed Capacity (MW)	2030					225	450	450
Available Energy (GWh)	2025							
Available Energy (GWh)	2027					885	1769	
Available Energy (GWh)	2030					885	1769	1769
Generation (GWh)	2025							
Generation (GWh)	2027					725	1113	
Generation (GWh)	2030					777	1317	1281
Over-supply (%)	2025							
Over-supply (%)	2027					14 %	24 %	
Over-supply (%)	2030					10 %	20 %	22 %
Curtailment (%)	2025							
Curtailment (%)	2027					2 %	3 %	
Curtailment (%)	2030					2 %	3 %	3 %
Constraint (%)	2025							
Constraint (%)	2027					2 %	10 %	
Constraint (%)	2030					0 %	3 %	3 %
Total Dispatch Down (%)	2025							
Total Dispatch Down (%)	2027					18 %	37 %	
Total Dispatch Down (%)	2030					12 %	26 %	28 %

Table C-46 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

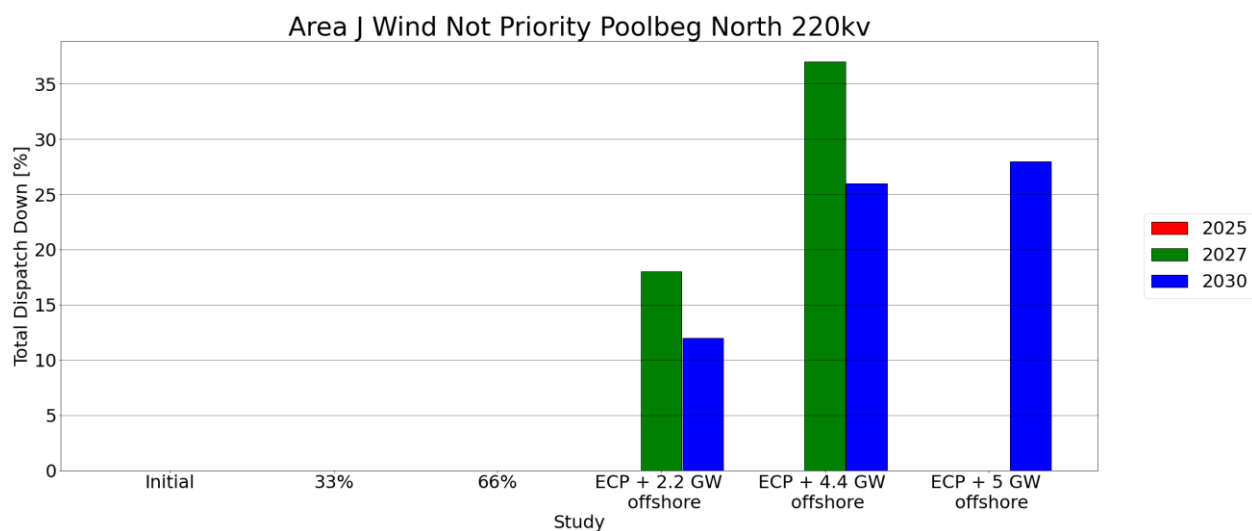


Figure C-46 - Total Dispatch Down for Wind not priority

C.23. Poolbeg South 220kV



Figure C-47 - Location of node Poolbeg south 220kv

Generator	SO	Capacity	Type	Status
Codling Offshore Wind B	TSO	500.0	wind not priority	due to connect
Codling Offshore Wind C	TSO	500.0	wind not priority	due to connect

Table C-47 - Generation Included in Study for Node

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025							
Installed Capacity (MW)	2027					500	1000	
Installed Capacity (MW)	2030					500	1000	1000
Available Energy (GWh)	2025							
Available Energy (GWh)	2027					1966	3932	
Available Energy (GWh)	2030					1966	3932	3932
Generation (GWh)	2025							
Generation (GWh)	2027					1611	2473	
Generation (GWh)	2030					1727	2926	2848
Over-supply (%)	2025							
Over-supply (%)	2027					14 %	24 %	
Over-supply (%)	2030					10 %	20 %	22 %
Curtailment (%)	2025							
Curtailment (%)	2027					2 %	3 %	
Curtailment (%)	2030					2 %	3 %	3 %
Constraint (%)	2025							
Constraint (%)	2027					2 %	10 %	
Constraint (%)	2030					0 %	3 %	3 %
Total Dispatch Down (%)	2025							
Total Dispatch Down (%)	2027					18 %	37 %	
Total Dispatch Down (%)	2030					12 %	26 %	28 %

Table C-48 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

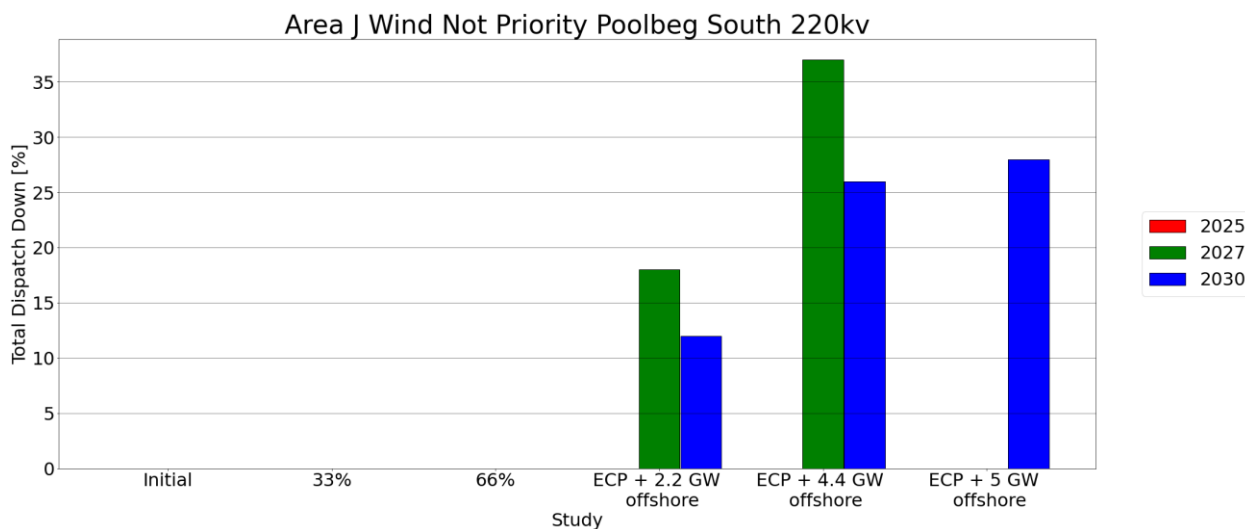


Figure C-48 - Total Dispatch Down for Wind not priority

C.24. Portlaoise

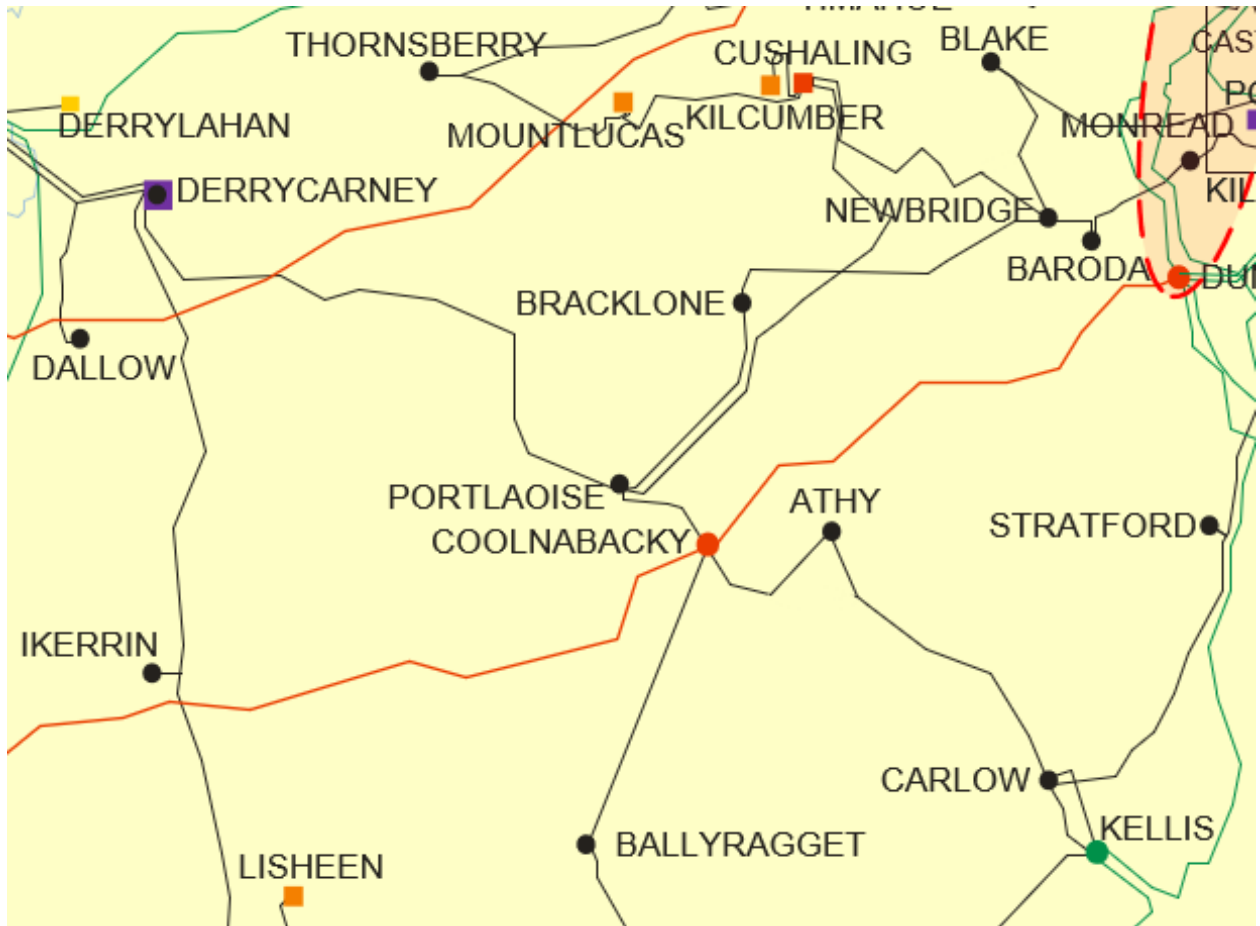


Figure C-49 - Location of node Portlaoise

Generator	SO	Capacity	Type	Status
Dooray WF	DSO	45.0	wind not priority	due to connect
Lisdowney (1)	DSO	9.0	wind priority	connected
Shanderry Solar Farm	DSO	4.0	solar not priority	due to connect

Table C-49 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		1	3	4			
Installed Capacity (MW)	2027		1	3	4	4	4	
Installed Capacity (MW)	2030				4	4	4	4
Available Energy (GWh)	2025		1	3	4			
Available Energy (GWh)	2027		1	3	4	4	4	
Available Energy (GWh)	2030				4	4	4	4
Generation (GWh)	2025		1	2	3			
Generation (GWh)	2027		1	2	3	3	3	
Generation (GWh)	2030				4	4	4	3
Over-supply (%)	2025		2 %	4 %	7 %			
Over-supply (%)	2027		1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025		1 %	1 %	2 %			
Curtailement (%)	2027		0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025		3 %	8 %	14 %			
Constraint (%)	2027		5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025		6 %	14 %	23 %			
Total Dispatch Down (%)	2027		6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-50 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

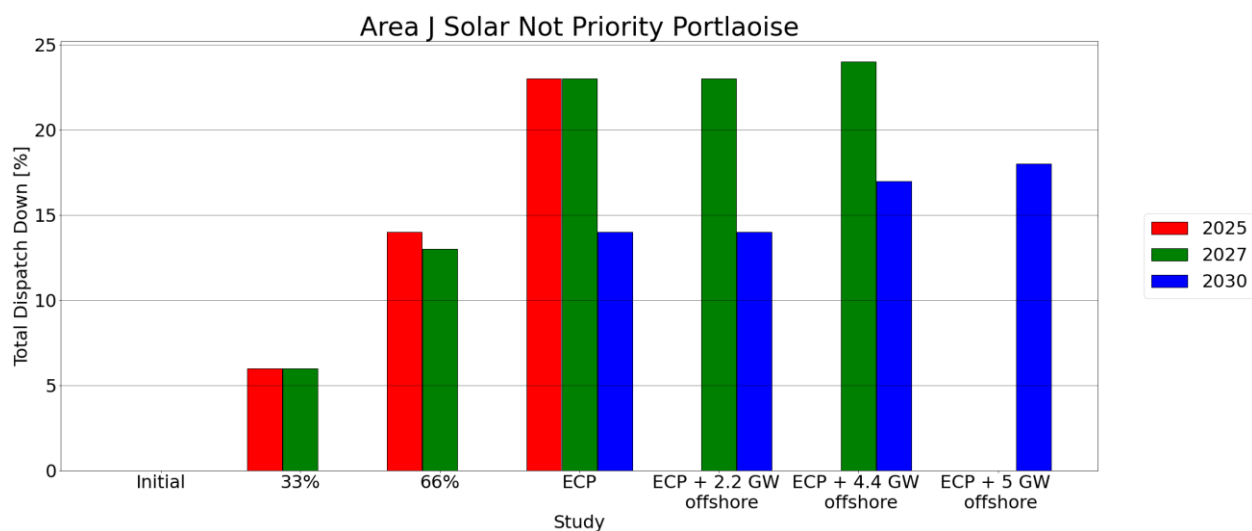


Figure C-50 - Total Dispatch Down for Solar not priority

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		15	30	45			
Installed Capacity (MW)	2027		15	30	45	45	45	
Installed Capacity (MW)	2030				45	45	45	45
Available Energy (GWh)	2025		46	93	139			
Available Energy (GWh)	2027		46	93	139	139	139	
Available Energy (GWh)	2030				139	139	139	139
Generation (GWh)	2025		37	68	94			
Generation (GWh)	2027		38	73	100	97	86	
Generation (GWh)	2030				106	104	94	92
Over-supply (%)	2025		6 %	10 %	14 %			
Over-supply (%)	2027		1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025		1 %	2 %	2 %			
Curtailement (%)	2027		1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025		14 %	14 %	15 %			
Constraint (%)	2027		17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025		21 %	26 %	32 %			
Total Dispatch Down (%)	2027		18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table C-51 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

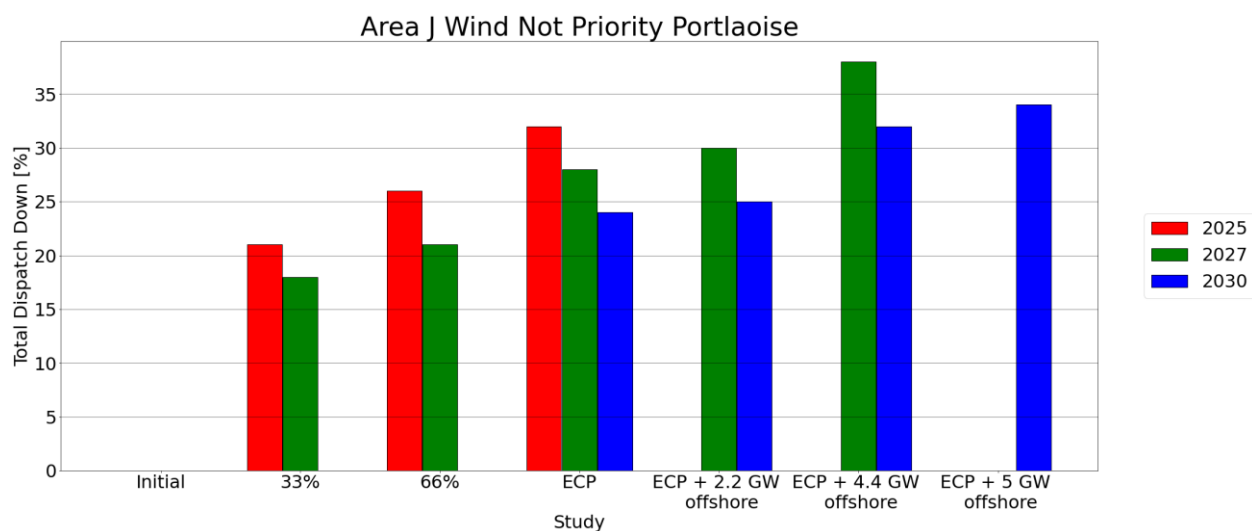


Figure C-51 - Total Dispatch Down for Wind not priority

The wind priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	9	9	9	9			
Installed Capacity (MW)	2027	9	9	9	9	9	9	
Installed Capacity (MW)	2030				9	9	9	9
Available Energy (GWh)	2025	28	28	28	28			
Available Energy (GWh)	2027	28	28	28	28	28	28	
Available Energy (GWh)	2030				28	28	28	28
Generation (GWh)	2025	23	23	23	22			
Generation (GWh)	2027	23	23	22	21	24	24	
Generation (GWh)	2030				22	24	25	25
Over-supply (%)	2025	0 %	0 %	0 %	0 %			
Over-supply (%)	2027	0 %	0 %	0 %	0 %	0 %	0 %	
Over-supply (%)	2030				0 %	0 %	0 %	0 %
Curtailement (%)	2025	1 %	2 %	3 %	4 %			
Curtailement (%)	2027	0 %	1 %	1 %	2 %	4 %	5 %	
Curtailement (%)	2030				1 %	3 %	5 %	5 %
Constraint (%)	2025	15 %	14 %	15 %	16 %			
Constraint (%)	2027	19 %	17 %	18 %	21 %	11 %	7 %	
Constraint (%)	2030				20 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025	16 %	16 %	18 %	19 %			
Total Dispatch Down (%)	2027	19 %	18 %	19 %	23 %	15 %	12 %	
Total Dispatch Down (%)	2030				21 %	13 %	10 %	10 %

Table C-52 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

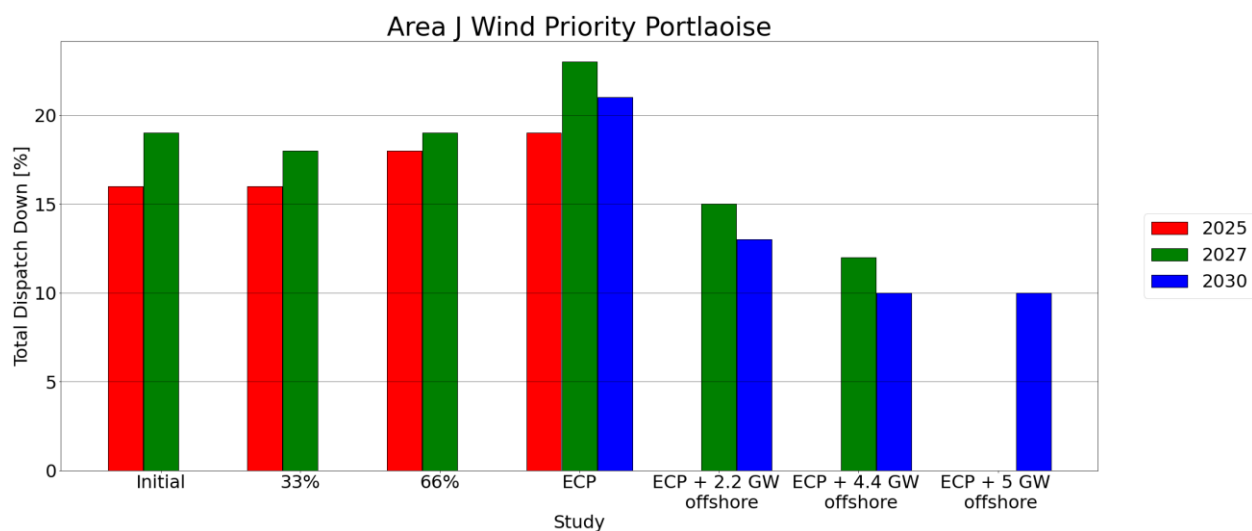


Figure C-52 - Total Dispatch Down for Wind priority

C.25. Stephenstown

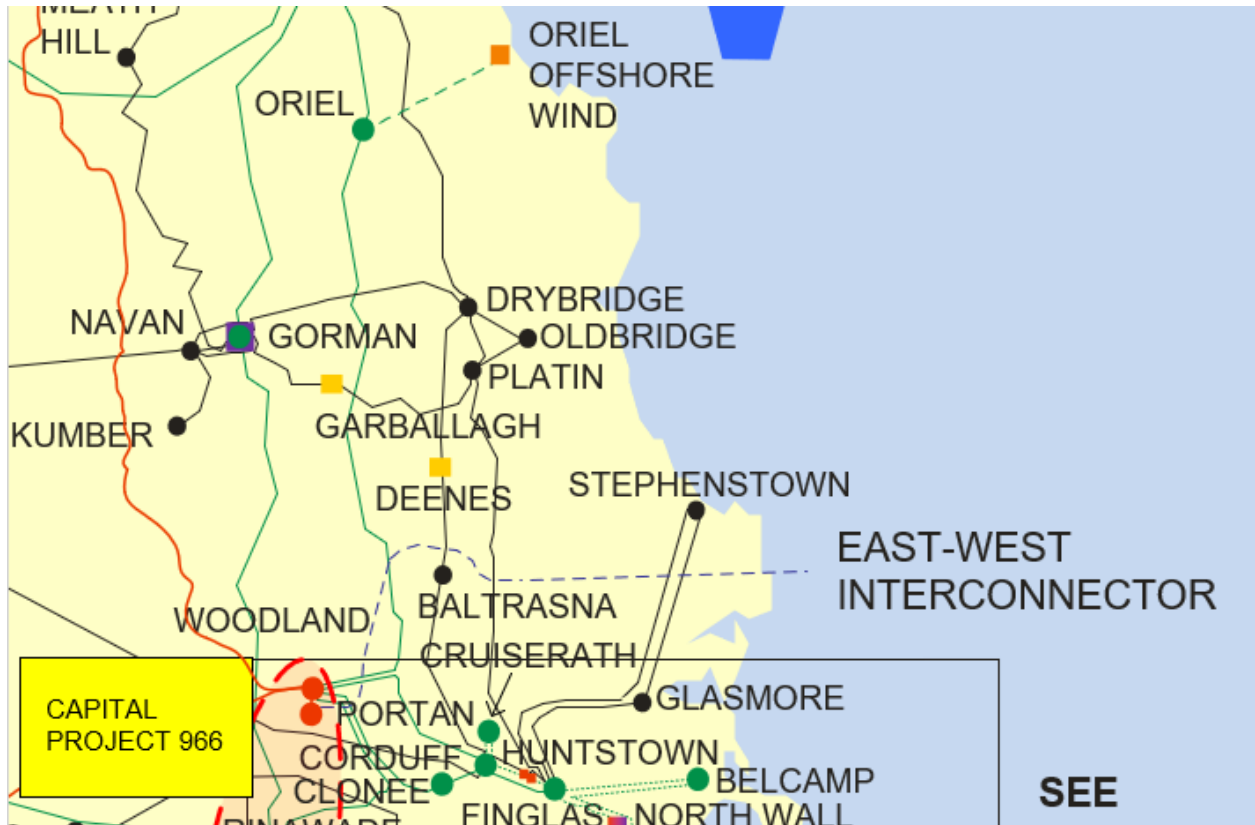


Figure C-53 - Location of node Stephenstown

Generator	SO	Capacity	Type	Status
Matt Solar Farm	DSO	5.0	solar not priority	due to connect

Table C-53 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	5	5	5	5			
Installed Capacity (MW)	2027	5	5	5	5	5	5	
Installed Capacity (MW)	2030				5	5	5	5
Available Energy (GWh)	2025	5	5	5	5			
Available Energy (GWh)	2027	5	5	5	5	5	5	
Available Energy (GWh)	2030				5	5	5	5
Generation (GWh)	2025	5	5	5	4			
Generation (GWh)	2027	5	5	5	4	4	4	
Generation (GWh)	2030				4	4	4	4
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	5 %	7 %			
Constraint (%)	2027	5 %	7 %	11 %	15 %	8 %	5 %	
Constraint (%)	2030				14 %	7 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	5 %	10 %	16 %			
Total Dispatch Down (%)	2027	5 %	8 %	14 %	20 %	18 %	20 %	
Total Dispatch Down (%)	2030				18 %	15 %	17 %	18 %

Table C-54 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

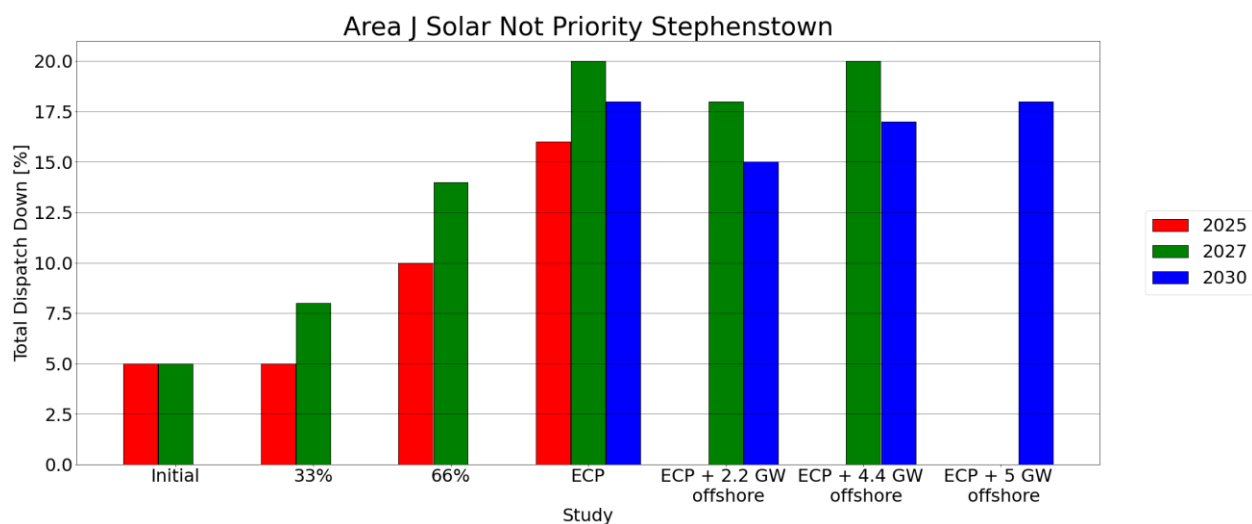


Figure C-54 - Total Dispatch Down for Solar not priority

C.26. Thornsberry

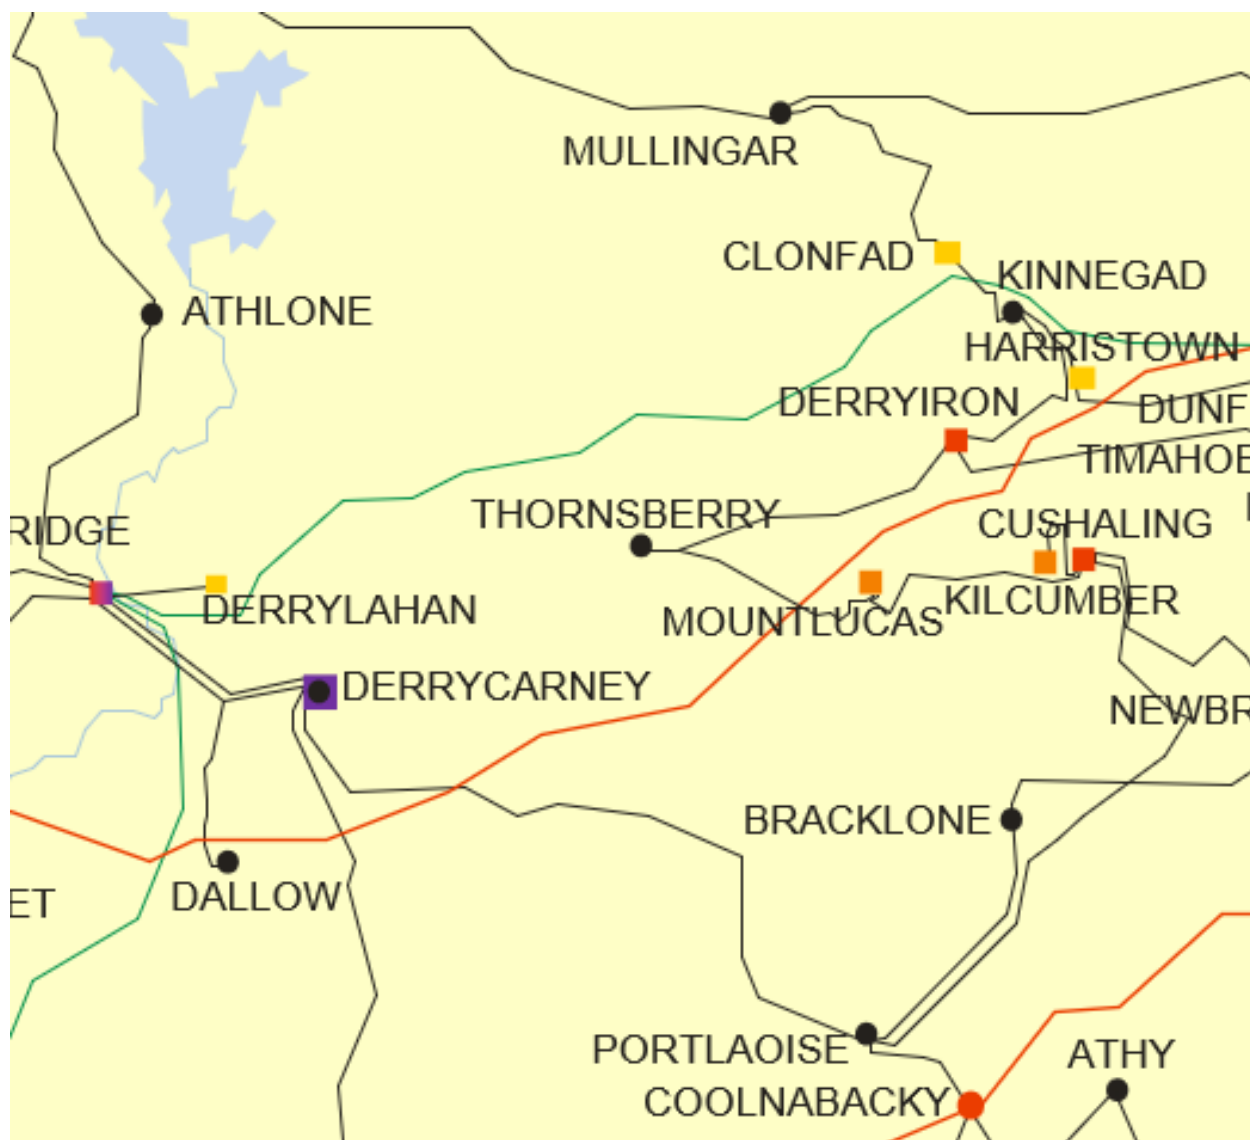


Figure C-55 - Location of node Thornsberry

Generator	SO	Capacity	Type	Status
Ballyboughlin Solar Farm	DSO	14.0	solar not priority	due to connect
Clonminch Community Wind Turbine	DSO	5.0	wind not priority	due to connect
Lehinch Solar Farm	DSO	4.0	solar not priority	due to connect
Muinagh Solar Farm	DSO	4.0	solar not priority	due to connect
Muinagh Solar Farm phase 2	DSO	1.8	solar not priority	due to connect

Table C-55 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	4	11	17	24			
Installed Capacity (MW)	2027	4	11	17	24	24	24	
Installed Capacity (MW)	2030				24	24	24	24
Available Energy (GWh)	2025	4	11	18	25			
Available Energy (GWh)	2027	4	11	18	25	25	25	
Available Energy (GWh)	2030				25	25	25	25
Generation (GWh)	2025	4	11	16	19			
Generation (GWh)	2027	4	11	16	19	20	19	
Generation (GWh)	2030				22	22	21	21
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-56 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

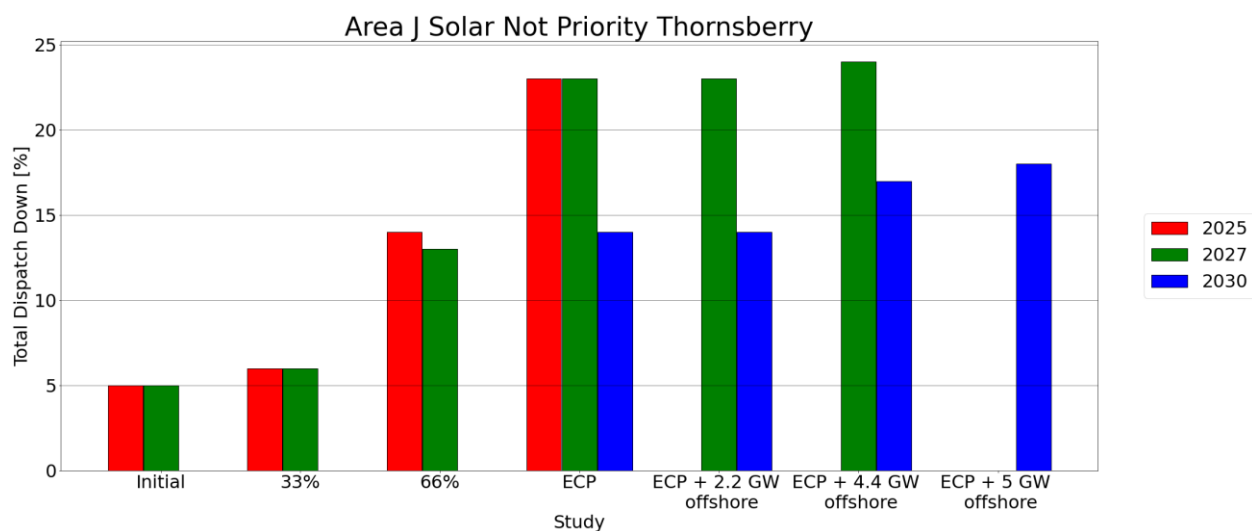


Figure C-56 - Total Dispatch Down for Solar not priority

The wind not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025		2	3	5			
Installed Capacity (MW)	2027		2	3	5	5	5	
Installed Capacity (MW)	2030				5	5	5	5
Available Energy (GWh)	2025		5	10	15			
Available Energy (GWh)	2027		5	10	15	15	15	
Available Energy (GWh)	2030				15	15	15	15
Generation (GWh)	2025		4	8	10			
Generation (GWh)	2027		4	8	11	11	10	
Generation (GWh)	2030				12	12	10	10
Over-supply (%)	2025		6 %	10 %	14 %			
Over-supply (%)	2027		1 %	3 %	5 %	17 %	29 %	
Over-supply (%)	2030				3 %	13 %	24 %	26 %
Curtailement (%)	2025		1 %	2 %	2 %			
Curtailement (%)	2027		1 %	1 %	2 %	3 %	3 %	
Curtailement (%)	2030				1 %	2 %	3 %	3 %
Constraint (%)	2025		14 %	14 %	15 %			
Constraint (%)	2027		17 %	18 %	21 %	11 %	6 %	
Constraint (%)	2030				19 %	10 %	6 %	5 %
Total Dispatch Down (%)	2025		21 %	26 %	32 %			
Total Dispatch Down (%)	2027		18 %	21 %	28 %	30 %	38 %	
Total Dispatch Down (%)	2030				24 %	25 %	32 %	34 %

Table C-57 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

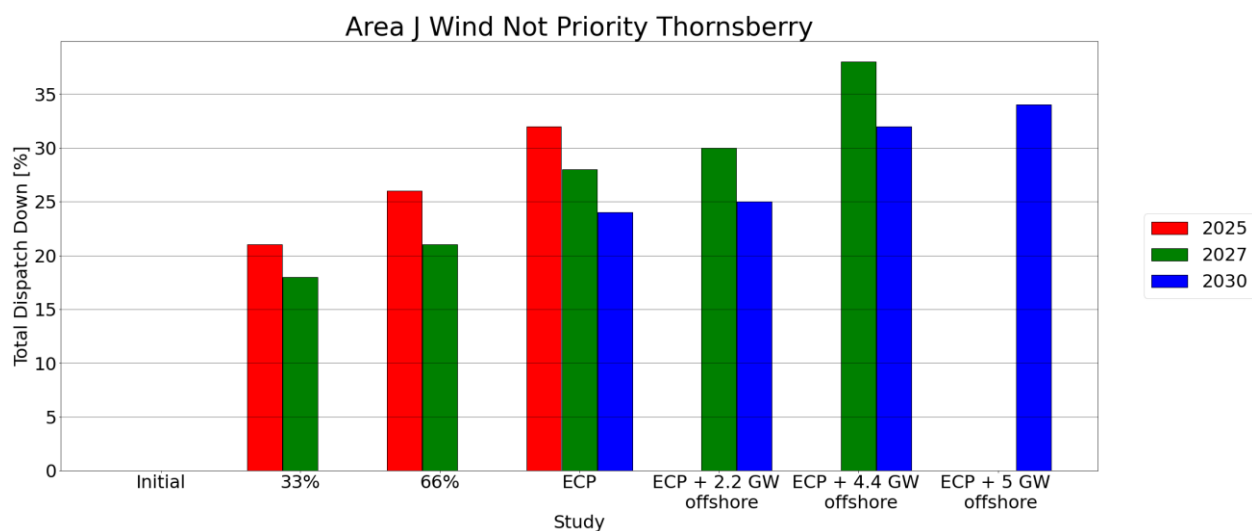


Figure C-57 - Total Dispatch Down for Wind not priority

C.27. Timahoe North

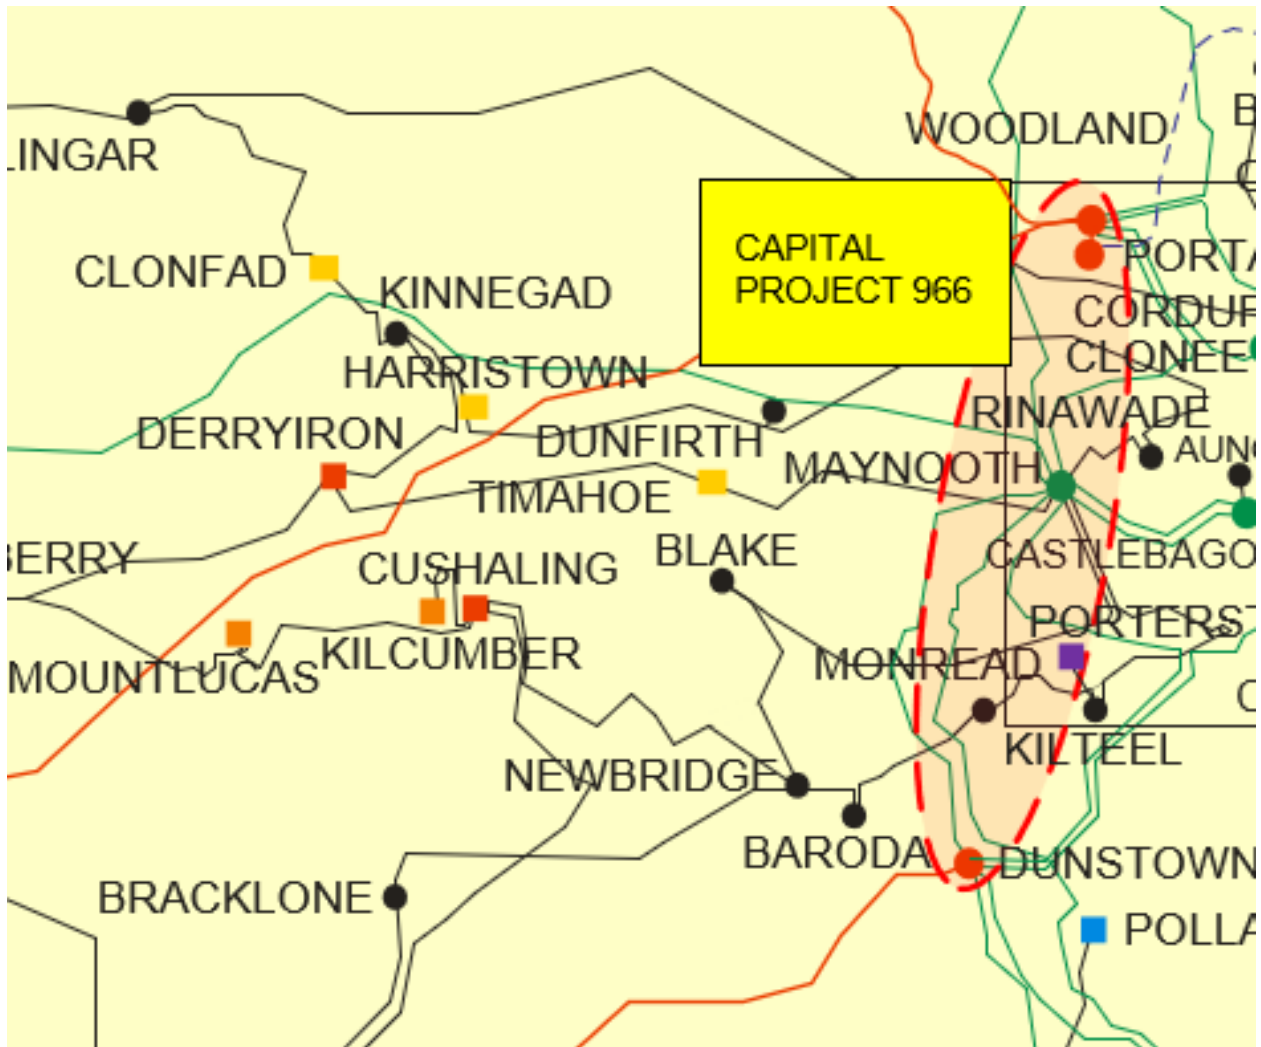


Figure C-58 - Location of node Timahoe north

Generator	SO	Capacity	Type	Status
Timahoe North Phase 2 Solar Farm	TSO	80.0	solar not priority	due to connect
Timahoe North solar	TSO	70.0	solar not priority	due to connect

Table C-58 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	70	97	123	150			
Installed Capacity (MW)	2027	70	97	123	150	150	150	
Installed Capacity (MW)	2030				150	150	150	150
Available Energy (GWh)	2025	74	102	131	159			
Available Energy (GWh)	2027	74	102	131	159	159	159	
Available Energy (GWh)	2030				159	159	159	159
Generation (GWh)	2025	70	96	113	122			
Generation (GWh)	2027	70	96	113	123	123	120	
Generation (GWh)	2030				136	136	132	130
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-59 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

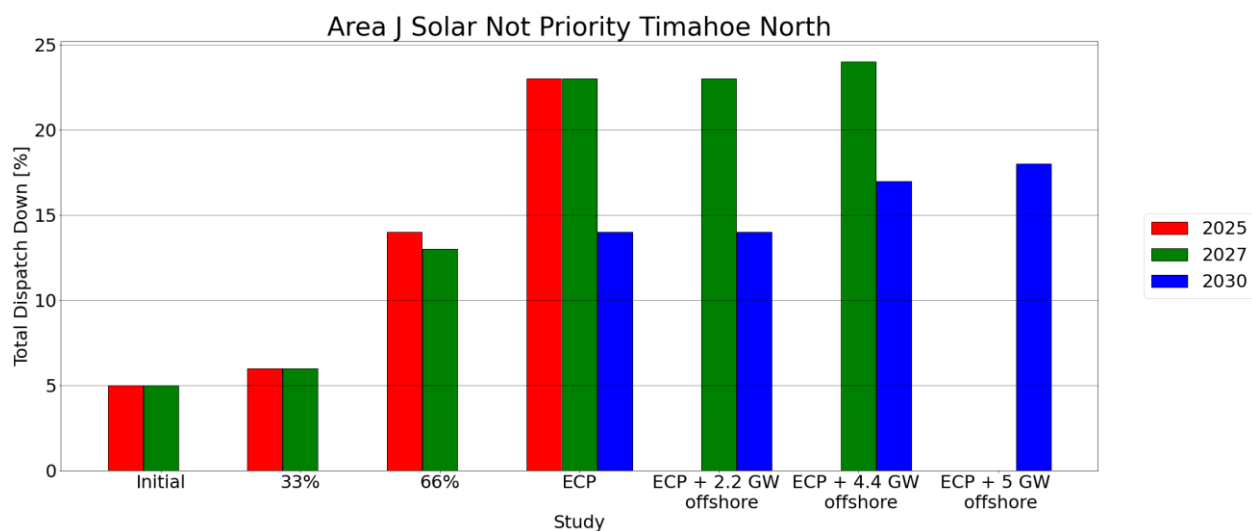


Figure C-59 - Total Dispatch Down for Solar not priority

C.28. Treascon

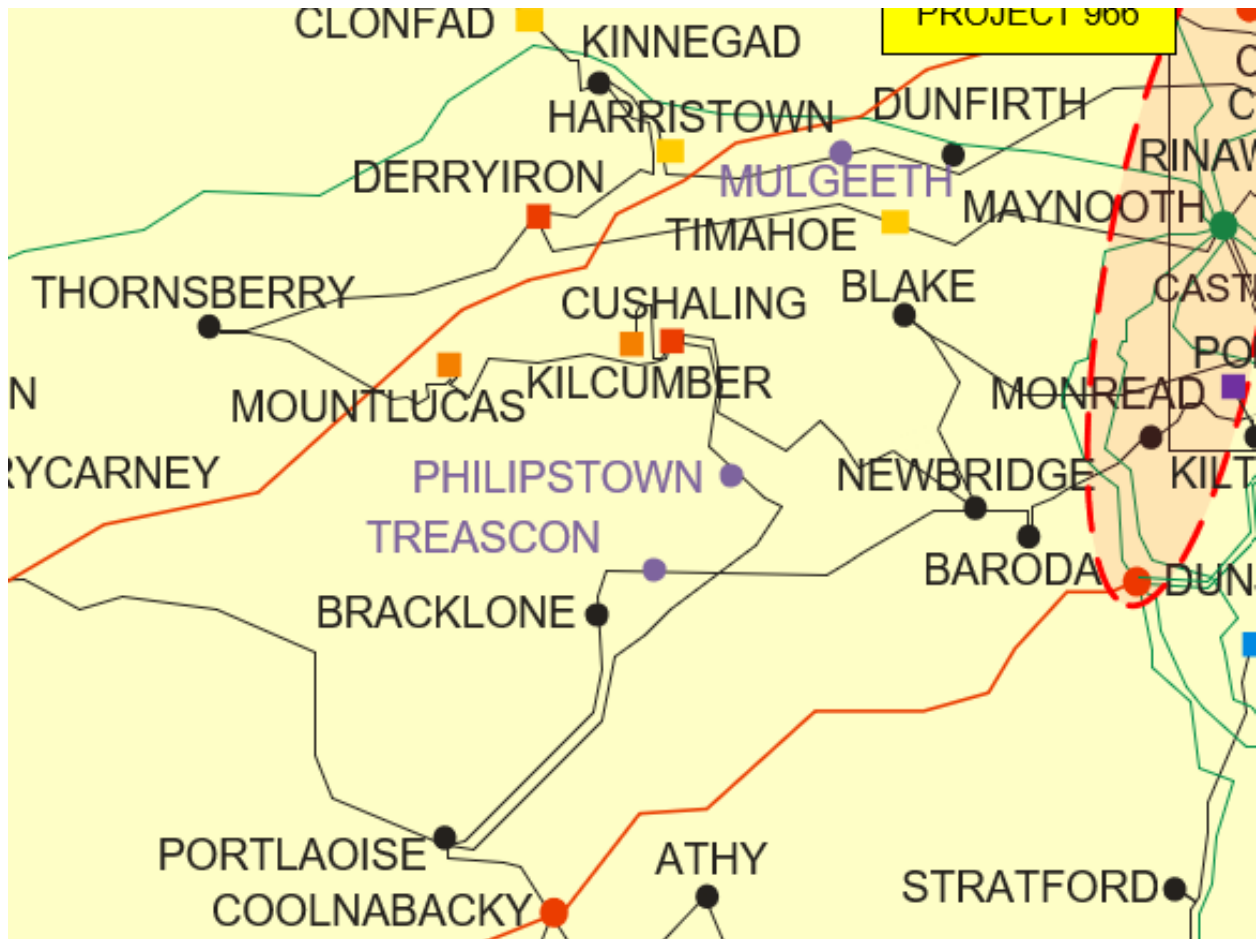


Figure C-60 - Location of node Treascon

Generator	SO	Capacity	Type	Status
Treascon Solar	TSO	40.0	solar not priority	connected

Table C-60 - Generation Included in Study for Node

The solar not priority data is given in the following table.

Area J	Year	Initial	33%	66%	ECP	ECP + 2.2 GW offshore	ECP + 4.4 GW offshore	ECP + 5 GW offshore
Installed Capacity (MW)	2025	40	40	40	40			
Installed Capacity (MW)	2027	40	40	40	40	40	40	
Installed Capacity (MW)	2030				40	40	40	40
Available Energy (GWh)	2025	42	42	42	42			
Available Energy (GWh)	2027	42	42	42	42	42	42	
Available Energy (GWh)	2030				42	42	42	42
Generation (GWh)	2025	40	40	37	33			
Generation (GWh)	2027	40	40	37	33	33	32	
Generation (GWh)	2030				36	36	35	35
Over-supply (%)	2025	1 %	2 %	4 %	7 %			
Over-supply (%)	2027	0 %	1 %	2 %	4 %	8 %	13 %	
Over-supply (%)	2030				3 %	7 %	11 %	12 %
Curtailement (%)	2025	0 %	1 %	1 %	2 %			
Curtailement (%)	2027	0 %	0 %	1 %	1 %	2 %	2 %	
Curtailement (%)	2030				1 %	2 %	2 %	2 %
Constraint (%)	2025	4 %	3 %	8 %	14 %			
Constraint (%)	2027	5 %	5 %	11 %	18 %	13 %	10 %	
Constraint (%)	2030				10 %	6 %	4 %	4 %
Total Dispatch Down (%)	2025	5 %	6 %	14 %	23 %			
Total Dispatch Down (%)	2027	5 %	6 %	13 %	23 %	23 %	24 %	
Total Dispatch Down (%)	2030				14 %	14 %	17 %	18 %

Table C-61 - Over-supply, Curtailment and Constraint for Solar Not Priority in Area J

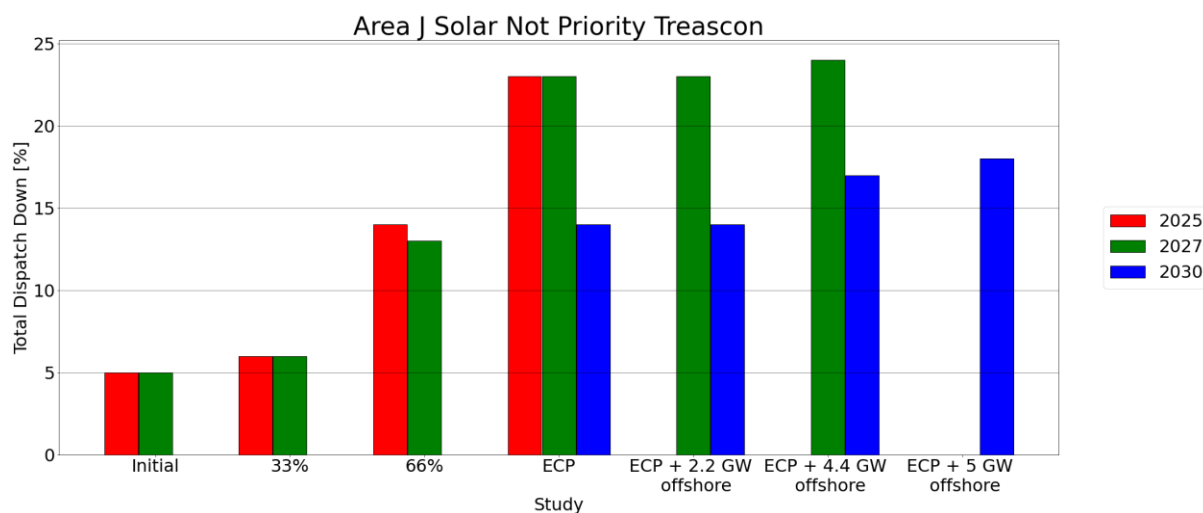


Figure C-61 - Total Dispatch Down for Solar not priority

Appendix D Contingencies and Lines Overloading

For different study scenarios, there were several transmissions boundaries that limit the power flow. Some of the main overload and contingency pairs binding for more than 150 hours for the two study years (2025 ECP (All) and 2027 (All)) can be seen below.

D.1. Year 2025

Line	Contingency Name	Hours Range
Line (Cushaling - Newbridge_110_1)	Loss of Mount Lucas - Thornsberry 110 1	3000-3250
Line (Cashla - Salthill_110_1)	Loss of Galway Salthill 110 1	2500-3000
Line (Moneypoint T4202)	Loss of Moneypoint 380-220 1	2000-2250
Line (Kilnap - Knockraha_110_1)	Loss of Clashavoon Knockraha 220	1750-2000
Line (Cushaling - Newbridge_110_1)	Loss of Philipstown - Portlaoise 110 1	1250-1500
Line (Maynooth - Timahoe North_110_1)	Loss of Harristown - Dunfirth 110 1	1000-1250
Line (Coolnaback - Portlaoise_110_1)	Loss of Dunstown-Kellis 220	1000-1250
Line (Flagford - Sligo_110_1)	Loss of Flagford-Srananagh 220 circuit 1	1000-1250
Line (Great Island T2102)	Loss of Cullenagh-Great Island 220	1000-1250
Line (Bandon - Dunmanway_110_1)	Loss of Clashavoon Knockraha 220	1000-1250
Line (Maynooth - Rinawade_110_1)	Loss of Maynooth - Timahoe North 110 1	1000-1250
Line (Great Island - Kellis_220_1)	Loss of Arklow Carrickmines 220 1	1000-1250
Line (Flagford - Sligo_110_1)	Loss of Srananagh 220-110 2	1000-1250
Line (Sligo - Srananagh_110_2)	Loss of Flagford-Srananagh 220 circuit 1	750-1000
Line (Sligo - Srananagh_110_2)	Loss of Srananagh 220-110 2	750-1000
Line (Kellis - Kilkenny_110_1)	Loss of Coolnaback Portlaoise 110 1	750-1000
Line (Castlebar - Cloon_110_1)	Loss of Cunghill Sligo 110 1	750-1000
Line (Maynooth - Shannonbridge_220_1)	Loss of Oldstreet Woodland 380	750-1000
Line (Cahir - Doon_110_1)	Loss of Cullenagh-Knockraha 220	750-1000
Line (Finglas - Mooretown_220_1)	Loss of Corduff Mooretown 220 1	750-1000
Line (Lisheen - Thurles_110_1)	Base	750-1000
Line (Castlebar - Cloon_110_1)	Loss of Bellacorick-Moy 110 1	500-750
Line (Arklow T2101)	Loss of Arklow 220-110 2	500-750
Line (Killoteran - Waterford_110_1)	Loss of Cullenagh-Waterford 110 1	500-750
Line (Maynooth - Timahoe North_110_1)	Loss of Cushaling Newbridge	500-750
Line (Killoteran - Waterford_110_1)	Loss of Cullenagh-Great Island 220	500-750
Line (Oldstreet - Tynagh_220_1)	Loss of Cashla-Tynagh 220	500-750
Line (Coolnaback - Portlaoise_110_1)	Loss of Great Island - Kellis 220	500-750
Line (Arklow T2101)	Loss of Arklow Lodgewood 220	500-750
Line (Flagford - Sligo_110_1)	Loss of Carrick on Shannon - Arigna T 110 1	250-500
Line (Rinawade - Dunfirth-T_110_1)	Loss of Corduff Blundelstown 110 1	250-500
Line (Arklow T2101)	Loss of Lodgewood 220-110 1	250-500
Line (Blundelstown_Mullingar_110_1)	Loss of Clonfad - Kinnegad 110 1	250-500
Line (Cashla - Dalton_110_1)	Loss of Cunghill Sligo 110 1	250-500
Line (Great Island T2102)	Loss of Great Island 220-110 1	250-500
Line (Coolnaback - Portlaoise_110_1)	Loss of Kellis Kilkenny 110 1	250-500
Line (Crane - Wexford_110_1)	loss of Great Island - Rosspile 110 1	250-500
Line (Maynooth - Blake-T_110_1)	Loss of Oldstreet Woodland 380	250-500

Line (Galway - Knockranny A1_110_1)	Base	250-500
Line (Crane - Wexford_110_1)	Loss of Great Island - Lodgewood 220	250-500
Line (Lisdrum - Lislea 110 1 newish)	Loss of Louth - Ratrussan 110 1	250-500
Line (Rinawade - Dunfirth-T_110_1)	Loss of Maynooth - Timahoe North 110 1	250-500
Line (Drybridge - Louth_110_1)	Loss of Oriel Woodland 220	250-500
Line (Corduff - Macetown_110_1)	Loss of Drybridge Gastkinstown 110 1	250-500
Line (Kilnap - Knockraha_110_1)	Loss of Killonan Knockraha 220	250-500
Line (Cushaling - Newbridge_110_1)	Loss of Maynooth - Timahoe North 110 1	250-500
Line (Coolnaback - Portlaoise_110_1)	Loss of Arklow Carrickmines 220 1	250-500
Line (Baroda - Monread_110_1)	Loss of Mount Lucas - Thornsberry 110 1	250-500
Line (Castlebar - Cloon_110_1)	Loss of Cashla Dalton 110 1	250-500
Line (Maynooth - Shannonbridge_220_1)	Loss of dunstown moneypoint 380	250-500
Line (Carrickmines - Poolbeg_220_1)	Loss of Oldstreet Woodland 380	250-500
Line (Drybridge - Louth_110_1)	Loss of Gorman Louth 220	250-500
Line (Cathaleens Fall - Srananagh_110_2)	Loss of Cathaleens Fall - Corraclassy 110 1	250-500
Line (Drybridge - Louth_110_1)	Loss of Louth-Oriel (Woodland) 220	<250
Line (Corduff - Macetown_110_1)	Loss of Oriel Woodland 220	<250
Line (Derryiron - Kinnegad_110_1)	Loss of Maynooth - Timahoe North 110 1	<250
Line (Cushaling - Newbridge_110_1)	Loss of Newbridge Treascon 110 1	<250
Line (Corduff - Macetown_110_1)	Loss of Louth-Oriel (Woodland) 220	<250
Line (Sligo - Srananagh_110_2)	Loss of Carrick on Shannon - Arigna T 110 1	<250
Line (Cashla - Dalton_110_1)	Loss of Bellacorick-Moy 110 1	<250
Line (Corduff - Macetown_110_1)	Loss of Maynooth - Timahoe North 110 1	<250
Line (Great Island T2102)	Loss of Great Island - Lodgewood 220	<250
Line (Maynooth - Rinawade_110_1)	Loss of Corduff Blundelstown 110 1	<250
Line (Maynooth - Timahoe North_110_1)	Loss of Rinawade Dunfirth T 110 1	<250
Line (Carlow - Kellis_110_2)	Loss of Dunstown-Kellis 220	<250
Line (Baltrasna - Corduff_110_1)	Loss of Drybridge Gastkinstown 110 1	<250
Line (Cushaling - Newbridge_110_1)	Loss of Bracklone - Newbridge 110 1	<250
Line (Crane - Wexford_110_1)	Loss of Arklow Carrickmines 220 1	<250
Line (Great Island - Kellis_220_1)	Loss of Great Island - Lodgewood 220	<250
Line (Corduff - Macetown_110_1)	Loss of Corduff-Ryebrook 110 1	<250
Line (Dunstown T4202)	Loss of Oldstreet Woodland 380	<250
Line (Cathaleens Fall - Srananagh_110_2)	Loss of Cathleens Fall - Srananagh 110 1	<250
Line (Bellacorick coupler a to b_110_1)	Loss of Cunghill Sligo 110 1	<250
Line (Lisdrum - Louth_110_1)	Loss of Louth - Ratrussan 110 1	<250
Line (Newbridge - Treascon_110_1)	Loss of Cushaling Newbridge	<250
Line (Rinawade - Dunfirth-T_110_1)	Loss of Oldstreet Woodland 380	<250
Line (Bandon - Dunmanway_110_1)	Loss of Ballynahulla Knockanure 220	<250
Line (Cauteen - Killonan_110_1)	Loss of Cauteen - Tipperary 110 1	<250

Table D-1 Binding contingency and overloading lines in 2025 ECP (All) study

D.2. Year 2027

Line	Contingency Name	Hours Range
Line (Cushaling - Newbridge_110_1)	Loss of Mount Lucas - Thornsberry 110 1	2500-3000
Line (Kilnap - Knockraha_110_1)	Loss of Clashavoon Knockraha 220	2500-3000
Line (Ballyragget - Kilkenny_110_1)	Loss of Kellis Kilkenny 110 1	2000-2250
Line (Galway - Salthill_110_1)	Base	1750-2000
Line (Bellacorick - Moy_110_1)	Loss of Bellacorick-Castlebar 110 1	1250-1500
Line (Maynooth - Timahoe North_110_1)	Loss of Harristown - Dunfirth 110 1	1250-1500
Line (Lisheen - Thurles_110_1)	Base	1000-1250
Line (Flagford - Sligo_110_1)	Loss of Flagford-Srananagh 220 circuit 1	1000-1250
Line (Maynooth - Rinawade_110_1)	Loss of Maynooth - Timahoe North 110 1	1000-1250
Line (Drybridge - Louth_110_1)	Loss of Turleenan Woodland 380	1000-1250
Line (Flagford - Sligo_110_1)	Loss of Srananagh 220-110 2	1000-1250
Line (Great Island T2102)	Loss of Cullenagh-Great Island 220	750-1000
Line (Cushaling - Newbridge_110_1)	Loss of Philipstown - Portlaoise 110 1	750-1000
Line (Knockraha - Barrymore-T_110_1)	Loss of Killonan Knockraha 220	750-1000
Line (Arklow T2101)	Loss of Arklow 220-110 2	750-1000
Line (Great Island - Kellis_220_1)	Loss of Arklow Carrickmines 220 1	500-750
Line (Drybridge - Louth_110_1)	Loss of Gorman Louth 220	500-750
Line (Finglas - Mooretown_220_1)	Loss of Corduff Mooretown 220 1	500-750
Line (Maynooth - Timahoe North_110_1)	Loss of Cushaling Newbridge	500-750
Line (Blundelstown_Mullingar_110_1)	Loss of Clonfad - Kinnegad 110 1	500-750
Line (Clonee - Woodland_220_1)	Loss of Corduff Woodland 220 1	500-750
Line (Arklow T2101)	Loss of Lodgewood 220-110 1	500-750
Line (Corduff - Macetown_110_1)	Loss of Gorman (or Woodland) to Maynooth 220	500-750
Line (Cashla - Dalton_110_1)	Loss of Castlebar - Cloon 1	500-750
Line (Killoteran - Waterford_110_1)	Loss of Cullenagh-Great Island 220	250-500
Line (Rinawade - Dunfirth-T_110_1)	Loss of Corduff Blundelstown 110 1	250-500
Line (Maynooth - Shannonbridge_220_1)	Loss of Oldstreet Woodland 380	250-500
Line (Oldstreet - Tynagh_220_1)	Loss of Cashla-Tynagh 220	250-500
Line (Maynooth - Blake-T_110_1)	Loss of Oldstreet Woodland 380	250-500
Line (Rinawade - Dunfirth-T_110_1)	Loss of Maynooth - Timahoe North 110 1	250-500
Line (Kilnap - Knockraha_110_1)	Loss of Killonan Knockraha 220	250-500
Line (Galway - Knockranny A1_110_1)	Base	250-500
Line (Killoteran - Waterford_110_1)	Loss of Cullenagh-Waterford 110 1	250-500
Line (Arklow T2101)	Loss of Arklow Lodgewood 220	250-500
Line (Knockraha - Barrymore-T_110_1)	Loss of Cahir-Doon 110 1	250-500
Line (Great Island T2102)	Loss of Great Island 220-110 1	250-500
Line (Great Island T2102)	Loss of Cullenagh 220-110 1	250-500
Line (Cushaling - Newbridge_110_1)	Loss of Maynooth - Timahoe North 110 1	250-500
Line (Kellis - Kilkenny_110_1)	Loss of coolnabacky dunstown 380	250-500
Line (Cashla - Dalton_110_1)	Loss of Bellacorick-Moy 110 1	250-500
Line (Maynooth - Timahoe North_110_1)	Loss of Derryiron Kinnegad 110 1	250-500
Line (Athlone - Lanesboro_110_1)	Loss of Lanesboro - Mullingar 110 1	250-500
Line (Louth - Meath Hill_110_1)	Loss of Gorman Louth 220	250-500
Line (Carrickmines - Poolbeg_220_1)	Loss of Oldstreet Woodland 380	250-500

Line (Moneypoint T4202)	Loss of kilpaddoge moneypoint 3 - 380 or 220	250-500
Line (Dunstown T4202)	Loss of Oldstreet Woodland 380	250-500
Line (Cunghill - Sligo_110_1)	Loss of Bellacorick-Castlebar 110 1	250-500
Line (Carlow - Kellis_110_2)	Loss of Dunstown-Kellis 220	250-500
Line (Cathaleens Fall - Srananagh_110_1)	Loss of Cathleens Fall - Srananagh 110 2	250-500
Line (Cahir - Doon_110_1)	Loss of Cullenagh-Knockraha 220	250-500
Line (Corduff - Macetown_110_1)	Loss of Drybridge Gastkinstown 110 1	250-500
Line (Drybridge - Louth_110_1)	Loss of Arva Navan 110 1	250-500
Line (Great Island T2102)	Loss of Great Island - Lodgewood 220	250-500
Line (Kellis - Kilkenny_110_1)	Loss of Dunstown-Kellis 220	250-500
Line (Maynooth - Shannonbridge_220_1)	Loss of Coolnabacky Moneypoint 380	250-500
Line (Rinawade - Dunfirth-T_110_1)	Loss of Blundelstown Mullingar 110 1	250-500
Line (Ballynahulla - Glenlara_wind_110_1)	Base	250-500
Line (Maynooth - Timahoe North_110_1)	Loss of Rinawade Dunfirth T 110 1	<250
Line (Lisdrum - Lislea 110 1 newish)	Loss of Louth - Ratrussan 110 1	<250
Line (Cashla - Galway_110_2)	Loss of cashla galway 110 3	<250
Line (Cauteen - Killonan_110_1)	Loss of Cauteen - Tipperary 110 1	<250
Line (Cushaling - Newbridge_110_1)	Loss of Newbridge Treascon 110 1	<250
Line (Flagford - Sligo_110_1)	Loss of Carrick on Shannon - Arigna T 110 1	<250
Line (Cushaling - Newbridge_110_1)	Loss of Bracklone - Newbridge 110 1	<250
Line (Cashla - Galway_110_3)	Loss of cashla - galway 110 2	<250
Line (Lisdrum - Louth_110_1)	Loss of Louth - Ratrussan 110 1	<250
Line (Maynooth - Blake-T_110_1)	Loss of Castlebagot Maynooth 220 1	<250
Line (Cahir - Barrymore-T_110_1)	Loss of Cahir-Doon 110 1	<250
Line (Cathaleens Fall - Srananagh_110_2)	Loss of Cathleens Fall - Srananagh 110 1	<250
Line (Baroda - Monread_110_1)	Loss of Mount Lucas - Thornsberry 110 1	<250
Line (Great Island - Rosspile_110_1)	Loss of Arklow Carrickmines 220 1	<250
Line (Maynooth - Rinawade_110_1)	Loss of Corduff Blundelstown 110 1	<250
Line (Corduff - Macetown_110_1)	Loss of Corduff-Ryebrook 110 1	<250
Line (Inchicore - Irishtown_220_1)	Loss of Kellystown - Woodland 220	<250
Line (Athy - Carlow_110_1)	Loss of coolnabacky dunstown 380	<250
Line (Knockraha - Barrymore-T_110_1)	Loss of Ballydine - Mothel 110 1	<250
Line (Corduff - Macetown_110_1)	Loss of Castlebagot Maynooth 220 1	<250
Line (Knockraha - Barrymore-T_110_1)	Loss of Ballynahulla Knockanure 220	<250
Line (Clashavoon - Macroom_110_2)	Loss of Clashavoon Knockraha 220	<250
Line (Irishtown - Shellybanks_220_1)	Loss of Kellystown - Woodland 220	<250
Line (Dunstown T4201)	Loss of Oldstreet Woodland 380	<250
Line (Kellis - Kilkenny_110_1)	Loss of Arklow Carrickmines 220 1	<250
Line (Great Island - Kellis_220_1)	Loss of Great Island - Lodgewood 220	<250
Line (Great Island - Rosspile_110_1)	Loss of Great Island - Lodgewood 220	<250
Line (Drybridge - Louth_110_1)	Loss of Garballagh Platin 110 1	<250
Line (Knockraha - Barrymore-T_110_1)	Loss of Cullenagh-Knockraha 220	<250
Line (Kilteel - Maynooth_110_1)	Loss of Baroda Newbridge 110 1	<250
Line (Corduff - Macetown_110_1)	Loss of Louth-Oriel (Woodland) 220	<250

Table D-2 Binding contingency and overloading lines in 2027 ECP (All) study

D.3. Year 2027 + 4.4 GW Offshore Study

Line	Contingency Name	Hours Range
Line (Kilnap - Knockraha_110_1)	Loss of Clashavoon Knockraha 220	3750-4000
Line (Belcamp - Finglas_220_1)	Loss of North Wall - Poolbeg 220	2500-3000
Line (Ballyragget - Kilkenny_110_1)	Loss of Kellis Kilkenny 110 1	2500-3000
Line (Cushaling - Newbridge_110_1)	Loss of Mount Lucas - Thornsberry 110 1	1750-2000
Line (Inchicore - Poolbeg_220_1)	Loss of Inchicore Poolbeg 220 2 - 349mva	1750-2000
Line (Cushaling - Newbridge_110_1)	Loss of Philipstown - Portlaoise 110 1	1500-1750
Line (Belcamp - Finglas_220_1)	Loss of Finglas - North Wall 220	1500-1750
Line (Great Island - Lodgewood_220_1)	Loss of Arklow Carrickmines 220 1	1250-1500
Line (Flagford - Sligo_110_1)	Loss of Flagford-Srananagh 220 circuit 1	750-1000
Line (Flagford - Sligo_110_1)	Loss of Srananagh 220-110 2	750-1000
Line (North Wall - Poolbeg_220_1)	Base	750-1000
Line (Finglas - Mooretown_220_1)	Loss of Corduff Mooretown 220 1	750-1000
Line (Maynooth - Rinawade_110_1)	Loss of Maynooth - Timahoe North 110 1	750-1000
Line (Drybridge - Louth_110_1)	Loss of Turleenan Woodland 380	500-750
Line (Arklow T2101)	Loss of Arklow Lodgewood 220	500-750
Line (Knockraha - Barrymore-T_110_1)	Loss of Cahir-Doon 110 1	500-750
Line (Knockraha - Barrymore-T_110_1)	Loss of Killonan Knockraha 220	500-750
Line (Maynooth - Timahoe North_110_1)	Loss of Harristown - Dunfirth 110 1	250-500
Line (Great Island T2102)	Loss of Cullenagh-Great Island 220	250-500
Line (Galway - Salthill_110_1)	Base	250-500
Line (Killoteran - Waterford_110_1)	Loss of Cullenagh-Waterford 110 1	250-500
Line (Finglas - North Wall_220_1)	Base	250-500
Line (Cahir - Barrymore-T_110_1)	Loss of Cahir-Doon 110 1	250-500
Line (Cathaleens Fall - Srananagh_110_1)	Loss of Cathleens Fall - Srananagh 110 2	250-500
Line (Bellacorick - Moy_110_1)	Loss of Bellacorick-Castlebar 110 1	250-500
Line (Great Island T2102)	Loss of Great Island 220-110 1	250-500
Line (Great Island - Rosspile_110_1)	Loss of Great Island - Lodgewood 220	250-500
Line (Great Island - Rosspile_110_1)	Loss of Arklow Carrickmines 220 1	250-500
Line (Lisheen - Thurles_110_1)	Base	250-500
Line (Great Island - Kellis_220_1)	Loss of Arklow Carrickmines 220 1	250-500
Line (Kellis - Kilkenny_110_1)	Loss of Dunstown-Kellis 220	250-500
Line (Carrickmines - Irishtown_220_1)	Loss of Great Island - Lodgewood 220	250-500
Line (Killoteran - Waterford_110_1)	Loss of Cullenagh-Great Island 220	250-500
Line (Clashavoon - Macroom_110_2)	Loss of Clashavoon Knockraha 220	250-500
Line (Kilnap - Knockraha_110_1)	Loss of Killonan Knockraha 220	250-500
Line (Great Island T2102)	Loss of Cullenagh 220-110 1	250-500
Line (Cathaleens Fall - Srananagh_110_2)	Loss of Cathleens Fall - Srananagh 110 1	250-500
Line (Oldstreet - Tynagh_220_1)	Loss of Cashla-Tynagh 220	250-500
Line (Arklow T2101)	Loss of Lodgewood 220-110 1	250-500
Line (Crane - Wexford_110_1)	Loss of Great Island - Lodgewood 220	250-500
Line (Great Island T2102)	Loss of Great Island - Lodgewood 220	250-500
Line (Kilteel - Maynooth_110_1)	Loss of Baroda Newbridge 110 1	250-500
Line (Carrickmines - Poolbeg_220_1)	Loss of Oldstreet Woodland 380	250-500
Line (Maynooth - Blake-T_110_1)	Loss of Oldstreet Woodland 380	250-500

Line (Drumline - Ennis_110_1)	Loss of Ardnacrusha - Ennis 110 1	<250
Line (Maynooth - Timahoe North_110_1)	Loss of Rinawade Dunfirth T 110 1	<250
Line (Maynooth - Timahoe North_110_1)	Loss of Cushaling Newbridge	<250
Line (Irishstown - Shellybanks_220_1)	Loss of Kellystown - Woodland 220	<250
Line (Crane - Wexford_110_1)	Loss of Arklow Carrickmines 220 1	<250
Line (Kellis - Kilkenny_110_1)	Loss of coolnabacky dunstown 380	<250
Line (Athlone - Lanesboro_110_1)	Loss of Cashla-Flagford 220	<250
Line (Cashla - Dalton_110_1)	Loss of Bellacorick-Moy 110 1	<250
Line (Corduff - Macetown_110_1)	Loss of Corduff-Ryebrook 110 1	<250
Line (Carrickmines - Irishstown_220_1)	Base	<250
Line (Ballyragget - Kilkenny_110_1)	Loss of Dunstown-Kellis 220	<250
Line (Corduff - Macetown_110_1)	Loss of Drybridge Gastkinstown 110 1	<250
Line (Flagford - Sligo_110_1)	Loss of Carrick on Shannon - Arigna T 110 1	<250
Line (Carrickmines - Poolbeg_220_1)	Loss of Carrickmines Irishstown 220	<250
Line (Drybridge - Louth_110_1)	Loss of Gorman Louth 220	<250
Line (Inchicore - Poolbeg_220_1)	Loss of Carrickmines Irishstown 220	<250
Line (Inchicore - Irishstown_220_1)	Base	<250
Line (Rinawade - Dunfirth-T_110_1)	Loss of Corduff Blundelstown 110 1	<250
Line (Tralee - Oughtragh-T_110_1)	Loss of Ballyvouskil Clashavoon 220	<250
Line (Louth - Meath Hill_110_1)	Loss of Gorman Louth 220	<250
Line (Cauteen - Killonan_110_1)	Loss of Cauteen - Tipperary 110 1	<250
Line (Baltrasna - Corduff_110_1)	Loss of Drybridge Gastkinstown 110 1	<250
Line (Athy - Carlow_110_1)	Loss of Dunstown-Kellis 220	<250
Line (Irishstown - Shellybanks_220_1)	Loss of Oldstreet Woodland 380	<250
Line (Cathaleens Fall - Srananagh_110_2)	Loss of Cathaleens Fall - Corraclassy 110 1	<250
Line (Killoteran - Waterford_110_1)	Loss of Great Island - Lodgewood 220	<250
Line (Carlow - Kellis_110_2)	Loss of Dunstown-Kellis 220	<250
Line (Knockraha - Barrymore-T_110_1)	Loss of Ballydine - Mothel 110 1	<250

Table D-3 Binding contingency and overloading lines in 2027 ECP (All) + 4.4 GW Offshore study

Abbreviation and Terms

Active Power

The product of voltage and the in-phase component of alternating current measured in Megawatts (MW). When compounded with the flow of 'reactive power', measured in Megavolt-Amperes Reactive (Mvar), the resultant is measured in Megavolt-Amperes (MVA).

Busbar

The common connection point of two or more circuits.

Capacity Factor

The capacity factor of a generator is the ratio of the actual electrical energy output over a given period of time to the maximum possible electrical energy output over that period.

$$\text{Capacity Factor} = \frac{\text{Energy Output}}{\text{Hours per year} * \text{Installed Capacity}}$$

Combined Cycle Gas Turbine (CCGT)

This is a type of thermal generator that typically uses natural gas as a fuel source. It is a collection of gas turbines and steam units; where waste heat from the gas turbines(s) is passed through a heat recovery boiler to generate steam for the steam turbines.

Commission for Regulation of Utilities (CRU)

The CRU is the regulator for the electricity, natural gas and public water sectors in Ireland.

Constraint

The reduction in output of a generator due to network limits. Usually, constraints are local to a transmission bottleneck.

Contingency

The unexpected failure or outage of a system component, such as a generation unit, transmission line, transformer or other electrical element. The transmission network is operated safe against the possible failure or outage of any system component. Hence, contingency usually refers to the possible loss of any system component. A contingency may also include multiple components, when these are subject to common cause outages.

Curtailement

Curtailement is when the transmission system operators EirGrid and SONI ask generation to reduce their output to ensure system security is maintained. Usually, curtailement is shared across the whole system.

Demand

The amount of electrical power that customers consume and which is measured in Megawatts (MW). In a general sense, the amount of power that must be transported from transmission network connected generation stations to meet all customers' electricity requirements.

Dispatch Balancing Costs (DBC)

Dispatch Balancing Costs refers to a number of payments related to the differences between generators' market position and their actual output. They include Constraint Payments, Uninstructed Imbalance Payments and Generator Testing Charges. The Transmission System Operators (TSOs) are responsible for forecasting and managing Dispatch Balancing Costs.

Enduring Connection Policy (ECP)

The Commission for Regulation of Utilities (CRU) has put in place a revised approach to issuing connection offers to generators. This approach is called the Enduring Connection Policy (ECP). With ECP, it is envisaged that batches of generator connection offers will issue on a periodic basis.

Enduring Connection Policy - 2 (ECP-2)

ECP-2 is the second stage of the CRU's development of enduring connection policy in Ireland. In June 2020 the CRU published their decision on ECP-2, this decision set policy for at least three batches of connection offers (ECP-2.1, ECP-2.2 and ECP-2.3).

Forced Outage Probability (FOP)

This is the statistical probability that a generation unit will be unable to produce electricity for non-scheduled reasons due to the failure of either the generation plant or supporting systems. Periods, when the unit is on scheduled outage, are not included in the determination of forced outage probability.

Generation Dispatch

This is the configuration of outputs from the connected generation units.

Interconnector

The electrical link, facilities and equipment that connect the transmission network of one power market to another.

Loadflow

Study carried out to simulate the flow of power on the transmission system given a generation dispatch and system load.

A DC loadflow is a study, which uses simplifying assumptions in relation to voltage and reactive power. DC loadflow studies are used as part of an overarching study. For example, Plexos uses DC loadflow because it is performing studies for every hour of every study year and is performing a large optimisation calculation for each of these.

Maximum Export Capacity (MEC)

The maximum export value (MW) provided in accordance with a generator's connection agreement. The MEC is a contract value that the generator chooses as its maximum output.

Megawatt (MW) and Gigawatt (GW)

Unit of power: 1 megawatt = 1,000 kilowatts = 10^6 joules / second

1 gigawatt = 1,000 megawatts

Megawatt Hour (MWh), Gigawatt Hour (GWh) and Terawatt Hour (TWh)

Unit of energy: 1 megawatt hour = 1,000 kilowatt hours = 3.6×10^9 joules

1 gigawatt hour = 1,000 megawatt hours

1 terawatt hour = 1,000 gigawatt hours

Operational Constraints/Limits

In order to operate a safe, secure and stable electricity system, the TSO must operate the system within certain operational constraints/limits which include; maximum SNSP, maximum RoCoF, minimum level of system inertia, minimum number of conventional units, minimum levels of reserve.

Conventional generator "must run" rules to ensure adequate system voltage and power flow control

Over-supply

Reduction of renewable generation to a level below its availability for over-supply reasons is necessary when the total available generation exceeds system demand plus interconnector export flows. Over-supply is applied through market processes prior to dispatch or balancing actions taken by the transmission system operator such as curtailment and constraint.

Plexos

Plexos is a commercially available power system simulation tool used in this study to evaluate over supply, curtailment and constraint. Plexos is a detailed generation and transmission analysis program that has been widely used in the electricity industry for many years.

Rate of Change of Frequency (RoCoF)

As low inertia non-synchronous generators displace high inertia synchronous generators in system dispatch, then the system gets lighter. Then, for the loss of a large infeed (e.g. trip of an interconnector or generator), the system frequency will change more quickly.

RoCoF is the agreed limit to which the system is agreed to be operated and which generators, demand and system protection schemes are expected to manage. In Ireland, the TSOs are proposing to increase the RoCoF

value. This will allow more renewable generation and may require confirmation by participants that they can meet the proposed RoCoF.

Short Run Marginal Cost (SRMC)

The instantaneous variable cost for a power plant to provide an additional unit of electricity, i.e. the cost of each extra MW it could produce excluding its fixed costs. The SRMC reflects the opportunity cost of the electricity produced, which is the economic activity that the generator forgoes to produce electricity. For example, in the case of a generator fuelled by gas, the opportunity cost includes the price of gas on the day that it is bidding in because if the generator is not producing electricity it could sell its gas in the open market.

System Non-Synchronous Penetration (SNSP)

The introduction of large quantities of non-synchronous generators such as solar and wind poses challenges to a synchronous power system. For Ireland, a system non-synchronous penetration (SNSP) ratio is defined to help identify the system operational limits. The present allowable ratio is 75% but future system services arrangements and proposed amendments to system operation are expected to allow SNSP to increase in future years.

Total Dispatch Down

For the purpose of this report Total Dispatch Down is equivalent to the sum of over-supply (generation self reduction due to market position), plus curtailment (re-dispatch due to system operational constraints), plus constraint (re-dispatch due to network limitations).

Total Electricity Requirement (TER)

TER is the total amount of electricity required by a country. It includes all electricity exported by generating units, as well as that consumed on-site by self-consuming electricity producers, e.g. CHP.

Transmission Peak

The peak demand that is transported on the transmission network. The transmission peak includes an estimate of transmission losses.

Transmission System

The transmission system is a meshed network of high-voltage lines and cables (400 kV, 275 kV, 220 kV and 110 kV) for the transmission of bulk electricity supply around Ireland and Northern Ireland.

Transmission System Operator (TSO)

In the electrical power business, a transmission system operator is the licensed entity that is responsible for transmitting electrical power from generation plants to regional or local electricity distribution operators and Large Energy Users connected at the transmission level.

Upgrading

A network reinforcement solution whereby an existing circuit's rating can be increased. This is achieved by increasing ground clearances and/or replacing conductor, together with any changes to terminal equipment, support structures and foundations.

Winter Peak

This is the maximum annual system demand. Historically this occurs in the winter period October to February, inclusive in Ireland and in the period November to February in Northern Ireland.

References

Enduring Connection Policy

<http://www.eirgridgroup.com/customer-and-industry/becoming-a-customer/generator-connections/enduring-connection-polic/>

Generation Capacity Statement

<http://www.eirgridgroup.com/site-files/library/EirGrid/208281-All-Island-Generation-Capacity-Statement-LR13A.pdf>

Reinforcement Projects

<http://www.eirgridgroup.com/the-grid/projects/>

<http://www.soni.ltd.uk/the-grid/projects/>

All-Island Ten Year Transmission Forecast Statement 2020

<https://www.eirgridgroup.com/site-files/library/EirGrid/All-Island-Ten-Year-Transmission-Forecast-Statement-2020.pdf>

Tomorrows Energy Scenarios

<http://www.eirgridgroup.com/site-files/library/EirGrid/EirGrid-TES-2019-Report.pdf>

Generator Information

<http://www.eirgridgroup.com/how-the-grid-works/renewables/>

<https://www.esbnetworks.ie/new-connections/generator-connections/generator-connection-statistics>

Shaping Our Electricity Future

<https://www.eirgridgroup.com/site-files/library/EirGrid/Full-Technical-Report-on-Shaping-Our-Electricity-Future.pdf>