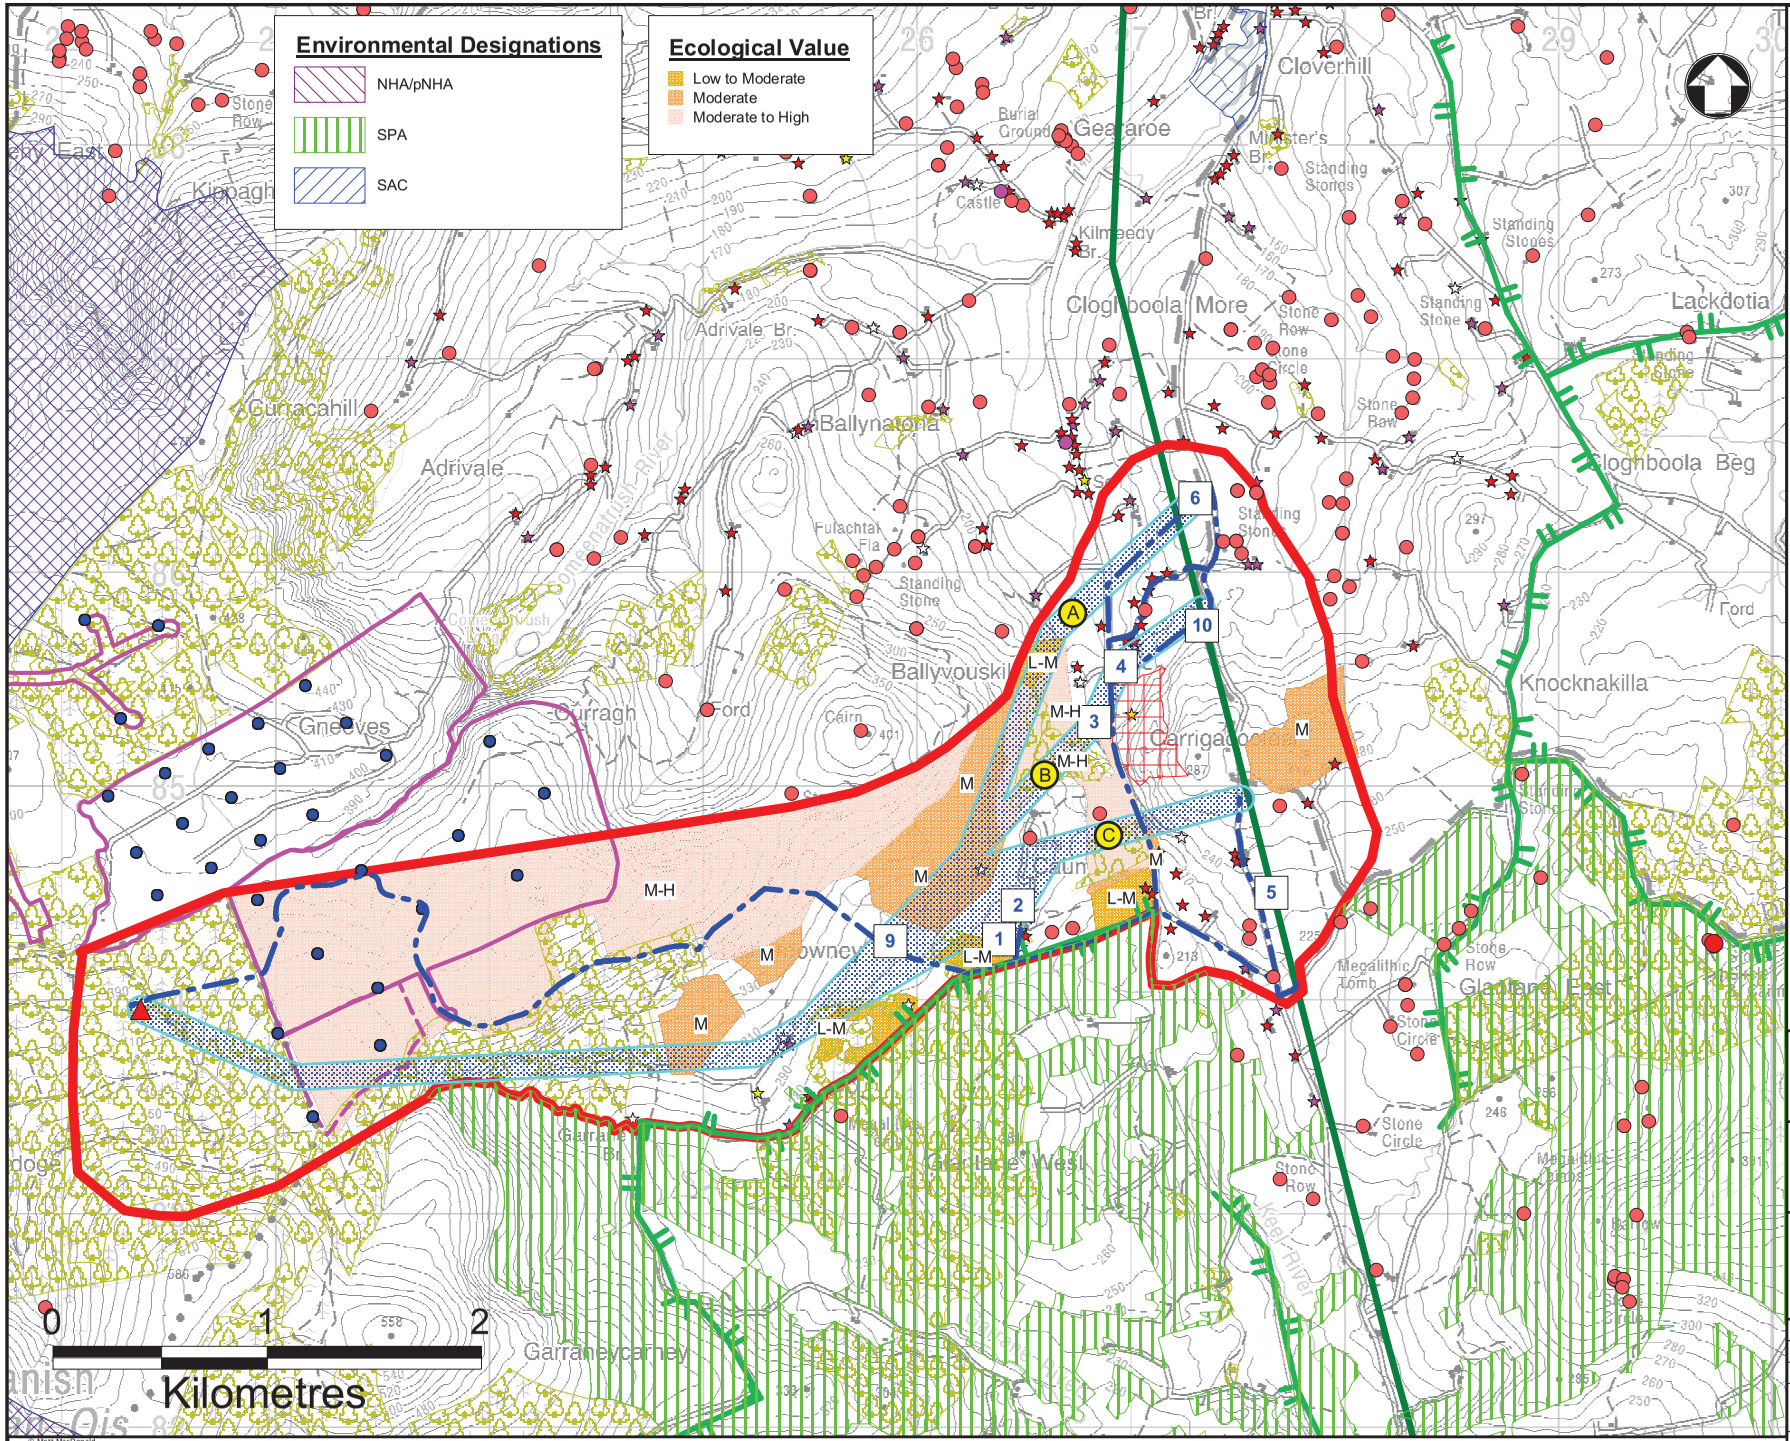

LEGEND

- Study Area
- Garrow Substation
- Existing Clashavoon - Tarbert 220kV Transmission Line
- Potential Substation Site
- Designated Scenic Landscape
- Scenic Route
- Forestry

Cultural Heritage Sites

- National Monuments
- Records of Monuments & Places
- Records of Protected Structures

GeoDirectory Data

(Data Sourced from An Post)

- Residential
- Commercial
- Both Residential & Commercial
- Unknown
- Caherdowney Windfarm (Permitted)
- Curragh, Gneeves & Coomachee Windfarms (Constructed)
- Quarry
- Wind Turbine
- Overhead Line Corridor
- Underground Cable

Mott MacDonald
South Block
Rockfield, Dundrum
Dublin, 16
Ireland
+353 01-2916700
+353 01-2916747
www.mottmac.com

Clien

EIRGRID
160 Shelbourne Road,
Ballsbridge,
Dublin 4.
www.eirgrid.com

Project

Route Corridor
Environmental Constraints
Figure 5.1

Designed	-		Eng. Chk.	-	
Drawn	DG		Coordination	PK	
Drg. Chk.	DH		Approved	PK	
Scale at A3	1:25,000	Project	261715	Status	INF
		Mapinfo file	261715-N-007		
Drawing Number	MMD-261715-N-MI-007			Rev	P1

© Mott MacDonald

This document should not be relied on or used in circumstances other than those for which it was originally prepared and for which Mott MacDonald was commissioned. Mott MacDonald accepts no responsibility for this document to any other party other than the person by whom it was commissioned.

Ordnance Survey Ireland Licence No. EN0034509
©Ordnance Survey Ireland/Government of Ireland

P:\Dublin\MPD\261715 Eirgrid-Ballyvouskill 220 kV substation\15.0 CAD\Working Drawings\Environmental\Mapinfo\Workspaces\.