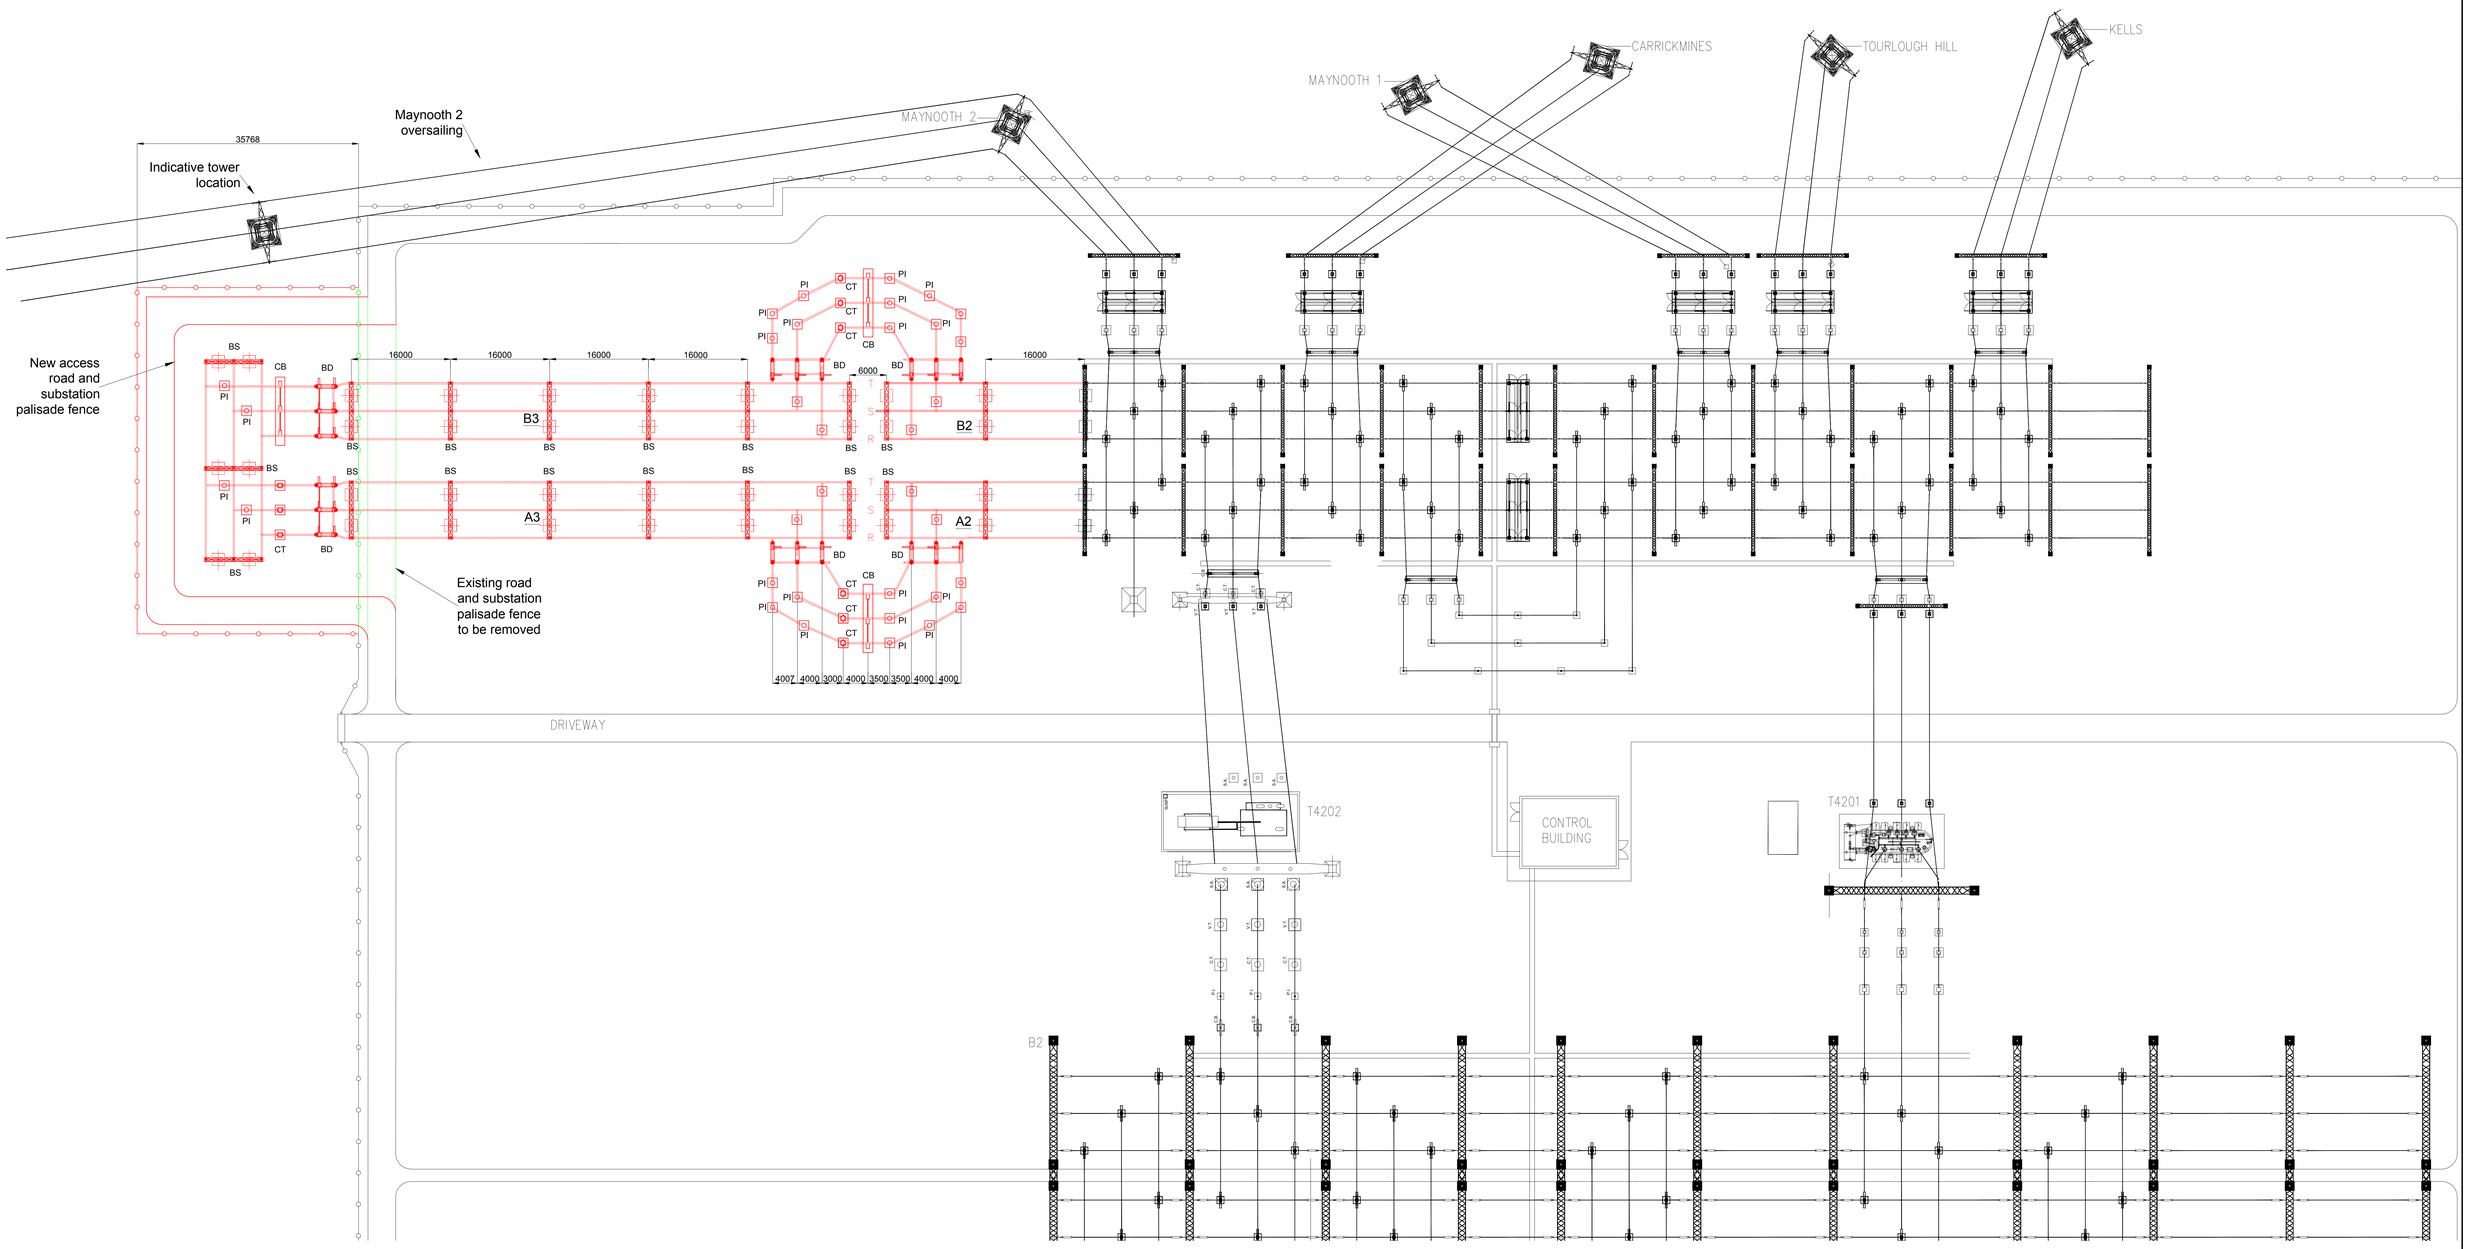

NOTES

1. This drawing is for development purposes.
2. The C-section extention is based on Eirgrid drawing PG406-D020-123-001

LEGEND

- Existing
- New
- To be removed
- Work by others

DL/DE - Line Disconnector/Earth
VT - Voltage Transformer
CT - Current Transformer
PI - Post Insulator
SH RX - Shunt Reactor
SA - Surge Arrestor
CB - Circuit Breaker
CSE - Cable Sealing End

REFERENCE DRAWINGS

Dunstown layout: 229100465-MMD-02-XX-M2-E-1110

Rev	Rev. Date	Purpose of revision	Drawn	Checkd	Rev'd	Apprv'd
B	31.03.2020	Amendments made to suit new deliverables	NS	SB	IJ	FL
A	09.01.20	Draft Issue	NS & SJ	SB	IJ	FL

© Copyright 2018 Jacobs U.K. Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of Jacobs' Client, and is subject to, and issued in accordance with, Jacobs' contract with the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.

JACOBS
95 Bothwell St, Glasgow, G2 7HX
Tel:+44(0)141 243 8000 Fax:+44(0)141 226 3109
www.jacobs.com

Client: EIRGRID

Project: EIRGRID CP966

Drawing title: DUNSTOWN 220kV C - TYPE EXTENSION

Drawing status: PRELIMINARY

Scale	1:350 @ A0	DO NOT SCALE
Jacobs No.	321084AE	Rev B
Client no.		

Drawing number: 321084AE-LAY-003

C:\Users\SmithN10\OneDrive - Jacobs\Eirgrid\Project\Deliverables\Drawings\D 2 Current\321084AE-LAY-003 - Dunstown 220kV C Type Extension Rev B.dwg - 31/03/2020 17:56:45 - A1 - SMITHN10