


C:\Users\Smith\10\Drawings - Jacobs\Eng\Project\Deliverables\Drawings\2.0 Current\321084AE-LAY-006 - Dunstons 400kV CHL RevA.dwg 31/03/2020 12:22:19 A1 - SMITH\10

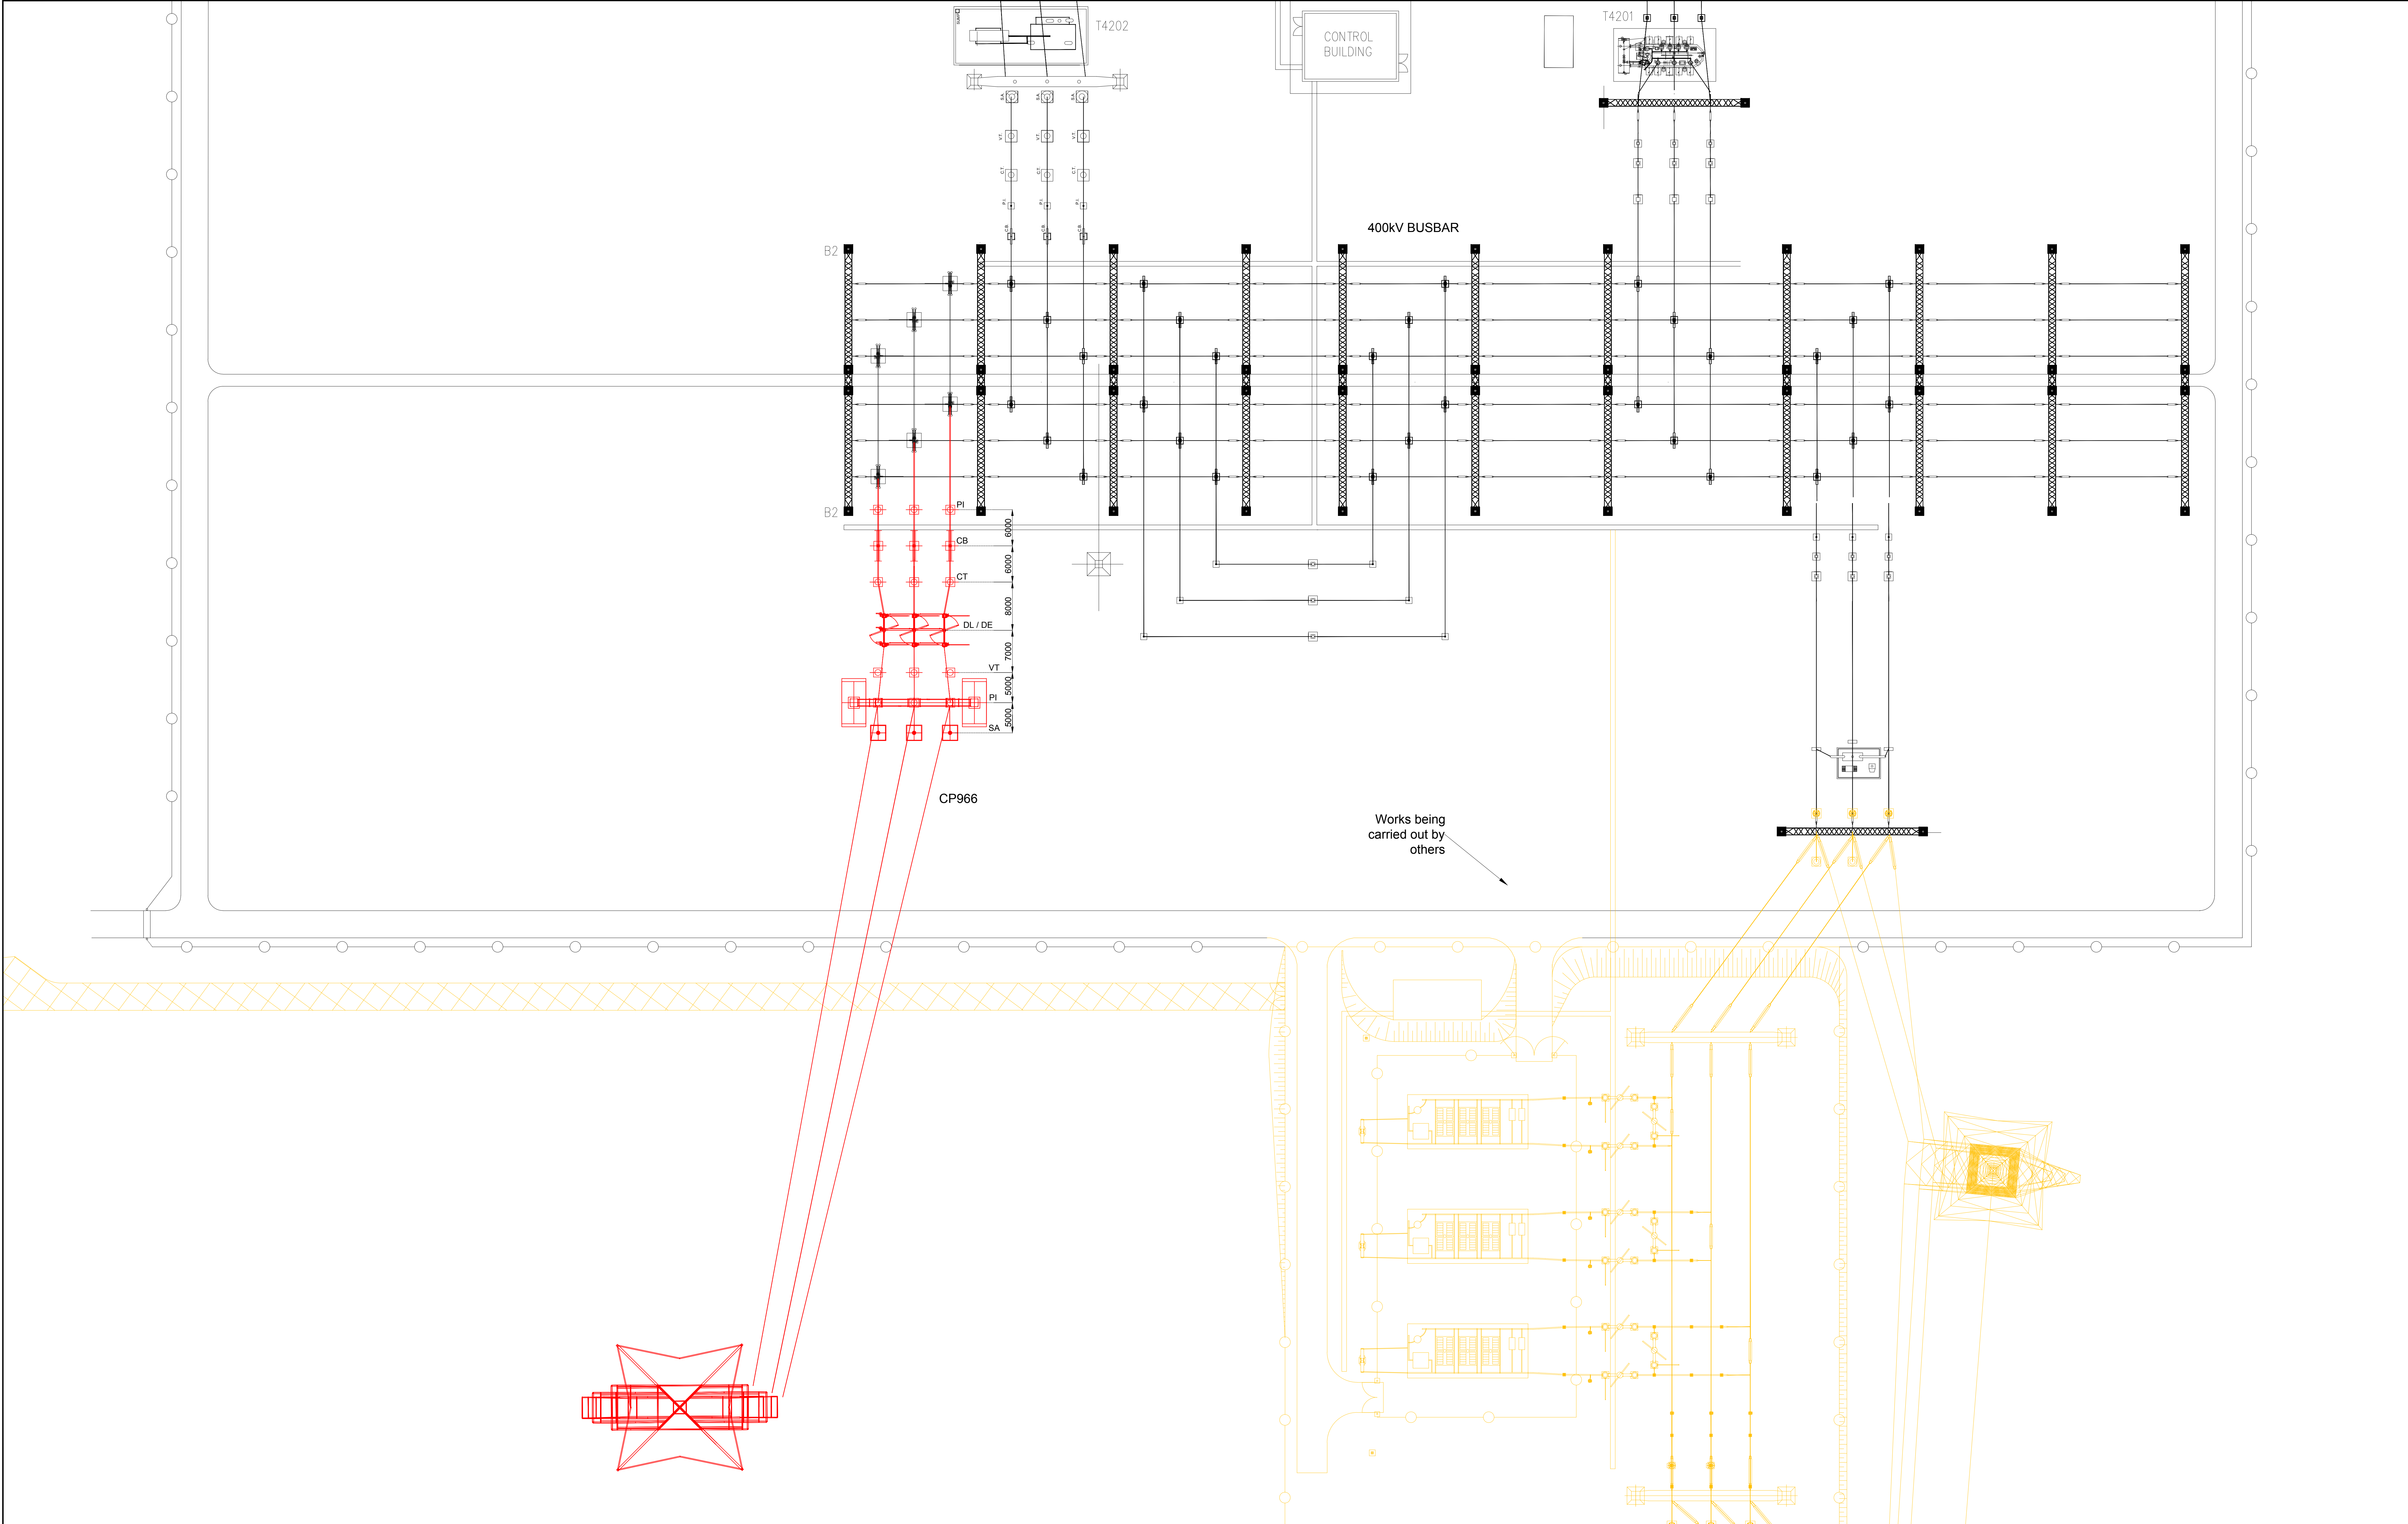

NOTES

1. This drawing is for development purposes.

LEGEND

- Existing
 - New
 - To be removed
 - Work by others
- DL/DE - Line Disconnector/Earth
VT - Voltage Transformer
CT - Current Transformer
PI - Post Insulator
SA - Surge Arrestor
CB - Circuit Breaker

REFERENCE DRAWINGS

Dunstons layout: 228100465-MMD-02-XX-M2-E-1110



EIRGRID CP966

DUNSTONS 400kV
CP966 400kV
OVERHEAD LINE OPTION

Drawing status: PRELIMINARY
Scale: 1:350 @ A0
Drawing No: 321084AE
Client no: 321084AE-LAY-006
Rev: A

Rev	Rev. Date	Purpose of revision	Drawn	Checked	Rev'd	Approved
A	09.01.20	Draft issue	NS	SJ	SR	U