





# Disclaimer

EirGrid and SONI have followed accepted practice in the collection and analysis of data available. While all reasonable care has been taken in the preparation of this statement, EirGrid and SONI/NIE Networks are not responsible for any loss that may be attributed to the use of this information. Prior to taking business decisions, interested parties are advised to seek separate and independent opinion in relation to the matters covered by this statement and should not rely solely upon data and information contained herein. Information in this document does not amount to a recommendation in respect of any possible investment. This document does not purport to contain all the information that a prospective investor or participant in the wholesale electricity market may need. Furthermore, all interested parties are strongly advised to channel any enquiries through EirGrid and SONI.

This document incorporates the Transmission System Capacity Statement for Northern Ireland and the Transmission Forecast Statement for Ireland.

For queries relating to this document or to request a copy contact: enquiries@soni.ltd.uk or info@eirgrid.com

#### **COPYRIGHT NOTICE**

All rights reserved. This entire publication is subject to the laws of copyright. This publication may not be reproduced or transmitted in any form or by any means, electronic or manual, including photocopying without the prior written permission of EirGrid and SONI.

©SONI Ltd 2018

12 Manse Rd, Belfast, BT6 9RT, N. Ireland

©EirGrid Plc 2018

The Oval, 160 Shelbourne Road, Ballsbridge, Dublin 4, Ireland

# Table of contents

Foreword		1
Documen	t Structure	2
Abbreviat	tion and Terms	3
Executive	Summary	11
1. Introdu	ıction	14
1.1.	Governing Arrangements	17
1.2.	Grid Development Strategy	18
1.3.	Data Management	18
1.4.	Other Information	19
1.5.	Publication	20
2. The Ele	ectricity Transmission System	22
2.1.	Overview of the All-Island Electricity Transmission System	24
2.2.	Existing Connections Between Ireland and	
	Northern Ireland Transmission Systems	26
2.3.	Interconnection with Great Britain and Europe	
2.4.	Ireland Transmission System Developments	29
2.5.	Northern Ireland Transmission System Developments	37
2.6.	Joint Ireland and Northern Ireland Approved Transmission System Developments	41
2.7.	Connection of New Generation Stations	42
2.8.	Connection of New Interface Stations	43
2.9.	Detailed Transmission Network Information	43
3. Deman	rd	44
3.1.	All-Island, Ireland and Northern Ireland Peak Transmission Demand	46
3.2.	Demand Data	48
3.3.	Forecast Demand at Transmission Interface Stations in Ireland	51
3.4.	Northern Ireland Bulk Supply Point (BSP) Demand	52
4. Genera	ation	54
4.1.	Generation in Ireland	56
4.2.	Generation in Northern Ireland	61
5. Transm	nission System Performance	68
5.1.	Forecast Power Flows	70
5.2.	Compliance with Planning Standards	71
5.3.	Short Circuit Current Levels	72
6. Overvi	ew of Transmission System Capability Analyses	78
6.1.	All-Island Demand Opportunity Analysis	80
6.2.	All-Island Generator Opportunity Analysis	85
6.3.	Factors Impacting On Results	88

7. Transmission System Capability for New Generation	90
7.1. Background	92
7.2. New Generation Capacity	92
7.3. Generation Opportunity	93
7.4. Generation Locational Signals and Their Impact on Transmission Network Capacity	95
7.5. Assumptions Behind the TLAF and GTUoS Models	98
7.6. How to Use the Information for Generation	99
8. Transmission System Capability for New Demand	100
8.1. Transmission System Demand Capability Obligations	102
8.2. All-Island Transmission System Capability for New Demand	102
8.3. Opportunities for New Demand in the Dublin Area	104
8.4. Transmission System Capability for New Demand in Ireland	110
8.5. Controllable Demand	113
8.6. Transmission System Capability for New Demand in Northern Ireland	114
8.7. How to Use the Information for Demand	115
Appendix A – Maps and Schematic Diagrams	118
A.1. Network Maps	120
A.2. Short Bus Codes	123
A.3. Schematic Diagrams of the All Island Transmission System	127
Appendix B – Transmission System Characteristics	130
B.1. Characteristics of the Existing Transmission System (Summer 2017	134
B.2. Transmission System Developments	157
Appendix C – Demand Forecasts at Individual Transmission Interface Stations	166
Appendix D – Generation Capacity and Dispatch Details	186
D.1. Generation Capacity Details	188
D.2. Generation Dispatch Details	200
Appendix E – Short Circuit Currents	212
E.1. Background of Short Circuit Currents	214
E.2. Short Circuit Current Calculation Methodology	216
E.3. Short Circuit Currents in Ireland	217
E.4. Short Circuit Currents in Northern Ireland	248
Appendix F – Approaches to Consultation	262
F.1. EirGrid Approach to Consultation	264
F.2. SONI Approach to Consultation	264
Appendix G – References	266
Appendix H – Power Flow Diagrams	270
H.1. Guide to the Power Flow Diagrams	272



# Foreword

EirGrid and SONI, as the transmission system operators (TSOs) for Ireland and Northern Ireland respectively, have collaborated to produce this all-island Ten Year Transmission Forecast Statement (TYTFS).

This statement has been prepared in accordance with the provisions of Section 38 of the Electricity Regulation Act, 1999 (EirGrid) and Condition 33 of SONI's TSO licence.

TYTFS 2017 presents the most up-to-date available transmission system information at the data freeze date of July 2017.

This statement shows that data centres now represent significant demand connections in Ireland. Based on customer enquiries, a large portion of these data centres plan to connect in the Dublin area. Depending on the level of demand from these connections, new large scale generation, transmission solutions, demand side response and/or storage will be required in the Dublin area to accommodate the further demand increases and ensure continued security of supply.

The system needs in the north Dublin area are dynamic due to the connection of these new large scale demand customers combined with potential changes in the connected generation portfolio.

In response to this we have confirmed the need for investment in the greater Dublin area. We are progressing two projects: Capital Project 966 and Capital Project 1021 which together reinforce the Dublin region. These projects are being developed in line with our revised consultation and engagement process which is outlined in our "Have Your Say" document. This is available on the EirGrid website.<sup>1</sup>

The opportunities to connect new large scale demand in Northern Ireland are dependent on the completion of the planned North – South 400 kV tie line. This tie line development will increase security of supply to Northern Ireland and on the island. It will also support realising the benefits, and the further development, of renewable power generation and provide economic benefits to customers on the island.

The results presented in the TYTFS highlight new generation opportunities in the east of the island, and in particular in the east of Northern Ireland and in north Dublin. The results also show that future generation connections in the North-West, West and South-West regions would require network reinforcements.

Those who are considering connecting generation or demand to the transmission systems of Ireland or Northern Ireland should contact us at <a href="mailto:info@eirgrid.com">info@eirgrid.com</a> or <a href="mailto:enquiries@soni.ltd.uk">enquiries@soni.ltd.uk</a>.

We hope you find this document informative and we welcome any feedback and suggestions.



Mark Foley Chief Executive, EirGrid Group



Robin McCormick General Manager, SONI and Executive Director Operations, Planning & Innovation, EirGrid Group

# **Document Structure**

This document contains an Abbreviations and Terms section, an Executive Summary, eight main sections and eight appendices. The structure of the document is as follows:

The **Abbreviations and Terms** provides a list of abbreviations and terms used in the document.

The **Executive Summary** gives an overview of the main highlights of the document.

**Chapter 1: Introduction:** presents the purpose and context of the All-Island Transmission Forecast Statement. Our statutory and legal obligations are also introduced.

**Chapter 2: The Electricity Transmission System:** describes the existing all-island transmission system. A brief outline of transmission system development plans for both Ireland and Northern Ireland is also given.

**Chapter 3: Demand:** describes the demand forecast assumptions over the study period of 2017 – 2026.

**Chapter 4: Generation:** describes the projected generation connection assumptions over the study period of 2017 – 2026.

**Chapter 5: Transmission System Performance:** provides information on power flow and short circuit study results.

**Chapter 6: Overview of Transmission System Capability Analysis:** outlines the analysis methods used to carry out the demand and generation opportunities' analyses.

**Chapter 7: Transmission System Capability for New Generation:** describes the opportunities for connection of new generation on the all-island transmission system.

**Chapter 8: Transmission System Capability for New Demand:** describes the opportunities for connection of new demand on the all-island transmission system.

**Appendix A: Maps and Schematic Diagrams** 

**Appendix B: Transmission System Characteristics** 

Appendix C: Demand Forecasts at Individual Transmission Interface Stations

**Appendix D: Generation Capacity and Dispatch Details** 

**Appendix E: Short Circuit Currents** 

**Appendix F: Additional Information on Opportunities** 

**Appendix G: References** 

**Appendix H: Power Flow Diagrams** 

# Abbreviations and terms

#### **Abbreviations**

AC Alternating Current

ACS Average Cold Spell

ATR Associated Transmission Reinforcement

BETTA The British Electricity Trading and Transmission Arrangements

BSP Bulk Supply Point

CAES Compressed Air Energy Storage

CCGT Combined Cycle Gas Turbine

CER Commission for Energy Regulation

CHP Combined Heat and Power

DC Direct Current / Double Circuit

DCCAE Department of Communications, Climate Action and Environment

DfE Department for the Economy

DO Distillate Oil

DSM Demand Side Management

DSO Distribution System Operator

EIDAC EirGrid Interconnector DAC

ESB Electricity Supply Board

ESRI Economic and Social Research Institute

EU European Union

FAQ Firm Access Quantity

GCS Generation Capacity Statement

GIS Gas Insulated Switchgear

HFO Heavy Fuel Oil

HVDC High Voltage Direct Current

IA Interconnector Administrator

IME Internal Market for Electricity

IMP Independent Market Participant

IPP Independent Power Producer

IRL Ireland

ITC Incremental Transfer Capability

kV Kilo Volts

LFG Land Fill Gas

MIL Moyle Interconnector Limited

MCR Maximum Continuous Rating

MEC Maximum Export Capacity

MIC Maximum Import Capacity

MVA Megavolt-Amperes

MW Megawatt

NI Northern Ireland

NIE Northern Ireland Electricity Networks

NTC Net Transfer Capacity

PPB Power Procurement Business

PU Per Unit

PST Phase Shifting Transformer

RES Renewable Energy Schemes

RIDP Renewable Integration Development Project

RMS Root Mean Square

RP Review Period

SEM Single Electricity Market

SONI System Operator for Northern Ireland

SPS Special Protection Scheme

SVC Static Var Compensator

SP Summer Peak

SS Substation

SV Summer Valley

TDP Transmission Development Plan

TYTFS Ten Year Transmission Forecast Statement

TRM Transfer Reserve Margin

TSO Transmission System Operator

TTC Total Transfer Capacity

TX Transformer

WFPS Wind Farm Power Station

WP Winter Peak

#### **Terms**

Active Power The product of voltage and the in-phase

component of alternating current measured in Megawatts (MW). When compounded with the flow of 'reactive power', measured in Megavolt-Amperes Reactive (Mvar), the resultant is measured in Megavolt-Amperes (MVA).

Autumn Peak This is the maximum Northern Ireland de

This is the maximum Northern Ireland demand in the period September to October inclusive.

Associated Transmission Reinforcement Associated Transmission Reinforcements(ATRs)

are all of the transmission reinforcements that must be completed in order for a generator to be allocated FAQ. ATRs include reinforcements such as line and busbar upratings, new stations and

new lines.

Bulk Supply Point A point at which the Northern Ireland

transmission system is connected to the

distribution system.

Busbar The common connection point of two or more

circuits.

Capacitor An item of plant normally utilised on the

electrical network to supply reactive power to loads (generally locally) and thereby supporting

the local area voltage.

Commission for Regulation of Utilities (CRU) The CRU is the regulator for the electricity,

natural gas and public water sectors in Ireland.

Circuit An element of the transmission system that

carries electrical power.

Combined Cycle Gas Turbine A collection of gas turbines and steam units;

waste heat from the gas turbine(s) is passed through a heat recovery boiler to generate steam

for the steam turbine(s).

Combined Heat and Power A plant designed to produce both heat and

electrical power from a single heat source.

Constraint A transfer limit imposed by finite network

capacity.

Contingency The unexpected failure or outage of a system

component, such as a generation unit,

transmission line, transformer or other electrical element. A contingency may also include multiple components, which are related by situations leading to simultaneous component outages.

Data Freeze Date

The dates on which the Transmission Forecast Statement data was effectively "frozen" for both EirGrid and SONI. Changes to transmission system characteristics made after these dates do not feature in the analyses carried out for this Transmission Forecast Statement.

Deep Reinforcement

Refers to transmission system reinforcement additional to the shallow connection that is required to allow a new generator or demand to operate at maximum capacity.

Demand

The peak demand figures in Table 3-1 in the introduction refer to the power that must be transported from transmission system-connected generation stations to meet all customers' electricity requirements. These figures include transmission losses.

Demand-Side Management

The modification of normal demand patterns usually through the use of financial incentives.

EirGrid

EirGrid plc is the state-owned company established to take on the role and responsibilities of Transmission System Operator in Ireland as well as market operator of the wholesale trading system.

EirGrid Interconnector DAC

EIDAC is an organistion that is part of the EirGrid Group. EIDAC owns the East West Interconnector linking the electricity grids in Ireland and Wales. EIDAC sell capacity on the East West Interconnector through auctions.

**Embedded Generation** 

Refers to generation that is connected to the distribution system or at a customer's site.

Firm Access Quantity

The level of firm financial access available in the transmission network for a generator is that generator's Firm Access Quantity or 'FAQ'. Firm financial access means that if a generator is constrained on or off, it is eligible for compensation in the manner set out in the Trading & Settlement Code.

Gate 2

The term given to the group-processing scheme that applies to approximately 1,300 MW of renewable generation seeking connection to the transmission and distribution systems.

Gate 3

The term given to the group-processing scheme that applies to approximately 10,000 MW of generation seeking connection to the transmission and distribution systems.

**Generation Dispatch** 

The configuration of outputs from the connected generation units.

Grid Code (EirGrid)

The EirGrid Grid Code is designed to cover all material technical aspects to the operation and use of the transmission system of Ireland. The code was prepared by the TSO (pursuant to Section 33 of the Electricity Regulation Act, 1999) and approved by the CER. The Grid Code is available on www.eirgrid.com.

Grid Code (SONI)

The SONI Grid Code is designed to permit the development, maintenance and operation of an efficient, co-ordinated and economical transmission system in Northern Ireland. It is prepared by the TSO (SONI) pursuant to condition 16 of SONI's Licence. The SONI Grid Code is available at www.soni.ltd.uk

Interconnector Administrator

An Interconnector Administrator (IA) facilitates the allocation of capacity and energy trading. Trading is carried out using an Auction Management Platform (AMP) for the Moyle and East West Interconnectors.

**Incremental Transfer Capability** 

A measure of the transfer capability remaining in the physical transmission system for further commercial activity over and above anticipated uses.

Interconnector

The tie line, facilities and equipment that connect the transmission system of one independently supplied transmission system to that of another.

Loadflow

Study carried out to simulate the flow of power on the transmission system given a generation dispatch and system load.

Maximum Continuous Rating

The maximum capacity (MVA) modified for ambient temperature conditions that the circuit can sustain indefinitely without degradation of equipment life.

The MCR of a generator is the maximum capacity (MW) modified for ambient temperature conditions that the generation unit can sustain indefinitely without degradation of equipment life. All generation capacity figures in this Transmission Forecast Statement are maximum continuous ratings (defined as its MCR at  $10 \infty C$ ), expressed in exported terms i.e., generation unit output less the unit's own load.

Maximum Export Capacity

The maximum export value (MW) provided in accordance with the generator's connection agreement. The MECs are contract values which the generator chooses to cater for peaking under certain conditions that are not normally

certain conditions that are not normally achievable or sustainable e.g., a CCGT plant can produce greater output at lower temperatures.

The Utility Regulator (UR)

UR is an independent non-ministerial

government department set up to ensure the effective regulation of the Electricity, Gas and Water and Sewerage industries in Northern

Ireland.

Node Connecting point at which several circuits meet.

Node and station are used interchangeably in this Transmission Forecast Statement.

Parametric Analysis (P-V) curves

A parametric study involves a series of power flows that monitor the changes in one set of

power flow variables with respect to another in a systematic fashion. In this Transmission Forecast Statement the two variables are voltage and ITC.

Per Unit (pu.)

Ratio of the actual electrical quantity to the selected base quantity. The base quantity used here for calculation of per unit impedances is 100

MVA.

Phase Shifting Transformer

An item of plant employed on the electrical network to control the flow of active power.

Power Factor The power factor of a load is a ratio of the active

power requirement to the reactive power

requirement of the load.

Reactive Compensation The process of supplying reactive power to the

network.

Reactor An item of plant employed on the electrical network to either limit short circuit levels or

prevent voltage rise depending on its installation

and configuration.

Shallow Connection Shallow Connection means the local connection

assets required to connect a customer to the Transmission System and which are for the specific benefit of that particular customer.

Single Electricity Market (SEM) is the

wholesale electricity market operating in Ireland and Northern Ireland. The SEM Committee is developing and delivering a new wholesale electricity market for the island of Ireland called the I-SEM. Further information is available at www.sem-o.com/ and www.semcommittee.com/

SONI

System Operator for Northern Ireland (SONI) Ltd is owned by EirGrid plc. SONI ensures the safe, secure and economic operation of the high-voltage electricity system in Northern Ireland and in cooperation with EirGrid is also responsible for running the all-island wholesale market for electricity.

Refers to the busbar(s) at a given substation which is operated electrically separated. Busbars are normally split to limit short circuit levels or to maintain security of supply.

Device which provides fast and continuous capacitive and inductive reactive power supply to the power system.

This is the minimum system demand. It occurs in the period March to September, inclusive in Ireland and May to August, inclusive in Northern Ireland

This is the maximum system demand in the period March to September, inclusive in Ireland and May to August, inclusive in Northern Ireland.

between two other stations.

The total capacity available on cross-border circuits between Ireland and Northern Ireland f

Un-switched connection into existing line

circuits between Ireland and Northern Ireland for all flows, including emergency flows that occur after a contingency in either system.

different nominal voltages. (see also Phase Shifting Transformer)

A station that is a point of connection between

the transmission system and the distribution system or directly-connected customers.

An item of equipment connecting busbars at

A small proportion of energy is lost mainly as heat whilst transporting electricity on the transmission system. These are known as transmission losses. As the amount of energy transmitted increases, losses also increase.

The peak demand that is transported on the transmission system. The transmission peak includes an estimate of transmission losses.

The set of standards that the transmission system of Ireland is designed to meet.

Split Busbar

Static Var Compensator

Summer Valley

Summer Peak

Tee Connection

Total Transfer Capability

Transformer

**Transmission Interface Station** 

Transmission Losses

Transmission Peak

Transmission Planning Criteria

**Transmission System** 

The transmission system is a meshed network of high-voltage lines and cables (400 kV, 275 kV, 220 kV and 110 kV) for the transmission of bulk electricity supply around Ireland and Northern Ireland. The transmission system and network are used interchangeably in this Transmission Forecast Statement.

Uprating

To increase the rating of a circuit. This is achieved by increasing ground clearances and/or replacing conductor, together with any changes to terminal equipment and support structures.

Winter Peak

This is the maximum annual system demand. It occurs in the period October to February, inclusive in Ireland and in the Period November to February in Northern Ireland.

# **Executive Summary**

The All-Island Ten Year Transmission Forecast Statement (TYTFS) 2017 provides the following information:

- Network models and data of the all-island transmission system;
- Forecast generation capacity and demand growth;
- Maximum and minimum fault levels at transmission system stations;
- Predicted transmission system power flows at different points in time; and
- Demand and generation opportunities on the transmission system.

TYTFS 2017 is prepared in accordance with the statutory regulations outlined in Table S-1.

#### Table S-1: Statutory Regulations Requiring the TSOs to Produce a Transmission Forecast Statement

#### Ireland

Section 38 of the Electricity Regulation Act 1999 (as amended)

#### **Northern Ireland**

Condition 33 of the Licence to participate in the Transmission of Electricity

TYTFS 2017 describes the transmission system on the island of Ireland from 2017 to 2026. EirGrid and SONI have jointly prepared TYTFS 2017. This document supersedes the All-Island Ten Year Transmission Forecast Statement 2016-2025.

This document presents the most up-to-date information available for the all-island transmission system at the data freeze date of July 2017. Where applicable we provide information on transmission system projects under development<sup>2</sup>.

Where multiple solutions are presented for a transmission system project, no particular preference is given to one solution<sup>3</sup>.

In recent years there has been an increase in activity in the demand sector. The demand forecast used in our analyses represents an average annual increase in all-island winter peak demand of 1.0% between 2017 and 2026. This demand forecast is taken from All-Island Generation Capacity Statement 2017-2026 (GCS)<sup>4,5</sup>.

This TYTFS shows that data centres now represent significant demand connections in Ireland. Based on customer enquiries, a large portion of these data centres plan to connect in the Dublin area. Depending on the level of demand connections, new large scale generation, transmission solutions, demand side response and/or storage will be required in the Dublin area to accommodate the further demand increases and ensure continued security of supply.

The system needs in the north Dublin area are dynamic due to the connection of these new large scale demand customers combined with potential changes in the connected generation portfolio.

<sup>2</sup> This information is in accordance with EirGrid's Grid Development Strategy, available at the following link: http://www.eirgridgroup.com/the-grid/irelands-strategy/

<sup>3</sup> In line with our strategy to consider all practical technology options for network development.

<sup>4</sup> http://www.eirgridgroup.com/site-files/library/EirGrid/4289\_EirGrid\_GenCapStatement\_v9\_web.pdf

<sup>5</sup> TYTFS 2017 references documents that were published at the July 2017 data freeze date.

In response to this we have confirmed the need for investment in the greater Dublin area. We are progressing two projects: Capital Project 966 and Capital Project 1021 which together reinforce across and into the Dublin region. We are progressing these projects in line with our revised consultation and engagement process which is outlined in our "Have Your Say" document. This is available on the FirGrid website<sup>6</sup>.

The all-island renewable generation capacity is expected to increase rapidly over the period of this statement, reaching approximately 7,000 megawatts (MW) of generation capacity. Onshore wind contributes to the majority of renewable generation. However, there has recently been a significant increase in solar generation applications<sup>7</sup>. As noted in GCS 2017 some large conventional plants, with a total capacity of 1,900 MW, are expected to retire in the period.

TYTFS 2017 includes maximum and minimum short circuit current levels<sup>8</sup> at transmission system stations. This information is given at each 110 kilovolt (kV), 220 kV, 275 kV and 400 kV transmission system station. Short circuit levels at each transmission system station are given for the following years: 2017; 2020; and 2023.

Results show that several stations on the island are approaching, or have the potential to exceed, their rated short circuit current level. This can be seen in the maximum short circuit current level analysis, when there are high generation levels on the system. We manage the transmission system to mitigate possible risks while investment plans are in place to resolve these issues. Information on short circuit current levels is presented in Chapter 5.

Interconnection with neighbouring countries offers many benefits, it:

- Enhances the security of supply of the transmission system;
- Facilitates the integration of variable renewable generation; and
- Allows greater competition and the potential for wholesale electricity prices to be reduced.

The benefits arise because interconnection gives the transmission system access to a wider generation base, and gives generators here access to a wider demand base.

Our analyses include the Moyle and East-West Interconnector (EWIC) high voltage direct current (HVDC) interconnectors. These interconnectors connect the all-island transmission system to the Great Britain transmission system. No connection offers were in place for further interconnection at the data freeze date but we are aware of enquirers for a number of potential interconnector projects.

Our analyses assume the planned North – South 400 kV tie line is in place in Winter 2020. The results of the analyses performed for TYTFS 2017, post 2020, are therefore dependent on the North South reinforcement being commissioned. The reinforcement will increase security of supply on the island. It will also support realising the benefits, and further the development, of renewable power generation and provide economic benefits to customers on the island. Information on the North - South 400 kV tie line is presented in Chapter 2.

TYTFS 2017 includes information on generation and demand opportunities for interested parties. This information is based on assessments and studies carried out on an all-island basis. The methodologies applied to the all-island opportunity analyses are presented in Chapter 6. Information on opportunities is presented in Chapter 7 and Chapter 8.

The all-island generation opportunities assessment in Chapter 7 provides information for generators wishing to connect to the transmission system. Generator opportunity is assessed at a number of 110 kV, 220 kV, 275 kV and 400 kV nodes across the all-island transmission system. The results show that there are opportunities for new generation of significant scale close to the large demand centres in the east of the island, in particular in the east of Northern Ireland and in north Dublin. The results

<sup>6</sup> http://www.eirgridgroup.com/\_\_uuid/7d658280-91a2-4dbb-b438-ef005a857761/EirGrid-Have-Your-Say\_May-2017.pdf

<sup>7</sup> See Chapter 4 Generation for more information on the increase in solar generation applications.

<sup>8</sup> Further information on short circuit currents levels is given in Chapter 5 and Appendix E.

also show that future generation connections in the North-West, West and South-West regions would require network reinforcements.

Regional changes in locational tariff signals are also described in Chapter 7. This information is provided to help network users make informed decisions when exploring potential transmission network connection locations. Regions with surplus generation capacity in the South West, West and North West of Ireland have lower Transmission Loss Adjustment Factors and higher Generator Transmission Use of System charges than Eastern regions with higher demand levels and less surplus generation.


The all-island demand opportunity results, based on the 2022 transmission system, are presented in Chapter 8. The study indicates that all stations studied across the island have the capability to accommodate demand connections, some to a lesser degree than others. This analysis assumes that the planned North-South 400 kV tie-line is in place in Winter 2020. This tie-line improves the generation adequacy situation in Northern Ireland. It is also an important factor when considering the capacity of the system to connect significant amounts of additional demand in Northern Ireland.

Chapter 8 also includes a qualitative assessment of the demand capability in the Dublin area. This assessment has been included as a result of the recent large volume of data centre enquires in the Dublin area. The Dublin area assessment provides:

- A description of the Dublin transmission network;
- Areas of focus for demand connections in Dublin and the scale of interest in each zone; and
- Planned transmission developments in Dublin.

The results of demand and generation opportunity analyses are based on high level transmission network assessments. The results provide guidance, the actual connection capacity and possible connection solutions can only be determined following detailed individual connection studies. We will continue to examine innovative solutions and technologies in response to future connection enquiries.

Those who are considering connecting generation or demand to the transmission systems of Ireland or Northern Ireland should contact us. It is advisable to consult us early in the project process. In Ireland customers can contact us at <a href="mailto:info@eirgrid.com">info@eirgrid.com</a> while in Northern Ireland customers can contact us at <a href="mailto:enquiries@soni.ltd.uk">enquiries@soni.ltd.uk</a> for further information.

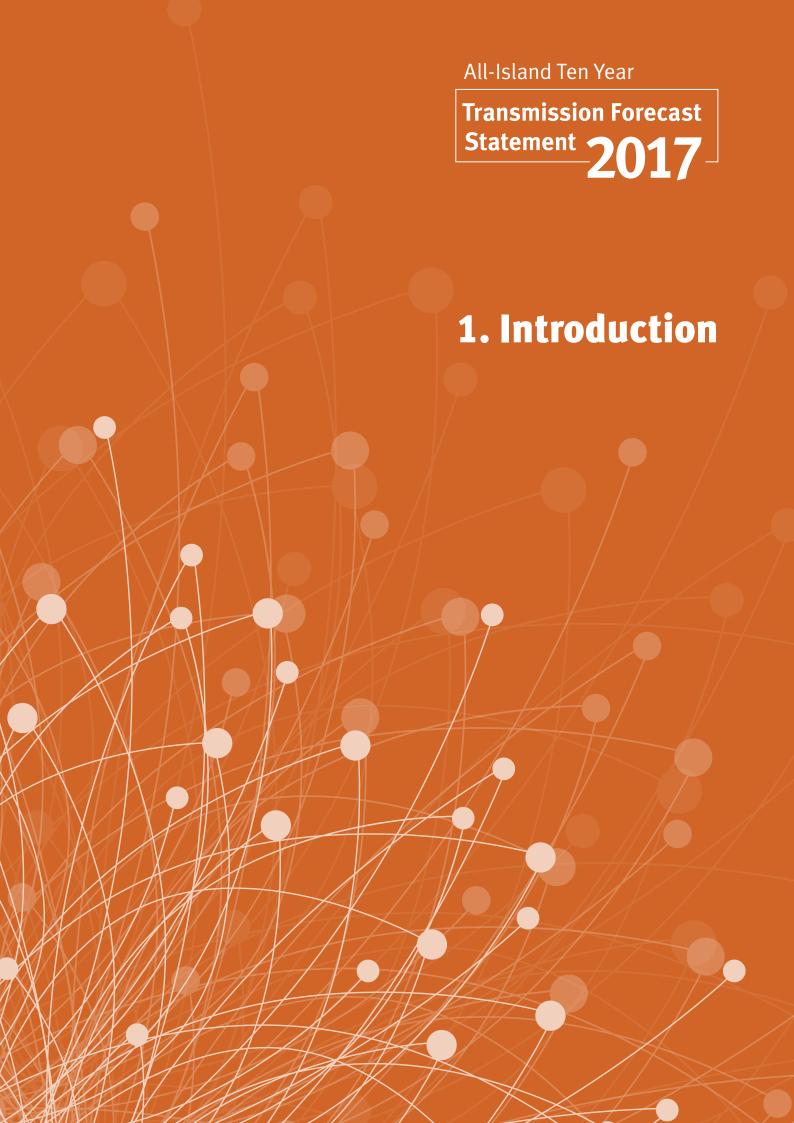



# 1. Introduction

The transmission system is a network of 400 kV, 275 kV, 220 kV and 110 kV high-voltage lines and cables. It is the backbone of the power system, efficiently delivering large amounts of power from where it is generated to where it is needed.

EirGrid is the Transmission System Operator (TSO) in Ireland, while SONI is the TSO in Northern Ireland. As TSOs, we jointly prepare and publish the All-Island Ten Year Transmission Forecast Statement (TYTFS) each year.

EirGrid plans and develops<sup>9</sup> the transmission system in Ireland to ensure it meets forecast transmission system operating conditions. SONI is responsible for planning and operating the transmission system in Northern Ireland within defined security standards.

The TYTFS 2017 provides information on:

- Planned network developments;
- Electricity demand growth;
- · Generation capacity; and
- Interconnection with other electricity transmission systems.

The appendices provide further information and transmission system data to enable the reader to perform power flow analysis.

When using data provided in the TYTFS 2017<sup>10</sup>, readers should consider other documents we produce, or are involved in producing, including:

- All-Island Generation Capacity Statement (GCS);
- EirGrid's Transmission Development Plan for Ireland;
- SONI's Transmission Development Plan for Northern Ireland; and
- European Network of Transmission System Operators for Electricity's (ENTSO-E's) Ten Year Network Development Plan for Europe.

Generation Capacity Statement 2017-2026 outlines demand forecasts and assesses the generation adequacy of the island of Ireland from 2017 to 2026. Where possible the TYTFS 2017 complements the demand information presented in the GCS.

EirGrid publishes a Transmission Development Plan (TDP) for Ireland each year. The most recent TDP (TDP 2017) is available on the EirGrid website. SONI will publish its first Transmission Development Plan Northern Ireland 2018-2027 (TDPNI) in 2018 under condition 40 of SONI's licence. The TDPs for Ireland and Northern Ireland provide details of the transmission system developments expected to be progressed in Ireland and Northern Ireland in the coming 10 years. These transmission system developments are also included in the data, assumptions and analyses in the TYTFS.

It is also important to note that every two years the European Network of Transmission System Operators for Electricity (ENTSO-E) publishes a Ten Year Network Development Plan (TYNDP). The TYNDP outlines projects of pan European significance.

<sup>9</sup> In January 2017 EirGrid published an updated Grid Development Strategy for the long-term development of the network. 10 TYTFS 2017 references documents published at the July 2017 data freeze date. These and all our publications are available at <a href="https://www.eirgridgroup.com">www.soni.ltd.uk/</a>

#### 1.1. Governing Arrangements

### 1.1.1. Roles and Responsibilities (Governance)

#### Northern Ireland

Under our licence in Northern Ireland, held by SONI, we are required to plan<sup>11</sup> and operate the Northern Ireland Transmission System.

In doing so we must comply with both the SONI Transmission System Security and Planning Standards (TSSPS) and the SONI Grid Code.

#### **Ireland**

Under our licence in Ireland, held by EirGrid, we are required to operate, develop and ensure the maintenance of the Irish Transmission System.

In doing so we must comply with both the EirGrid TSSPS and the EirGrid Grid Code.

### 1.1.2. Duty to Prepare a Statement

EirGrid and SONI are each required to publish a Transmission Forecast Statement in line with the Statutory Regulations in Table 1-1. Since 2012 we have jointly prepared and produced an all-island document, following an agreement with the Regulatory Authorities in Ireland<sup>12</sup> and Northern Ireland<sup>13</sup>.

Table 1-1: Statutory Regulations Requiring the TSOs to Produce a Transmission Forecast Statement

Ireland	Northern Ireland
Section 38 of the Electricity Regulation Act 1999 (as amended)	Condition 33 of the Licence to participate in the Transmission of Electricity

TYTFS 2017 has been prepared in accordance with and in fulfilment of these obligations. The format was approved by the Commission for Regulation of Utilities (CRU) and the Utility Regulator (UR).

### 1.1.3. Single Electricity Market

A Single Electricity Market (SEM) has been operating on the island of Ireland, since 2007. The allisland wholesale electricity market allows customers in both Ireland and Northern Ireland to benefit from increased competition. This in turn allows customers to benefit from reduced energy costs and improved reliability of supply.

The model of the SEM is due to change considerably to take account of the requirements of the European Network Codes<sup>14</sup> and the Target Model<sup>15</sup>. The new market design will be called the Integrated - Single Electricity Market (I -SEM<sup>16</sup>).

<sup>11</sup> Under the direction of the Utility Regulator (NI), investment planning functions are now the responsibility of SONI as of May 2014 (ref:Commission Decisions 12.4.2013 pursuant to Article 3(1) of Regulation (EC) No 714/2009 and Article 10(6) of Directive 2009/72/EC – United Kingdom (Northern Ireland) – SONI/NIE).

<sup>12</sup> The Commission for Regulation of Utilities is the Electricity Regulatory Authority in Ireland.

<sup>13</sup> The Utility Regulator is the Regulatory Authority in Northern Ireland.

<sup>14</sup> https://www.entsoe.eu/major-projects/network-code-development/Pages/default.aspx

<sup>15</sup> https://www.entsoe.eu/about-entso-e/market/long-term-market-design/Pages/default.aspx

<sup>16</sup> Further information on the I-SEM is available on http://www.sem-o.com/isem/Pages/Home.aspx

The transmission systems of Ireland and Northern Ireland are electrically connected by means of a 275 kV tie-line. This tie-line connects Louth station in Co. Louth (Irl) to Tandragee station, in Co. Armagh (NI).

There are also two 110 kV connections between Ireland and Northern Ireland:

- Letterkenny station in Co. Donegal (Irl) and Strabane station in Co. Tyrone (NI); and
- Corraclassy station in Co. Cavan (Irl) and Enniskillen station in Co. Fermanagh (NI).

Generation on the transmission systems of Ireland and Northern Ireland are dispatched on an all-island basis. The TYTFS transmission network models are also dispatched in this manner, to reflect how the all-island transmission system is operated.

### 1.2. Grid Development Strategy

EirGrid published an updated Grid Development Strategy<sup>17</sup> (GDS) in January 2017. The GDS documents our strategy for the long-term development of the network and involves:

- Open engagement and inclusive consultation with local communities and stakeholders will be central to our approach to network development;
- Consideration of all practical technology options for network development; and
- Optimisation of the existing network to minimise requirements for new infrastructure.

The GDS aims to achieve a balance between the costs and impact of new infrastructure, while maximising the capability of the existing network.

#### 1.3. Data Management

Transmission system development is continuously evolving. A data freeze date of July 2017 applies to TYTFS 2017, with all information correct at that date. All data for system model files, and sequence data for use with short circuit current level analysis, was collected on this date. A data freeze date enables us to:

- Perform analyses;
- Update system models; and
- Update the appendices of TYTFS 2017.

Since the data freeze, a number of changes in the following areas have emerged. The capital approval (CP) numbers enable readers to cross reference transmission projects in Ireland with the TDP.

The following transmission system developments have been initiated as projects:

- CP1013 Darndale 110 kV New Station;
- CP1009 Cruiserath 220 kV Permanent Connection;
- CP0942 Corderry Srananagh 110 kV Line Uprate; and
- CP1020 Blundelstown 110 kV Solar Farm.

<sup>17</sup> http://www.eirgridgroup.com/the-grid/irelands-strategy/

The expected completion date of the following transmission system developments have changed by one year or more:

- CP0466 North South 400 kV Interconnector;
- CP0646 Finglas 110 kV Station Redevelopment;
- CP0816 North Connacht 110 kV Reinforcement;
- · Agivey Cluster Substation (NI); and
- Kells Cluster Substation (NI).

The following transmission system developments have been terminated as projects:

• CP0721 Grid West.

The following transmission system developments have been completed:

- CP0927 Clonee 220 kV Station;
- CP0651 Ballynahulla 220/110 kV Station; and
- Brockaghboy Wind Farm 110 kV Station (NI).

The following transmission system developments are under review:

N/A.

#### 1.4. Other Information

Potential users of the transmission system should also be aware of the following key documents:

- SONI Grid Code<sup>18</sup>;
- EirGrid Grid Code<sup>19</sup>;
- SONI Transmission System Security and Planning Standards<sup>20</sup>;
- The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012<sup>21</sup>;
- EirGrid Transmission System Security and Planning Standards<sup>22</sup>;
- EirGrid Operating Security Standards<sup>23</sup>;
- SONI Transmission Connection Charging Methodology Statement<sup>24</sup>;
- EirGrid Transmission Connection Charging Methodology Statement 2008<sup>25</sup>;
- EirGrid Statement of Charges 2017/2018<sup>26</sup>;

<sup>18</sup> http://www.soni.ltd.uk/customer-and-industry/general-customer-information/grid-code/

<sup>19</sup> http://www.eirgridgroup.com/site-files/library/EirGrid/GridCodeVersion6.pdf

<sup>20</sup> http://www.soni.ltd.uk/media/Northern-Ireland-TSSPS-September-2015.pdf

<sup>21</sup> http://www.legislation.gov.uk/nisr/2012/381/pdfs/nisr\_20120381\_en.pdf

 $<sup>{\</sup>bf 22 \ http://www.eirgridgroup.com/site-files/library/EirGrid/EirGrid-Transmission-System-Security-and-Planning-Standards-TSSPS-Final-May-2016-APPROVED.pdf}$ 

<sup>23</sup> http://www.eirgridgroup.com/site-files/library/EirGrid/Operating-Security-Standards-December-2011.pdf

<sup>24 &</sup>lt;a href="http://www.soni.ltd.uk/media/SONI-Transmission-Connection-Charging-Methodology-Statement-Effective-1-Sept-2016-Approved-by-UR.pdf">http://www.soni.ltd.uk/media/SONI-Transmission-Connection-Charging-Methodology-Statement-Effective-1-Sept-2016-Approved-by-UR.pdf</a>

<sup>25</sup> http://www.eirgridgroup.com/site-files/library/EirGrid/Connection-Charging-Statement.pdf

<sup>26</sup> http://www.eirgridgroup.com/site-files/library/EirGrid/Statement-of-Charges-17\_18\_Final.pdf

- Statement Of Charges For Use of Northern Ireland Electricity Ltd Transmission System<sup>27</sup>; and
- All-Island Generation Capacity Statement 2017-2026<sup>28</sup>.

#### 1.5. Publication

The TYTFS 2017 is available in pdf format on our websites:

- www.eirgridgroup.com; and
- http://www.soni.ltd.uk/.


For a hard-copy version, please send a request to <a href="mailto:info@eirgrid.com">info@eirgrid.com</a> or <a href="mailto:enquiries@soni.ltd.uk">enquiries@soni.ltd.uk</a>.

Transmission system model files are also available on both websites.

 $<sup>27 \ \</sup>underline{\text{http://www.soni.ltd.uk/media/documents/Customers/TUOS/Charging-Statements/Final\%20TUoS\%2\ 0Statement\%20} \\ \underline{\text{of\%20Charges\%202017-18.pdf}}$ 

<sup>28</sup> http://www.eirgridgroup.com/site-files/library/EirGrid/4289\_EirGrid\_GenCapStatement\_v9\_web.pdf



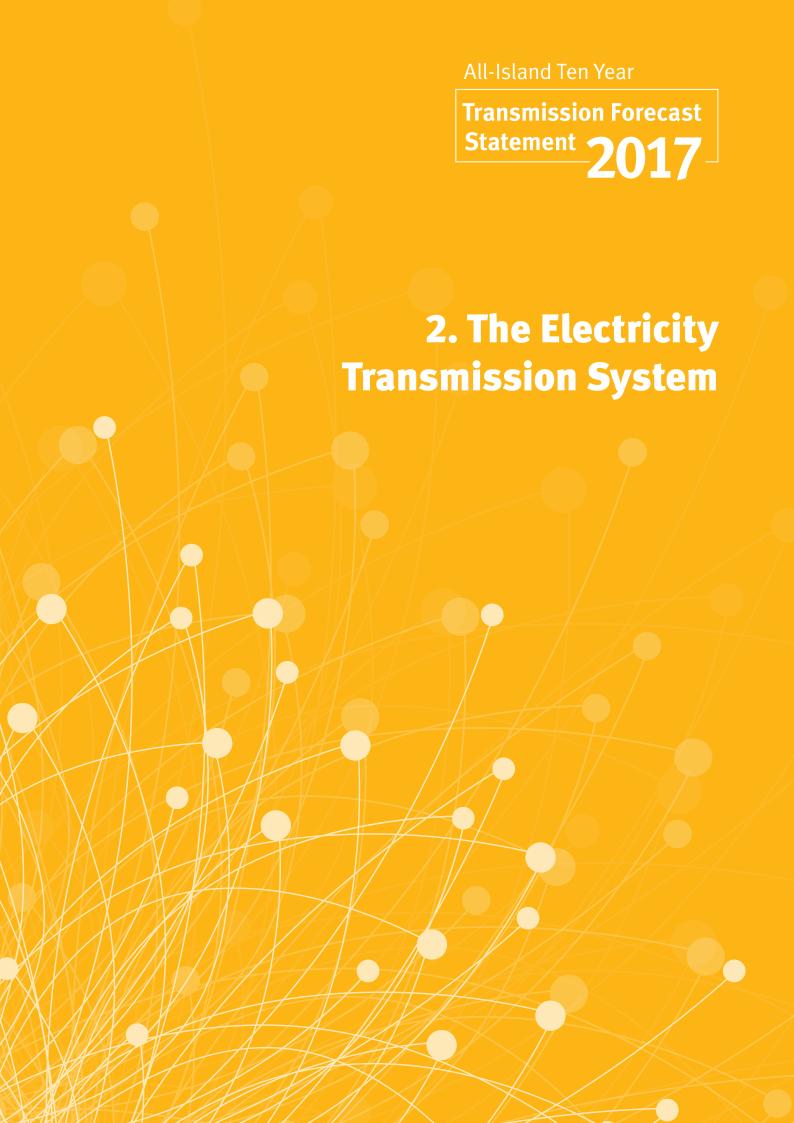



# 2. The Electricity Transmission System

## 2.1. Overview of the All-Island Electricity Transmission System

The transmission system in Ireland and Northern Ireland plays a vital role in the supply of electricity. It provides the means to transport energy from generators to demand centres across the island.

The transmission system in Northern Ireland is operated at 275 kV and 110 kV. The transmission system in Ireland is operated at 400 kV, 220 kV and 110 kV. The two transmission systems are connected by means of one 275 kV double circuit, from Louth station in Co. Louth (Irl) to Tandragee station in Co. Armagh (NI). There are also two 110 kV connections:

- Letterkenny station in Co. Donegal (Irl) to Strabane station in Co. Tyrone (NI); and
- Corraclassy station in Co. Cavan (Irl) to Enniskillen station in Co. Fermanagh (NI).

See Section 2.2 below for further information on the existing transmission connections between Ireland and Northern Ireland.

EirGrid and SONI together operate the transmission systems - North and South - on an all-island basis.

The 400 kV, 275 kV and 220 kV networks form the backbone of the transmission system. They have higher power carrying capacity and lower losses than the 110 kV network.

In Ireland, the 400 kV network provides a high capacity link between the Moneypoint generation station on the west coast and Dublin on the east. We are planning a new 400 kV interconnector between Ireland and Northern Ireland called the North South Interconnector. For the purposes of the 2017 TYTFS analysis, this project was anticipated to be installed by the end of 2020. Since the data freeze date the scheduled completion date has changed to 2023.

In Northern Ireland the 275 kV network is comprised of:

- A double circuit ring;
- A double circuit spur to Coolkeeragh Power Station; and
- A double circuit spur southwards into Co. Louth, in Ireland.

In Ireland the transmission network is comprised of single circuit lines which are interconnected to cover the wider geographical distances between stations. Typically large generation stations (greater than 100 MW) are connected to the 220 kV or 400 kV networks.

The 110 kV<sup>29</sup> circuits provide parallel paths to the 220 kV, 275 kV and 400 kV networks and are the most extensive element of the all-island transmission system, reaching into every county on the island of Ireland.

The all-island transmission system is generally comprised of overhead lines. There are exceptions to this, such as in the city centres of Belfast, Cork and Dublin, where underground cables are used. Table 2-1 presents the total lengths of overhead lines<sup>30</sup> and cables at the different voltage levels. Revision of individual line lengths may change following completion of network development projects.

<sup>29</sup> A number of radial 110 kV circuits in Ireland and the 110 kV lines and cables within Dublin City are operated by the Distribution System Operator (DSO). The DSO licence is held by ESB Networks. Details of the distribution network in Dublin are not included in this All-Island Transmission Forecast Statement.

30 Some lines may contain short sections of cable.

Table 2-1: Total Length of Existing Transmission System Circuits as at the Data Collection Freeze Date (July 2017)

Voltage Level (kV)	Total Circuit Lengths (km)
400	439
275	825
220	1,920
110	6,430

Transformers located at substations link the different voltage networks together providing paths for power flow between voltage levels. The total transformer capacity between the different voltage levels on the all-island system is presented in Table 2-2.

Table 2-2: Total Transmission System Transformer MVA Capacity as at the Data Collection Freeze Date<sup>31</sup> (July 2017)

Voltage Levels (kV)	Capacity (MVA)	Number of transformers
400/220	3,550	7
275/220	1,200	3
275/110	4,080	17
220/110	12,249	60

Reactive compensation devices are used to improve transmission system voltages in local areas. Existing reactive devices connected to the transmission system include shunt capacitors, static var compensators (SVCs) and shunt reactors.


Capacitors and SVCs help to support local voltages in areas where low voltages may otherwise occur. Shunt reactors suppress voltages in areas where they would otherwise be too high, most likely during periods of low demand and/or high wind. Table 2-3 displays the reactive compensation on the all-island transmission system.

<sup>31</sup> Transformer details are provided in Tables B-4 and B-5 in Appendix B.

Table 2-3: Total Reactive Compensation<sup>32</sup> as at the Data Collection Freeze Date (July 2017)

Voltage Level (kV)	Туре	Capacity (Mvar)	Number of Devices
400	Line Shunt Reactor	160	2
400	Voltage Source Converter Interconnector	+/-175	1
275	Shunt Capacitor	236	4
220	Shunt Reactor	150	2
440	Static Var Compensator	90	2
110	Shunt Capacitor	981	42
20	Shunt Capacitor	4	2
38	Shunt Reactor	100	5
33	Shunt Capacitor	29	5
22	Shunt Reactor	210	7
22	Shunt Capacitor	125	5
20	Shunt Capacitor	57.5	10
10	Shunt Capacitor	30	1

2.2. Existing Connections Between Ireland and Northern Ireland Transmission Systems

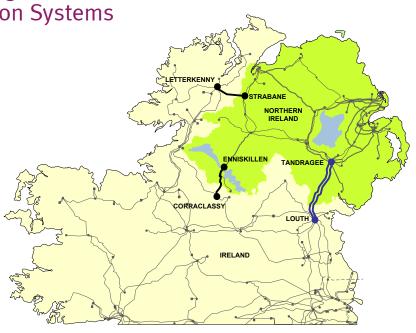

**Figure 2-1: Existing Cross-Border Circuits** 

<sup>32</sup> Details of existing reactive compensation devices are provided in Table B-6 in Appendix B.

As illustrated in Figure 2-1, the transmission systems of Ireland and Northern Ireland are connected via a double circuit 275 kV line. This line connects the Northern Irish transmission system at Tandragee to the Irish transmission system in Louth, Ireland. There are three 275/220 kV transformers in Louth station, one 600 MVA unit and two ganged<sup>33</sup> 300 MVA units.

The design capacity of each of the 275/220 kV cross-border circuits is 600 MVA. However, the actual capacity of the circuits to accommodate transfers between the two systems at any time depends on the prevailing system conditions on either side of the border. This includes the ability to deal with system separation.

In addition to the main 275/220 kV double circuit, there are two 110 kV connections:

- One between Letterkenny, Co. Donegal and Strabane, Co. Tyrone; and
- One between Corraclassy, Co. Cavan and Enniskillen, Co. Fermanagh.

The purpose of these 110 kV circuits is to provide support to either system in certain system conditions. Phase shifting transformers (PSTs) in Strabane and Enniskillen are used to control the power flow under normal conditions.

### 2.3. Interconnection with Great Britain and Europe

Transmission grids are often interconnected so that energy can flow from one country to another. By linking to other transmission systems, we can:

- Increase the diversity and security of energy supplies;
- Facilitate competition in the European market; and
- Aid the transition to a low carbon energy sector by integrating renewable sources.

This helps provide a safe, secure, reliable and affordable energy supply for everybody.

The East West Interconnector links the electricity grids in Ireland and Wales, while the Moyle Interconnector links the electricity grids in Northern Ireland and Scotland.

Power can be either imported or exported on the interconnectors. Interconnector power flows have system impacts that need to be managed operationally. For example, during times of import conventional generation is displaced by these non-synchronous power sources. This reduces the allisland system inertia<sup>34</sup>. Interconnector flows can also have implications for the system frequency and transmission system stability and operation. Frequency changes are faster in transmission systems with low rotational inertia, making frequency control and system operation more challenging.

The Moyle Interconnector also increases the dynamic reactive support required by the transmission system as the link does not have dynamic reactive power export capability<sup>35</sup>.

SONI acts as Interconnector Administrator (IA) for the East West and Moyle interconnectors.

Interconnector capacity is auctioned by the IA on behalf of EirGrid Interconnector DAC (EIDAC)<sup>36</sup> and Moyle Interconnector Limited (MIL)<sup>37</sup>. The capacity is purchased by market participants and utilised in the wholesale electricity markets on the islands of Ireland and Great Britain. Figure 2-2 shows the location of the Moyle Interconnector and EirGrid East-West Interconnector.

<sup>33</sup> Plant connected in parallel through common switchgear.

<sup>34</sup> System inertia is also reduced by the increased wind penetration (another form of non-synchronous generation).

<sup>35</sup> Unlike Moyle the East-West Interconnector has dynamic reactive power export capability.

<sup>36 &</sup>lt;a href="http://www.eirgridgroup.com/customer-and-industry/interconnection/">http://www.eirgridgroup.com/customer-and-industry/interconnection/</a>

<sup>37</sup> http://www.mutual-energy.com/electricity-business/

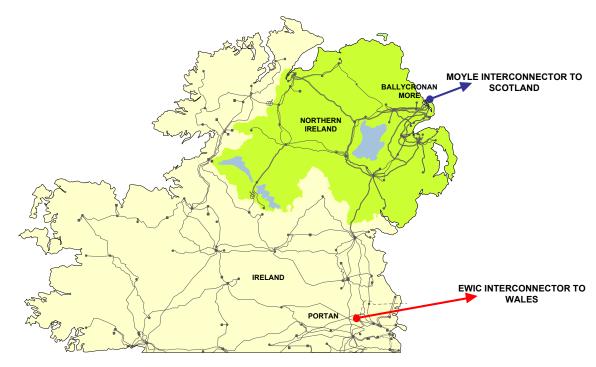


Figure 2-2: Existing Interconnectors

The amount of power that can currently be traded between Northern Ireland and Scotland across the Moyle Interconnector is detailed in Table 2-4. The amount of power that is permitted to be traded between Ireland and Wales across the East-West Interconnector is also detailed in Table 2-4. The available capacity is measured at the SEM and BETTA market reference point in Deeside 400 kV station in Wales. Table 2-4 below details the available capacity of the interconnectors.

**Table 2-4: Contracted Capacity on Existing Interconnectors** 

Interconnector	Direction	Summer (MW)	Winter (MW)
AA l -	SCO – NI <sup>39</sup>	410	450
Moyle	NI – SCO	80	80
FWIC 20	WAL – IRL	500	500
EWIC <sup>38</sup>	IRL – WAL	500	500

### 2.3.1. Moyle Interconnector

The Northern Ireland transmission system is currently connected to Scotland via a 500 MW High Voltage Direct Current (HVDC) link, the Moyle Interconnector. It is a Line Commutated Converter (LCC) HVDC link, which commenced full commercial operation in 2002.

It is constructed as a dual monopole HVDC link with two coaxial sub-sea cables from Ballycronan More in Islandmagee, Northern Ireland to Auchencrosh in Ayrshire, Scotland. The link has a physical installed capacity of 500 MW. An emergency flow of up to 75 MW is available should the frequency on the island drop below 49.4 Hz.

<sup>38</sup> The Moyle Interconnector contracted export capacity is limited to 80 MW from November 2017 due to network limitations in Scotland. Additional capacity up to 500 MW may be available under certain circumstances – more details are available here: <a href="http://www.mutual-energy.com/wpcontent/uploads/downloads/2017/06/Moyle\_Capacity\_Calculation\_2017\_consultation\_web.pdf">http://www.mutual-energy.com/wpcontent/uploads/downloads/2017/06/Moyle\_Capacity\_Calculation\_2017\_consultation\_web.pdf</a>

<sup>39</sup> Power delivered to connection point at receiving power system.

The convertor station at Ballycronan More is looped into one of the 275 kV Ballylumford to Hannahstown circuits. The Moyle link is self-compensating for reactive power losses. There are 4 x 59 Mvar capacitor banks at the Ballycronan More converter station with three of these capacitor banks acting as filters.

Where there are faults on the transmission system, effects are limited to a brief distortion of the HVDC 50 Hz AC synchronous waveform in import mode. The rapid response means that the HVDC link can have a net stabilising effect on the transmission system in the event of generation loss.

The contracted export capacity of the Moyle Interconnector will be limited to 80 MW from winter 2017 onwards. This is due to the commissioning of large wind farms in Scotland which will use up capacity on the single circuit from Auchencrosh to Coylton.

#### 2.3.2. East-West Interconnector

The East-West Interconnector is a 500 MW HVDC link which runs between Woodland, County Meath in Ireland and Deeside in North Wales. The link comprises approximately 186 km of sub-sea cable and 76 km of land underground cable.

The East-West Interconnector uses Voltage Source Converter (VSC) technology. VSC technology offers independent and rapid control of active and reactive power. It does not suffer from commutation failures, and is capable of offering emergency power control in the event of low or high frequency events.

In addition, due to the VSC technology, the East-West Interconnector provides black start capability. The link can operate in either voltage control or reactive power control mode independently in both converter stations. It can supply or absorb up to 175 Mvar at Portan 400 kV station which is connected directly to Woodland 400 kV station. The East-West Interconnector commenced commercial operation in December 2012.

### 2.3.3. Future European Interconnection

Currently, there are two proposed interconnectors between Ireland and France, and Ireland and Great Britain that are deemed Projects of Common Interest (PCIs) by the European Commission. PCIs are intended to help the EU achieve its energy policy and climate objectives: affordable, secure and sustainable energy for all citizens.

### 2.4. Ireland Transmission System Developments

### 2.4.1. Grid Development Strategy

A secure supply of electricity is essential to the economy. Our transmission system must remain stable and secure under a broad range of possible future scenarios.

We published "Your Grid, Your Views, Your Tomorrow", a discussion paper on Ireland's Grid Development Strategy in March 2015. This discussion paper responded to feedback received from the public over recent years. It was part of our renewed efforts to encourage more participation in our decision-making process. It also reflected an updated economic context, and our growing experience of new technologies.

The updated Grid Development Strategy "Your Grid, Your Tomorrow<sup>40</sup>" was published in January 2017. In drafting our updated grid development strategy, we took account of feedback received on the 2015 discussion paper. We also considered the Government's Energy White Paper, published in December 2015. We were further guided by the Action Plan for Jobs and the IDA's 2015-2019 strategy, which includes ambitious regional targets.

Our grid development strategy is based on all available information at the time of publication in 2017, and is an informed view of network development needs in the coming years. However, we will continue to review it on a regular basis. This is to ensure that our strategy continues to be up to date, and fit for purpose in a changing Ireland.

The United Kingdom's June 2016 referendum on EU membership has introduced new considerations. However, most issues covered by our grid development strategy relate to Ireland only, and are unaffected. Regardless of the UK leaving the EU, there will always be many shared benefits of working closely with our nearest neighbours. We aim to maintain a strong relationship between Ireland, Northern Ireland and Great Britain on energy matters.

### 2.4.2. Reviewing and Improving our Public Consultation Process

Following a review of our public consultation process, we promised to improve the way we consult with the public and other stakeholders. We have produced a summary guide of our improved consultation process - Have Your Say<sup>41</sup>. It explains why we develop the electricity grid, and how we consult with the public and other stakeholders to get feedback on our plans.

This guide tells you what to expect from us, and what we would like from you. There is one very important principle that is at the heart of our consultation process. The earlier you get involved in our projects, the more influence you can have on them.

The new approach comprises a 6-step Framework for Grid Development that provides an "end -to-end" structure for all our grid projects. It ensures an appropriate balance between technical, economic, environmental, social and community considerations, with significant provision for stakeholder engagement at all stages. A general structure of the Framework is set out in Figure 2-3 below.



Figure 2-3: General Structure of the Framework for Grid Development

## 2.4.3. Transmission Development Plan in Ireland

EirGrid's Transmission Development Plan<sup>42</sup> (TDP), details the transmission system development projects that have been initiated by us. It also discusses further developments that may arise in the period of the plan. The TDP describes projects that are required to:

- Facilitate demand growth;
- Provide new generation and demand connections<sup>43</sup>;
- 40 http://www.eirgridgroup.com/the-grid/irelands-strategy/
- 41 http://www.eirgridgroup.com/the-grid/have-your-say/
- 42 The latest TDP can be obtained from the EirGrid website <a href="http://www.eirgridgroup.com/">http://www.eirgridgroup.com/</a>
- 43 For example data centres or large industrial sites.

- Ensure the transmission system is in compliance with the Transmission System Security and Planning Standards (TSSPS)<sup>44</sup>;
- Provide interconnection capacity; and
- Refurbish or replace existing assets.

The planned transmission system developments presented in this statement are based on those projects that have received internal EirGrid approval by the data freeze date<sup>45</sup>. Appendix B outlines these developments. These projects are currently scheduled to be completed at various stages between now and 2026. It should be noted that the information presented in later chapters on transmission system transfer capabilities and opportunities is dependent on the completion of these development projects in the assumed timeframe.

Table 2-5 below shows the level of transmission system developments delivered by EirGrid (together with ESB Networks and independent contestable build contractors) that have been completed over the past six years.

Table 2-5: Recent Historical Level of Transmission Developments

Year	Circuit Uprate (km)	New Line Build (km)	New Station Build
2011	340	76	3
2012	215	128	2
2013	225	38	3
2014	167	79	2
2015	76	14	3
2016	35	8	2

Information presented in the TDP and TYTFS documents represent a snapshot of an evolving transmission system development plan. While we are considering other reinforcements, these are not at the stage of maturity required for inclusion in this statement.

The Transmission Development Plan includes details of major transmission system developments planned for the transmission system of Ireland. Each planned development is illustrated in the maps and schematics in Appendix A. New generation connections and new transmission interface stations are described in Sections 2.7 and 2.8 respectively.

### 2.4.4. Project Delivery

The development of the transmission network is subject to delivery risk. We use risk management plans and processes to identify, analyse, monitor and manage project and programme risks. These plans and processes facilitate the management of project dependencies and critical path issues within the context of a changing environment.

Project completion dates in the TYTFS are forecasts based on the best project information available at the time of the data freeze date. Certainty with regard to completion dates increases as a project moves through the various phases in its lifecycle, as represented below in Figure 2 -4.

The project schedule at the concept stage is developed based on standard lead times for generic project types. As a project moves forward from the concept phase a detailed schedule is developed, milestones are defined and there is therefore greater certainty regarding the completion date.

<sup>44</sup> Formerly known as the Transmission Planning Criteria (TPC). 45 1 July 2017



Figure 2-4: Relationship Between Phases in Project Lifecycle and Completion Date Certainty

The level of certainty or risk in a project also varies by project type as shown in Figure 2-5.



Figure 2-5: Project Certainty Depending on Project Type

We differentiate between moderate and high risk projects based on project type and project phase. Thus, line and station busbar uprate projects which are due to be completed by 2018 are considered to be within the moderate risk category. Large scale linear developments, scheduled to be completed post 2019 have a higher level of risk. Projects that are due for completion in the near-term generally carry less risk than those due for completion in later years.

The region or location of a project also has an impact on its risk profile. When interdependent projects are on-going at the same time, care has to be taken scheduling the required outages. In this case we will prioritise projects according to our prioritisation processes. This programme risk review may drive changes to the way projects are sequenced and the timing of project delivery in a region.

We review the network development programme on an on-going basis, which may result in project delivery changes for the reasons cited above. In such cases we endeavour to communicate with, and mitigate impacts on, customers.

In summary, completion dates are subject to change and the level of change typically depends on:

- The type of project;
- Phase-specific project and programme risks; and
- The region a project is in.

All developments included in this section have received internal EirGrid approval.

# 2.4.5. Descriptions of Ireland Development Projects

# Kilpaddoge 220 kV Development<sup>46</sup>

Kilpaddoge 220 kV station, in north Co. Kerry, will be connected into the existing Clashavoon-Tarbert and Killonan-Tarbert 220 kV lines. All existing 110 kV circuits currently connecting at the existing Tarbert 220 kV station will be transferred to Kilpaddoge 220 kV station. This will make Kilpaddoge a new hub for power flows into the south-west. The Kilpaddoge 220/110 kV project is needed to replace Tarbert 220 kV station as the main transmission station in north Co. Kerry. This is because the location was restricting further access and development of the transmission station. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2017.

### Finglas 220 kV Redevelopment

The 220 kV and 110 kV busbars in the existing Finglas 220 kV station will be reconfigured and redeveloped into a ring busbar arrangement. This project will address issues regarding the station's ability to: accommodate future load growth; security of supply to north Dublin; asset condition of existing equipment; inadequate circuit breaker ratings and the need for upgrade of the protection systems. The project will also increase operational flexibility and improve maintainability of station equipment. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2023.

# Belcamp Phase 1 220 kV Development<sup>47</sup>

Belcamp 220 kV station, in north Co. Dublin, will be connected to the 220 kV network by an underground cable from Finglas in order to facilitate new demand connections to the system in the North East Dublin area. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2018.

### Belcamp Phase 2 220/110 kV Development

A 220 kV cable will connect Shellybanks station to Belcamp station, by utilising the existing Shellybanks – Finglas 220 kV and Finglas – Dardistown 110 kV cables before continuing on to Belcamp. This will lead to a revision in the feeding arrangements of the underlying Finglas and Belcamp 110 kV network which is still being finalised. Due to uncertainty regarding the transfer of DSO circuits this project has not been modelled in the 2017 TYTFS analysis. However, it will be modelled in future TYTFS.

### Carrickmines 220 kV Development

This project involves installation of a fourth 220/110 kV transformer at Carrickmines 220 kV station as well as upgrading to Gas Insulated Switchgear (GIS) and reconfiguration of the existing busbar. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2018.

# Inchicore 220 kV Redevelopment

The oldest section of the existing Inchicore 220 kV station, in Co. Dublin will be replaced with a new GIS compound. This project will address issues with the condition of existing equipment, inadequate circuit breaker ratings, and the need for upgrade of the protection systems. The new GIS compound will increase operational flexibility, improve maintainability of station equipment and allow for future 220 kV expansion. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2022.

<sup>46</sup> http://www.eirgridgroup.com/the-grid/projects/north-kerry/the-project/

<sup>47 &</sup>lt;a href="http://www.eirgridgroup.com/the-grid/projects/dublin-north-fringe/the-project/">http://www.eirgridgroup.com/the-grid/projects/dublin-north-fringe/the-project/</a>

# Louth Station Redevelopment

Louth station comprises three voltage levels, 275 kV, 220 kV and 110 kV. The station will undergo a major refurbishment of assets at all three voltage levels. The 110 kV busbar will be reconfigured from the existing double busbar configuration to ring busbar arrangement. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2022.

### Poolbeg 220 kV Development

Two 50 Mvar shunt reactors will be installed in Poolbeg 220 kV station, in Co. Dublin. There has been an increase in the number of cable circuits and a reduction in the usage of the conventional generation in Dublin. This has made it more difficult to control voltage during low-demand periods. These reactors will help to adequately control the voltages, reducing the operational constraint of running generators outside of merit order. Installation of the first reactor is complete. For the purpose of the 2017 TYTFS analysis, the second reactor is expected to be completed in 2018.

# Castlebagot 220 kV Development<sup>48</sup>

Castlebagot 220 kV station, in west Co. Dublin, will be connected into the existing Inchicore-Maynooth No. 1 and No. 2 220 kV lines. A number of the existing 110 kV circuits in the area will be connected to the new Castlebagot station. This development will offload demand from Inchicore 220 kV station. It will also ensure compliance with the distribution system planning standards as new demand connects to the system in the West Dublin area. For the purpose of the 2017 TYTFS analysis, it is expected to be completed in 2019.

# Maynooth 220 kV Station Upgrade

This project involves refurbishment of the entire 220 kV and 110 kV busbars, reconfiguration of both the 220 kV and 110 kV busbars to an enhanced ring configuration, and an increase in the short circuit rating of both busbars. Series reactors will be incorporated into the 110 kV wing couplers to manage short circuit levels within limits. For the purposes of the 2017 TYTFS analysis, it is expected to be complete in 2025.

# Laois-Kilkenny Reinforcement Project<sup>49</sup>

A new 400/110 kV station to be located near Portlaoise, Co. Laois, with an associated 110 kV circuit to Kilkenny 110 kV station via Ballyragget station. The 400/110 kV station will be looped into the existing Dunstown-Moneypoint 400 kV line and the existing Athy-Portlaoise 110 kV line. The proposed infrastructure will improve quality of supply to the south-east. It will also increase capacity in the region. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2020.

# Capital Project 966

This project will involve reinforcement of the network between Dunstown and Woodland 400 kV stations.

We are progressing this project in line with our revised consultation and engagement process which is outlined in our Have Your Say<sup>50</sup> document.

For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2024.

<sup>48</sup> Formerly known as West Dublin 220 kV Development.

<sup>49</sup> http://www.eirgridgroup.com/the-grid/projects/laois-kilkenny/the-project/

<sup>50</sup> http://www.eirgridgroup.com/the-grid/have-your-say/

# Ballynahulla 220 kV Development

Ballynahulla 220 kV station will be looped into the existing Clashavoon-Tarbert 220 kV line. The station will be linked to the existing Glenlara 110 kV station by a new 110 kV circuit. The Ballynahulla 220/110 kV project is needed to accommodate renewable generation in the south-west. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed by Spring 2018. This station was formerly known as Kishkeam but has been renamed.

# Ballynahulla Station Development

A new ±100 Mvar STATCOM will be installed and commissioned on the 110 kV busbar at Ballynahulla. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2020.

# Aghada 220 kV Redevelopment

The 220 kV busbar in Aghada 220 kV station will be reconfigured from the existing double busbar into a 'C' configuration. The 110 kV busbar will also be uprated. The project will increase security of supply, increase operational flexibility and improve maintainability of station equipment. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2022.

### Knockraha 220 kV Reconfiguration

The 220 kV busbar in Knockraha 220 kV station will be reconfigured from the existing double busbar configuration to a ring busbar arrangement. The third Knockraha 220/110 kV transformer will be decommissioned resulting in the station having two 220/110 kV transformers. The project will resolve issues regarding security of supply, operational flexibility and improve maintainability of station equipment. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2021.

# Ballyvouskill Station Development

A new ±100 Mvar STATCOM on the 110 kV busbar at Ballyvouskill will be installed and commissioned. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2020.

### Thurles Station Development

The existing 15 Mvar capacitor on the 110 kV busbar at Thurles will be removed and replaced with a new ±30 Mvar STATCOM. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2020.

### **Knockanure Station Development**

A new 50 Mvar reactor will be installed on the 220 kV busbar at Knockanure. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2020.

### Kilpaddoge-Moneypoint 220 kV Circuit

There is a planned new submarine cable across the Shannon estuary from Moneypoint in Co. Clare to Kilpaddoge in north Co. Kerry. This will create a new path for power out of the Dublin-Moneypoint group of generators into the South West. It will also create a path for power out of the South West to the 400 kV network. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed by the end of 2017.

### Moneypoint Redevelopment

A new 400 kV substation will replace the existing Moneypoint 400 kV substation, which will be retired. The existing Moneypoint-Oldstreet and Dunstown-Moneypoint 400 kV circuits and Moneypoint 400/220 kV transformer will be transferred to the new Moneypoint 400 kV busbar. The station will also accommodate a second 400/220 kV transformer.

For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2017.

### Moneypoint – Kilpaddoge – Knockanure 220 kV Development

There is a planned new 220 kV cable from Moneypoint in Co. Clare to Knockanure in north Co. Kerry, via Kilpaddoge also in north Co. Kerry. This will create a new path for power out of the South West to the existing 400 kV network. The project will comprise a submarine 220 kV cable under the Shannon and a 21 km 220 kV land cable.

For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2019.

# **Regional Solution**

The Regional Solution is made up of a number of projects, with the objective of improving security of supply in the south-east and facilitating connection of generation in the south-west.

#### (i) Cross-Shannon 400 kV Cable

A 400 kV cable crossing the Shannon estuary will be installed between Kilpaddoge and Moneypoint stations. The cable length is estimated at approximately 6 km consisting of approximately 3 km land cable and approximately 3 km marine cable. A new 400/220 kV 500 MVA transformer will also be required at Kilpaddoge station. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2022

#### (ii) Great Island - Wexford 110 kV line uprate

The entire Great Island - Wexford 110kV line will be uprated. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2020.

#### (iii) Great Island - Kilkenny 110 kV line uprate

The entire Great Island - Kilkenny 110kV line will be uprated. For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2021.

#### (iv) Wexford 110 kV busbar uprate

For the purpose of the 2017 TYTFS analysis, this project is expected to be completed in 2021.

#### (v) Dunstown, Moneypoint and Oldstreet Series Compensation

Series capacitors will be installed at Dunstown, Moneypoint and Oldstreet 400 kV stations to compensate the Laois-Moneypoint, Laois-Dunstown and Oldstreet-Woodland 400 kV lines. For the purpose of the 2017 TYTFS analysis, these projects are expected to be completed in 2022.

### North Connacht 110 kV Reinforcement

This project includes a new 110 kV circuit to facilitate additional renewable generation in Co. Mayo. An investigation of overhead and underground options utilising various technologies will be undertaken for this project. We will consult on these options before selecting a preferred technology type.

For the purpose of the 2017 TYTFS analysis, this project is assumed to be completed in 2022.

# Tievebrack/Ardnagappary 110 kV Development

A 110 kV station will be constructed at Tievebrack, near Glenties in Co. Donegal. This will be looped into the existing Binbane – Letterkenny 110 kV line. New 110/38 kV transformers will be installed at Ardnagappary in Derrybeg and connected via a new 110 kV distribution overhead line to the Tievebrack station.

For the purpose of the 2017 TYTFS analysis, this project is assumed to be complete in 2019.

# North-West Project

The cross-border Renewable Integration Development Project (RIDP)<sup>51</sup> identified that the existing network in the north west of the island is insufficient to accommodate the future wind generation in the area. The North-West project is one element of the original RIDP preferred solution. It would connect the existing Srananagh 220 kV substation to the existing Clogher 110 kV substation in Donegal. However, alternative solutions to evacuate the wind generation from Co. Donegal are now being considered.

Should the North-West Project progress, an investigation of overhead and underground options utilising various technologies will be undertaken. For the purpose of the 2017 TYTFS analysis, this project is assumed to be completed in 2027.

# 2.5. Northern Ireland Transmission System Developments

This section details the transmission system projects that are planned to take place in Northern Ireland over the period covered by this forecast statement. Projects have been included using completion dates assessed to be appropriate at the time of the data freeze (July 2017).

### 2.5.1. Approach to Grid Development

The approach taken to developing the grid is described by the following:

- The projects listed here have all progressed through either the SONI approval and governance
  process or have been identified to SONI by NIE Networks. In cases where the project is at an early
  stage this approval may be limited to the investigation of feasibility of several options prior to route
  selection and consents. Therefore, the outline design that progresses to the consents stage may
  vary from that assumed in the forecast statement study files;
- Developments are based on assumptions relating to the forecast change in demand and generation; and
- Studies have concluded that the following projects are required to address non-compliance with standards, subject to the forecast change in demand and generation. However, further cost benefit analysis may result, in some cases, in the identification of alternative solutions or operational interventions.

Further projects for which a need has been identified but approval has not yet been granted have not been included in the TYTFS analysis. These will be discussed in more detail in the forthcoming Transmission Development Plan Northern Ireland 2018-2027, due for publication in 2018.

<sup>51</sup> http://www.eirgridgroup.com/how-the-grid-works/ridp/

### 2.5.2. Description of Northern Ireland Development Projects

# **Dungannon Main Refurbishment**

The 110 kV mesh at Dungannon Main is currently undergoing refurbishment. All switchgear is being replaced with 40 kA equipment. For the purpose of the 2017 TYTFS this work is expected to be completed by winter 2017.

### Windfarm Clusters Development

#### (i) Curraghmulkin 110/33 kV Cluster (formerly Drumquin)

It is planned to establish a new 110/33 kV cluster substation close to Drumquin village. The Curraghmulkin cluster is to be connected to the existing Enniskillen - Omagh 110 kV circuits by means of a new switching station (Omagh South) north of Dromore village. A single portal overhead line will be built from the new station to the cluster site. For the purpose of the 2017 TYTFS, this project is assumed to be complete by summer 2018.

#### (ii) Agivey (formerly Garvagh) 110 kV Cluster

It is planned to establish a 110/33 kV cluster substation at Agivey, near Garvagh, connected to the Rasharkin cluster via a portal overhead line. For the purpose of the 2017 TYTFS, this work is assumed to be complete by winter 2019.

#### (iii) Kells Wind 110 kV Cluster

It is planned to establish a 110/33 kV cluster substation near Kells, connected to the existing Kells station via an overhead line. For the purpose of the 2017 TYTFS, this work is assumed to be complete by 2020.

### Donegall Main (North)

The 60 MVA transformer TxB at Donegall North is to be replaced by a new 90 MVA unit. For the purpose of the 2017 TYTFS this work is expected to be complete by summer 2018.

### Omagh Main – Omagh South Restring

With the connection of Curraghmulkin cluster substation to Omagh South it will be necessary to restring the Omagh Main – Omagh South tower line with high temperature conductor. For the purpose of the 2017 TYTFS analysis, this work is assumed to be complete by summer 2019.

### **Reactive Compensation**

#### (i) Omagh Reactive Compensation

It is planned to install reactive support at Omagh Main. Approximately 120 Mvar of reactive support will be installed, connected to the 110 kV bus from 2021.

#### (ii) Tamnamore Reactive Compensation

It is planned to install reactive support at Tamnamore. Approximately 200 Mvar of reactive support will be installed, connected to the 110 kV bus from 2021.

#### (iii) Coleraine Reactive Compensation

It is planned to install reactive support at Coleraine. Approximately 150 Mvar of reactive support will be installed, connected to the 110 kV bus from 2021. The existing 36 Mvar Capacitor at Coleraine is to be recovered.

### Airport Road Main

It is planned to construct a new 110/33 kV substation including 2 x 60 MVA transformers and a 33 kV switchboard in the Belfast Harbour Estate, close to Airport Road. The substation will be connected as a teed transformer feeder arrangement from Rosebank Main 110 kV. The substation will supply both Airport Road and Queens Road 33 kV substations which are to be transferred from Cregagh Main. Additionally, Ballymacarrett 33 kV substation is also to be transferred from Knock Main. For the purpose of the 2017 TYTFS, this work is assumed to be completed by winter 2022.

# Ballylumford Switchgear

The existing 110 kV switchgear at Ballylumford is to be replaced with a new 110 kV GIS double busbar and the 110 kV circuits diverted accordingly. For the purpose of the 2017 TYTFS, this project is assumed to be completed by winter 2020. Currently one 275/110 kV interbus transformer at Ballylumford is operated out of service to ensure the fault level is kept within existing switchgear fault rating. After this work is complete, this restriction can be removed.

# Coolkeeragh-Magherafelt 275 kV Circuits

It is planned to replace the conductor on the existing double circuit tower line. The rating of the replacement conductor will be defined as part of the redesign of the circuit. For the purpose of the 2017 TYTFS, this work is assumed to be complete by winter 2021.

### Kells-Rasharkin New 110 kV Circuit

As a result of increasing growth in renewable generation there will be a need to construct a second 110 kV circuit between Kells and Rasharkin 110/33 kV cluster substation. This circuit will require to have a minimum rating of c. 190 MVA. For the purpose of the 2017 TYTFS, this project is assumed to be complete by 2024.

# Castlereagh and Tandragee 110 kV Switchgear

Due to the X/R ratio at Castlereagh and Tandragee substations that is in excess of the design value of the 110 kV switchgear, both substations are at risk of being in excess of maximum fault levels. The most prudent option to address this risk would be to replace the switchgear with uprated equipment. Other options that require consideration are an operational intervention to reduce the fault level (although that would have the potential for reduced security) and assigning a higher fault rating based on engagement with the OEM or through the testing of a sample of the circuit breakers. For the purpose of the 2017 TYTFS, this project is assumed to be complete by 2021.

# Castlereagh IBTx 1

The interbus transformer IBTx 1 at Castlereagh is to be replaced. The replacement transformer will have a 240 MVA primary winding and a 60 MVA tertiary winding. For the purpose of the 2017 TYTFS, this project is assumed to be complete by 2018.

# Ballylumford-Castlereagh 110 kV Circuit

The conductor on the existing tower line will be replaced and uprated. For the purpose of the 2017 TYTFS, this project is assumed to be complete by 2018.

### 2.5.3. Projects Not Included in the 2017 TYFTS Analysis

A number of projects have not been included in the TYTFS analysis due to uncertainty at this time over either:

- The case of need; and/or
- Scope; and/or
- Timescales.

The following projects have not been included in the 2017 TYTFS analysis. However, they are under consideration and are included for information. They will be described in more detail in the forthcoming Northern Ireland Transmission Development Plan 2018-2027 which will be published for consultation in 2018.

# Circuit Development to Reinforce the West of NI

The following projects are being considered to improve the ability of the transmission network in the west of NI to carry the significant power flows due to renewable generation or in the event of an outage of the 275 kV double circuit line between Magherafelt and Coolkeeragh:

- Coolkeeragh Trillick new 110 kV line;
- Omagh Strabane 110 kV Uprate;
- Coolkeeragh Strabane 110 kV Uprate;
- Coolkeeragh Killymallaght 110 kV Uprate;
- Coolkeeragh Limavady 110 kV Uprate;
- Killymallaght Strabane 110 kV Uprate; and
- Omagh South Turleenan new 275 kV line.

### **Further Network Projects**

#### (i) Castlereagh 275 kV IBTx 4

Taking account of future growth in demand, consideration is presently being given to the need for a 4th transformer at Castlereagh. However, due to the existing level of capacity and the uncertainty over the timing of the need for the additional transformer, TYTFS 2017 does not include this development.

- (ii) Turleenan Tamnamore 275 kV Uprate
- (iii) Armagh Main and Armagh Tandragee

### Other Projects

#### (i) Compressed Air Energy Storage Scheme (CAES)

A developer has planned the construction of a Compressed Air Energy Storage facility close to Ballylumford Power Station. A connection offer was made by SONI but this expired in November 2017 and a new application would be necessary for this project to go ahead. Despite this occurring after the freeze date, due to the significance of this project a decision was made not to include it in the TYTFS analysis.

#### (ii) Tidal Scheme

Developers are planning to establish two 100 MW tidal generation schemes off the County Antrim coast close to Torr Head and Fair Head. At the freeze date these had not yet received a connection offer and the timescale for connection was unknown.

#### (iii) Belfast Power Station

Evermore Energy are proposing a new 480 MW CCGT, to be located in Belfast Harbour Estate. The project is in the early stages of development, and no connection application had been received at the time of the freeze date. As a result, it has not been included in the analysis for this statement.

#### (iv) Cam and Newtownstewart 110 kV Wind Clusters

Cluster substations were previously proposed at Cam near Coleraine and Newtownstewart near Strabane to support expected levels of wind generation. However, these projects are now not anticipated to go ahead due to the withdrawal of a number of connection applications.

# 2.6. Joint Ireland and Northern Ireland Approved Transmission System Developments

This section includes transmission system developments which both EirGrid and SONI have identified the need for.

We are proposing a new 400 kV circuit rated at 1500 MVA which will connect Woodland 400 kV station in County Meath (Irl) and Turleenan 400/275 kV station in County Tyrone (NI). A new 400 kV station at Turleenan is required.

At present, transmission capacity between Ireland and Northern Ireland is not sufficient. Due to a lack of capacity, we must limit power flows across the border to prevent stress on the grid. The North South Interconnector would deliver a more secure and reliable electricity supply throughout the island of Ireland. It would bring about major cost savings and address significant issues around the security of electricity supply. This is particularly the case in Northern Ireland.

A key benefit is that it would remove bottlenecks between the two systems. This would enable the two systems to work together as if they were a single network. This would benefit residents and businesses on both sides of the border. Other benefits would include cost savings for consumers, as larger electricity systems operate more efficiently than smaller ones.

The North South Interconnector would also allow for greater connection of renewable generation. This would help Ireland and Northern Ireland achieve their renewable energy targets.

For the purpose of the 2017 TYTFS analysis, this project was planned to be installed and commissioned by winter 2020. Since the data freeze date the scheduled completion date has changed to 2023. Once this connection is established, the constraints on the existing Tandragee-Louth 275 kV double circuit will be significantly reduced.

# 2.7. Connection of New Generation Stations

New generators will connect over the period covered by this statement. Table 2-6 lists the transmission system developments associated with future generation. New generators are included in the appropriate network models according to their expected connection date. Details of these generators and their expected connected dates are given in Section B.2 in Appendix B.

**Table 2-6: Transmission System Station Development to Facilitate the Connection of Future Generation** 

Generator	Planned Connection Method	Location
Athea Wind Farm (Extension)	Connected into the existing Athea 110 kV substation	Ireland
Barnadivane	New Barnadivane 110 kV Station, looped into the Dunmanway- Macroom 110 kV circuit	Ireland
Brockaghboy <sup>52</sup>	Connected at 110 kV into the Rasharkin 110/33 kV substation	Northern Ireland
Castletownmoor	Connected into Gorman 220 kV substation	Ireland
Clahane Wind Farm (Extension)	Connected into the existing Clahane 110 kV substation	Ireland
Coomataggart	Connected into the planned Ballyvouskill 220 kV substation	Ireland
Cordal	Construction of the new Cordal 110 kV station tailed out of Ballynahulla	Ireland
Croaghbrack	Connected into the existing Mulreavy 110 kV substation which is	Ireland
Cronacarkafree	tail-connected into the existing Clogher 110 kV substation	
Curraghamulkin Cluster	Future Curraghamulkin 110/33 kV cluster substation tail- connected into Omagh South 110 kV substation	Northern Ireland
Agivey Cluster	Future Agivey 110/33 kV cluster substation is planned to be connected via a loop in to the Rasharkin – Brockaghboy 110 kV circuit.	Northern Ireland
Keelderry	Connected to a new Slievecallan 110 kV substation, itself tail-	Ireland
Loughaun North	connected into Ennis 110 kV substation	
Kells Cluster	Future Kells 110/33 kV cluster substation is planned to be tail-connected into Kells 275/110 kV switching station at 110 kV.	Northern Ireland
Kelwin	Connected into Kilpaddoge 220 kV substation	Ireland
Knockacummer	Permanent connection of the new Knockacummer 110 kV substation, tailed out of Ballynahulla.	Ireland
Knockalough	Connected into Knockranny station on the Salthill-Screebe 110 kV circuit	Ireland
Moneypoint Wind	Connected into Moneypoint substation at 110 kV	Ireland
Oriel	Connected into the existing Louth-Woodland 220 kV circuit	Ireland
Oweninny	Connected into the existing Bellacorick 110 kV substation	Ireland
Rasharkin Cluster <sup>53</sup>	Rasharkin 110/33 kV cluster substation looped into the Coleraine-Kells 110 kV circuit	Northern Ireland

<sup>52</sup> Connected August 2017

<sup>53</sup> Connected August 2017

### 2.8. Connection of New Interface Stations

Transmission interface stations are the points of connection between the transmission system and the distribution system or connecting 110 kV connected customers.

Table 2-7 lists the planned new 110 kV stations connecting the distribution system to the transmission system, for the period covered by this statement. These stations are included in the network models according to their expected connection date. Details of the connections and dates are given in Section B.2, Appendix B.

**Table 2-7: Planned Transmission Interface Stations** 

Station	Code	Transformer Size (MVA)	Nearest Main Town or Load Centre	County
Airport Road	AIR	2 x 90	Belfast	Down
Tievebrack	TIV	n/a	Glenties	Donegal
Ballyragget	BGT	31.5	Ballyragget	Kilkenny
Belfast North Main	BNM	2 x 90	Belfast	Antrim
Bracklone	BRA	2 x 20	Portarlington	Laois
New station near Kilbarry	KBY 2	2 x 31.5	Cork	Cork

#### 2.9. Detailed Transmission Network Information

The all-island network schematic diagrams in Appendix A show snapshots of the transmission system as at July 2017 and the planned transmission system expected by the end of 2026. The diagrams indicate stations, circuits, transformers, generation, reactive devices and phase shifting transformers.

Figure A-1 in Appendix A presents a geographical map of the all-island transmission system as at the end of 2017. Figure A-2 in Appendix A presents a geographical map of the planned all-island transmission system expected by the end of 2026.

The electrical characteristics and capacity ratings of the existing and planned transmission system are included in Appendix B. Characteristics of existing and planned overhead lines, underground cables, transformers and reactive compensation devices are provided.





# 3. Demand

This chapter provides information on forecasts for the all-island demand on the transmission system.

The forecast is taken from the All-Island Generation Capacity Statement 2017-2026 (GCS)<sup>54</sup> which was published by EirGrid and SONI in April 2017. The 2017 GCS contains forecasts of future energy consumption and demand levels between 2017 and 2026.

The GCS states that there will no longer be significant transmission constraints between Ireland and Northern Ireland provided the proposed North South Interconnector is in place. It therefore concludes that with the commissioning of the second North South Interconnector, the all-island system will meet the required generation adequacy standard for most scenarios during these years.

This chapter also provides an introduction to the anticipated large demand increase in the Dublin area. This anticipated demand increase is associated primarily with the connection of new data centres. The impact of these data centres on the future all-island demand forecast is also discussed.

# 3.1. All-Island, Ireland and Northern Ireland Peak Transmission Demand

Table 3-1 presents the median all-island, Ireland and Northern Ireland, winter peak demand forecasts over the period 2017-2026, as published in the GCS.

It is difficult to accurately predict a peak demand figure for a particular year in the future. This is due to a number of factors that can cause fluctuations in the forecast. These factors include weather conditions, economic activity, electricity usage patterns and government policy.

The annual peak demand figures listed in Table 3-1 are expected to occur during the winter period of each year. For example, we would expect that the 2017 peak demand forecast of 6.75 gigawatts (GW) would occur in winter 2017/18. In Ireland and Northern Ireland, the winter peak demand usually occurs between 17:00 and 19:00 on a weekday evening. However, the peak demand in each region generally does not occur on the same day.

Table 3-1: All-Island, Ireland and Northern Ireland Peak Demand Forecast

	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
All-Island (GW)	6.75	6.87	6.99	7.09	7.15	7.18	7.21	7.23	7.30	7.37
Ireland (GW)	5.08	5.19	5.30	5.40	5.49	5.53	5.55	5.56	5.57	5.64
Northern Ireland (GW)	1.73	1.73	1.73	1.74	1.75	1.75	1.76	1.77	1.77	1.78

As well as winter peak forecasts, we also develop summer peak and summer valley forecasts in Ireland and Northern Ireland, and autumn peak forecasts in Northern Ireland only.

The summer peak refers to the average peak demand levels that are forecast to occur during the summer period of each year. The Ireland and Northern Ireland summer peaks are combined to produce an all-island summer peak.

<sup>54 &</sup>lt;a href="http://www.eirgridgroup.com/site-files/library/EirGrid/4289\_EirGrid\_GenCapStatement\_v9\_web.pdf">http://www.eirgridgroup.com/site-files/library/EirGrid/4289\_EirGrid\_GenCapStatement\_v9\_web.pdf</a>

The TYTFS 2017 references documents that where published at the July 2017 data freeze date. The All-Island Generation Capacity Statement 2018-2027 is due to be published. The information in the 2018 GCS however does not fundamentally impact the study results presented in the 2017 TYTFS.

The overall transmission system power flows are usually lower in summer than in winter. However, this may not be the case for flows on all circuits. The capacity of overhead lines is lower during the summer period because of higher ambient temperatures. Network maintenance is also usually carried out during the summer/autumn period. Both of these factors can restrict the network, reducing its capability to transport power.

The annual minimum expected demand is referred to as the summer valley. It represents the lowest annual demand that is forecast, and is expected to occur during the summer period of each year. The Ireland and Northern Ireland summer valley demands are combined to produce an all-island summer valley demand. The summer valley cases examine the impact of the combination of low demand and low levels of conventional generation on the transmission system.

This minimum condition is of particular interest when assessing the capability of the transmission system to connect new generation. This is because with local demand at a minimum, the connecting generator must export more of its power across the transmission system.

The summer peak and valley demands occur between May and August. The autumn peak demand refers to the average peak demand value expected in the spring and autumn seasons. The autumn peak occurs between September - October and March - April.

Summer peak, summer valley and autumn peak demand forecasts can be expressed in terms of percentage of winter peak demand. These are shown in Table 3-2.

Table 3-2: Ireland and Northern Ireland Seasonal Demand Forecast as a Percentage of Winter Peak Demand

Season	Ireland seasonal demand forecast as a percentage of winter peak (%)	Northern Ireland seasonal demand forecast as a percentage of winter peak (%)
Winter Peak	100	100
Autumn Peak	N/A	86
Summer Peak	80	79
Summer Valley	35	30

These figures are consistent with historical demand data.

# 3.1.1. Large Demand Increases in the Dublin Area

# Background

In recent years there has been an increase in the level of enquiries for connection to the transmission system in the Dublin area. This document includes information on both current demand connections and future demand opportunities at the freeze date of July 2017. Our assessment of demand opportunities is presented in Chapter 8 and includes a section focused on the Dublin area.

The level of enquiries in the Dublin area is principally driven by the need for Information, Communications and Technology (ICT) industries and high-tech manufacturing companies to connect to a high quality power supply in the Dublin area.

### **Data Centres**

Ireland is an attractive business location and continues to attract world-class investments. The Industrial Development Authority (IDA) Ireland has cited access to a high-quality electricity grid as critically important for attracting new investment. This is particularly important in the ICT and high-tech manufacturing sectors.

Some of the world's best known companies have chosen Ireland as the location for their European data centre operations. Factors such as a temperate climate, stable power sources, internet connectivity and a skilled workforce have influenced their decisions. This is emphasised by nine out of the top 10 global software companies and US ICT companies locating strategic business activities in Ireland<sup>55</sup>.

At the data freeze date of July 2017, connected data centres had a combined total contracted maximum import capacity (MIC) of approximately 405 MVA. This includes both TSO and DSO connections. Beyond this, there continues to be significant interest in connecting other data centres to the grid in Ireland. There is approximately 920 MVA of data centres with either contracted capacity for connection to the grid or in the respective TSO/DSO connection offer processes. In addition to this, there continues to be ongoing enquiries regarding further data centres applications.

To put this in context, the current winter peak demand on the all-island transmission system is approximately 6,750 MW. If all applicants currently being processed were to connect, the data centre load could account for 20% of the all-island system peak demand.

#### What is a data centre?

A data centre is a facility used to house computer systems and associated components, such as telecommunications and storage systems. They underpin the operations of companies in the broad ICT sector, particularly those in social media and cloud computing. The size of the individual electricity demand connections depends on the scale of the business operation. These have varied from 20MW with some possibly extending to 250MW in the final stages of development. Their use of electricity tends to be constant throughout the year. The modern world increasingly requires the retention and use of vast volumes of data, so this trend is likely to continue for the foreseeable future.

# Impact on the System Demand Forecast

The all-island demand forecast used in this statement is based on an underlying growth rate trend of 1%. This includes a small amount of industrial block demand increases. Therefore, the potential connection of data centre demand on the scale discussed is equivalent to decades of natural demand growth. This will have an impact on the all island system demand forecast and generation capacity adequacy. This is assessed and discussed in the GCS.

The focus of the majority of the connection enquiries have been in the greater Dublin area. Depending on the number and scale of projects that materialise, new transmission solutions will be required to strengthen the grid to facilitate these connections. These transmission solutions are now under initial investigations and could vary from short lead-time to longer lead-time developments. The impact of these Dublin demand connections are described in greater detail in Chapter 8, Section 8.3.

### 3.2. Demand Data

Electricity usage follows some generally accepted patterns. For example, annual peak demand occurs between 17:00 - 19:00 hrs on winter weekday evenings. Minimum usage occurs during summer weekend night-time hours.

### 3.2.1. Generated Peak Demand Profiles

Figure 3-1 shows the generated peak demand profiles of Ireland and Northern Ireland on the day of the 2016 winter peak. The Ireland and Northern Ireland peaks did not occur on the same day. Peak demand for Ireland occurred on 21 November 2016, while peak demand occurred in Northern Ireland on 23 November 2016.

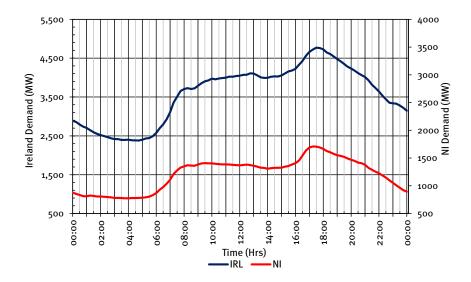


Figure 3-1: Generated Peak Demand Profiles for 2016

### 3.2.2. All-Island Demand Profiles

Figure 3-2 shows the profiles of the 2016 all-island winter peak, summer peak and summer valley. The percentage demand attributable to each jurisdiction during the peak and valley scenarios is also shown.

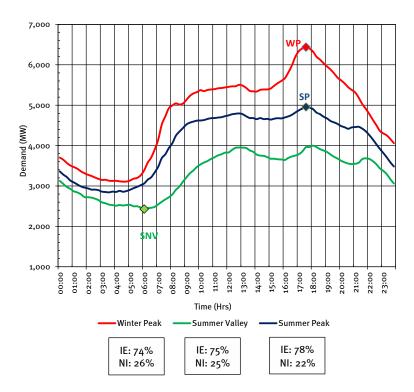


Figure 3-2: All-Island Daily Demand Profiles for Year 2016

# 3.2.3. All-Island Weekly Demand Peaks

Figure 3-3 shows the profile for the all-island, Northern Ireland and Ireland weekly peaks across the year for 2016.

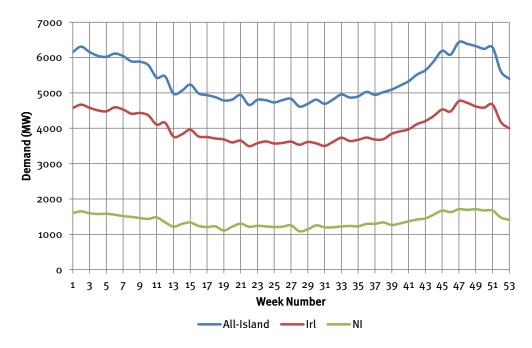


Figure 3-3: Weekly Demand Peak Values for Year 2016

### 3.2.4. Load Duration Curves

Figures 3-4 and 3-5 show the Ireland and Northern Ireland 2016 load duration curves, respectively. The curves show the percentage of time in the year that a particular demand value was exceeded. For example, demand exceeded 3,000 MW for 58% of the year in Ireland. Demand in Northern Ireland exceeded 1,000 MW for 49% of the year.

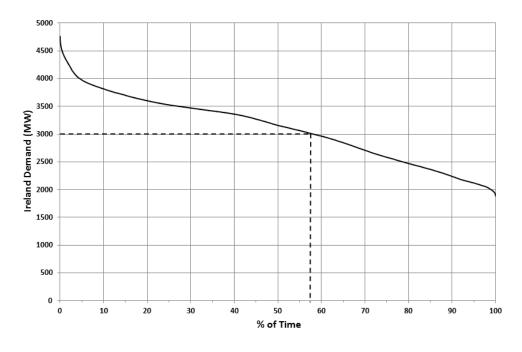


Figure 3-4: Ireland Load Duration Curve 2016

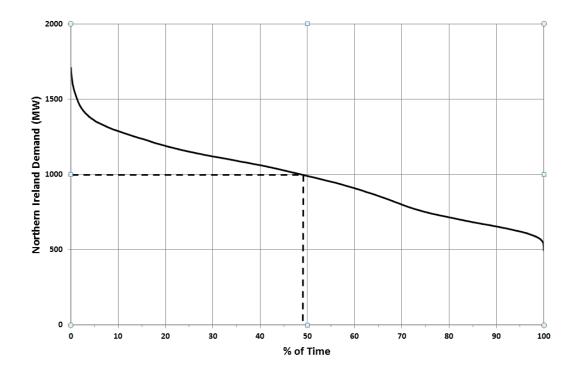


Figure 3-5: Northern Ireland Load Duration Curve 2016

# 3.3. Forecast Demand at Transmission Interface Stations in Ireland

Transmission interface stations are the points of connection to the transmission system. These interfaces include:

- Connections between the transmission and the distribution systems; and
- · Customers connected at 110 kV.

The interfaces are mostly 110 kV stations. In Dublin city, where the Distribution System Operator (DSO) operates the 110 kV network, the interface is usually at 220 kV stations.

Appendix C lists forecast demands at each transmission interface station. The forecast demands are given for winter peak, summer peak and summer valley for all years from 2017-2026. Demand projections at individual transmission stations are developed from the system demand forecasts on a top-down<sup>56</sup> basis.

The forecasting process includes regular monitoring and review of consumption trends in all parts of the country. The allocation of the system demand forecast to each station is pro-rata. This is based on an up-to-date measurement of actual peak demand at each station. Account is taken of planned transfers of demand between stations, as agreed with ESB Networks<sup>57</sup>. In this way, changes in the geodiversity of electricity consumption are captured. This process provides a station demand forecast and by extension a regional demand forecast for the short to medium term.

The system-wide demand forecasts, presented in Table 3-1, include transmission losses whereas the individual station demand forecasts do not. Transmission losses therefore account for the difference between system-wide demand and the sum of the demand at each interface station. The demand at each interface is given in Appendix C.

<sup>56</sup> This approach takes the overall demand forecast and breaks it down - using transmission system information, including historical data - to gain better knowledge of the sub-components of the demand forecast.

57 ESB Networks is the Distribution System Operator (DSO) in Ireland.

Demand forecasts for the small number of directly-connected customers are the current best estimates of requirements. In some cases, the estimates may be less than contracted MIC values. These values are chosen to give a better projection of expected demand on a system-wide basis. However, when analysing the capacity for new demand in a particular area, the MIC values of local directly-connected customers are assumed. These values are assumed to ensure that the contracted MIC is preserved.

A demand-side unit (DSU) consists of one or more demand sites that can be instructed by EirGrid and SONI to reduce electricity demand. DSUs are usually medium to large industrial premises. A DSU uses a combination of on-site generation or plant shutdown to deliver a demand reduction. Providing this dispatch availability means that the DSU is eligible for capacity payments in the Single Electricity Market (SEM).

It is noted that DSUs may reduce some customers' demands from time to time over winter peak hours. However, normal demand levels are included in the winter peak demand forecasts shown in Table C-1 in Appendix C. Normal demand levels are also used in the power flow diagrams in Appendix H. These normal demand levels are used since they are more indicative of general power flows.


### 3.4. Northern Ireland Bulk Supply Point (BSP) Demand

The 110/33 kV BSP demand forecasts are provided by NIE Networks<sup>58</sup>. These forecasts are based on demand trends at an individual nodal level and adjusted to align with system average cold spell (ACS<sup>59</sup>) forecasts. Consideration is also given to future block load transfers from one BSP to another. Tables and information relating to demand forecasts are contained in Appendix C.

<sup>58</sup> NIE Networks is the DSO in Northern Ireland.

<sup>59</sup> Demand trends are based on historical information. ACS analysis produces a peak demand which would have occurred had conditions been averagely cold for the time of year. This ACS adjustment to each winter peak seeks to remove any sudden changes caused by extremely cold or unusually mild weather conditions.



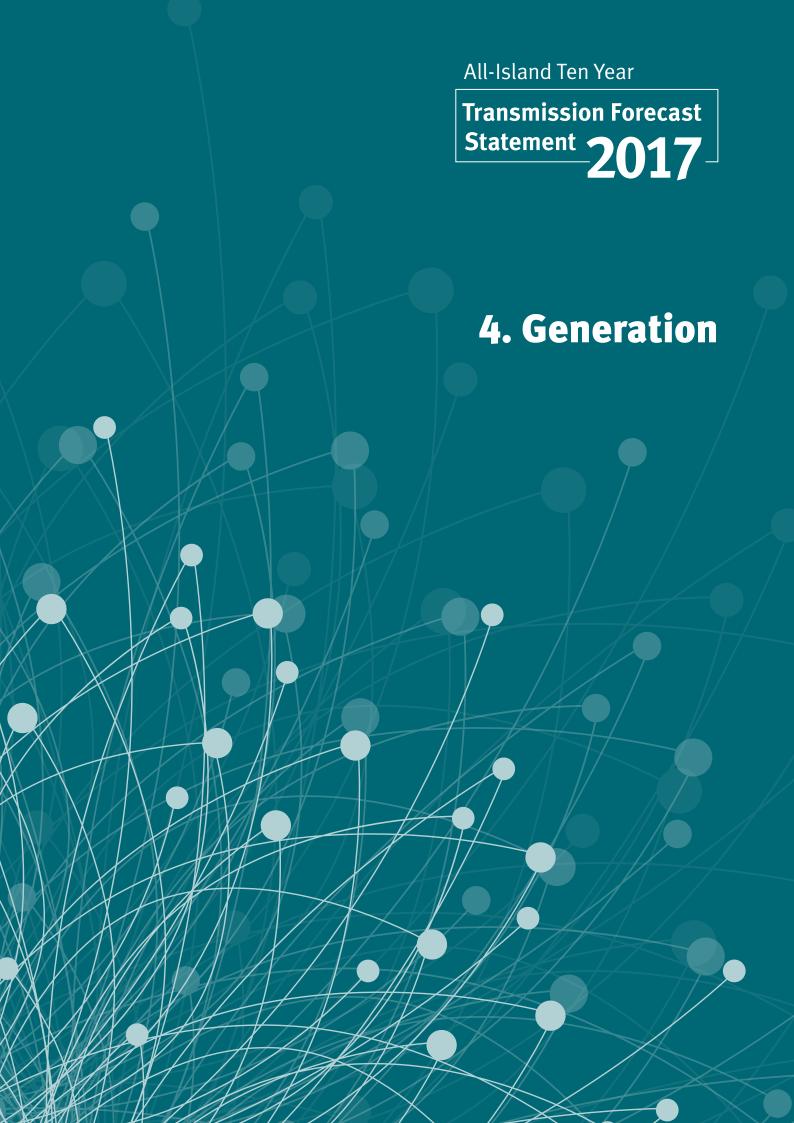



# 4. Generation

This chapter gives information about existing generation capacity. The chapter also defines future projections for the ten years 2017 to 2026. All generation capacity and dispatch figures in this statement are expressed in exported or net terms. This is the generation unit output less the unit's own auxiliary load.

In Ireland, renewable energy policy is driven by a binding European legal requirement. The requirement is for 16% of the country's total energy consumption to be met by renewable energy sources (RES) by 2020.

The Irish Government aims to achieve 40% renewable electricity, 12% renewable heat and 10% renewable transport to meet this overall requirement. 3,900 - 4,300 MW of installed wind generation will be needed to meet approximately 37% of electricity demand in 2020. The remaining 3% is expected to be sourced from hydro generation, solar, bio-energy and renewable Combined Heat and Power (CHP) energy production.

The Strategic Energy Framework (SEF)<sup>60</sup> 2010 for Northern Ireland sets the renewable energy policy in Northern Ireland. It states that 40% of electricity consumption in Northern Ireland should come from renewable sources by the year 2020.

Currently SONI, along with NIE Networks, are working to facilitate the connection of the renewable generation required to meet the 40% target by the year 2020. This 40% government target translates into approximately 1,600 MW of renewable generation capacity in Northern Ireland<sup>61</sup>.

A freeze date for data was applied when compiling this TYTFS. This freeze date enables transmission system analyses to be carried out for inclusion in the document. The data freeze date for TYTFS 2017 is July 2017, with all data accurate as at that date.

### 4.1. Generation in Ireland

At the data freeze date 10,015 MW of generation capacity was installed in Ireland, as detailed in Table 4-1.

Table 4-1: Installed Generation Capacity in Ireland

Transmission System Connected (MW)	Distribution System Connected (MW)	Total Generation Capacity (MW)
8,125 MW <sup>62</sup>	1,890 MW	10,015 MW

# 4.1.1. Existing and Planned Transmission Connected Generation

Table 4-2 lists planned generators that have executed transmission connection agreements, along with their expected connection dates.

Since the data freeze date some customers have modified their connection agreements to release contracted capacity. This was done in line with CRU's Connection Policy Transitional Arrangements Decision (CER/16/284). The transmission customers that released contracted capacity are listed separately in Table 4-3.

<sup>60</sup> https://www.economy-ni.gov.uk/articles/strategic-energy-framework-2010

<sup>61</sup> Approximately 1,350MW of this renewable generation capacity will be wind generation capacity.

<sup>62</sup> Please note this figure does not include the East West Interconnector.

Table 4-2: Contracted Transmission Generation<sup>63</sup>

Generator	Generation Type	Generation Capacity (MW)	Expected Connection  Date
Athea Phase 2	Wind	19	Dec-21 <sup>63</sup>
Barnadivane	Wind	60	Oct-17
Buffy	Wind	64	Dec-22 <sup>63</sup>
Cahernagh Mid Merit	OCGT	20	Dec-22 <sup>63</sup>
Castletownmoor	Wind	120	Dec-22 <sup>63</sup>
Clahane Phase 2	Wind	14	Aug-18
Cordal	Wind	90	Dec-22 <sup>63</sup>
Carrickaduff	Wind	66	Dec-22 <sup>63</sup>
Carrickalangan	Wind	72	Dec-22 <sup>63</sup>
Dromada Phase 2	Wind	18	Dec-20 <sup>63</sup>
Grousemount	Wind	114	Nov-17
Keelderry	Wind	27	Nov-17
Kelwin Power Plant	Hybrid	42	Jun-18
Knockalough	Wind	34	May-18
Loughaun North	Wind	45	Nov-17
Oriel	Wind	210	Dec-22 <sup>63</sup>
Oweninney Power 1	Wind	89	Mar-19
Oweninney Power 2	Wind	83	Mar-19
Oweninney 5	Wind	50	Dec-22 <sup>63</sup>

Table 4-3: Connection Policy Transitional Arrangements Capacity Release by Transmission Customer

Facility Name	Original Station	MEC Released	Full/Partial Release
Athea Wind Farm	Athea 110 kV station	48	Full
Kill Hill Wind Farm	Kill Hill 110 kV station	22.5	Partial
Glanlee Wind Farm	Glanlee 110 kV station	6	Partial
Cordal Wind Farm	New 110 kV station at Cordal, Co. Kerry	11	Partial
Cahernagh Mid Merit Plant	New 110 kV station in north Limerick	81	Partial
Oweninny Wind Farm 5	New 110 kV station in north Mayo	148.9	Partial
Cuileen Power	Athlone 110 kV station	98.4	Full
Suir Power	Cahir 110 kV station	98	Full
Nore Power	Kilkenny 110 kV station	98.4	Full

<sup>63</sup> At the date of the data freeze (July 2017), this generation project did not have an estimated energisation date available. For the purposes of our analyses, we have assumed that this project will connect over the period of this TYTFS.

### 4.1.2. Planned Closure of Generation Plant

The closure of generation plant could have a significant impact on the ability of the transmission system to comply with standards. The EirGrid Grid Code specifies the minimum length of notice a generator must give the TSO before retirement or divestiture. The closure of a generator with capacity less than or equal to 50 MW requires at least 24 months' notice. Generators with larger capacity than this must give at least 36 months' notice.

Some older generators will come to the end of their lifetimes over the next ten years. These generators are noted in All-Island Generation Capacity Statement 2017-2026 (GCS) and are listed in Table 4-4.

**Table 4-4: Closure of Conventional Generation** 

Generator	Generation Capacity (MW)	Expected to close by end of year:
Aghada AD1	258	2023
Aghada AT1	90	2023
Marina CC	95	2023
North Wall 5	104	2023
Tarbert 1, 2, 3, 4	592	2022

### 4.1.3. Wind Generation

Over the past two decades wind power generation in Ireland has increased significantly. The level of wind generation in Ireland is expected to continue to grow over the period of this TYTFS. The expected growth in wind generation is displayed in Figure 4-1. The information presented in Figure 4-1 is a combination of connected and contracted wind generation<sup>64</sup>.

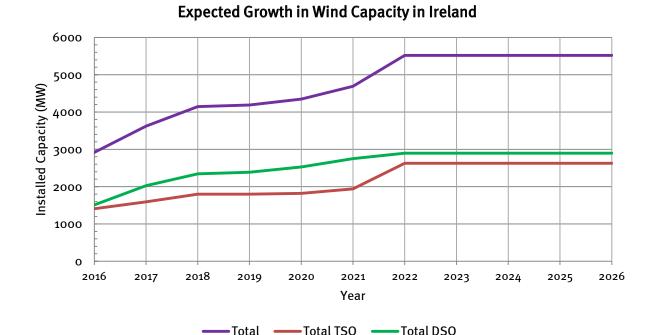


Figure 4-1: Expected Growth in Wind Capacity, 2016 to 2026

<sup>64</sup> Detailed information on these figures is presented in Tables D-2 and D-3 in Appendix D.

Table 4-5 shows the existing and committed wind generation capacity totals expected to be connected by the end of each year<sup>65</sup>. These wind farms have signed connection agreements and are committed to connecting to either the transmission or distribution system over the next few years.

Table 4-5: Existing and Committed Wind Capacity Totals (MW)

Connection	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
Transmission	1594	1800	1800	1818	1942	2625	2625	2625	2625	2625
Distribution	2027	2344	2387	2528	2750	2896	2896	2896	2896	2896
Total	3621	4144	4187	4346	4692	5521	5521	5521	5521	5521

#### 4.1.4. Offshore Generation

Currently there is one offshore generation unit in Ireland, a 25 MW offshore wind farm at Arklow bank. In February 2014, the Irish Government published an Offshore Renewable Energy Development Plan (OREDP)<sup>66</sup>. The aim of this work is to implement a framework for the sustainable development of offshore renewable generation in Ireland. The OREDP identifies three high level goals:

- 1. That Ireland harnesses the market opportunities presented by offshore renewable energy to achieve economic development, growth and jobs;
- 2. To increase awareness of the value, opportunities and societal benefits of developing offshore renewable energy; and
- 3. That offshore renewable energy development does not adversely impact our rich marine environment and its living and non-living resources<sup>66</sup>.

The OREDP will also provide a structure through which Ireland can input to the development of the:

- European Blue Energy Strategy; and
- US/Ireland Memorandum of Understanding (MoU) on Ocean Energy.

The Department of Communications, Climate Action and Environment (DCCAE) is leading the implementation of OREDP. It has developed a robust governance structure to deliver on the aims of the plan. EirGrid sits on the steering group and are on a number of OREDP working groups.

### 4.1.5. Demand Side Units

As at the data freeze date, in Ireland nine demand side units (DSU) had entered the Single Electricity Market. These DSUs have a combined dispatchable capacity of 346 MW.

### 4.1.6. Fmbedded Generation

As of July 2017, there was approximately 1,890 MW of embedded generation plant. This includes plant connected to the distribution system or to the system of a directly-connected demand customer. This figure comprises of small conventional and renewable units. Conventional units include CHP schemes and small industrial thermal units.

<sup>65</sup> The individual wind farm details are included in Tables D-2 and D-3 of Appendix D.

<sup>66</sup> http://www.dcenr.gov.ie/energy/en-ie/Renewable-Energy/Pages/OREDP-Landing-Page.aspx

Renewable generation included in this figure consists of:

- Wind;
- Small Hydro;
- Land-fill gas (LFG);
- Biogas; and
- Biomass.

Table 4-6 details the existing embedded generation capacity totals by generation type.

Table 4-6: Existing Embedded Generation in Ireland

	Wind	Small Hydro	Biomass/LFG	СНР	Peaking	Total
Net Capacity (MW)	1,640	26	85	75	64	1,890

Embedded generators reduce the demand supplied through Transmission Interface Stations. Forecasts of demand levels at individual Transmission Interface Stations are presented in Appendix C. These forecasts take account of the contribution of the existing non-wind embedded generators<sup>67</sup>.

GCS 2017 estimated biomass CHP to grow steadily from 0 MW in 2017 to 60 MW capacity by 2020. It is not expected that conventional CHP capacity will change significantly during this period.

Table 4-7 shows details of embedded non-wind generation capacity committed to the distribution system at the freeze date of July 2017.

<sup>67</sup> Because of the variability of wind, a fixed contribution from embedded wind farms is not taken into account in the calculation of the peak transmission flow forecasts. Rather a number of wind scenarios are considered in the TYTFS analyses.

Table 4-7: Contracted Non-Wind Embedded Generation in Ireland

Station	Technology	Capacity	Connection Date
College Park	Diesel	4 MW	Dec-18
Glasmore	Biogas	0.5 MW	Dec-18
Glasmore	Biomass	0.5 MW	Dec-17
Bandon	Biomass	16 MW	Sep-18
Meath Hill	Natural Gas	4 MW	Jan-18
Mallow	Solar	5 MW	Aug-18
Moy	Landfill Gas	0.5 MW	Dec-17
Mullingar	Solar	4 MW	Sep-18
Cahir	Solar	4 MW	Dec-18
Kilkenny	Solar	4 MW	Aug-18
Tonroe	Biogas	1.5 MW	Mar-18
Drybridge	Solar	4 MW	Sep-18
Newbridge	Solar	4 MW	Dec-18
Dungarvan	Biogas	1.7 MW	Dec-17
Navan	Biomass	13 MW	Dec-18
Letterkenny	Biogas	0.5 MW	Nov-17
Bellacorick	Wave	10 MW	Sep-18
Arklow	Hydro	0.1 MW	Dec-17
Tawnaghmore	Biomass	49 MW	Dec-20
Doon	Hydro	0.9 MW	Dec-17

### 4.2. Generation in Northern Ireland

At the data freeze date 3,624 MW of generation capacity was installed in Northern Ireland, as detailed in Table 4-8.

Table 4-8: Northern Ireland Installed Generation Capacity

Transmission System Connected (MW)	Distribution System Connected (MW)	Total Generation Capacity (MW)
2,178	1,446	3,624

The 2,178 MW connected to the transmission system consists of:

- Conventional generation; and
- Slieve Kirk Wind Farm<sup>68</sup>.

<sup>68</sup> At the freeze date Slieve Kirk was the only transmission connected wind farm power station and has a capacity of 73.6 MW. Brockaghboy wind farm, with a capacity of 47.5 MW, was connected in August 2017.

### 4.2.1. Existing and Planned Transmission Connected Generation

# **Existing Conventional Generation**

In Northern Ireland, conventional thermal generation plant can be split into two contractual categories:

- Plant contracted to Power NI Energy Limited PPB (Contracted Plant); and
- Independent Market Participants (Non-Contracted Plant).

Table D-6 in Appendix D provides a list of contracted and non-contracted generators connected to the Northern Ireland Transmission System.

### Contracted Conventional Generation

Plant contracted to Power NI Energy Limited via their Power Procurement Business (PPB) under prevesting contracts, or contracts negotiated thereafter, totals 587 MW. It is measured as output capacity at generator terminals. Details of capacity and contract information for individual generators can be seen in Tables D-1 and D-6 in Appendix D. The contracts contain expiry dates, though the Utility Regulator may cancel contracts at earlier cancellation dates.

The Power Purchasing Agreements (PPA) or Generating Unit Agreements (GUAs) cover availability, operating characteristics, payments, metering etc. These agreements cover matters such as outage planning, emissions and fuel stocks.

# Independent Market Participants (IMP)

The Utility Regulator has a duty to promote competition in the generation and supply of electricity. This is in line with the EU IME Directive (concerning common rules for the internal market in electricity 2003/54/EC). This directive was introduced in June 2003. As of July 2017 there is 1,477 MW of IMP capacity in Northern Ireland.

### 4.2.2. Planned Retirement/Divestiture of Generation

In line with the information available to SONI at the data freeze date of July 2017, the following assumptions have been made. In 2016, AES Ballylumford entered into a Local Reserve Services Agreement (LRSA) with SONI for the provision of 250 MW of local reserve. This will see Ballylumford ST4 and ST5 remaining connected (at reduced capacity) until the end of 2018 with an option for SONI to extend this by a further 2 years if deemed required.

The generation output of Kilroot ST1 and ST2 is anticipated to be restricted. The restriction is due to the Industrial Emissions Directive (IED)<sup>69</sup>. The restriction includes limited emissions each year from 2016-2020, followed by severely restricted running hours from 2021-2022. As noted in GCS 2017 Kilroot ST1 and ST2 are due to be decommissioned by the end of 2023.

<sup>69</sup> http://ec.europa.eu/environment/industry/stationary/ied/legislation.htm

### 4.2.3. Northern Ireland Renewable Generation

# Existing/Approved Renewable Generation

Existing and approved renewable generation in NI is shown geographically in Figure 4-2. The totals are derived from locational and capacity information<sup>70</sup> on:

- Renewable generation schemes that are connected to the Northern Ireland network;
- · Schemes that are currently in construction; and
- Schemes approved by the planning service.



Figure 4-2: Existing and Committed Northern Ireland Renewable Generation

The map indicates points at which renewable generation is connected to or is assumed to connect to. These points include 110/33 kV Bulk Supply Points (BSPs) and 110/33 kV Cluster substations.

In line with the criteria set out in the NIE Distribution Charging Statement<sup>71</sup>, NIE Networks, in its role as Distribution Network Owner (DNO), identified a number of Cluster<sup>72</sup> substations that they wished to develop.

These distribution generators connect into the cluster at the 33 kV level. SONI is responsible for the delivery of the transmission elements of the Cluster substation. Cluster substations already exist at Magherakeel, Tremoge, Gort, Rasharkin and Brockaghboy, with a further three planned at Curraghmulkin, Agivey and Kells (see Chapter 2).

<sup>70</sup> As at data freeze date – July 2017

<sup>71</sup> Statement of Charges for Connection to the Northern Ireland Electricity Networks' Distribution System: http://www.nienetworks.co.uk/documents/connections/statement-of-charges

<sup>72</sup> A 110/33kV substation in the vicinity of a number of distribution generator locations.

# **Unapproved Renewable Generation**

A number of renewable generation projects are assumed to be commissioned in Northern Ireland between 2017 and 2026. These assumptions have been derived from a number of sources. The sources include:

- NIE Networks;
- The Strategic Energy Framework for Northern Ireland;
- The Strategic Environmental Assessment of offshore wind and marine renewable energy<sup>73</sup>; and
- The Onshore Renewable Electricity Action Plan (OREAP).

Renewable generation included in the TYTFS study files is detailed in Appendix D.

#### Offshore Renewable Generation

Our assumptions regarding the level and location of offshore generation connected to the NI transmission system are based on best information available at the data freeze date.

For the purpose of TYTFS analyses we assume that by 2026 there will not be any offshore wind connected. However, development rights are in place for tidal sites in Northern Ireland's coastal waters.

The development rights were announced for two 100 MW tidal developments along the north coast. The developers granted these developments rights have been in contact with SONI regarding the connection of off-shore renewable generation.

### 4.2.4. Demand Side Units

As at the data freeze date, in Northern Ireland five demand side units (DSU) had entered the Single Electricity Market. These DSUs have a combined dispatchable capacity of 74 MW.

<sup>73</sup> https://www.economy-ni.gov.uk/articles/strategic-energy-framework-2010

### 4.2.5. Embedded Generation

# **Existing Embedded Generation**

Table 4-9 shows a breakdown of the existing Northern Ireland embedded generation.

Table 4-9: Northern Ireland Embedded Generation

Generation	Net Capacity (MW)
Large Scale Wind	1038
Small Scale Wind	145
Large Scale Biomass	17
Small Scale Biomass	5
Small Scale Solar	96
Small Scale Hydro	5
Landfill Gas	23
CHP	30
AGU	86
Tidal/Wave	1
Total	1,446

There is a total of 86 MW of Aggregated Generating Units (AGUs) in Northern Ireland registered in the SEM by three parties.

Two of these AGUs, iPower and EmPower, consist of mostly distribution connected diesel generator sets located around Northern Ireland. The third, ContourGlobal, consists of CHP gas generation. These units currently participate in the SEM.

Including the ContourGlobal AGU, there is 42 MW of CHP plant connected to the Northern Ireland Distribution System. This will increase with the connection of the 15 MW energy from waste CHP plant currently under construction by Bombardier in Belfast.

There is currently 5 MW of small-scale hydro generation installed on the waterways of Northern Ireland. This is a mature technology. Due to the lack of suitable new locations, limited increase in the small-scale hydro is expected in the foreseeable future.

### **Peak Load Reduction**

A number of customers have been reducing energy consumption at times of peak demand. This is achieved by load shifting or by running private generation. SONI has tended to view this generation as non-permanent due to a number of factors:

- The operation of this plant is not as reliable as conventional contracted plant;
- Variable generation costs, e.g. diesel and hire charges; and
- Variable tariff price signals.

Generation of this type is estimated to total 25 MW.

### 4.2.6. Northern Ireland Generation Mix

The chart in Figure 4-3 shows all existing and planned generation in NI over the ten year period covered by this TYTFS. Superimposed onto the chart is the median demand forecast<sup>74</sup> for NI. The chart illustrates a surplus of generation in relation to the demand from a deterministic point of view. However, factors such as economic dispatch, wind variability, reserve requirements and actual HVDC interconnector flows are not taken into account. The chart also shows the large increase in renewable generation expected over the next ten years.

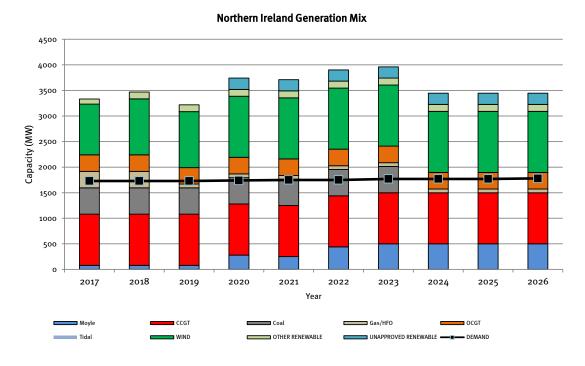


Figure 4-3: Northern Ireland Generation Mix

<sup>74</sup> As in the All-Island Generation Capacity Statement 2017-2026.







# 5. Transmission System Performance

This chapter describes the future performance of the transmission system in terms of compliance with planning standards<sup>75</sup>. System performance levels are assessed using:

- Forecast power flows; and
- Short circuit<sup>76</sup> current levels.

The power flow and short circuit analyses results presented in this document are based on updated information, which includes changes to:

- The existing and planned transmission system;
- · Demand projections; and
- · Generation connections.

This updated information is based on the best information available at the data freeze date, July 2017.

#### 5.1. Forecast Power Flows

The power flows on the all-island transmission system, at any given time, depend on:

- The transmission system configuration;
- Demand levels; and
- The output from each generator.

There are many possible combinations of generator dispatches that can meet the demand requirements. There are also many demand scenarios that may occur on the transmission system.

Renewable generation connected to the all-island transmission and distribution system has the effect of altering power flows. The increase in renewable generation<sup>77</sup> is one of the main factors behind recent changes to power flows on the transmission system.

When examining transmission system performance a range of economic generation dispatches are considered. The generation dispatches used in our power flow analysis are prepared on an all-island basis<sup>78</sup>. Power flows across the existing 275 kV and planned 400 kV internal<sup>79</sup> interconnectors are modelled to operate within transfer limits. The dispatch scenarios also consider imports and exports of power across the existing Moyle and East-West interconnectors.

Transmission system power flows are shown on the schematic diagrams found in Appendix H. The power flow diagrams show the flow of real and reactive power on the transmission system under normal conditions.

As can be seen in Appendix H, the level of renewable generation increases over the ten year period. As renewable generation increases, power flows from the West of the Island to the East can be seen to increase. This is because renewable power generated in the Western regions is supplying the larger demand levels in the East (Belfast and Dublin). These increased power flows are more significant at times of minimum demand and high renewable generation output.

<sup>75</sup> Please note that different planning standards are applied in Ireland and Northern Ireland.

<sup>76</sup> Short circuit analysis was carried out on both the Ireland and Northern Ireland transmission systems.

<sup>77</sup> Projected levels of renewable generation connections are detailed in Tables D-2 and D-3 in Appendix D.

<sup>78</sup> This is reflective of how generation is dispatched in the Single Electricity Market.

<sup>79</sup> Internal to the all-island transmission system. These are the interconnectors between Ireland and Northern Ireland. This type of interconnector is also known as a tie line.

Another effect that can be seen in Appendix H is the effect of increased renewable generation levels on reactive power requirements on the transmission system. At high levels of renewable generation, reactive power support is needed to keep voltages within planning standard<sup>80</sup> limits. The power flow diagrams show the following:

- In the 2017 winter case there is 328 Mvar of reactive power support in service.
- In the winter 2023 case this figure increases to 622 Mvar of reactive power support in service<sup>81</sup>.

# 5.2. Compliance with Planning Standards

The transmission system is planned and operated to technical requirements and standards in Ireland and Northern Ireland. These requirements are laid out in the Transmission System Security and Planning Standards (TSSPS<sup>82</sup>) documents. These standards are in line with international standards.

The standards are deterministic<sup>83</sup> – as are those generally used throughout the world in transmission planning. They set out an objective standard which delivers an acceptable compromise between the cost of development and service delivered. Rather than conducting subjective benefit analysis in each case, it is preferable to plan to meet an objective standard and carry out analysis of the options available to meet the standard.

The need for transmission system development is identified when the simulation of future conditions indicates that the TSSPS would be breached.

#### 5.2.1. Ireland

Our view of future transmission needs and our plan to develop the Irish network through specific projects to meet these needs over the next ten years is presented in our Transmission Development plan (TDP<sup>84</sup>). The TDP presents the projects which are currently being advanced to solve the needs of the transmission network. In addition, future needs that drive future potential projects are also discussed. We issue the TDP annually.

It is possible that changes will occur in the need for; scope of; and timing of the developments in the TDP. Similarly, it is likely, given the continuously changing nature of electricity requirements, that new developments will emerge that could impact the plan as presented. The long-term development of the network is under review on an on-going basis.

TYTFS 2017 includes transmission system development projects that have received capital approval. Details of these projects can be found in the TDP.

<sup>80</sup> This refers to the Ireland and Northern Ireland planning standards. (TSSPS Ireland applies to the Irish transmission system and TSSPS Northern Ireland applies to the NI transmission system).

<sup>81</sup> This is in addition to reactive power that is supplied by online generation.

<sup>82</sup> The Irish transmission system is developed in accordance with the TSSPS Ireland: <a href="http://www.eirgridgroup.com/site-files/library/EirGrid-Transmission-System-Security-and-Planning-Standards-TSSPS-Final-May-2016-APPROVED.pdf">http://www.eirgridgroup.com/site-files/library/EirGrid-Transmission-System-Security-and-Planning-Standards-TSSPS-Final-May-2016-APPROVED.pdf</a>

 $<sup>\</sup>label{thm:condition} \begin{tabular}{ll} The Northern Irish Transmission System is developed in accordance with the TSSPS Northern Ireland: $$\underline{http://www.soni.ltd.uk/media/Northern-Ireland-TSSPS-September-2015.pdf}$$$ 

<sup>83</sup> The deterministic methodology is often referred to as the N-1 criterion. The system must have sufficient capacity so that in the eventuality of a probable system outage, there are no resulting system problems such as overloading, under-voltage, over-voltage or instability.

<sup>84</sup> This is not an all-island document. The latest version of the Irish Transmission Development Plan is available at www.eirgridgroup.com.

# 5.2.2. Northern Ireland

The Northern Ireland transmission projects included in TYTFS 2017 are based on the Transmission Investment Plan. Capital projects are mainly driven by increases in Northern Ireland demand and renewable generation connection levels. Planned developments include load related and asset replacement projects. These projects mainly impact on the rating of switchgear<sup>85</sup> and circuits. Details of these projects can be found in Chapter 2.

# 5.3. Short Circuit Current Levels<sup>86</sup>

Short circuit currents<sup>87</sup> occur during a fault condition on the transmission system. Depending on the type of fault, these short circuit currents can be very high. All transmission system equipment must be capable of carrying these very high currents.

Protection devices, in particular circuit breakers, must be capable of closing onto high currents created by a fault on the transmission system. They must also be capable of interrupting high currents to isolate a fault. Correct operation is essential for minimising risk to personnel and preventing damage to transmission equipment. Correct operation of protection devices is also necessary for maintaining system stability, security and quality of supply.

Short circuit current levels must be considered as the transmission system is developed and as new generation or demand is connected. In Ireland the EirGrid Grid Code specifies short circuit levels at the transmission connection point. These values are shown in Table 5-1. Users connecting to the transmission system are required to design their plant and apparatus to these specified levels. Equipment at lower voltage levels must also be designed to withstand short circuit current levels.

Table 5-1: Standard Equipment Rating and Maximum Design Short Circuit Currents

Voltage Level (kV)	Standard Equipment Short Circuit Rating (kA)		
	Ireland		Northern Ireland
400	50		50
275	n/a		40
220	40		n/a
110	Countrywide	25	40
	Designated sites	31.5	

Table 5-1 also includes short circuit requirements for new users connecting to the Northern Ireland transmission system. Northern Ireland system users are recommended to design their plant and apparatus to withstand short circuit current levels set out in Table 5-1, as a minimum. The design of a user's plant is also subject to detailed short circuit current level assessment.

<sup>85</sup> Devices used to control, protect and isolate electrical equipment.

<sup>86</sup> Short circuit currents can also be known as "fault levels".

<sup>87</sup> A short circuit current is an abnormal current that flows along an unintended, low resistance path. Short circuit currents can be extremely high and may cause harm to personnel or damage equipment.

Changes to the transmission system or the addition of generation can increase the short circuit current levels at nearby<sup>88</sup> stations. Forecast increases in short circuit current levels can indicate transmission system equipment at risk of having its rating exceeded. Should this be the case, it may be necessary to replace this equipment with higher rated plant. Risk mitigation measures may also be implemented to reduce short circuit current levels. Short circuit current levels are calculated for all transmission system nodes in accordance with engineering recommendation G74<sup>89</sup>. Engineering recommendation G74 is based on international standards.

The analysis was carried out for single and three phase faults, for winter peak and summer valley studies. Short circuit levels were assessed for the years 2017, 2020 and 2023, and the results are presented in Section 5.3.1. A description of the calculation methods used are given in Appendix E.

Appendix E also provides the results of the short circuit analysis alongside an explanation of the terms used in short circuit discussions in this document.

Winter peak analysis is carried out to represent the most onerous transmission system conditions, where maximum short circuit currents on the transmission system are most likely to occur. During winter peak analysis, generators that are not providing real or reactive power are switched on in the study and dispatched at 0 MW. This measure ensures short circuit current contributions from all generator sources are considered in the studies. This ensures the most onerous, but credible, conditions are used for the calculation of short circuit current levels at each bus.

Analysis of summer valley is carried out to indicate minimum short circuit currents on the transmission system based on intact network conditions. The minimum short circuit current at each bus is dependent on generation dispatch and transmission system conditions. Those requiring the expected minimum short circuit current level at a particular bus are advised to contact us directly. During summer valley analysis, generators that were not dispatched were not connected to the system.

Both the maximum and minimum short circuit current level studies assume that the transmission system is in the normal intact condition. The economic generation dispatches for the winter peak and summer valley studies are presented in Appendix D.

The results presented in Section 5.3.1 are the total busbar short circuit current levels. Short circuit current that could flow through each individual circuit breaker may be less than the total busbar short circuit current. This is dependent on network configuration and conditions.

# 5.3.1. Assessment of Short Circuit Levels in Ireland

The transmission system in Ireland is designed and operated to maintain short circuit current levels below the standard equipment ratings<sup>90</sup>. In planning the system a 10% margin is applied (for example 220 kV short circuit currents will be kept below 36 kA). This is done for security reasons.

As Table 5-1 indicates, while most 110 kV stations are designated as 25 kA, the EirGrid Grid Code stipulates that certain 110 kV stations may be designated as 31.5 kA. A new station could be designated as 31.5 kA from the start, or an existing 25 kA station may be changed to 31.5 kA. When a station changes from 25 kA to 31.5 kA, the equipment at that station may need to be modified. Station equipment at lower voltages also needs to be replaced in order to comply with this design rating.

<sup>88</sup> This means stations that are electrically nearby, which does not necessarily mean those geographically closest. 89 IEC 60909 was an international standard issued in 1988 which provided guidance on the manual calculation of short circuit currents in a three phase AC system. The conservative results produced by this method could result in over investment and Engineering Recommendation G74 was introduced as an outline procedure for computer-based derivation of short circuit currents.

<sup>90</sup> These are listed at each voltage level in Table 5-1.

The stations currently designated with a 31.5 kA 110 kV equipment rating are: Barnahely, Cloghran, College Park, Corduff, Finglas, Kilbarry, Knockraha, Louth, Marina, Raffeen, Tarbert and Trabeg. EirGrid will annually publish an updated list of designated stations.

In Appendix E, the results for Ireland include X/R ratios, transient AC ( $I_k$ ') and subtransient AC ( $I_k$ '') currents. These results provide an indication of the strength of the transmission system.

#### 5.3.2. Assessment of Short Circuit Levels in Northern Ireland

The Northern Ireland transmission system is designed and operated to maintain short circuit current levels below equipment ratings. These ratings are listed in the tables in Appendix E, Section E.6.3. The individual substation ratings are based on the lowest rated equipment at each substation.

The Northern Ireland results in Appendix E include transmission substation ratings for:

- AC & DC X/R Ratios;
- Initial Short Circuit Current (I");
- · Peak Make Current (ip) and
- RMS Break Current (IB).

The I" and ip values are used to assess the necessary rating of electrical equipment required to close onto short circuit currents.

The IB values are used to assess the capability of electrical equipment required to open and break short circuit current.

#### 5.3.3. Maximum Short Circuit Current Results

Short circuit results show that a number of Northern Ireland transmission nodes are experiencing short circuit current levels close to their current rated capability. Careful management of these issues is needed to ensure levels remain within their current rated capability.

In general throughout Ireland short circuit currents are well within standard ratings. However, there are a number of stations in Dublin and Cork where short circuit current levels are above 80% of standard ratings. There are also stations in Kerry, Limerick, Wexford, Clare and Offaly where short circuit current levels are high. We will continue to monitor short circuit current levels at all stations and have plans in place to ensure that they remain within safety standards.

Figure 5-1 indicates the locations where short circuit current levels are high in 2023. In Ireland the short circuit level results are represented as a percentage of standard equipment ratings. In Northern Ireland the short circuit level results are represented as a percentage of actual equipment ratings.

Three short circuit level ranges are represented in Figure 5-1:

- Yellow dots represent substations where short circuit current results are between 80% and 90% of the ratings;
- Orange dots represent substations where short circuit current results are between 90% and 100% of the ratings; and
- Red dots indicate substations where the short circuit current results exceed ratings.

Several nodes have been found to experience short circuit current levels that exceed 100% of their current rated capability. In Northern Ireland analysis indicates that Coolkeeragh will exceed 100% of its current rated capability. In Ireland, Corduff and Kilpaddoge 110 kV stations exceed 100% of standard ratings. However, Corduff is a designated station with 110 kV equipment designed to 31.5 kA and Kilpaddoge has equipment designed to 40 kA.

We have plans in place to uprate equipment or mitigate risks at the stations identified in this analysis.

In the interim risk mitigation measures such as system reconfiguration have been employed to maintain short circuit current levels at safe levels.

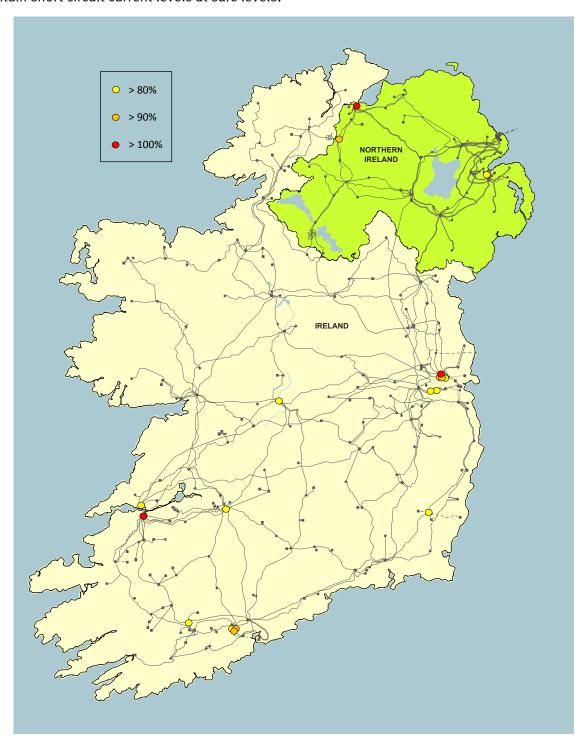


Figure 5-1: Short Circuit Current Levels for Winter Peak 2023

Table 5-2 below provides information on the transmission nodes where the short circuit current level is above 90% of equipment ratings<sup>91</sup> in tabular form for the study years: 2017; 2020; and 2023.<sup>92,93</sup>

Table 5-2: Nodes Approaching or Exceeding Rating

Rating%	2017	2020	2023
>100	BPS 110 kV	CDU 110 kV <sup>92</sup>	CDU 110 kV <sup>92</sup>
	CDU 110 kV	CPS 110 kV	CPS 110 kV
		KPG 110 kV <sup>92</sup>	KPG 110 kV <sup>92</sup>
	CLG 110 kV <sup>93</sup>	CLA 110 kV	CLG 110 kV <sup>93</sup>
	COL (I) 110 kV	CLG 110 kV <sup>93</sup>	COL (I) 110kV <sup>93</sup>
	CPS 110 kV	COL (I) 110 kV <sup>93</sup>	KBY 110 kV <sup>93</sup>
	MR 110 kV <sup>93</sup>	CPS 110 kV	KLN 110 kV
	TAN 110 kV	CSH 110 kV	KRA 110 kV <sup>93</sup>
>90	TBG 110 kV <sup>93</sup>	KBY 110 kV <sup>93</sup>	MR 110 kV <sup>93</sup>
		TAN 110 kV	STR 110 kV
		KLN 110 kV	TBG 110 kV <sup>93</sup>
		KRA 110 kV <sup>93</sup>	
		MR 110 kV <sup>93</sup>	
		STR 110 kV	
		TBG 110 kV <sup>93</sup>	

# Stations Where the Rating has been Exceeded

#### i) Ireland Stations where the rating has been exceeded

In Ireland, Corduff and Kilpaddoge 110 kV stations exceed 100% of standard ratings. However, Corduff is a designated station with 110 kV equipment designed to 31.5 kA and Kilpaddoge has equipment designed to 40 kA.

In Ireland there are plans in place to manage short circuit current levels at the identified stations.

#### ii) Northern Ireland Stations where the rating has been exceeded

#### Ballylumford 110 kV

Short circuit current levels at the Ballylumford 110 kV node exceed the existing substation ratings. This occurs under maximum generation conditions when both of the 275/110 kV interbus transformers are in service.

<sup>91</sup> In Ireland these results are presented as a percentage of standard equipment ratings. In Northern Ireland they are a percentage of actual equipment ratings. Please note the Northern Ireland results in 2020 and 2023 take account of planned switchgear upratings in deriving this percentage.

<sup>92</sup> Short circuit current levels at Corduff and Kilpaddoge 110 kV stations exceed 100% of the standard equipment rating for 110 kV equipment - 25 kA. However, Corduff is a designated station with 110 kV equipment designed to 31.5 kA and Kilpaddoge has equipment designed to 40 kA.

<sup>93</sup> Short circuit current levels at Cloghran, College Park, Kilbarry, Knockraha, Marina and Trabeg 110 kV stations exceed 90% of the standard equipment rating for 110 kV equipment - 25 kA. Again these are designated stations with 110 kV equipment designed to 31.5 kA.

The existing substation is programmed to be replaced with a substation incorporating a new 110 kV GIS switchboard. This work is planned to be completed by 2020. In the interim, we manage this risk by operating with one interbus transformer out of service. This reduces the short circuit current level below the equipment rating.

#### Coolkeeragh 110 kV

Single-phase short circuit current levels at Coolkeeragh 110 kV substation exceed 100% of the substation assigned rating in 2020. This is a result of increased renewable generation levels. It is important that NIE put plans in place to address this issue at Coolkeeragh before winter 2020.

#### 5.3.4. Minimum Short Circuit Current Results

The minimum short circuit current results are presented in Appendix E. These results indicate minimum short circuit currents on the transmission system based on intact network conditions. These results are representative of the assumed generation dispatch and transmission system conditions.

Any parties requiring the expected minimum short circuit current level at a particular bus are advised to contact us directly.

The Moyle Interconnector has a minimum operating requirement of 1,500 MVA. This is equivalent to a short circuit current level of 3.15 kA. Below this short circuit current level the high voltage direct current (HVDC) interconnector fails to commutate<sup>94</sup>. However, as shown in Appendix E, this is not an issue over the period covered by this TYTFS.

<sup>94</sup> Commutation is the process of reversing the direction of electric current. It is commonly used when turning alternating current to a direct current.





# 6. Overview of Transmission System Capability Analyses

This chapter describes analyses carried out to determine the capability of the transmission system to accommodate additional demand and generation. The results of these analyses<sup>95</sup> provide the basis for the statements of opportunity<sup>96</sup> discussed in Chapter 7 and Chapter 8.

# 6.1. All-Island Demand Opportunity Analysis

This section describes the demand opportunity analysis performed on the Ireland and Northern Ireland power systems. This analysis is used to determine the capability of the transmission system to accommodate additional demand connections at the defined areas. The statements of opportunity presented in Chapter 8 are a result of this demand opportunity analysis.

The all-island demand opportunity analysis is carried out for a single year, 2022. This year gives developers a useful indication as to the demand opportunities that exist in the medium-term on the transmission system. Studies are carried out for the summer period and the winter period of 2022/2023.

In Northern Ireland the demand opportunity analysis provides an indication of capability of the backbone<sup>97</sup> transmission network to accommodate additional demand. In Ireland, the locations analysed for new demand have been carefully chosen based on feedback from industry sources. The chosen stations have been tailored to align with potential areas that are of interest to customers seeking connection to the transmission system.

It should be noted that the results of these studies are dependent on:

- Generation assumptions;
- Demand assumptions; and
- Completion dates of transmission system development projects.

Factors that may influence the results are discussed in Section 6.3.

# 6.1.1. Approach for Calculation of Demand Opportunity

The transmission system is planned to meet forecast demand levels at all stations in Ireland and Northern Ireland. The demand forecast for each 110 kV station is a proportion of the overall system demand forecast. This forecast is based on historical demand distributions. Future demand customers that have signed connection agreements are also included in station demand forecasts as presented in Chapter 3.

Additional demand connections above the forecast levels are not explicitly catered for in transmission system development plans. However, capacity for additional demand on the transmission system may exist at certain locations. For example, the addition of transmission system infrastructure generally provides a step increase in transmission system capacity. This addition may permit demand connections higher than forecast levels, as illustrated in Figure 6-1.

<sup>95</sup> It is important to note that the statements of opportunity are not only based on these analyses, but also with information presented in other chapters of this document.

<sup>96</sup> Information on how to become a customer can be accessed at the following address http://www.eirgridgroup.com/customer-and-industry/becoming-a-customer/

<sup>97</sup> The backbone transmission system connects local area networks together, enabling the efficient bulk transfer of electricity around the country and beyond.

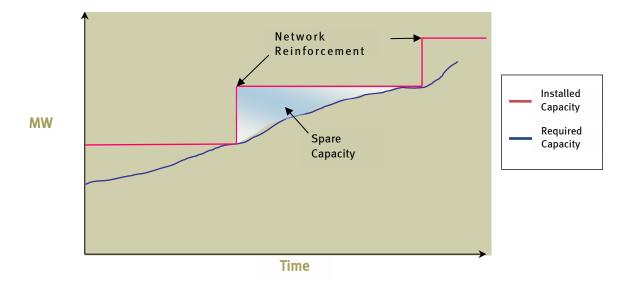


Figure 6-1: Illustration of Typical Step Change in System Capacity Due to the Addition of Transmission System Infrastructure

In Figure 6-1 the blue line represents the required MW capacity at a particular location on the transmission system. The red line represents the installed transmission system capacity. As Figure 6-1 shows, changes in installed capacity generally appear as a step increase following completion of a network reinforcement project. Therefore following a network reinforcement project there is spare capacity available on the transmission system for a period of time.

In general, demand for electricity increases over time. Figure 6-2 below displays the typical demand growth profile of a typical station. The blue line represents the demand forecast at the station. The blue bars represent potential new step increases in demand that could potentially be accommodated at this typical station.

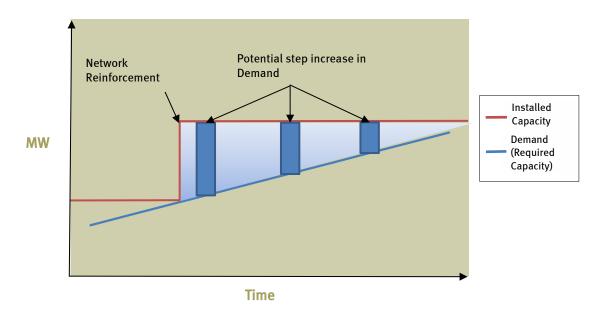


Figure 6-2: Forecast Demand Profile of a Typical Station and Station Potential to Accommodate Additional Step Increase in Demand

The analysis examines the transmission system's capability to accept such increased demand above forecast levels. Capability to accept additional demand is examined at a number of 110 kV, 220 kV and 275 kV stations. The stations analysed are distributed throughout Ireland and Northern Ireland, as shown in Figure 8-1 in Chapter 8. The results of this analysis are useful in identifying opportunities for the connection of new or increased demand.

The opportunity value calculated is a measure of the transfer capability remaining in the physical transmission system. It provides an indication of the flexibility of the transmission system to accommodate future demand increases before additional reinforcements are required.

The transfer analysis is intended as a pre-feasibility indication of opportunity for increased demands. The method for determining capacity closely aligns with pre-feasibility study techniques.

In Ireland, the Irish Transmission System Security and Planning Standards (TSSPS)<sup>98</sup> have been applied in the analyses of demand opportunities. The transmission system is assessed for the loss of any single item of plant (N-1). Unlike generators, demand stations are typically not dispatchable. It is therefore necessary to assess the transmission system performance against standards for maintenance-trip contingencies (N-1-1) in the analysis of increased demand in Ireland.

In Northern Ireland, the Northern Irish Transmission System Security and Planning Standards (TSSPS)<sup>99</sup> have been applied for analyses of demand opportunities. The transmission system is assessed for loss of any single item of transmission plant (N-1) and loss of a double circuit (N-DCT) all year round. During the summer season the Northern Ireland transmission system is also assessed for maintenance-trip (N-1-1) contingencies for specific cases.

Voltage analysis is performed as part of the demand capacity studies in both Ireland and Northern Ireland. This is because the addition of demand is likely to impact on local voltages levels.

# 6.1.2. Method for Calculating Limits for Increased Demand Connections

An AC load flow linear algorithm is used to screen critical contingencies for thermal overloads or voltage limitations.

#### What is a load flow?

A load flow is a numerical analysis of the flow of electric power in an interconnected system. Load flow analysis is performed on a power system model to determine steady-state (normal operation) values such as voltages, voltage angles, real power and reactive power.

#### What is a linear algorithm?

A linear algorithm uses an interactive approach to find the solution to a numerical problem, such as determining voltages on the power system. A linear algorithm is a simple and robust method of finding a solution.

Power transfers are considered using dispatch scenarios typically experienced on the transmission system. While these dispatches are typical, we chose them for our analysis to stress the network in terms of power transfers.

By analysing different scenarios that stress the transmission system, we can reasonably ensure that the demand opportunities reported in our analysis will not breach our Transmission System Security and Planning Standards.

98 http://www.eirgridgroup.com/site-files/library/EirGrid/EirGrid-Transmission-System-Security-and-Planning-Standards-TSSPS-Final-May-2016-APPROVED.pdf

99 http://www.soni.ltd.uk/media/Northern-Ireland-TSSPS-September-2015.pdf

The conventional units selected for each dispatch scenario align with market projections for the study year 2022.

# **Modelling Details**

#### For single (N-1) and double circuit (N-DC) contingency studies

- Generators are modelled with their maximum output equivalent to their Maximum Export Capacity (MEC); and
- Local wind generation is switched out in the vicinity of the test station<sup>100</sup>.

#### For maintenance-trip studies (N-1-1)

- Generators are modelled with their maximum output equivalent to their Maximum Export Capacity (MEC); and
- Some centrally-dispatchable generation local to the test station is maximised to its MEC value<sup>101</sup>.

To calculate the opportunity, demand at 0.90 power factor is added to a test station in increasing amounts. This is balanced by an increase in generation<sup>102</sup> outside the local test area. This is illustrated in Figure 6.3 below.

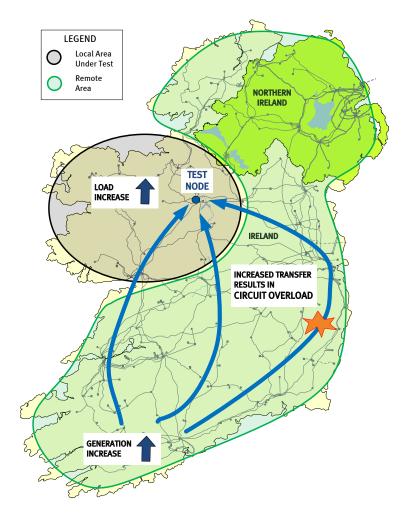


Figure 6-3: Illustration of Incremental Transfer Capability Study Method for Demand

<sup>100</sup> As renewable generation is classified as an intermittent energy source, it cannot be relied upon to serve demand.

<sup>101</sup> This is implemented to create a more favourable dispatch for the maintenance case.

<sup>102</sup> Generation increased as per merit order.

The limit for increased transfers to the test station is then established. This is achieved by checking the post-contingency performance of the transmission system against thermal and voltage standards. This process is carried out for each dispatch scenario studied. Issues on the transmission system are not considered limiting unless they are sensitive to the incremental transfers under examination.

#### Calculation of Results

For single (N-1) and double circuit (N-DCT) contingency studies in Ireland and Northern Ireland, and for maintenance-trip studies (N-1-1) in Ireland the demand opportunity is the minimum demand capacity result from the studies.

As noted above for the maintenance-trip studies (N-1-1) in Ireland, less onerous generation dispatches can be scheduled to accommodate maintenance outages.

The results of this analysis are reported in Chapter 8 and provide an indication of the capabilities for increased demand at each station studied. It should be noted that demand opportunity is tested at each station on an individual basis. As such, the opportunities presented are not cumulative. If new demand connects in an area that is currently shown to have capacity, this will then use up some or all of the available capacity in that area.

# 6.1.3. Calculation of Capability for Demand in Dublin

The Dublin region is the largest demand centre on the all-island transmission system. Dublin has been and remains the focus of continual interest for the connection of large new demand.

There has been a significant increase in the number of enquiries and applications for new demand connections in the Dublin region and its environs since 2014. Many of these requests are for data centres. Data centres present relatively flat load profiles that impact on both the minimum and maximum demand requirements in the region. If all of these enquiries were to materialise and connect, the maximum demand of Dublin could exceed 3,000 MW (see Chapter 3 Demand).

The Dublin 220 kV transmission network is operated by EirGrid, the transmission system operator (TSO). The radial 110 kV circuits are operated by ESB Networks, the distribution system operator (DSO). System development and operation in the area requires both system operators to work closely together. This is to ensure power flows are optimised and to facilitate new connections.

Due to the volume of demand enquiries and applications received for the Dublin area, and their potential impact, Section 8.3 of this document focuses on the demand opportunities in the Dublin region.

The Dublin region has been divided into three geographic zones (see Figure 8-3 in Chapter 8), namely the North, West and South clusters. This is aimed at providing a more detailed insight into the available connection capacity. This takes into account the three main corridors servicing the main bulk supply points<sup>103</sup>.

The methodology used to consider demand opportunities in the Dublin region is based on the existing transmission system. It also includes criteria, such as:

- How each zone is expected to develop; and
- The associated lead times for project delivery.

<sup>103</sup> These main bulk supply points act as the transmission to distribution interfaces in the region.

# 6.1.4. Calculation of Capability for Demand at Any Station Outside Dublin

This section provides a general example of the analysis of the capability of any station studied in Chapter 8 to accept additional new demand. The station is tested to accommodate increased demand in summer peak 2022.

The assessment is carried out by simulating the transmission system for summer peak 2022. The relevant demand forecasts and generator dispatches are used.

Due to its variable nature, wind generation cannot be relied on to meet the demand at all times. Therefore, all wind generation in the vicinity of the test station is switched off. Studies are carried out according to the dispatch scenario assumed. The extra demand in each study is met by increasing generation according to the merit order. For each study in turn, a test demand (for example 100 MW) is added to the station under study. The power system is then analysed using an AC load flow linear algorithm.

The analysis tested an exhaustive range of N-1 contingencies (individual circuit/transformer or generator outages) to identify any resultant TSSPS violations. Thus TSSPS violations identify a capacity limit. Some contingencies cause violations of thermal overload or voltage standards at the maximum capacity. In these cases, the analysis reverts to 0 MW and performs the test in increasing steps, 10 MW in size. The test runs in increasing steps until a violation of thermal overload or voltage standards occurs. The preceding step value is then the calculated capacity value.

In assessing opportunities for new demand, the TYTFS considers the capability of the transmission system only. The capability of the distribution system is not addressed in Ireland or Northern Ireland. The implications for generation adequacy of demand growth above the median forecast levels are dealt with separately in the All-Island Generation Capacity Statement 2017-2026 (GCS) which is available on the FirGrid and SONI websites.

# 6.2. All-Island Generator Opportunity Analysis

This section describes the generation opportunity analysis performed on the Ireland and Northern Ireland power systems. This analysis is used to determine the capability of the transmission system to accommodate additional generation connections at the defined areas. The statements of opportunity presented in Chapter 7 are a result of this generation opportunity analysis<sup>104</sup>.

The generation opportunity for a selection of nodes across the all-island transmission network is presented in Chapter 7. The final year of this forecast statement, 2026, is used in the analysis. The analysis is performed using an AC load flow linear algorithm, the same approach used in the demand opportunity analysis. The methodology is described in Section 6.2.1.

We included information on the harmonised all-island Transmission Use of System (TUoS) charge and Transmission Loss Adjustment Factor (TLAF) arrangements in SEM in TYTFS 2015 and TYTFS 2016. We have also included similar information in this TYTFS. The all-island TUoS and TLAF arrangements have an objective to provide locational signals to generators that reflect the costs they impose on the transmission system<sup>105</sup>.

We describe the changing connection capacity locations, the impact on network power flows and the resulting effect on TUoS charges and TLAFs. These TUoS and TLAF values have an impact on power generation costs.

<sup>104</sup> It is important to note that the statements of opportunity are not only based on these analyses, but also with information presented in other chapters of this document.

<sup>105</sup> This is not the only objective of the charges and losses arrangements in SEM.

This approach is aimed at helping transmission network users to make informed decisions when exploring potential transmission network connection locations. Based on positive feedback to this approach, we are continuing to include this information in this year's generation opportunity analysis.

All information relating to generation opportunity presented in Chapter 7 is indicative only. Connection applications are required to follow the connection offer process.

# 6.2.1. Approach for Calculation of Generation Opportunity

Generation opportunity at a node is assessed via the use of an AC load flow linear algorithm. It is based on the premise that new generation at a particular point on the network will displace generation at a different point on the network. Figure 6-4 presents a simple illustration of the calculation methodology used for the generator opportunity analysis.

All existing generation, and all generation planned to connect in Ireland and Northern Ireland during the period covered by the TYTFS, is considered for dispatch before assessing any further generation opportunity on the all-island transmission network.

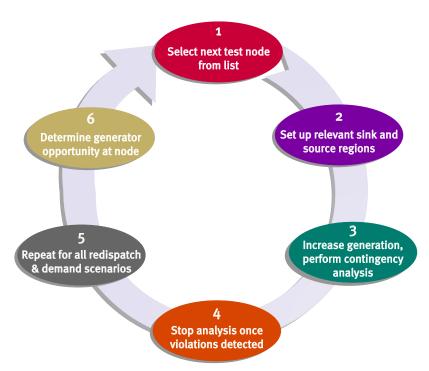


Figure 6-4: Generator Opportunities Analysis Methodology

We compiled a list of 110 kV, 220 kV, 275 kV and 400 kV nodes for generation opportunity analysis. These nodes are distributed across the all-island network so that potential users can understand how opportunities vary across the network.

When testing a node, existing generation in the area around the node is maximised; this group of generators is referred to as the source region. The remaining generation required to meet the demand is dispatched based on a merit order. Finally, the test generator is then dispatched.

As the output of the test generator increases, the output from other generation in a separate area of the network - the sink area - is reduced. This forces power flows along specific corridors of the transmission network.

For each incremental increase in new generation capacity at the test node, an AC load flow linear algorithm is used to test the network for compliance with the TSSPS. The generation opportunity is determined once overloads are detected on the network.

For the generation opportunity analysis, single (N-1) and double circuit (N-DCT) contingency studies only are considered.

For each node assessed, three different analyses are performed. Figure 6-5 demonstrates an example of this approach.

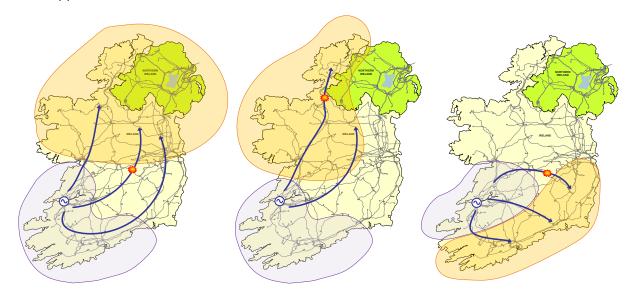


Figure 6-5: Illustration of Incremental Transfer Capability Study Method for Generation

For each scenario, the purple area represents the source region, where generation is maximised. The test generator is then increased, and generation in the orange area - the sink region - is reduced. The blue arrows represent the resulting power flows. These three scenarios are then repeated for the following network demand scenarios:

- Winter peak;
- Autumn peak (Northern Ireland only);
- Summer peak; and
- Summer valley.

The lowest result from all of the scenarios analysed is used to determine the capacity of the node under test. By analysing several scenarios across different demand scenarios that stress the transmission system, we can reasonably ensure that the generation opportunities reported in our analysis will not breach our Transmission System Security and Planning Standards.

It is important to note that results of the generation opportunity analysis are indicative only. The results of the analysis are not cumulative, as the capability of a node to accept new generation capacity is tested individually.

The transmission system is planned to meet forecast generation levels at all stations in Ireland and Northern Ireland. Additional generation connections above the forecast levels are not explicitly catered for in transmission system development plans. However, capacity for additional generation on the transmission system may exist at certain locations.

Because of the relative size of individual generators, changes in generation installations, whether new additions or closures can have a more significant impact on power flows than demand. New generation capacity will inevitably alter the power flows across the network, which has the potential to create overload problems deep into the network. Problems deep into the network are resolved by network reinforcements known as deep reinforcements.

The generation opportunity analysis presents the level of generation that can be accommodated on the planned transmission system without the need for deep reinforcements to allow full network access.

# 6.3. Factors Impacting On Results

The results<sup>106</sup> of the analyses described in this chapter are based on a set of assumptions. These assumptions are associated with:

- Future demand growth;
- · Generation connections; and
- Transmission system developments.

The key forecast factors on which the results depend are dynamic. Therefore, the reality that emerges will not exactly match the forecasts. Consequently, the results, while reasonably indicative, should not be interpreted as definitive projections.

The factors likely to have an impact on the outcomes include:

- The signing of a connection agreement by a new generator;
- Delays in connection of committed new generation stations;
- Closure of existing generation stations;
- Changes in the economy which give rise to consequential changes in the overall demand for electricity;
- Changes in demand in a particular region or area, arising from new industry developments or closures;
- Delays in the provision of transmission system reinforcements; and
- Selection and construction of new transmission system reinforcement developments which may significantly increase transmission system capacity.

<sup>106</sup> These results are presented in Chapter 7 and Chapter 8.







# 7. Transmission System Capability for New Generation

# 7.1. Background

In this chapter we provide the results of the detailed generation capacity opportunity analysis, of which the calculation methodology is described in Chapter 6.

The analysis considers the final year of this statement - 2026- and details the opportunity for connecting further generation beyond the assumed installed generation portfolio. The results provide potential network users with a guide to the ability of the all-island transmission system to accept new generation. It must be stressed that this analysis is indicative only; the actual transmission network capacity can only be determined during the connection offer process. This process requires detailed network assessments to determine the optimal connection arrangement that complies with the Transmission System Security and Planning Standards (TSSPS) in Ireland and Northern Ireland. EirGrid is completing a separate East Coast Generation Assessment study which will provide more detail on the capacity available for new generation on the east coast and also the available space in existing substations for new connections.

Significant changes to generation dispatch patterns and the geographical location of generation impact on all-island transmission network power flows. As a consequence, Generator Transmission Use of System (GTUoS) tariffs and Transmission Loss Adjustment Factors (TLAFs) have changed, resulting in an impact on the economics and location of power generation. Resulting regional changes in GTUoS and TLAFs are described to help network users make informed decisions when exploring potential transmission network connection locations.

# 7.2. New Generation Capacity

The level of generation expected to connect to the all-island transmission system is described in detail in Chapter 4 of this statement.

The largest recent generation capacity increase has been wind generation. At the freeze date of July 2017 there was about 4,100 MW connected to the all-island transmission system. Depending on project completion rates this all-island figure could increase to approximately 7,000 MW of wind generation capacity over the period of this statement (see Chapter 4).

This generation is mainly connected in remote locations in the South-West, West and North-West of the island of Ireland. At times of high wind generation this can result in very high power flows on transmission circuits supplying power to the large demand centres on the East coast of Ireland and Northern Ireland.

In contrast there are a number of large conventional power stations due for retirement or to have restricted output due to the EU Industrial Emissions Directive. These are detailed in All-Island Generation Capacity Statement 2017-2026 and noted in Chapter 4 of this document.

# 7.3. Generation Opportunity

# 7.3.1. At Selected 220 kV, 275 kV and 400 kV Stations

This section provides the opportunities for additional generation on the 220 kV, 275 kV and 400 kV networks in 2026. For these high voltage stations, new generation of up to 500 MW in size was considered for assessment. Figure 7-1 illustrates the stations selected across the all-island network, and their resultant generation opportunity. It is important to note that the results are not cumulative, as the opportunity at each station is assessed individually. The capacities shown are relevant to the station tested, but also provide an indication of the opportunities available at neighbouring stations.

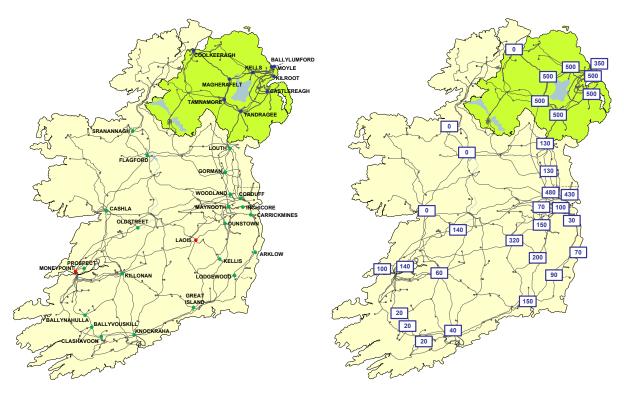


Figure 7-1: Generation Opportunity at 220 kV, 275 kV and 400 kV Stations in 2026

In general, there is no opportunity for new generation in the North and West of Ireland, and very limited opportunity in the South-West of Ireland. The transmission network in these areas is mainly comprised of 110 kV circuits; these areas also have significant levels of connected and planned renewable generation. As a result, there is little to no additional capacity available. The only exception is the area around Moneypoint, located close to the 400 kV network. In the East and South East regions, there is increased opportunity for new generation, being located closer to the large demand centres.

With the potential development of large data centres in the Dublin area, there will be increased generation opportunities at stations around Dublin beyond that indicated in this analysis. Further details on the generation opportunities created by increased load in Dublin will be provided in the East Coast Generation Assessment study.

In Northern Ireland, there is currently very little opportunity for new generation in the North - West region, although this may change in future. Similar to Ireland, this area has significant levels of renewable generation, both connected and planned, and the transmission network is almost entirely comprised of 110 kV circuits. However, there is significant opportunity on the 275 kV network towards the South and East, with 500 MW of capability at many of the nodes on the 275 kV network.

#### 7.3.2. At Selected 110 kV Stations

A number of 110 kV stations were also analysed to complement the higher voltage stations analysed in Section 7.3.1. For these stations, new generation of up to 200 MW in size was considered for assessment. The stations, and their resultant generation opportunity, are displayed in Figure 7-2.

As in the previous section, the results are not cumulative, as the opportunity at each station is assessed individually. The capacities shown are relevant to the station tested, but also provide an indication of the opportunities available at neighbouring stations.

As expected, there is very little opportunity for generation connection at 110 kV. By 2026 in Ireland, there is a high level of renewable generation connected to both the transmission and distribution systems. This is concentrated in the North-West, West and South-West, and the installed capacities exceed the demand in these areas. As a result, there is little to no opportunity available anywhere in those areas.

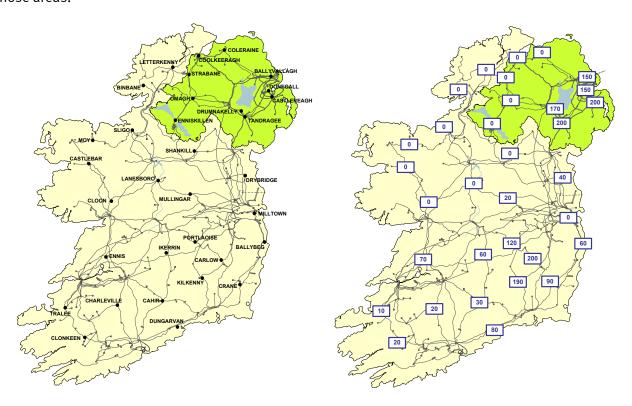


Figure 7-2: Generation Opportunity at 110 kV Stations in 2026

Towards the South-East and East of Ireland, there is opportunity available at 110 kV nodes. The largest demand centres are located in these areas, and the transmission network is stronger. Additionally, renewable generation penetration is lower in these areas. Connection studies would be required to determine the available capacity and connection arrangements.

Not dissimilar to Ireland, Northern Ireland is connecting high levels of renewable generation, with more planning to connect to the transmission and distribution systems by 2026. This generation in the North and West of Northern Ireland is greater than local demand and causes congestion on the transmission network.

In the East of Northern Ireland, opportunities for generation connection are possible, with a less congested transmission network and higher demand density. Again, detailed connection studies would be required to determine the available capacity and connection arrangements.

# 7.4. Generation Locational Signals and Their Impact on Transmission Network Capacity

Harmonised transmission arrangements provide locational signals to users reflecting the costs they impose on the transmission system. TLAFs and GTUoS tariffs, as part of harmonised transmission arrangements, can provide generators with locational signals informing their decision on where to connect to the grid and incentivise efficient generation dispatch.

Electrical losses, which occur as electricity is transported along transmission circuits, are accounted for in the settlement process with the application of TLAFs. Some units are responsible for proportionally more transmission losses than others, depending on their point of connection to the grid and use of transmission network capacity.

The methodology used by the transmission system operators (TSOs) to calculate the TLAFs has been approved by the regulatory authorities<sup>107</sup>.

The most efficient way to transfer power in terms of losses is to minimise the distance between generation and demand, and not to heavily load lines. Due to the locality and amount of demand and generation, power can be transmitted over sizeable distances. If the power generated in a region is in excess of the demand in that region, the excess generation will be utilised some distance away from the source.

The transmission network consists of high voltage overhead lines and cables ranging from 110 kV to 400 kV. When current flows across these circuits, some energy is lost as heat. The higher the power transmitted on a line, the higher the current. Current has a squared relationship to power losses, therefore if the power on a line is doubled, the losses will increase by a factor of four. In general, transmitting power on a higher voltage level will lower the associated current. The associated losses will be dependent on how congested the line is; increasing power on an already congested line will result in greater losses than increasing power on a similar less congested line.

The Transmission Use of System (TUoS) tariff is the main tariff for transporting power in bulk across the power system. Generator Transmission Use of System (GTUoS) tariffs contains a locational component, which provides a signal of the costs associated with a generator's use of the transmission network.

Such signals provide a commercial incentive for generators to make informed decisions (both siting/entry and exit decisions) concerning their use of the transmission system. This is intended to improve efficiency in respect of both the use of, and investment in, the transmission system.

#### 7.4.1. TLAFs

Generator TLAFs are reflective of their contribution to transmission losses. The principle is that market participants that contribute more to transmission losses, due to their location, should have a lower TLAF, than those generators who contribute less to transmission losses. The regional average 2017/18 TLAF values are shown in Figure 7-3, and are based on the published approved 2017/18 TLAF values.

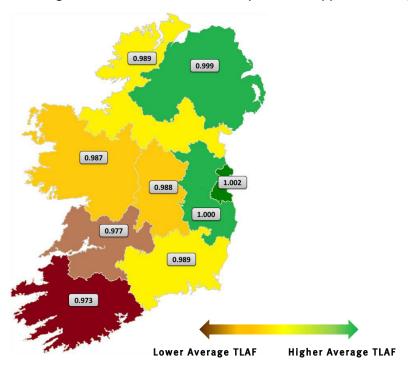


Figure 7-3: All-Island 2017/18 Regional Average TLAF Values

Figure 7-4 shows the change in TLAFs between 2016/17 and 2017/18. These changes are influenced by yearly dispatch, demand and topology changes.

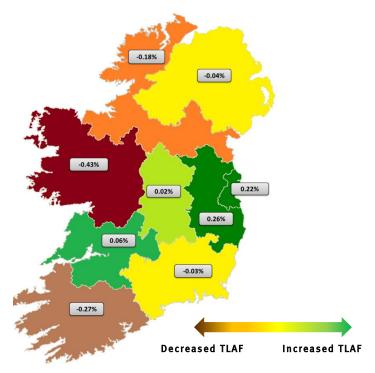


Figure 7-4: % TLAF Change Between 2016/17 & 2017/18

The information presented in Figures 7-3 and 7-4 should be used as regional indicators. For example in Northern Ireland (NI), Figure 7-4 shows the average TLAF value has decreased between 2016/17 and 2017/18. However, as shown in Figure 7-3, the average TLAF value remains high and above average when considering all-island TLAFs. TLAFs for the Dublin region are relatively high as there tends to be local use of generation, and an increasing demand. These considerations should be taken into account when reviewing year on year TLAF changes for generators.

#### 7.4.2. GTUoS

The regional average 2017/18 GTUoS tariffs are shown in Figure 7-5, and are based on the approved 2017/18 GTUoS tariffs. Higher GTUoS tariffs are reflective of transmission investment costs linked to a generator's use of the system. This promotes efficient use of the transmission system by generators, which should, in turn, facilitate efficient investment in the transmission system.

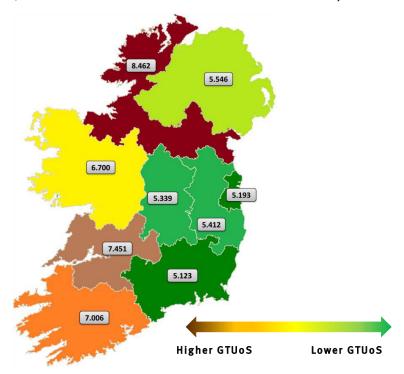


Figure 7-5: All-Island 2017/18 Regional Average GTUoS Values

-5.88%
-0.33%
-0.1.59%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%
-0.15%

Figure 7-6 shows the change in GTUoS tariffs between 2016/17 and 2017/2018.

Figure 7-6: GTUoS Change Between 2016/17 & 2017/18

For 2017/18, there is an overall increase in tariffs due to an increase in the all-island revenue pot of 10.6%; regional changes are attributed to changes in network flows. The annual revenue is the amount allowed to build, operate and maintain the transmission network, and this has increased in Ireland and Northern Ireland for 2017/18. GTUoS tariffs have increased on average by 4% in 2017/18 compared to 2016/17. As shown in Figure 7-6, GTUoS tariffs for Northern Ireland have significantly increased, predominantly due to changes in network flows from 2016/17. It should be noted that they are still around 12% lower than the average Ireland GTUoS tariff, and are at levels seen in Northern Ireland in previous years. Further information on the 2017/18 GTUoS tariffs, including the approved methodology, can be found on the EirGrid Group website<sup>108</sup>.

# 7.5. Assumptions Behind the TLAF and GTUoS Models

#### 7.5.1. TLAFs

The assumptions used to determine TLAFs are essentially a snapshot of a particular study year, comprised of complex and detailed data. This data is as reflective as reasonably practicable for the study year.

For the level of detail involved, specifically for calculating TLAFs, the assumptions are only valid for the study year.

The increasing complexity of these assumptions year on year, all of which can vary independently, have a collective impact on TLAFs that is neither predictable nor forecastable for future years. Looking past the study year increases the time from determination of the assumptions to their application - doing so would remove validity from the data.

<sup>108 &</sup>lt;a href="http://www.eirgridgroup.com/site-files/library/EirGrid/Proposed-1718-Generator-Transmission-Use-of-System-(GTUoS)-Tariffs.pdf">http://www.eirgridgroup.com/site-files/library/EirGrid/Proposed-1718-Generator-Transmission-Use-of-System-(GTUoS)-Tariffs.pdf</a>

#### 7.5.2. GTUoS

Similar to the TLAF calculation process above, the GTUoS data is collected up to the commencement of the calculation process. The GTUoS model includes an element of 'looking to the future' by incorporating future network. Looking at the future network involves including the next five years of network files in the model; the network files are consistent with the information published in this document. Indicative asset costs for a 12 year window are also included in the GTUoS model (looking five years forward and seven years back). Under normal circumstances this starts when the asset first appears in the 'Year+5' network file, until seven years post-commissioning.


GTUoS tariffs are calculated on an all-island basis, and assumptions or network changes in one jurisdiction can have an impact on the other. For example, if the revenue to recover in Ireland significantly increased, but the revenue to recover in Northern Ireland remained the same as the previous year, the all-island average tariff would increase as there is a greater all-island pot to recover; local variations would then be related to changes in network flows. Another example could be when looking at interconnector flows, where an assumption for the Moyle Interconnector impacts flows in Ireland, and an assumption for the EWIC Interconnector impacts flows in Northern Ireland.

Although there is an element of forecasting in the GTUoS model by looking at future network and associated costs, alongside this are many assumptions and variables that only apply for the study year.

#### 7.6. How to Use the Information for Generation

Generation developers wishing to use the information contained within this section when considering where to connect should follow these steps:

- Consult the maps in Appendix A to find the nearest transmission station to the proposed development. Also, review the regions and nodes identified in Section 7.3 which are indicating opportunity for generation connections.
- Consult the forecasted increase and retirement of generation within a region shown in Appendix D.
- Review assumptions in Chapters 2 to 4 and consider the impact of changes to the transmission system since the analysis was carried out. Chapter 5 and Appendix E should also be considered to determine short circuit levels at the nearest transmission station.
- Consult with EirGrid and SONI on the proposed location as early as possible as well as consulting the EirGrid application process and SONI application process.

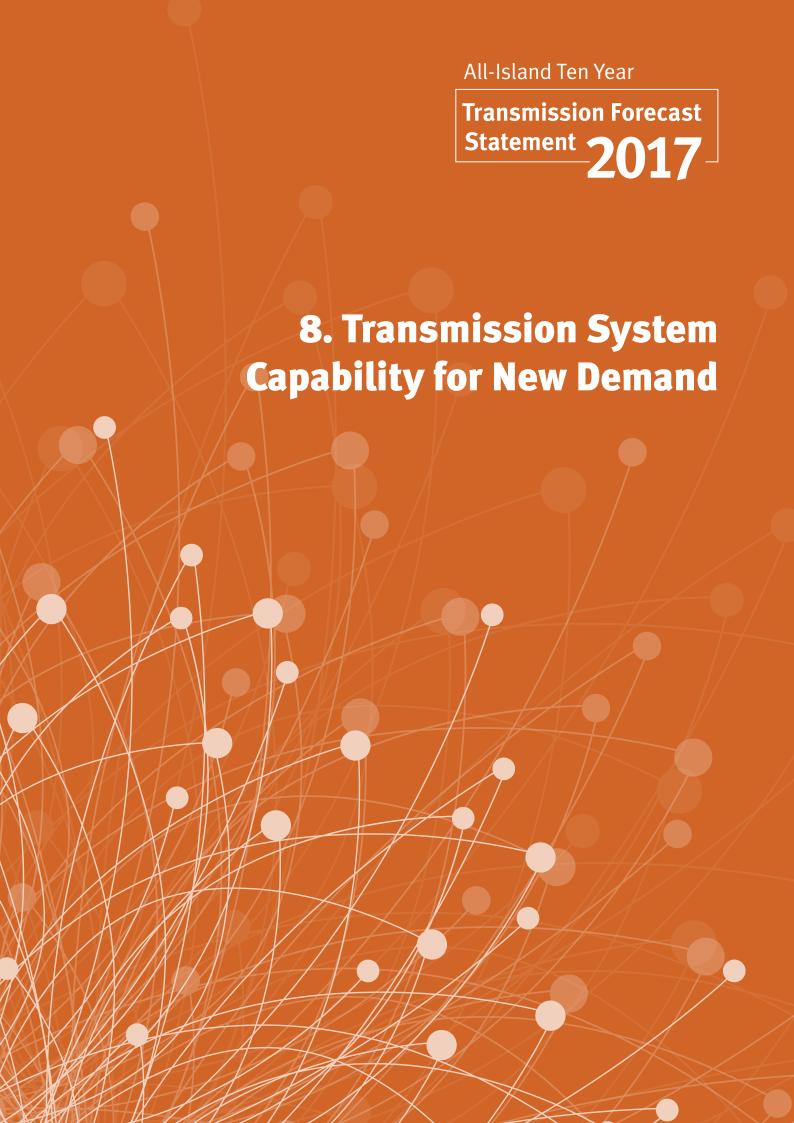



# 8. Transmission System Capability for New Generation<sup>109</sup>

This chapter presents demand opportunity analysis which assesses the capability of the existing and planned transmission system to accommodate increased demand. Opportunities for further demand connections in Ireland and Northern Ireland are discussed.

Analysis of the 2022 transmission system indicates that all regions studied across the island have opportunities to connect demand at 275 kV, 220 kV and 110 kV stations.

There continues to be a significant volume of enquiries and applications for the connection of data centres in the Dublin region (see Chapter 3). This is addressed in Section 8.3, in which a qualitative approach to describe demand opportunities in the Dublin area is presented.

# 8.1. Transmission System Demand Capability Obligations

This chapter of the TYTFS is published in order to meet the requirements of EirGrid's Section 38 of the 1999 Electricity Act and Condition 33 of SONI's licence.

The analysis illustrated in Chapter 8 is presented to provide a high-level indication of transmission network capacity for developers. Results from demand capability studies are based on a specific set of assumptions (see Chapter 6) which may be subject to change. Developers wishing to connect to the transmission system will therefore require further detailed studies.

The TYTFS is not intended to have any legal effect on the negotiation of contractual terms for transmission system connections. Before making any commercial decisions developers should contact us for discussions on their proposed developments.

# 8.2. All-Island Transmission System Capability for New Demand

As detailed in Chapter 6, the transmission system's capability to accommodate new demand is assessed using demand opportunity analysis. The study was performed for 2022 winter and summer peaks.

Data used for the demand opportunity analysis is based on the best available information at the July 2017 data freeze date. The results of the demand opportunity analysis presented in this chapter are based on the following assumptions:

- Year 2022 demand forecast was used (see Appendix C);
- Only transmission reinforcements with capital approval (Ireland) which are planned to be completed by 2022 were included in the analysis (see Chapter 2);
- Planned generation up until 2022 was included in the analysis (see Appendix D);
- Variable generation cannot be relied upon to serve demand. As such, variable generation local to the test station was switched out; and
- The 2022 transmission system was assessed for the loss of a single transmission asset (N-1), maintenance-trip (N-1-1) and loss of a double transmission circuit (N-DC, Northern Ireland) contingencies.

109 Information for potential Demand Connections can be accessed at the following addresses:  $\frac{\text{http://www.eirgridgroup.}}{\text{com/\_uuid/463e7512-d115-4d94-b1ab-79b8cb366f73/index.xml}} \\ \text{and http://www.soni.ltd.uk/\_uuid/463e7512-d115-4d94-b1ab-79b8cb366f73/index.xml} \\ \text{and http://www.soni.ltd.uk/\_uuid/463e7512-d115-4d94-b1ab-79b8cb366f73/$ 

We analysed 41 transmission stations throughout Ireland and Northern Ireland. These consisted of twenty-six 110 kV stations, five 220 kV stations and ten 275 kV stations. These stations were analysed to help identify locations that are potentially suitable for major industrial load centres with large power requirements. The stations examined and their accompanying results are shown in Figure 8-1.

It should be noted that demand opportunity is tested at each station on an individual basis. As such, the opportunities presented are not cumulative. If new demand connects in an area that is currently shown to have capacity, this will then use up some or all of the available capacity in that area.

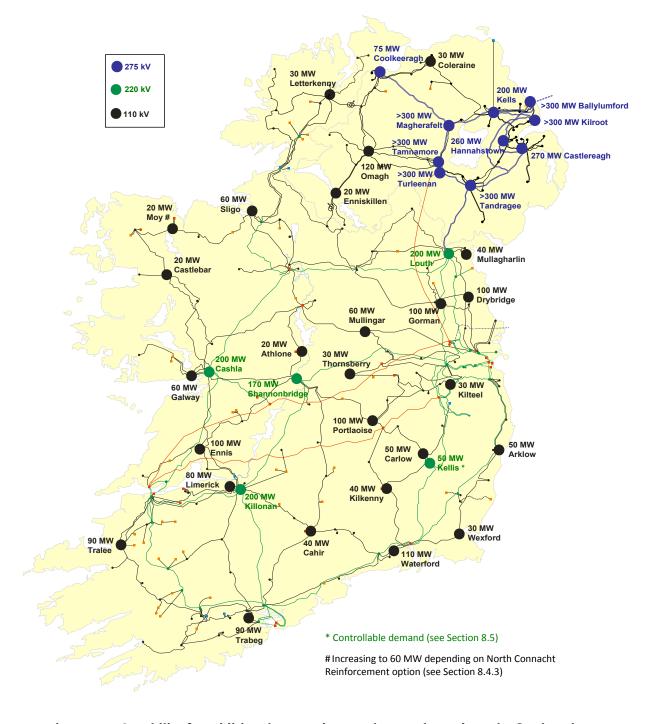


Figure 8-1: Capability for Additional Demand at 275 kV, 220 kV and 110 kV Stations in 2022

As a general rule, demand opportunity at a particular station would tend to reduce over time. This is due to normal demand growth using up available capacity. Yet, in many cases demand opportunities can improve as a result of planned transmission system or generation developments.

The results of the analysis are presented on a regional basis below. The results indicate that in 2022 there will be opportunities at all the stations examined.

#### 8.3. Opportunities for New Demand in the Dublin Area

#### 8.3.1. Context

Dublin is the largest load centre on the island of Ireland. We have expanded this section due to the considerable interest and number of enquiries for connection to the grid around Dublin (see Chapter 3 Demand). The volume of enquiries and the uncertainty of their final power requirements and interaction require us to make a qualitative assessment of demand opportunities for the future.

The scale of individual demand connection enquiries to the transmission system vary from 20 MW to some possibly extending to over 250 MW in the final stages of development. The enquiries are mainly comprised of data centres that support the information, communications and technology (ICT) infrastructure of large multinational companies.

At the data freeze date of July 2017, connected data centres had a combined total contracted maximum import capacity (MIC) of approximately 405 MVA. This includes both TSO and DSO connections. Beyond this, there continues to be significant interest in connecting other data centres to the grid in Ireland. There is approximately 920 MVA of data centres with either contracted capacity for connection to the grid or in the respective TSO/DSO connection offer processes. In addition to this, there continues to be ongoing enquiries regarding further data centre applications.

To put this in context, the current winter peak demand on the all-island transmission system is approximately 6,750 MW. If all applicants currently being processed were to connect, the data centre load would sum to around 20% of the all-island system peak demand.

Loads of this scale typically require connections to the 220 kV or 110 kV network. EirGrid is working with customers and the distribution system operator, ESB Networks, to meet their individual needs and to ensure optimal network development and solutions.

#### 8.3.2. The Dublin Network

The diagram in Figure 8-2 represents the 220 kV backbone transmission system in the greater Dublin area in 2022. There also exists a 110 kV network in the Dublin area however, for clarity we have not shown it in Figure 8-2.

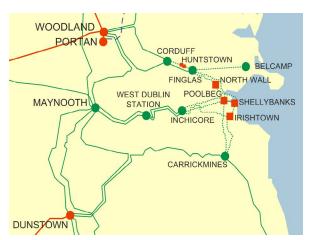


Figure 8-2: Dublin Area 220 kV Transmission System

Electricity is supplied within Dublin via a 220 kV network arranged in a figure of eight. A combination of operational arrangements and network devices can create open points that effectively divide the Dublin 220 kV network into North and South rings as required.

This network configuration is primarily used to maintain fault currents at safe levels should a network fault occur. It also prevents excessive power flows through the Dublin region. Dublin is then fed via the underlying 110 kV distribution infrastructure which is mainly arranged radially from transmission bulk supply point (BSP) interface stations (220/110 kV).

The larger Dublin power stations are located at Huntstown, which is made up of two separate generators, in North Dublin and one each at Irishtown and Shellybanks in Dublin Bay. The combined capacity of these four stations is approximately 1,600 MW. The 500 MW East West Interconnector is connected to Woodland 400 kV station on the periphery of North Dublin.

Analysis is carried out to ensure compliance with the Transmission System Security and Planning Standards (TSSPS) for all new connections to the transmission system.

This ensures the co-ordinated development of a reliable, efficient, and economical system for transmission system users. EirGrid must ensure the performance requirements of the TSSPS are met. For example, the thermal capacity limits of equipment must be maintained for all operating conditions.

To ensure the optimised, efficient and economic development of the network, EirGrid aims to make maximum use of existing assets. This can be achieved by using generation output to help offset power flows on the network and avoid the need for reinforcement. The cost of using generation in this way is compared to the cost of new network reinforcements.

There are primarily three limitations that can restrict the availability of transmission capacity in Dublin:

- 1. Limitations at the 220/110 kV interface stations, these can include restrictions due to the 220/110 kV transformers or spatial constraints;
- 2. Power flow limitations on local transmission circuits within Dublin; and
- 3. Limited capacity on circuits outside Dublin in terms of facilitating large power flows across the transmission network.

Generation dispatch is critical in assessing the capability of the network and can have a significant impact on (2) and (3) above, especially in the case of Dublin.

The power delivered to Dublin demand centres can originate from power sources located within or outside Dublin or a combination of both. This is dependent on wholesale electricity market generation costs in the Single Electricity Market (SEM)<sup>110</sup> as well as network or system issues.


Recently there has been a tendency for increased high power flows into Dublin from generation located outside the area. This is a result of the increased penetration of wind generation and the commissioning of other high merit order generators outside of Dublin.

In some instances these high power flows from outside the Dublin area can be reduced when power is generated inside Dublin. This could release network capacity for transmission users. However, as more demand has sought to connect in Dublin our analysis indicates an increased requirement for existing generation in Dublin to offset high power flows into, and around, Dublin.

<sup>110</sup> A new wholesale electricity market for the island of Ireland, known as I-SEM, will be introduced in 2018.

#### 8.3.3. Dublin Transmission Development Plans

Figure 8-3 below describes the areas of focus for demand connections in Dublin and the scale of interest in each zone. The connections fall into three zones: North, West and South Dublin.

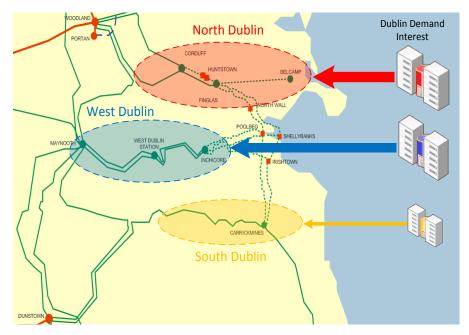

**Figure 8-3: Dublin Potential Demand Connections** 

The transmission network can accommodate both the current level of demand connections and demand customers with contracts for additional capacity. However, further large demand increases may put the system outside standards. Therefore, additional transmission and/or generation capacity, demand side response and/or storage will be required to accommodate further demand increases and ensure continued security of supply.

Each zone is described below with consideration given to existing transmission infrastructure, transmission network projects and lead-times.

Should the reader require more detailed transmission network project information please read our updated grid development strategy "Your Grid, Your Tomorrow." published in January 2017<sup>111</sup>, the current Transmission Development Plan<sup>112</sup> and the latest Associated Transmission Reinforcement (ATR) update<sup>113</sup>.

#### 8.3.4. Dublin Transmission Development Plans

North Dublin has two 220/110 kV interface stations at Corduff and Finglas with another planned at Belcamp. The level of interest for connection in North Dublin is the highest of all Dublin areas.

A number of transmission projects are in place to increase the network capacity and security of supply in this area. They are summarised in Table 8-1 below.

<sup>111</sup> http://www.eirgridgroup.com/the-grid/irelands-strategy/

<sup>112</sup> The latest TDP can be found on the EirGrid website <a href="http://www.eirgridgroup.com/">http://www.eirgridgroup.com/</a>

<sup>113</sup> The latest ATR update can be found on the EirGrid website http://www.eirgridgroup.com/

**Table 8-1: North Dublin Projects** 

North Dublin		
Project Name/Number	<b>Project Description</b>	Estimated Delivery Date
Cloghran-Corduff (CP0859)	New 110 kV cable	2016 (complete)
Belcamp (CP0437)	New 220/110 kV station	2018
Finglas (CP0646)	110 kV station redevelopment	2019
Belcamp Phase 2 (CP0984)	Additional 220/110 kV transformer and second circuit	2022
Finglas (CP0792)	220 kV station redevelopment	2023

Facilitating further high levels of demand connections will require additional network reinforcement in the area. As noted in Transmission Development Plan 2017 we have confirmed the need for such investment in north Dublin, the future potential project is called North Dublin Corridor Reinforcement (CP1021). This could be in the form of increased network connectivity with Woodland 400 kV station for example. Typically, such major projects delivering additional network capacity have significant lead times (five to eight years) which are dependent on the chosen technology.

#### 8.3.5. West Dublin

West Dublin has one main 220/110 kV interface station at Inchicore with another planned at Castlebagot<sup>114</sup>. These stations are supported by the Maynooth 220 kV station on the outer rim of the Dublin region.

A number of transmission projects are in place to increase the network capacity and security of supply in this area. They are summarised in Table 8-2 below.

**Table 8-2: West Dublin Projects** 

West Dublin		
Project Name/Number	<b>Project Description</b>	<b>Estimated Delivery Date</b>
Inchicore-Maynooth (CP0667)	Uprate 220 kV No.1 & No.2 lines	2015 (complete)
Maynooth-Ryebrook (CP0747)	Uprate 110 kV line	2015 (complete)
Poolbeg (CP0760)	Installation of 100 Mvar reactive support	2018
Ryebrook-Corduff (CP0668)	Uprate 110 kV line	2018
Ryebrook (CP0789)	110 kV station redevelopment	2017 (complete)
Castlebagot (CP0872)	New 220/110 kV station	2019
Inchicore (CP0692)	220 kV station upgrade	2022
Capital Project 966	Increase capacity between the two existing 400 kV stations at Dunstown and Woodland	2024
Maynooth (CP0808)	220/110 kV station redevelopment	2025

<sup>114</sup> Formerly known as West Dublin 220/110 kV station.

As noted in Transmission Development Plan 2017 we have confirmed the need for investment in this area. In response, we are progressing Capital Project 966 which seeks to increase the strength of the link between two existing 400 kV stations at Dunstown and Woodland.

#### 8.3.6. South Dublin

South Dublin has one main 220/110 kV interface station at Carrickmines. Carrickmines is connected at 220 kV to Dunstown 400 kV station and Arklow 220 kV station.

A number of transmission projects are in place to increase the network capacity and security of supply in this area. They are summarised in Table 8-3 below.

**Table 8-3: South Dublin Projects** 

South Dublin		
Project Name/Number	<b>Project Description</b>	Estimated Delivery Date
Dunstown (CP0683)	New 400/220 kV 500 MVA transformer	2015 (complete)
Carrickmines (CP0580)	New 220/110 kV 250 MVA transformer & GIS development	2018

As noted in Transmission Development Plan 2017, currently we do not see an imminent need to reinforce this area.

## 8.3.7. Impact of Additional Generation & Flexible Demand on North, West and South Dublin

As described in Chapter 7, there are generation opportunities in the Dublin region, particularly in north Dublin. If additional generation was to locate in the Dublin area this would generally improve the network capacity available for transmission system users in North, West and South Dublin zones.

However, the specific location of any proposed additional generation would have to be assessed to fully understand its full impact on the network.

Similarly, if major demand customers can ensure demand side flexibility during low probability system events this would also improve the capability of the network to accommodate further demand increases.

#### 8.3.8. Looking Forward

In January 2017 we published an updated grid development strategy for the long-term development of the network. In the strategy paper<sup>115</sup>, we explain the role of electricity transmission infrastructure in supporting new investments and jobs as well as ensuring competitiveness by offering cost-effective power capacity.

The strategy puts forward a number of major projects to upgrade the transmission network. The Regional Solution (see Chapter 2) and Capital Project 966 have many system benefits, which include providing additional network capacity and improving security of supply for the eastern side of Ireland.

The Regional Solution involves a new circuit across the Shannon Estuary and the installation of series compensation equipment on the 400 kV circuits that extend from Moneypoint 400 kV power station in the West of Ireland towards Woodland and Dunstown 400 kV stations located on the western outskirts of Dublin.

<sup>115</sup> http://www.eirgridgroup.com/the-grid/irelands-strategy/

This project will greatly enhance the capability of the existing 400 kV circuits to transfer bulk power generated in the South-West and West to Dublin and other demand centres in the East as illustrated in Figure 8-4.

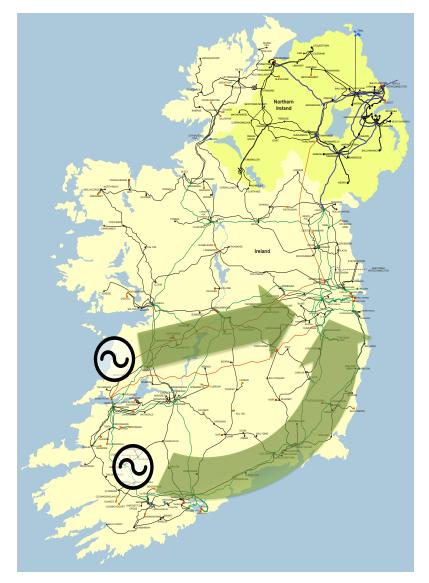


Figure 8-4: Transfer of Power Generated in the West and South-West Regions to the East

Capital Project 966 is at an early point in the project life-cycle. The project will increase the strength of the link between two 400 kV stations at Dunstown and Woodland. This will provide benefits by reducing power flows that pass through the Dublin 220 kV transmission network, thus releasing network capacity on several key constrained circuits.

To maintain system stability and facilitate significant inter-regional power flows we are also developing a number of voltage support solutions across Ireland.

In addition, as noted in Transmission Development Plan 2017, we have confirmed the need for investment in north Dublin. The future potential project is called North Dublin Corridor Reinforcement (CP1021).

#### 8.3.9. Summary

New transmission solutions will be required to strengthen the grid. These solutions are now under initial investigation.

We continue to apply a strategic approach to network development and we are continuously considering the approach to the level of demand enquires. Our strategic approach takes account of the following:

- Companies developing data centres operate in a rapid and dynamic environment. Their business requires connection timescales that are short relative to time taken for transmission reinforcement. Most are considering being operational within two to three years and growing their power usage rapidly thereafter.
- We are working to understand the needs of these developers and their impact in terms of our grid development strategy. We are publishing information on the system adequacy, grid needs and opportunities to ensure transparency so that the impacts of this sector and its developments are known.
- To date, we have been able to facilitate connections for developers who have applied. We will continue to examine innovative solutions and technologies in response to future requests. However, as interest in connecting additional demand has developed into contracted connections, the available capacity on the existing transmission network for further large scale demand connections has largely been depleted.

It is advised that any potential new demand consumers contact EirGrid early so that we can work jointly to achieve a connection solution. This facilitates the optimisation of transmission reinforcements so that the requested capacity can be delivered.

It is also recommended to locate any new large scale data centres in close proximity to existing 220 kV stations or circuits as this may help expedite the provision of a suitable connection.

As a prudent system operator, EirGrid ensures that adequate spare capacity for regional and national demand growth is available, while avoiding unnecessary over investment in grid capability. Therefore a balance is maintained between the reasonable expectations placed on the network and the cost of grid development and maintenance. Delivering an efficient transmission grid requires that this balance of investment is maintained.

#### 8.4. Transmission System Capability for New Demand in Ireland

Demand opportunities available on an Ireland regional basis are discussed in Sections 8.4.1 to 8.4.5. Results presented in Section 8.4 are based on the assumptions detailed in Chapter 6.

#### 8.4.1. Opportunities for New Demand in the Midlands and West

The demand opportunities available in the Midlands and West are shown in Figure 8-5. It is shown that there are potential demand opportunities available for new customers at all stations examined in the region. In particular, Cashla and Shannonbridge 220 kV stations would be suitable connection points for major industrial load centres. Both of these stations are capable of accommodating in the order of 200 MW additional demand without additional network reinforcements.

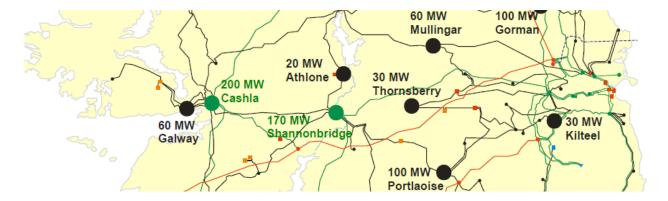


Figure 8-5: Capability for Additional Demand in Midlands and West Regions

#### 8.4.2. Opportunities for New Demand in the North-East

The demand opportunities available for the North-East region are shown in Figure 8-6. It is shown that there are potential demand opportunities available for industrial customers at all stations examined in the region. The delivery of the North-South interconnector aids demand opportunity in the North-East. The North-South interconnector provides a route for large power transfers to flow between Northern Ireland and Ireland via the North-East region of Ireland. The North-South interconnector will benefit potential demand customers connecting in this region by releasing more capacity on the underlying 110 kV network.

Potential overloading of the Louth – Mullagharlin 110 kV line is responsible for limiting the opportunity at Mullagharlin (40 MW). The overload occurs during winter and summer peaks for single circuit outage conditions. This is a local issue as only two circuits supply the load at Mullagharlin. Drybridge (100 MW), however, is more interconnected with four circuits supplying the station. Demand opportunity studies were performed at two additional stations, Louth and Gorman 220/110 kV stations.

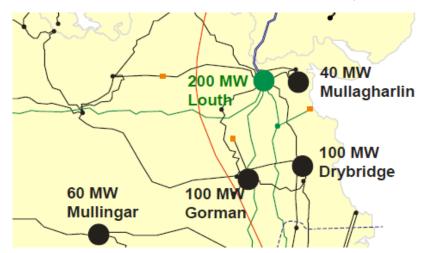


Figure 8-6: Capability for Additional Demand in North-East Region

#### 8.4.3. Opportunities for New Demand in the North-West

The demand opportunities available for the North-West region are shown in Figure 8-7. It is shown that there are potential demand opportunities available for industrial customers at all stations examined in the region. The potential demand opportunity at Castlebar is 20 MW. Analysis has shown that the Castlebar – Cloon 110 kV line could overload as power tries to flow to Castlebar under certain maintenance-trip scenarios (see Chapter 6). The uprate of Castlebar – Cloon 110 kV line would allow for more demand opportunity at Castlebar.

Demand opportunity studies were performed at one additional station, Moy 110 kV station. In our studies we identified an opportunity for 20 MW. However, depending on the North Connacht Reinforcement solution option this could increase to 60 MW.

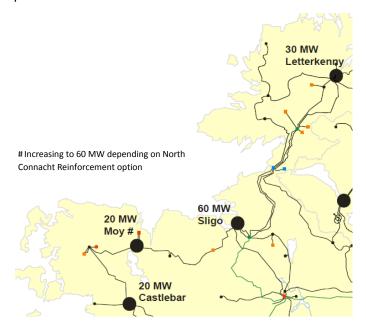


Figure 8-7: Capability for Additional Demand in North-West Region

#### 8.4.4. Opportunities for New Demand in the South-East

The demand opportunities available for the South-East region are shown in Figure 8-8. It is shown that there are potential opportunities available for industrial customers at all stations examined in the region.

The demand opportunity at Kellis 220 kV station is limited to 50 MW due to the maintenance-trip scenario (see Chapter 6) where both 220 kV lines supplying Kellis are assumed to be out of service. This scenario means that demand at Kellis 220 kV station must be supplied by the underlying 110 kV network, which does not have the capacity to carry as much power as the 220 kV network.

However, should a demand facility wishing to connect at Kellis 220 kV station implement a 'Controllable Demand' strategy there would be potential for much greater capacity of demand to connect to Kellis 220 kV. This is explained further in Section 8.5 on 'Controllable Demand'.

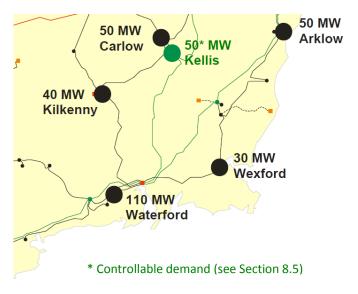


Figure 8-8: Capability for Additional Demand in the South-East Region

#### 8.4.5. Opportunities for New Demand in the South-West

The demand opportunities available for the South-West region are shown in Figure 8-9. It can be seen that there are potential opportunities available for industrial customers at all stations examined in the region.

In particular the Killonan 220 kV station would be a suitable connection point for a major industrial load centre, with the capability of accommodating in excess of 200 MW without additional network reinforcements.

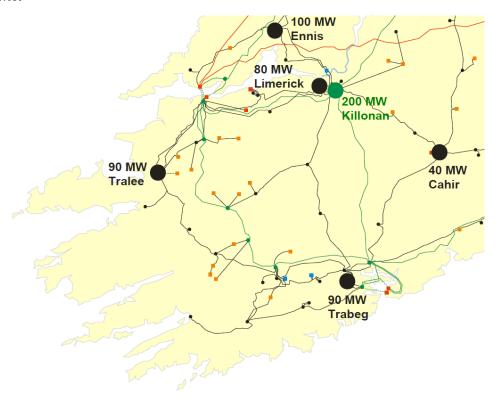


Figure 8-9: Capability for Additional Demand in South-West Region

#### 8.5. Controllable Demand

Kellis 220 kV station is a good example to demonstrate the potential to increase the assessed capacity of a station through the concept of 'controllable demand'. In the case of Kellis 220 kV station, demand opportunity is limited to 50 MW due to a maintenance-trip scenario where both 220 kV lines supplying Kellis 220 kV station are assumed to be out of service. The next limiting scenario after the outage of both 220 kV lines supplying Kellis would allow for much greater demand opportunity at Kellis 220 kV station.

Maintenance-trip contingency planning forms part of a suite of contingencies considered by EirGrid for prudent planning of the transmission system. However, it is also recognised in the Transmission System Security and Planning Standards (TSSPS) that exposure to maintenance-trip events is much less than the other contingency events considered.

This means that under certain circumstances, potential demand customers may enter an agreement with EirGrid to connect a higher level of demand at a particular station, on the condition that the customer would reduce load if certain contingencies occurred.

Using Kellis 220 kV station as an example, a potential demand customer may enter an agreement with EirGrid to connect 200 MW of load at Kellis, but drop to 50 MW if either of the 220 kV lines supplying Kellis is out of service.

It should be noted that Kellis has been used as an example. Depending on reliability requirements, this type of agreement may not be suitable for all types of demand facilities or locations. We encourage any potential customers to discuss the possibility of controllable demand with us at an early stage of project planning and development.

### 8.6. Transmission System Capability for New Demand in Northern Ireland

Section 8.6.1 discusses the demand opportunities available in the Eastern region of Northern Ireland. Section 8.6.2 discusses the demand opportunities available in the Western region. These results are based on the assumptions detailed in Chapter 6.

### 8.6.1. Opportunities for New Demand in East of Northern Ireland

The demand opportunities available in the Eastern region are shown in Figure 8-10.

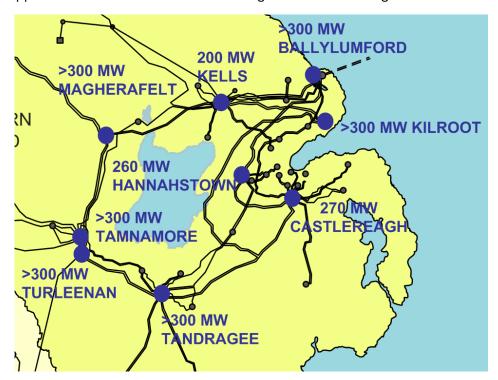


Figure 8-10: Capability for Additional Demand (MW) in the East of Northern Ireland

It can be seen that there are potential opportunities available for industrial customers at all stations examined in the region. Each of the 275 kV stations in the East of Northern Ireland would be suitable connection points for major industrial load centres. Each of these stations is capable of accommodating in the order of 300 MW<sup>116</sup> of additional demand without additional network reinforcements.

<sup>116</sup> Please note that the demand opportunities results are not cumulative. Each station is assessed individually, taking account of forecast demand growth only at stations outside of the test node. These figures are indicative only, with further detailed assessment of each station required. Customers considering connecting demand to the NI transmission system are advised to contact SONI as early in the project as possible.

## 8.6.2. Opportunities for New Demand in West of Northern Ireland

The demand opportunities available for the West of Northern Ireland are shown in Figure 8-11.

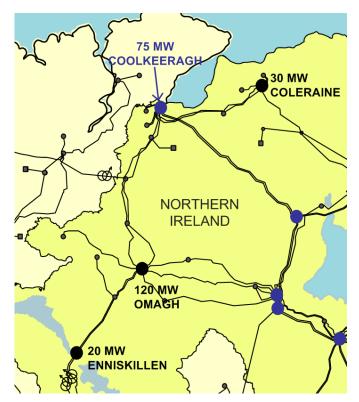


Figure 8-11: Capability for Additional Demand in the West of Northern Ireland

It can be seen that there are potential opportunities available for industrial customers at all stations examined in the region. It should be noted that the North-West of Northern Ireland requires specific assessment in line with the TSSPS (see Chapter 6). As the North-West is connected by a single double circuit 275 kV spur, an N-1-1 contingency is performed as a credible contingency.

Under N-1-1 the demand capability of Coolkeeragh is limited to 75 MW. This is under the following conditions:

- The loss of the Coolkeeragh-Magherafelt 275 kV double circuit;
- Coolkeeragh steam and gas units are out on maintenance; and
- Coolkeeragh G8 is dispatched.

Enniskillen 110 kV station represents the lowest capability of the nodes assessed. Enniskillen 110 kV is connected to Omagh South station via two 110 kV circuits. The loss of one of these circuits creates a thermal overload on the other. This limits demand connection capability.

#### 8.7. How to Use the Information for Demand

Although not every station was considered, the results presented can be regarded as a guide to opportunities at other stations in the same area.

Customers wishing to use the demand opportunity results described in this chapter when considering where to connect should follow these steps:

- 1. Consult the maps in Appendix A to find the nearest transmission station to the proposed development. Also, the nearest station for which opportunity has been assessed (Sections 8.4 and 8.6) should be identified, where it differs from the nearest transmission station.
- 2. The anticipated demand growth at the relevant station can be obtained from the demand forecasts presented in Appendix C. The transmission system is being planned to meet this level of demand increase.
- 3. Review assumptions in Chapters 2 to 4 and consider the impact of changes to the transmission system since the analysis was carried out.
- 4. Consult with EirGrid and SONI on the proposed location as early as possible as well as consulting the EirGrid application process<sup>117</sup> and SONI application process<sup>118</sup>.

Potential demand customers should not be discouraged by choosing a site in which there appears to be a lack of transmission system capacity. Early consultation with us is encouraged so that we can work jointly to explore options relating to any potential proposals and enable timely decision making.

<sup>117 &</sup>lt;a href="http://www.eirgridgroup.com/customer-and-industry/becoming-a-customer/">http://www.eirgridgroup.com/customer-and-industry/becoming-a-customer/</a>

<sup>118 &</sup>lt;a href="http://www.soni.ltd.uk/Customers/howconnected/">http://www.soni.ltd.uk/Customers/howconnected/</a>







# Appendix A Maps and Schematic Diagrams


Appendix A contains geographical maps of the All-Island Transmission System and short bus codes for every transmission voltage node on the island. Geographical maps are presented illustrating the All-Island Transmission System as it exists in 2017 and as planned for 2026.


#### A.1. Network Maps

This section includes two network maps:

- Figure A-1 is a map of the expected All-Island Transmission System as at December 2017; and
- Figure A-2 is a map of the planned All-Island Transmission System in 2026.

Note: There are a number of network reinforcement projects that do not have a finalised reinforcement solution. They are shown on the Transmission System Map as a transparent bubble in Figure A-2. The solution that will be used for these projects have not yet been finalised.

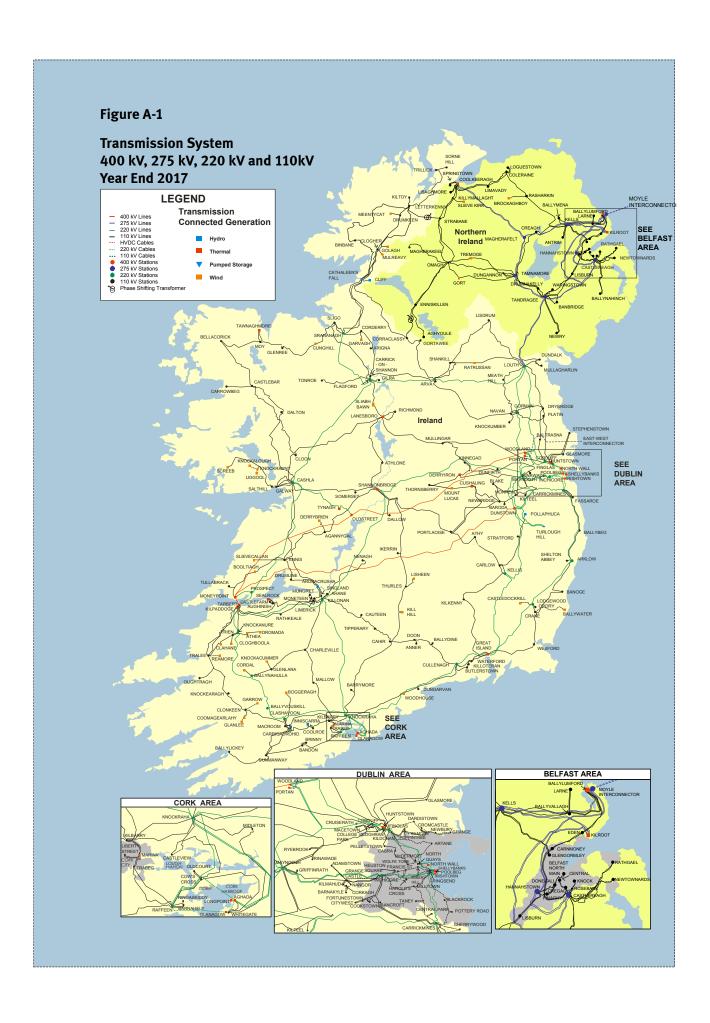

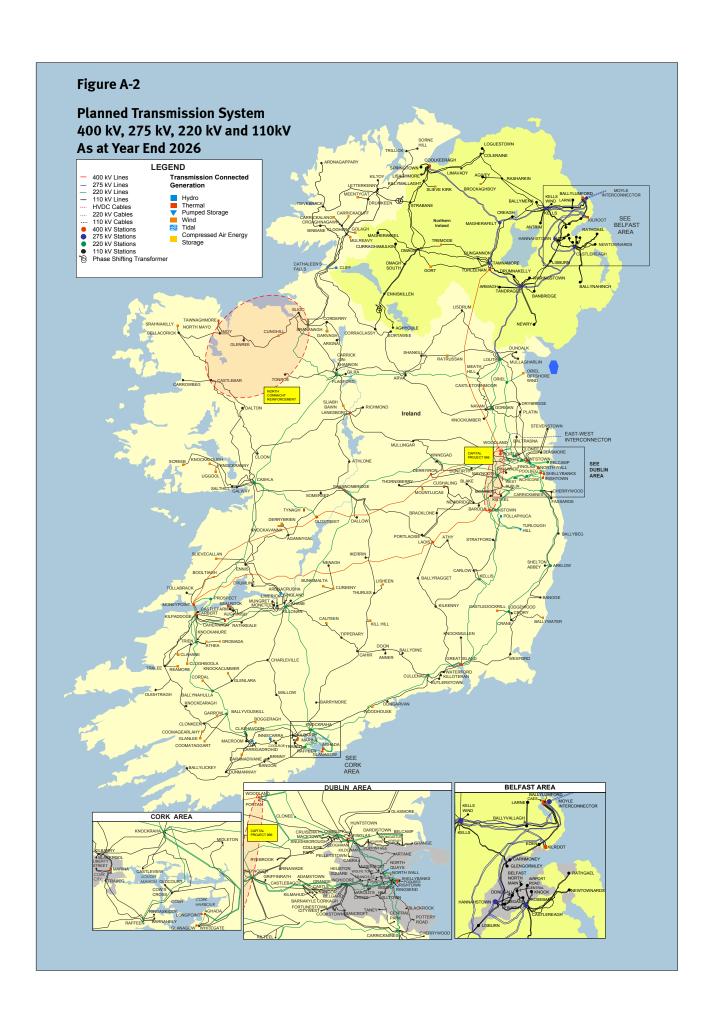

#### A.2. Short Bus Codes

The following table associates full station names with the two or three letter codes used in the schematic diagrams in Section A.3, in the tables in Appendices B and C, and the power flow diagrams in Appendix H. Stations in Northern Ireland and Ireland with the same three letter bus code are distinguished with (N) for Northern Ireland and (I) for Ireland

**Table A-1 Short Bus Codes** 

Short Bus Code	Full Name
AA	Ardnacrusha
AD	Aghada
ADM	Adamstown
AGH	Aghyoule Main
AGL	Agannygal
AGI	Agivey Cluster
AGY	Ardnagappary
AHA	Ahane
AIR	Belfast - Airport Road Main
ANR	Anner
ANT	Antrim Main
ARI	Arigna
ARK	Arklow
ARM	Armagh Main
ART	Artane
ARV	Arva
ATE	Athea
ATH	Athlone
ATY	Athy
AUG	Aughinish
BAL	Baltrasna
BAN (I)	Bandon
BAN (N)	Banbridge Main
BAR	Athlone
ВСМ	Athy
ВСТ	Aughinish
BDA	Baltrasna
BDN	Bandon
BDV	Banbridge Main

Short Bus Code	Full Name
BEG	Ballybeg
BGD	Belgard Road
BGH	Boggeragh
BGT	Ballyragget
BIN	Binbane
ВК	Bellacorick
BKM	Bunkimalta
ВКҮ	Barnakyle
BLA	Blackrock
BLC	Belcamp
BLI	Ballylickey
BLK	Blake
BLP	Blackpool
ВМА	Ballymena Mesh (Rural)
ВМА	Ballymena SWBD (Town)
BNH	Ballynahinch Main
BNM	Belfast - Belfast North Main
BOG	Banoge
BOL	Booltiagh
BPS	Ballylumford Power Station
BRA	Bracklone
BRI	Brinny
BRO	Brockaghboy Main
BRY	Barnahely
BUF	Buffy
BUT	Butlerstown

Short Bus Code	Full Name
BVG	Ballyvallagh
BVK	Ballyvouskill
BWR	Ballywater
BY	BallaKelly
BYC	Ballycronan More (Moyle)
ВҮН	Ballynahulla
CAB	Cabra
CAE	CAES
CAG	Carrickalang
CAH	Cahir
CAM	Cam Cluster
CAR	Belfast - Carnmoney Main
CAS	Castlereagh Main
CBG	Carrowbeg
CBL	Cloghboola
CBR	Castlebar
CD	Carrigadrohid
CDF	Carrickaduff
CDK	Castledockrill
CDL	Cordal
CDU	Corduff
CDY	Corderry
CEN	Belfast - Belfast Central Main
CF	Cathaleen's Fall
CFM	Castlefarm
CGL	Coomagearlahy
СН	Cahernagh

#### **Table A-1 Short Bus Codes**

Short	Full Name
Bus Code	
СНА	Charleville
CHE	Cherrywood
CHR	Cahernagh
CKG	Corkagh
CKM	Carrickmines
CKN	Clonkeen
CL	Cliff
CLA	Clashavoon
CLG	Cloghran
CLH	Clahane
CLN	Cloon
CLO	Clogher
CLS	Clonshaugh
CLW	Carlow
СМК	Curraghmulkin Cluster
CNF	Caraunduff
CNN	Croaghnagawn
COL (I)	College Park
COL (N)	Coleraine Main
COO	Cookstown
COR	Corraclassy
cos	Carrick-on- Shannon
COW	Cow Cross
СРК	Central Park
CPS	Coolkeeragh Power Station
CRA	Crane
CRE	Belfast - Cregagh Main
CRF	Cronacarkfree
CRG	Creagh Main
CRH	Cruiserath
CRM	Cromcastle

Short Bus	Full Name
Code	
CRO	Coolroe
CRY	Crory
CSH	Cashla
CTG	Coomataggart
CTN	Cauteen
CTR	Castletownmoor
CTY	City West
CUI	Cuilleen
CUL	Cullenagh
CUN	Cunghill
CUR	Cureeny
CUS	Cushaling
CVW	Castleview
DAL	Dallow
DDK	Dundalk
DER	Derryiron
DFR	Dunfirth
DGN	Dungarvan
DLN	Derrylyn
DLT	Dalton
DMY	Dunmanway
DON	Belfast - Donegall Main
DOO	Doon
DRM	Drumkeen
DRO	Dromada
DRU (I)	Drumline
DRU(N)	Drumnakelly Main
DRY	Drybridge
DSN	Dunstown
DTN	Dardistown
DUN	Dungannon Main
DYN	Derrybrien

Short	Full Name
Bus Code	
EDE	Eden Main
ENN (I)	Ennis
ENN (N)	Enniskillen Main
FAS	Fassaroe
FAS E	Fassaroe East
FIN (I)	Finglas
FIN (N)	Belfast - Finaghy Main
FLA	Flagford
FNT	Finnstown
FRN	Francis Street
GAE	Glanlee
GAL	Galway
GAR	Garvagh
GCA	Grange Castle
GGO	Glanagow
GI	Great Island
GIL	Gilra
GLA	Glasmore
GLE (I)	Glenlara
GLE (N)	Belfast - Glengormley Main
GLR	Glenree
GLT	Glentanemacelligot
GOL	Golagh
GOR (I)	Gorman
GOR (N)	Gort Cluster
GRA	Grange
GRI	Griffinrath
GRO	Garrow
GWE	Gortawee
HAN	Hannastown
HAR	Harolds Cross
HEU	Heuston Square

**Table A-1 Short Bus Codes** 

Short Bus	Full Name
Code	
HN	Huntstown
IA	Inniscarra
IKE	Ikerrin
INC	Inchicore
ISH	Irishtown
KBY	Kilbarry
KCR	Knockacummer
KDN	Kildonan
KEL	Kells Main
KEL C	Kells Cluster
KER	Knockearagh
KHL	Kill Hill
KIN	Kinnegad
KKY	Kilkenny
KLH	Knockalough
KLM	Kilmore
KLN	Killonan
KLS	Kellis
KLW	Kells Wind Cluster
KMT	Killymallaght
KNO	Belfast - Knock Main
KNR	Knockanure
KNV	Knockavanna
KNY	Knockranny
KPG	Kilpaddoge
KPN	Killinaparson
KPS	Kilroot Power Station
KRA	Knockraha
KTL	Kilteel
KTN	Killoteran
KUD	Kilmahud
KUR	Knockumber
LA	Lanesboro

Short Bus	Full Name
Code	
LAR	Larne Main
LET	Letterkenny
LIB	Liberty Street
LIM (I)	Limerick
LIM (N)	Limavady Main
LIS (I)	Lisdrum
LIS (N)	Lisburn Main
LMR	Lisaghmore Main
LOG	Loguestown Main
LOU	Louth
LPT	Longpoint
LSE	Laois
LSN	Lisheen
LWD	Lodgewood
MAC	Macroom
MAG	Magherafelt
MAL	Mallow
MAY	Maynooth
MCD	McDermott
MCE	Macetown
MEE	Meentycat
MHL	Misery Hill
MID	Midleton
MIL	Milltown
MKL	Magherakeel Cluster
MLC	Mountlucas
MLN	Mullagharlin
MON	Monread
MOY	Moy
MP	Moneypoint
MR	Marina
MRY	Mulreavy
MTH	Meath Hill

Short	Full Name
Bus Code	
MTN	Moneteen
MUL	Mullingar
MUN	Mungret
NAN (I)	Nangor
NAR	Newtownards Main
NAV	Navan
NBY	Newbury
NEN	Nenagh
NEW (I)	Newbridge
NEW (N)	Newry Main
NMO	North Mayo
NO	Nore
NQS	North Quays
NW	North Wall
OLD	Oldcourt
OMA	Omagh Main
OMS	Omagh South Main
ORL	Oriel
OST	Oldstreet
OUG	Oughtragh
OWN	Oweninney
PA	Pollaphuca
РВ	Poolbeg
PLA	Platin
PLS	Portlaoise
POP	Poppintree
POT	Pottery Road
PRO	Prospect
PRT	Portan
PTN	Pelletstown
RAF	Raffeen
RAT (I)	Rathkeale
RAT (N)	Rathgael Main

#### **Table A-1 Short Bus Codes**

Short Bus Code	Full Name
RE	Ringsend
REM	Reamore
RIC	Richmond
RNW	Rinawade
ROS	Belfast - Rosebank Main
RRU	Ratrussan
RSK	Rasharkin Cluster
RSY	Ringaskiddy
RYB	Ryebrook
SAL	Salthill
SBH	Snughborough
SBN	Strabane
SCR	Screeb
SH	Shannonbridge
SHE	Shelton Abbey
SHL	Shellybanks
SK	Sealrock
SKL	Shankill
SKY	Srahnakilly
SLB	Sliabh Bawn
SLC	Slievecallan
SLI	Sligo
SLK	Slieve Kirk
SNG	Singland
SOM	Somerset

Short Bus Code	Full Name
SOR	Sorne Hill
SPR	Springtown Main
SRA	Srananagh
STR (I)	Stratford
STR (N)	Strabane Main
SUR	Suir
SVN	Stevenstown
TAN	Tandragee
TAW	Tawnaghmore
ТВ	Tarbert
TBG	Trabeg
TBK	Tullabrack
TH	Turlough Hill
THU	Thurles
TID	Tidal
TIP	Tipperary
TIV	Tievebrack
TLK	Trillick
TLY	Tanley
TMN	Tamnamore
TON	Tonroe
TRE	Tremoge Cluster
TRI	Trien
TRL	Tralee
TRN	Trinity

Short Bus Code	Full Name
TSB	Thornsberry
TUR	Turleenan
TYN	Tynagh
UGL	Uggool
WAR	Waringstown Main
WAT	Waterford
WDU	West Dublin
WEX	Wexford
WH	Woodhouse
WHI	Whitegate
WOL	Wolfe Tone
WOO	Woodland


#### A.3. Schematic Diagrams of the All Island Transmission System


Schematic diagrams of the All-Island Transmission System are included to assist users in understanding the transmission system and in the identification of the changes outlined in Appendix B. Lines, cables, transformers, station busbars and reactive compensation devices are illustrated in the diagrams. The type of generation (thermal, wind, hydro or solar) at a station is also displayed. Table A-2 indicates the diagram conventions.

The schematic diagram for 2017 shows the expected transmission system as of December 2017. The schematic diagram for 2026 shows the planned transmission system due to be completed by the end of 2026.

#### **A-2 Schematic Legend**

Symbol	Network Element Represented
	110 kV circuit
	220 kV circuit
	275 kV circuit
	400 kV circuit
	System Link
$\bigcirc$	110 kV Busbar
	220 kV Busbar
	275 kV Busbar
	400 kV Busbar
	Busbar with Thermal Generation
	Busbar with Wind Generation (>5 MW)
	Busbar with Hydro Generation
	Busbar with Solar Generation (>5 MW)
	Busbar with Wind and Thermal Generation
	Busbar with Wind and Hydro Generation
	Busbar with Wind and Solar Generation
卡	Capacitor
<u></u>	Static Var Compensator (SVC)
6	Reactor
PST	Phase Shifting Transformer
<u> </u>	Transformer
—NO	Normally Open Point
—sc—	Series Compensation

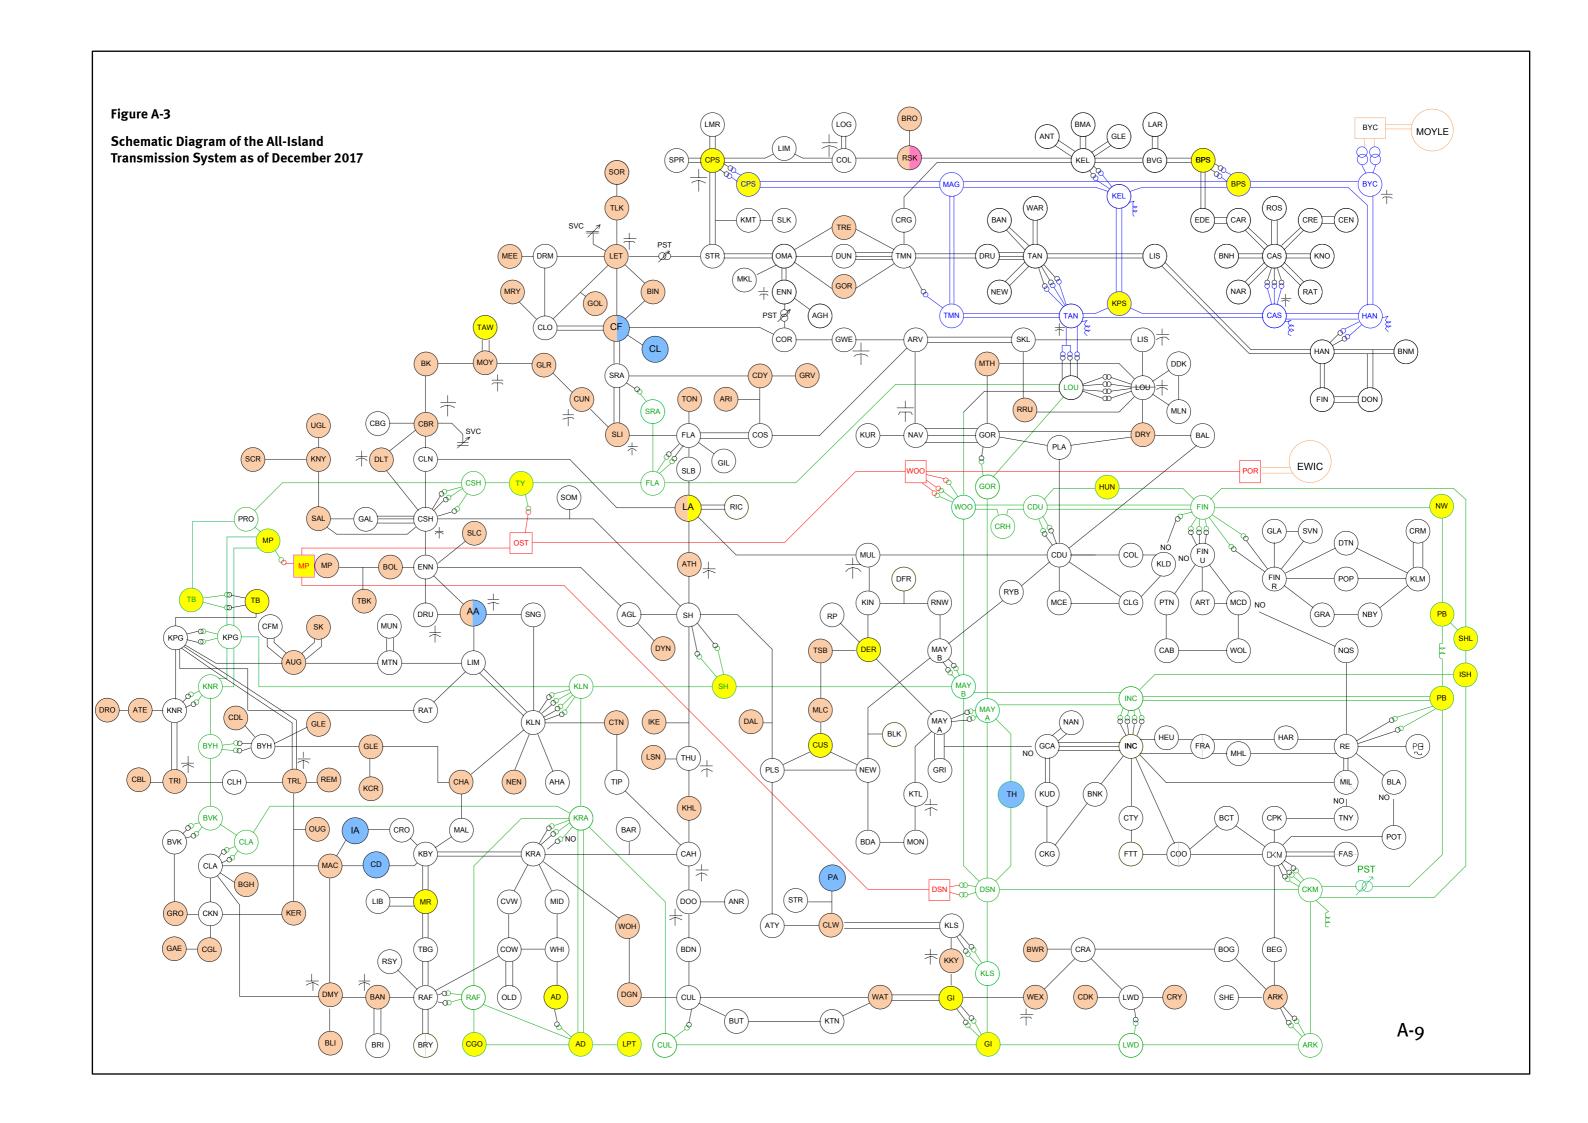

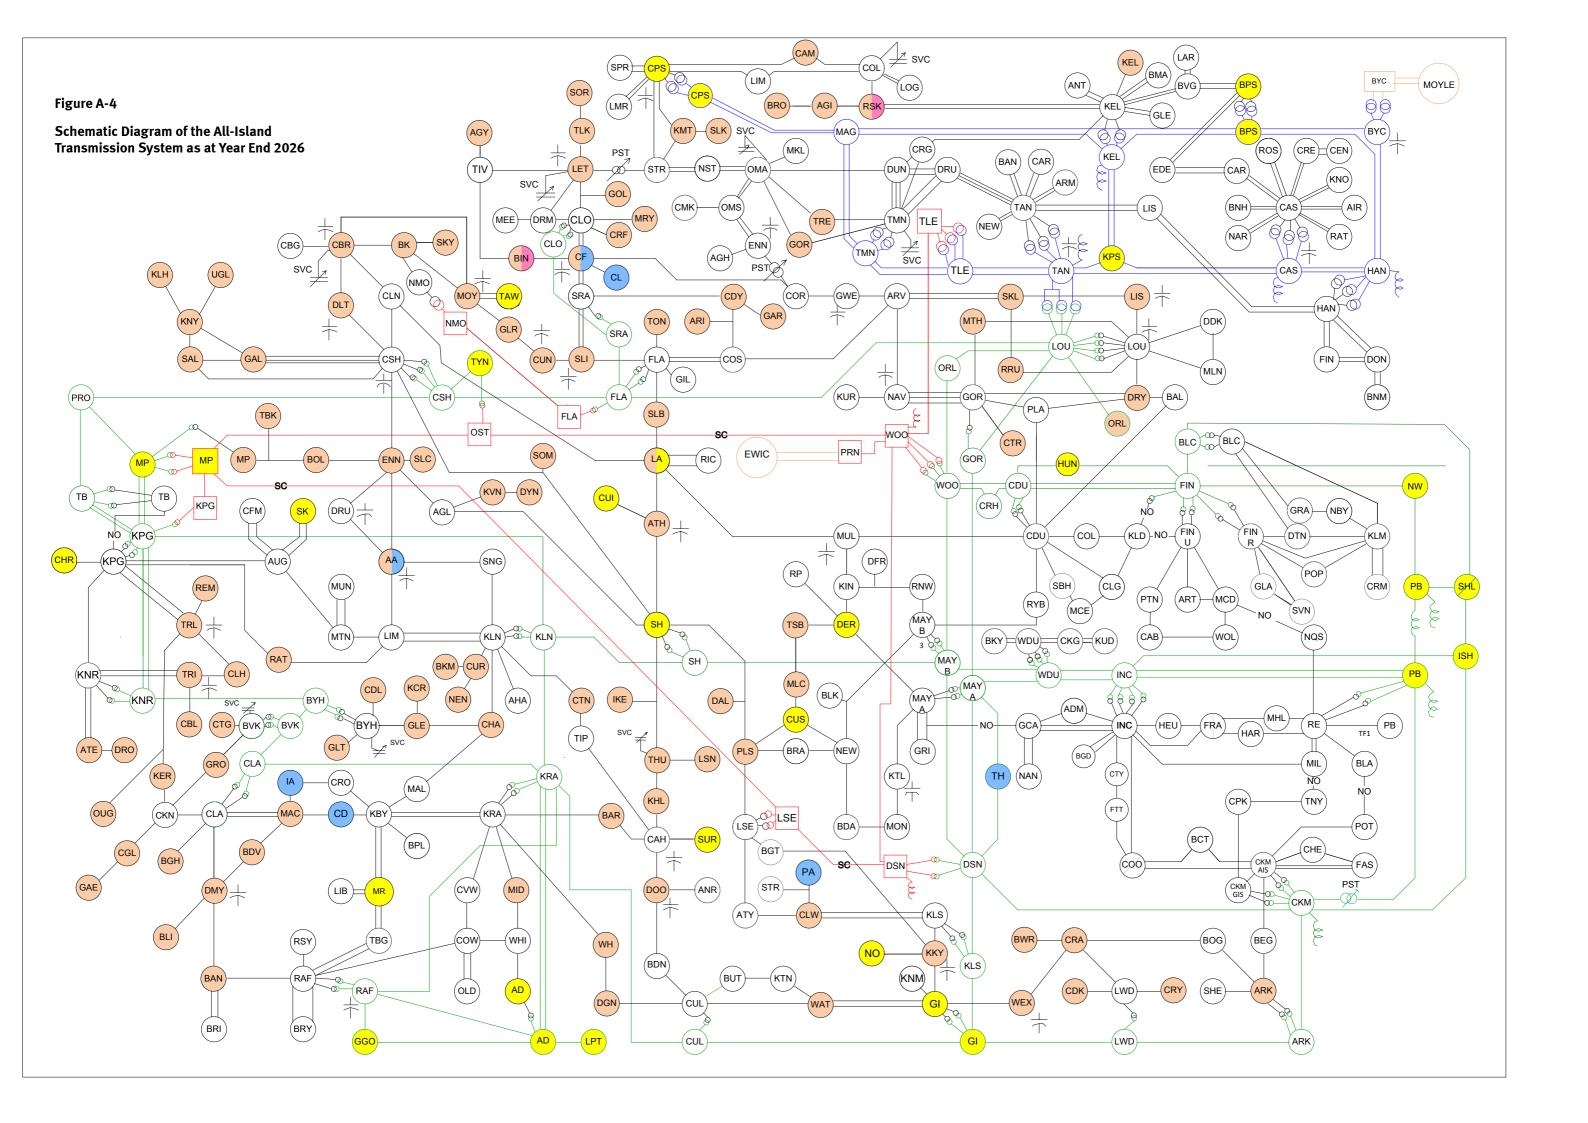





## Appendix B Transmission System Characteristics

This appendix presents details of the physical and electrical characteristics of the all-island transmission system in tabular form:

- Section B.1 details the data for the existing<sup>119</sup> transmission system; and
- Section B.2 details the data for planned transmission system developments<sup>120</sup>.

Section 1.4 in Chapter 1 of the main text provides information on project developments since the data freeze.

The following is a list of tables in Section B.1:

- Table B2 Characteristics of Existing Transmission Circuits;
- Table B3 Characteristics of Existing Transformers in Ireland;
- Table B4 Characteristics of Existing 3 Winding Transformers in Northern Ireland;
- Table B-5 Characteristics of Existing 2 Winding Transformers in Northern Ireland;
- Table B6 Characteristics of Existing Power Flow Controllers; and
- Table B7 Characteristics of Existing Reactive Compensation.

The following is a list of tables in Section B.2:

- Table B8 Characteristics of future Transmission Circuits;
- Table B9 Characteristics of future Transformers in Ireland;
- Table B10 Characteristics of future 3 Winding Transformers in Northern Ireland;
- Table B11 Characteristics of future 2 Winding Transformers in Northern Ireland; and
- Table B12 Characteristics of future Reactive Compensation.

Tables B-2 and B-8 include the ratings for lines and cables in MVA for winter and summer reference temperature conditions at 1 per unit (pu) voltage. The higher ambient temperature in summer dictates a reduced thermal rating for overhead lines. The rating is the maximum permissible power that the circuit can transport on a continuous basis.

Reference ambient temperatures are:

winter: 5°C; and

summer: 25°C.

The electrical characteristics of the all-island transmission system at the four nominal voltage levels are documented. They are represented in per unit values; with a 100 MVA base; and the applicable reference voltage. Table B1 below displays the four nominal and reference voltage levels on the all-island transmission system.

<sup>119</sup> As at Summer 2017.

<sup>120</sup> Includes transmission system reinforcement projects and developments necessary to connect new generation and demand.

Table B-1 Nominal and Reference Voltage Levels

Nominal Voltage Level (kV)	Reference Voltage (kV)
400	400
275	275
220	220
110	110

In some cases equipment associated with a line or cable may be lower rated than the circuit or line. However, this equipment<sup>121</sup> is easier to upgrade than lines and cables and is therefore not expected to restrict access to the transmission system.

A small number of 110 kV stations are connected to the transmission system via a tee. A tee is an unswitched connection into an existing line between two other stations. For the purposes of describing the various sections of lines in the following tables, tee points are identified by the name of the tee'd 110 kV station with a suffix "T" added.

## B.1. Characteristics of the Existing Transmission System (Summer 2017)

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	Impedance on 100 MVA Base (pu)			ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
400	DSN	MP	1	208.5	0.004	0.0465	1.0489	1577	-	1944
400	MP	OST	1	105	0.002	0.0234	0.53	1577	-	1944
400	OST	WOO	1	125	0.0024	0.0278	0.6309	1577	-	1944
400	WOO	PRT	1	0.5	0.0001	0.0001	0.0428	685	-	685
275	LOU	TAN	1	49.8	0.0026	0.021	0.1269	710	820	881
275	LOU	TAN	2	49.8	0.0026	0.021	0.1269	710	820	881
275	BPS	HAN	2	45.5	0.00204	0.01913	0.11407	710	820	881
275	BPS	KEL	1	34.5	0.00155	0.01445	0.08889	710	820	881
275	BPS	MAG	1	65.5	0.00294	0.02743	0.16876	710	820	881
275	BPS	BYC	1	0.8	0.00004	0.00034	0.00201	710	820	881
275	CAS	HAN	1	18.4	0.00082	0.00774	0.04613	710	820	881
275	CAS	HAN	2	18.4	0.00082	0.00774	0.04613	710	820	881
275	CAS	KPS	1	66.8	0.00299	0.028	0.17101	710	820	881
275	CAS	TAN	1	45.6	0.00204	0.01917	0.11432	710	820	881
275	CPS	CACO2A	1	0.2	0	0.0003	0.0398	761	761	837
275	CPS	CACO2B	1	0.2	0	0.0003	0.03383	761	761	837
275	CACO2A	MAG	1	56	0.00586	0.02451	0.15119	412	477	513
275	CACO2B	MAG	1	56	0.00586	0.02451	0.15119	412	477	513
275	HAN	BYC	1	44.7	0.002	0.0188	0.11206	710	820	881
275	KEL	KPS	1	29	0.0013	0.01214	0.07472	710	820	881
275	KEL	KPS	2	29	0.0013	0.01214	0.07472	710	820	881
275	KEL	MAG	1	31.1	0.00139	0.01302	0.08013	710	820	881
275	KPS	TAN	1	80.8	0.00362	0.03389	0.2061	710	820	881
275	MAG	TMN	1	25.8	0.00117	0.01098	0.06543	710	820	881
275	MAG	TMN	2	25.8	0.00117	0.01098	0.06543	710	820	881
275	TAN	TMN	1	25.8	0.00116	0.01085	0.0647	710	820	881
275	TAN	TMN	2	25.8	0.0016	0.01085	0.0647	710	820	881
220	AD	AD	1	1.4	0.0001	0.0006	0.0384	593	-	593
220	AD	KRA	1	25.6	0.003	0.0222	0.0335	434	-	534
220	AD	KRA	2	25.6	0.003	0.0222	0.0335	434	-	534
220	AD	RAF	1	14.387	0.00263	0.00933	0.24517	593	-	534
220	AD	LPT	1	0.968	0.0001	0.0004	0.0265	593	-	593

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedance on 100 MVA Base (pu)			Ra	ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
220	AD	GGO	1	3.78	0.0002	0.0015	0.1035	434	-	593
220	ARK	CKM	1	53.3	0.0062	0.0462	0.0697	434	-	534
220	ARK	LWD	1	39.02	0.0046	0.0338	0.051	434	-	534
220	BVK	CLA	1	18.4	0.00243	0.00181	0.0539	761	-	804
220	BVK	BYH	1	14.5	0.00189	0.01212	0.0535	660	-	660
220	CDU	FIN (I)	1	3.734	0.0005	0.0033	0.0049	434	-	534
220	CDU	FIN (I)	2	3.734	0.0005	0.0033	0.0049	434	-	534
220	CDU	HN	1	4.5	0.0002	0.0018	0.1232	593	-	593
220	CDU	WOO	1	18.427	0.0022	0.016	0.0241	434	-	534
220	CDU	WOO	2	17.835	0.0021	0.0155	0.0234	434	-	534
220	CKM	DSN	1	41.61	0.0049	0.0361	0.0544	434	-	534
220	CKM	ISH	1	11.5	0.0004	0.0045	0.3148	593	-	593
220	CLA	KRA	1	45	0.0062	0.0385	0.0612	644	-	788
220	CSH	FLA	1	88.091	0.0103	0.0763	0.1152	405	-	405
220	CSH	PRO	1	88.54	0.0103	0.0767	0.1158	392	-	482
220	CSH	TYN	1	33.8	0.0046	0.0289	0.0459	761	-	804
220	CUL	GI	1	23.34	0.0034	0.0198	0.0445	746	-	803
220	CUL	KRA	1	86	0.0117	0.0735	0.1168	761	-	804
220	DSN	KLS	1	59.3	0.0069	0.0513	0.0774	434	-	534
220	DSN	MAY	1	36.29	0.0043	0.0317	0.0479	434	-	534
220	DSN	MAY	2	30.55	0.0036	0.0265	0.04	434	-	534
220	DSN	TH	1	26.62	0.003	0.0221	0.1443	351	-	351
220	FIN (I)	HN	1	1.4	0.0001	0.0006	0.0384	593	-	593
220	FIN (I)	SHL	1	13.4	0.0005	0.0053	0.3668	593	-	593
220	FIN (I)	NW	1	11.9	0.0006	0.0036	0.6798	332	-	332
220	FLA	LOU	1	110.08	0.0128	0.0954	0.144	434	-	534
220	FLA	SRA	1	55	0.0064	0.0477	0.0719	434	-	534
220	GGO	RAF	1	9.5	0.00031	0.00489	0.41386	570	-	570
220	GI	KLS	1	69.3	0.0081	0.0601	0.0906	434	-	534
220	GI	LWD	1	47.89	0.0056	0.0415	0.0626	434	-	534
220	GOR (I)	LOU	1	32.409	0.0038	0.0281	0.0424	434	-	534
220	GOR (I)	MAY	1	42.189	0.0049	0.0366	0.0552	434	-	534
220	INC	ISH	1	12.06	0.0004	0.0047	0.3301	593	-	593

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	Impedance on 100 MVA Base (pu)		Ra	ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
220	INC	MAY	2	19.218	0.0027	0.0165	0.0261	793	-	833
220	ISH	SHL	1	1.31	0.0001	0.0006	0.0359	593	-	593
220	KLN	SH	1	89.7	0.0144	0.0795	0.1147	269	-	377
220	KLN	TB	1	70.6	0.0082	0.0612	0.0923	434	-	534
220	KNR	BYH	1	47	0.0064	0.0402	0.0639	660	-	660
220	KNR	TB	1	22.883	0.0028	0.0198	0.0373	353	-	454
220	KRA	KLN	1	82.4	0.0145	0.0732	0.107	512	-	565
220	KRA	RAF	1	23.4	0.0028	0.0203	0.0306	353	-	454
220	LOU	WOO	1	61.2	0.0071	0.053	0.08	405	-	454
220	MAY	TH	1	53.1	0.0058	0.0442	0.1839	351	-	351
220	MAY	INC	1	19.128	0.0026	0.0164	0.026	793	-	833
220	MAY	SH	1	105.6	0.0169	0.0936	0.135	269	-	377
220	MAY	WOO	1	22.3	0.0027	0.0195	0.0295	434	-	534
220	MP	PRO	1	12.7	0.0007	0.0085	0.0205	868	-	1070
220	NW	PB	1	4.5	0.0003	0.0013	0.2612	332	-	332
220	OST	TY	1	14.5	0.0017	0.0126	0.019	434	-	534
220	РВ	SHL	1	0.12	0.0001	0.0001	0.0033	593	-	593
220	РВ	CKM	1	14.5	0.0012	0.0049	0.6184	267	-	267
220	РВ	INC	1	12.5	0.001	0.0043	0.5037	267	-	267
220	PB	INC	2	11.3	0.0005	0.0032	0.7216	351	-	351
220	PRO	TB	1	10.159	0.0012	0.0072	0.1732	467	-	467
110	AA	DRU (I)	1	18.4	0.0286	0.067	0.0059	98	-	125
110	AA	ENN (I)	1	33	0.0208	0.1072	0.0117	178	-	219
110	AA	LIM (I)	1	11.702	0.0071	0.037	0.0116	178	-	219
110	AD	WHI	1	3.1	0.0049	0.0107	0.001	98	-	125
110	AGH	ENN (N)	1	31.1	0.03948	0.09468	0.01902	109	119	124
110	AGL	DYN	1	8	0.0125	0.0276	0.0026	105	-	128
110	AGL	ENN (I)	1	38.2	0.0594	0.1314	0.0123	98	-	128
110	AGL	SH	1	46.2	0.0718	0.1589	0.0148	105	-	128
110	AHA	KLN	1	3.766	0.0039	0.0123	0.0035	112	-	112
110	ANR	DOO	1	2	0.0031	0.0069	0.0006	105	-	128
110	ANT	KEL	1	8.9	0.01162	0.02994	0.00303	82	95	103
110	ANT	KEL	2	8.9	0.01162	0.02994	0.00303	82	95	103
110	ARI	ARI T	1	0.207	0.0004	0.0008	0.0001	105	-	128

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	Impedance on 100 MVA Base (pu)			ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
110	ARK	BEG	1	21.946	0.0102	0.0787	0.0071	136	-	166
110	ARK	BOG	1	29.006	0.0207	0.0952	0.0102	178	-	219
110	ARK	SHE	1	2.2	0.0035	0.0077	0.0008	34	-	57
110	ART	FIN (I)	1	9	0.0047	0.0101	0.0548	120	-	131
110	ART	MCD	1	4.9	0.0026	0.0055	0.0298	120	-	131
110	ARV	COS	1	43.038	0.0666	0.1479	0.0138	98	-	125
110	ARV	GWE	1	30.6	0.0193	0.0994	0.0108	178	-	219
110	ARV	NAV	1	65.497	0.0412	0.2128	0.0231	178	-	219
110	ARV	SKL	1	18.583	0.0292	0.0645	0.006	80	-	110
110	ARV	SKL	1	23.56	0.0148	0.0763	0.0097	178	-	219
110	ATE	DRO	1	5.463	0.0032	0.00311	0.064	140	-	140
110	ATE	KNR	1	9	0.0057	0.0293	0.0032	178		219
110	ATE	KNR	2	9	0.0057	0.0293	0.0032	178		219
110	ATH	LA	1	35.793	0.054	0.123	0.0116	105		128
110	ATH	SH	1	21.628	0.0135	0.0696	0.0113	178		219
110	ATY	CLW	1	25.001	0.0389	0.086	0.0081	99		125
110	ATY	PLS	1	26.601	0.0414	0.0915	0.0086	99		125
110	AUG	CFM	1	0.65	0.001	0.002	0.0011	96		96
110	AUG	CFM	2	0.67	0.001	0.0021	0.0012	96		96
110	AUG	MTN	1	27.5	0.0173	0.0894	0.0097	178		219
110	AUG	SK	1	1	0.0006	0.0012	0.0061	120		131
110	AUG	SK	2	1	0.0006	0.0012	0.0061	120		131
110	AUG	TB	1	34	0.0214	0.1105	0.012	152		152
110	BAL	CDU	1	16.8	0.0106	0.0546	0.006	178		219
110	BAL	DRY	1	20	0.0126	0.065	0.0071	178		219
110	BAN (I)	BRI	1	2.6	0.004	0.009	0.0009	105		128
110	BAN (I)	BRI	1	2.5	0.0039	0.0086	0.0008	105		128
110	BAN (I)	DMY	1	25.901	0.0403	0.0891	0.0083	99		125
110	BAN (I)	RAF	1	26.886	0.0413	0.0914	0.0115	105		128
110	BAN (N)	TAN	1	18.4	0.02403	0.06239	0.00622	82	95	103
110	BAN (N)	TAN	1	14.2	0.01855	0.04902	0.00471	82	95	103
110	BAR	BAR T	1	0.308	0.0004	0.0011	0.0002	136		166
110	BCT	CKM	1	3.1	0.0022	0.0047	0.0311	140		140
110	BDA	MON	1	12.47	0.0121	0.0367	0.031	99		124

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	ce on 100 I (pu)	MVA Base	Ra	ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
110	BDA	NEW (I)	1	7.87	0.0073	0.0214	0.0295	120		124
110	BDN	CUL	1	21.8	0.0312	0.0751	0.0073	196		222
110	BDN	DOO	1	11.3	0.0071	0.0368	0.004	178		219
110	BEG	CKM	1	32.3	0.0148	0.1159	0.0104	136		166
110	BGH	CLA	1	13.5	0.008	0.0395	0.0394	178		219
110	BIN	CF	1	34.261	0.0533	0.1178	0.011	105		128
110	BIN	LET	1	69	0.0719	0.2302	0.0235	136		166
110	ВК	CBR	1	37.396	0.0579	0.1282	0.013	99		125
110	ВК	MOY	1	27	0.017	0.0877	0.0096	99		114
110	BLA	POT	1	5.2	0.002	0.0041	0.092	119		119
110	BLA	RE	1	7.7	0.003	0.006	0.1362	119		119
110	BLI	DMY	1	27.57	0.0426	0.0943	0.0098	105		128
110	BLK	BLKT	1	0.5	0.0006	0.0017	0.0002	136		166
110	ВМА	KEL	1	10	0.01306	0.03455	0.00332	109	119	124
110	ВМА	KEL	1	11.5	0.01502	0.03973	0.00381	109	119	124
110	BNH	CAS	1	21.2	0.02769	0.07132	0.00722	82		103
110	BNH	CAS	2	21.2	0.02769	0.07132	0.00722	82		103
110	BNM	DON	1	6	0.00479	0.00462	0.0531	75	75	82
110	BNM	DON	2	6	0.00479	0.00462	0.0531	75	75	82
110	BOG	CRA	1	24.677	0.0179	0.0811	0.0087	178		219
110	BOL	ENN (I)	1	24	0.0151	0.078	0.0085	178		219
110	BOL	TBKT	1	19.6	0.0305	0.0674	0.0063	105		128
110	BPS	BVG	1	17.3	0.02259	0.0582	0.00589	82	95	103
110	BPS	BVG	2	17.3	0.02259	0.0582	0.00589	82	95	103
110	BPS	EDE	1	15.1	0.02283	0.05361	0.00487	69	80	86
110	BPS	EDE	2	15.1	0.02271	0.05291	0.0049	70	81	87
110	BRO	RSK	1	17.4	0.01	0.062	0.02	186	191	193
110	BRY	RAF	1	1.7	0.0027	0.0059	0.0006	63		99
110	BRY	RAF	2	1.8	0.0021	0.0061	0.0007	105		128
110	BUT	CUL	1	12.317	0.0078	0.038	0.013	192		192
110	BUT	KTN	1	2.717	0.0038	0.0099	0.001	200		221
110	BVG	KEL	1	21.2	0.02769	0.073	0.00705	109	119	124
110	BVG	KEL	2	20.3	0.02651	0.06989	0.00675	109	119	124
110	BVG	LAR	1	7.1	0.0071	0.02336	0.00249	79	96	113

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	Impedance on 100 MVA Base (pu)		Ra	ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
110	BVG	LAR	2	7.1	0.0071	0.02336	0.00249	79	96	113
110	BVK	GRO	1	4.91	0.00209	0.00247	0.03289	195		220
110	BWR	CRA	1	21.89	0.0111	0.03	0.1366	116		116
110	BYH	GLE	1	12.5	0.0049	0.02398	0.24418	178		219
110	CAB	PTN	1	2.66	0.0024	0.0072	0.0053	80		129
110	CAB	WOL	1	4.7	0.0025	0.0053	0.0286	120		131
110	CAH	DOO	1	15.732	0.0099	0.0511	0.0056	178		219
110	CAH	KHL	1	17.95	0.0113	0.0584	0.0064	178		219
110	CAH	TIP	1	18.055	0.0114	0.0587	0.0064	178		219
110	CAH	BAR T	1	43.69	0.0653	0.1497	0.0141	105		128
110	CAR	CAS	1	24.7	0.03714	0.0875	0.00798	69	80	86
110	CAR	CAS	2	24.7	0.03695	0.08641	0.00803	70	81	87
110	CAR	EDE	1	12.4	0.01865	0.04345	0.00402	70	81	87
110	CAR	EDE	2	12.4	0.01875	0.04402	0.004	69	80	86
110	CAS	CRE	1	3	0.00118	0.00363	0.06079	132	132	145
110	CAS	CRE	2	3	0.00118	0.00364	0.06093	132	132	145
110	CAS	KNO	1	4.5	0.00532	0.00448	0.0442	66	66	73
110	CAS	KNO	2	4.5	0.00524	0.00442	0.04353	66	66	73
110	CAS	NAR	1	18	0.01516	0.04027	0.07135	109	119	124
110	CAS	NAR	2	19.8	0.0177	0.04614	0.07049	109	119	124
110	CAS	RAT (N)	1	18.9	0.02468	0.06358	0.00644	82	95	103
110	CAS	RAT (N)	2	18.9	0.02468	0.06358	0.00644	82	95	103
110	CAS	ROS	1	1.9	0.00064	0.00252	0.0154	144	144	144
110	CAS	ROS	2	1.9	0.00064	0.00252	0.0154	144	144	144
110	CBL	TRI	1	13.797	0.0094	0.0293	0.0902	124		124
110	CBR	CBG	1	26.52	0.0375	0.0825	0.0518	99		124
110	CBR	CLN	1	57.527	0.0893	0.1978	0.0195	99		125
110	CBR	DLT	1	27.764	0.0432	0.0955	0.0089	98		124
110	CD	KBY	1	32.091	0.0202	0.1043	0.0113	178		219
110	CD	MAC	1	2.411	0.0016	0.0079	0.0009	178		219
110	CDK	LWD	1	6.6	0.0034	0.0091	0.0412	116		116
110	CDU	MUL	1	73.255	0.0884	0.237	0.0413	105		128
110	CDU	PLA	1	37	0.0233	0.1202	0.0131	178		219
110	CDU	RYB	1	13.01	0.0119	0.0394	0.0209	103		128

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	ce on 100 I (pu)	MVA Base	Ra	ting (MVA	)
					R X 5 0.0143 0.0457 0		В	Summer	Autumn	Winter
110	CDY	ARI T	1	13.675	0.0143	0.0457	0.0047	136		166
110	CDY	GRV	1	7.3	0.0046	0.0238	0.0026	178		219
110	CDY	SRA	1	12.65	0.0197	0.0435	0.0041	99		125
110	CEN	CRE	1	4.2	0.00113	0.00437	0.03032	144	144	144
110	CEN	CRE	2	4.2	0.00113 0.00437 0.0303		0.03032	144	144	144
110	CF	CL	1	5.5	0.0058	0.0184	0.0019	136		166
110	CF	COR	1	61.3	0.0385	0.1992	0.0216	178		219
110	CF	SRA	1	52.98	0.0649	0.1787	0.0211	187		190
110	CF	CLO	1	25.85	0.0368	0.0943	0.0091	187		222
110	CGL	CKN	1	6.3	0.004	0.0205	0.00276	178		219
110	CGL	GAE	1	2	0.0007	0.0032	0.0147	130		130
110	CHA	GLE (I)	1	30	0.0467	0.1032	0.0096	105		128
110	CHA	KLN	1	36.9	0.0385	0.1231	0.0126	136		166
110	CHA	MAL	1	22.5	0.0142	0.0731	0.008	178		219
110	CHE	FAS	1	2.2	0.0035	0.0076	0.0008	105		128
110	CKG	ВКҮ	1	3	0.0007	0.0033	0.033	187		223
110	CKG	KUD	1	0.75	0.0002	0.0009	0.0083	187		223
110	CKM	CHE	1	4	0.0038	0.0081	0.0295	105		128
110	CKM	СРК	1	0.1	0.0002	0.0004	0.0001	136		166
110	CKM	FAS	1	2.9	0.0046	0.01	0.001	105		128
110	CKM	POT	1	3.2	0.0013	0.0025	0.0566	119		119
110	CKN	KER	1	20.3	0.0128	0.066	0.0072	178		219
110	CLA	CKN	1	29.8	0.0188	0.0968	0.0105	178		219
110	CLA	MAC	1	5.66	0.0036	0.0184	0.002	160		196
110	CLG	CDU	1	2.5	0.0006	0.0028	0.0276	187		219
110	CLG	FIN (I)	1	3.64	0.0035	0.0111	0.0073	124		124
110	CLG	MCE	1	4.7	0.0047	0.0151	0.0054	99		125
110	CLH	TRI	1	9	0.014	0.031	0.0029	99		125
110	CLH	TRL	1	13.5	0.0199	0.0445	0.0251	105		128
110	CLN	LA	1	64.758	0.0951	0.2216	0.021	99		125
110	CLO	MRY	1	7.4	0.0053	0.0111	0.0743	124		124
110	CLO	CF	1	26.45	0.0164	0.0847	0.0157	178		219
110	CLO	GLT	1	0.25	0.0003	0.0008	0.0007	187		222
110	CLW	KLS	1	5.401	0.0084	0.0186	0.0018	99		125

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	ce on 100 I (pu)	MVA Base	Ra	ting (MVA	)
					R X		В	Summer	Autumn	Winter
110	CLW	KLS	2	5.28	0.0082	0.0186	0.0017	99		125
110	CLW	STR (I)	1	17.6	0.0274	0.0606	0.0057	105		128
110	COL (I)	CDU	1	2.665	0.0009	0.0043	0.0196	130		130
110	COL (I)	FIN (I)	1	5.021	0.0034	0.0127	0.0373	104		124
110	COL (N)	CPS	1	46.7	0.06086 0.16057 0.015		0.01549	82	95	103
110	COL (N)	LIM (N)	1	18.6	0.02433	0.06431	0.00618	82	95	103
110	COL (N)	LOG	1	8.1	0.01058	0.02725	0.00276	82	95	103
110	COL (N)	LOG	2	8.1	0.01058	0.02725	0.00276	82	95	103
110	COL (N)	RSK	1	21.3	0.0237	0.06914	0.00665	185	191	193
110	COO	ВСТ	1	15.1	0.0136	0.045	0.0272	130		130
110	COO	CKM	1	16	0.0134	0.0417	0.0604	130		130
110	COR	ENN (N)	1	27.5	0.0427	0.1068	0.0088	105		128
110	COR	GWE	1	10.9	0.0069	0.0355	0.0039	178		219
110	COS	ARIT	1	20.71	0.0216	0.0693	0.0071	120		128
110	COS	FLA	1	3.4	0.0053	0.0117	0.0011	99		125
110	COS	FLA	2	3.3	0.0052	0.0114	0.0011	99		125
110	COW	CVW	1	17.22	0.0245	0.0543	0.0182	99		125
110	COW	OLD	1	2.3	0.0035	0.0079	0.0008	105		128
110	COW	OLD	2	2.2	0.0033	0.0076	0.0007	105		128
110	COW	RAF	1	6.898	0.01	0.0236	0.0033	99		125
110	COW	WHI	1	17.786	0.0272	0.0615	0.0058	105		128
110	CPK	CPK T	1	3.375	0.0018	0.0037	0.0247	100		100
110	CPK	TLY	1	5.589	0.0029	0.0056	0.0725	100		100
110	CPS	KMT	1	14.5	0.01077	0.04817	0.00513	143	158	166
110	CPS	LIM (N)	1	29.5	0.03853	0.10139	0.00983	82	95	103
110	CPS	LMR	1	9	0.01175	0.03028	0.00307	82	95	103
110	CPS	LMR	2	9	0.01175	0.03028	0.00307	82	95	103
110	CPS	SPR	1	9.2	0.01069	0.02893	0.01157	82	95	103
110	CPS	SPR	2	9.4	0.01073	0.02908	0.01263	82	95	103
110	CPS	STR (N)	1	27	0.01813	0.05288	0.01685	143	158	166
110	CRA	LWD	1	8	0.0051	0.026	0.0029	178		219
110	CRA	WEX	1	21.3	0.0222	0.0711	0.0073	136		166
110	CRG	KEL	1	23.1	0.02933	0.07667	0.01292	82	95	103
110	CRG	TMN	1	36.2	0.04482	0.11909	0.02184	109	119	124

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	ce on 100 I (pu)	MVA Base	Ra	ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
110	CRM	KLM	1	1.35	0.001	0.0021	0.0136	140		140
110	CRM	KLM	2	1.35	0.001	0.0021	0.0136	140		140
110	CRO	IA	1	2.74 0.004 0.0101		0.0101	0.001	196		222
110	CRO	KBY	1	14.356	0.0094	0.0468	0.0054	178		219
110	CSH	CLN	1	22.803	0.0144	0.0741	0.0081	178		219
110	CSH	DLT	1	60.763	0.0745	0.2049	0.0202	99		125
110	CSH	ENN (I)	1	53.468	0.0336	0.1737	0.0189	178		219
110	CSH	GAL	1	13.801	0.0215	0.0475	0.0045	99		125
110	CSH	GAL	2	11.3	0.0176	0.0389	0.0037	99		125
110	CSH	GAL	3	11.3	0.0176	0.0389	0.0037	99		125
110	CSH	SAL	2	24.856	0.0248	0.0718	0.0677	99		105
110	CSH	SOM T	1	50.019	0.0778	0.172	0.0161	99		125
110	CTN	KLN	1	28.07	0.0436	0.0975	0.009	105		128
110	CTN	TIP	1	13.15	0.0205	0.0463	0.0043	105		129
110	CTY	FTT	1	1.5	0.001	0.0009	0.0183	124		132
110	CTY	INC	1	8.9	0.0111	0.0301	0.003	103		128
110	CUL	DGN	1	34.239	0.0215	0.1093	0.0203	178		219
110	CUL	WAT	1	13.143	0.0064	0.0326	0.0547	178		219
110	CUN	GLR	1	26.293	0.0374	0.096	0.0087	178		219
110	CUN	SLI	1	21.104	0.0302	0.0727	0.0071	196		222
110	CUS	MLC	1	13.674	0.0151	0.0483	0.005	136		166
110	CUS	NEW (I)	1	24.607	0.0257	0.0821	0.0084	136		166
110	CUS	PLS	1	42.14	0.0436	0.1396	0.0143	136		166
110	CVW	DKL	1	0.355	0.0006	0.0013	0.0002	105		128
110	CVW	KRA	1	7.59	0.0117	0.0259	0.0035	99		125
110	DAL	DALT	1	12.2	0.019	0.042	0.004	105		128
110	DDK	LOU	1	16.811	0.0262	0.0582	0.0054	105		128
110	DDK	LOU	1	16.811	0.0262	0.0582	0.0054	105		128
110	DDK	MLN	1	7.5	0.0117	0.0258	0.0025	105		128
110	DER	KIN	1	15.116	0.0123	0.0498	0.0053	99		125
110	DER	MAY	1	42.955	0.0271	0.1393	0.0179	74		93
110	DER	TSB	1	19.673	0.0308	0.0681	0.0064	105		128
110	DFR	DFR T	1	0.06	0.0001	0.0002	0.0001	105		128
110	DGN	WH	1	8.65	0.0055	0.0281	0.0031	178		219

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	(pu)			Ra	ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
110	DMY	MAC	1	26.22	0.0374	0.0958	0.0087	120		222
110	DON	FIN (N)	1	3.7	0.0044	0.01101	0.00755	69	80	86
110	DON	FIN (N)	1	3.7	0.00449	0.01117	0.00748	69	80	86
110	DON	HAN	2	5.8	0.00163 0.0045		0.13972	144	144	158
110	DON	HAN	2	5.8	0.00163	0.00451	0.13972	144	144	158
110	DRM	LET	1	8.346	0.0125	0.0276	0.0026	105		128
110	DRM	MEE	1	5	0.0078	0.0172	0.0016	105		128
110	DRM	CLO	1	27	0.0386	0.0909	0.0152	103		128
110	DRU (I)	ENN (I)	1	17.437	0.027	0.0601	0.0063	99		125
110	DRU (N)	TAN	1	4.4	0.0044	0.01448	0.00154	79	96	113
110	DRU (N)	TAN	2	4.4	0.0044	0.01448	0.00154	79	96	113
110	DRU (N)	TAN	3	4.1	0.00478	0.0136	0.00142	96	106	119
110	DRU (N)	TMN	1	22.7	0.02789	0.07256	0.01196	82	95	103
110	DRU (N)	TMN	2	21.5	0.02937	0.07549	0.00768	82	95	103
110	DRY	GOR (I)	1	19.394	0.0293	0.0667	0.0063	99		125
110	DRY	LOU	1	31.9	0.0201	0.1037	0.0113	178		219
110	DRY	PLA	1	5.3	0.0082	0.0182	0.0017	105		128
110	DTN	FIN (I)	1	9.245	0.0017	0.0144	0.1108	140		140
110	DTN	KLM	1	3.2	0.0023	0.0048	0.0321	140		140
110	DUN	OMA	1	36.1	0.04195	0.12375	0.01197	186	191	193
110	DUN	TMN	1	5.82	0.00428	0.01712	0.00501	144	144	144
110	DUN	TMN	2	6.53	0.00913	0.02342	0.0024	144	144	144
110	DUN	TMN	3	6	0.00374	0.01978	0.01856	186	191	193
110	ENN (N)	OMA	1	33.8	0.04401	0.11337	0.01148	82	95	103
110	ENN (N)	OMA	2	33.7	0.04401	0.11337	0.01148	82	95	103
110	FAS E	CKM	1	7.5	0.0117	0.0258	0.0024	105		128
110	FAS E	FAS T	1	5	0.0078	0.0172	0.0016	105		128
110	FIN (I)	GLA	1	14.02	0.0218	0.0482	0.0047	105		128
110	FIN (I)	GRA	1	13.2	0.005	0.0115	0.2359	119		119
110	FIN (I)	MCD	1	7.9	0.003	0.0069	0.1412	119		119
110	FIN (I)	POP	1	4.3	0.0023	0.0048	0.0262	120		131
110	FIN (I)	PTN	1	3.52	0.0033	0.0099	0.0061	80		129
110	FIN (I)	SVN	1	32.22	0.0394	0.104	0.0564	105		115
110	FIN (N)	HAN	1	3.1	0.00084	0.00322	0.02238	144	144	144

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	(pu)			Ra	ting (MVA	)
					R	Х	В	Summer	Autumn	Winter
110	FIN (N)	HAN	2	3.1	0.00084	0.00322	0.02238	144	144	144
110	FLA	GIL	1	10.6	0.0165	0.0365	0.0034	105		128
110	FLA	SLI	1	50.5	0.0785	0.1737	0.0162	98		124
110	FLA	TON	1	32.31	0.0502	0.1111	0.0104	99		126
110	FLA	SLB	1	21.705	0.0337	0.0747	0.007	105		128
110	FRN	HAR	1	2.28	0.0018	0.004	0.03	107		107
110	FRN	HEU	1	2.4	0.0017	0.0036	0.0241	140		140
110	FRN	INC	1	5.6	0.0044	0.0098	0.0727	107		107
110	FRN	TRN	1	2.8	0.002	0.0042	0.0281	140		140
110	FIT	COO	1	4.4	0.004	0.0106	0.0193	124		132
110	GAL	SAL	1	6.112	0.0016	0.00746	0.0674	105		105
110	GCA	GRIT	1	8.87	0.009	0.0286	0.0058	103		131
110	GCA	INC	1	8.1	0.0079	0.0246	0.0091	103		143
110	GCA	INC	2	8.1	0.0079	0.0246	0.0091	103		143
110	GCA	INC	3	7.71	0.0047	0.0044	0.0939	124		124
110	GCA	KUD	1	2.1	0.0015	0.0032	0.0211	140		140
110	GCA	KUD	2	2.1	0.0015	0.0032	0.0211	140		140
110	GCA	NAN	1	1.82	0.001	0.0021	0.0111	120		131
110	GCA	NAN	2	1.74	0.0009	0.002	0.0106	120		131
110	GI	KKY	1	49.2	0.0765	0.1692	0.0158	99		125
110	Gl	WAT	1	11.7	0.0074	0.0381	0.0042	178		219
110	Gl	WAT	2	12.92	0.0082	0.042	0.0046	178		219
110	GI	WEX	1	34.5	0.0537	0.1187	0.0111	99		125
110	GLA	SVN	1	18	0.0173	0.0552	0.0517	136		154
110	GLE (N)	KEL	1	21.4	0.02726	0.06833	0.02722	82	82	90
110	GLE (N)	KEL	2	21.4	0.02726	0.06834	0.02732	82	82	90
110	GOL	GOLT	1	3.9	0.0061	0.0135	0.0013	105		128
110	GOR (I)	MTH	1	27.3	0.0282	0.0904	0.0125	99		125
110	GOR (I)	NAV	1	5.33	0.0079	0.0187	0.0018	99		125
110	GOR (I)	NAV	2	6.297	0.0089	0.0217	0.0021	99		125
110	GOR (I)	NAV	3	6.5	0.0068	0.0217	0.0023	99		125
110	GOR (I)	PLA	1	19.732	0.0302	0.0681	0.0064	98		124
110	GOR (N)	OMA	1	17.1	0.01058	0.06565	0.0063	200	200	200
110	GOR (N)	TMN	1	34.8	0.02117	0.13129	0.0126	186	191	193

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	ce on 100 I (pu)	MVA Base	Ra	ting (MVA	)
					R X 0.002 0.0046 0		В	Summer	Autumn	Winter
110	GRA	NBY	1	5.05	0.002	0.0046	0.0887	119		119
110	GRI	GRI T	1	1	0.0016	0.0035	0.0004	105		128
110	GRO	CKN	1	15.17	0.0079	0.0142	0.1387	120		120
110	HAN	LIS (N)	1	9.2	0.00974	0.02647	0.0182	82	95	103
110	HAN	LIS (N)	2	9.2	0.00864 0.0263 0.0		0.01795	80	93	100
110	HAR	RE	1	5.63	0.0045	0.0098	0.0728	107		107
110	HEU	INC	1	3.6	0.0026	0.0054	0.0362	140		140
110	IA	MAC	1	18.611	0.0266	0.068	0.0062	211		222
110	IKE	IKE T	1	0.15	0.0002	0.0006	0.0001	80		129
110	INC	ВКҮ	1	10	0.0023	0.011	0.11	187		0
110	INC	CO0	1	6.17	0.0055	0.0155	0.0293	136		140
110	INC	MIL	1	8.4	0.0044	0.0094	0.0511	120		131
110	KEL	RSK	1	36	0.03909	0.13303	0.01317	185	190	193
110	KER	OUG T	1	22.6	0.0142	0.0735	0.008	178		219
110	KHL	THU	1	21.241	0.0134	0.069	0.0075	178		219
110	KIN	DFR T	1	29.25	0.0213	0.0957	0.0103	99		125
110	KIN	MUL	1	27	0.017	0.0877	0.0096	178		219
110	KKY	KLS	1	34.3	0.0534	0.118	0.011	99		125
110	KLM	NBY	1	1.2	0.0006	0.0012	0.0199	119		119
110	KLM	POP	1	6	0.0031	0.0067	0.0365	120		131
110	KLN	LIM (I)	1	9	0.014	0.031	0.0029	99		125
110	KLN	NEN	1	33.6	0.0523	0.1156	0.0108	105		128
110	KLN	SNG	1	4.05	0.0026	0.0131	0.0026	178		219
110	KMT	SLK	1	6.2	0.00728	0.01822	0.0061	98	105	110
110	KMT	STR (N)	1	11.2	0.00818	0.03674	0.00394	143	158	166
110	KNR	TB	1	15	0.0157	0.0501	0.0052	136		166
110	KNR	TRI	1	4.4	0.0046	0.0166	0.0015	120		128
110	KNR	TRI	2	5.73	0.0036	0.0187	0.0021	178		219
110	KNY	GAL	1	26.5	0.00505	0.03101	0.36265	228		228
110	KNY	SAL	1	28.33	0.01891	0.0634	0.08137	187		223
110	KNY	UGL	1	3.43	0.0007	0.0039	0.047	228		228
110	KRA	BAR	1	19.452	0.0203	0.0649	0.0067	136		166
110	KRA	KBY	1	11.9	0.0075	0.0387	0.0042	178		219
110	KRA	KBY	2	12.5	0.0183	0.0428	0.0041	99		125

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	ce on 100 <i>l</i> (pu)	MVA Base	Ra	ting (MVA	)
					R X 0.0167 0.0368		В	Summer	Autumn	Winter
110	KRA	MID	1	10.7	0.0167	0.0368	0.0035	99		125
110	KRA	WH	1	41.456	0.0261	0.1347	0.0146	178		219
110	KTL	MAY	1	21.405	21.405 0.0223 0.0716 0.0073		99		125	
110	KTL	MON	1	8.878	78 0.0093 0.0297 0.0031		136		166	
110	KTN	WAT	1	5	0.0036 0.0075 0.0502		99		125	
110	KUR	NAV	1	6.1	0.0095	0.021	0.002	105		128
110	LA	MUL	1	46.27	0.0719	0.1595	0.0149	105		128
110	LA	RIC	1	15.742	0.0242	0.0535	0.0068	105		128
110	LA	RIC	2	12.549	0.0195	0.043	0.0051	105		128
110	LA	SLB	1	9.105	0.0141	0.0313	0.003	105		128
110	LET	GOLT	1	38.4	0.0578	0.1317	0.0124	103		128
110	LET	STR (N)	1	22.25	0.0346	0.0765	0.0072	105		128
110	LET	TLK	1	34.85	0.0541	0.1196	0.0127	105		128
110	LIB	MR	1	2.7	0.0014	0.0031	0.0165	100		100
110	LIB	MR	2	2.74	0.0015	0.0031	0.0167	120		131
110	LIM (I)	KLN	1	11.7	0.0179	0.0396	0.0089	80		110
110	LIM (I)	MTN	1	6.479	0.0053	0.0245	0.0027	178		219
110	LIM (I)	RAT (I)	1	29.11	0.0438	0.1006	0.0123	99		125
110	LIS (I)	LOU	1	40.4	0.0628	0.1389	0.013	105		128
110	LIS (I)	SKL	1	39.3	0.0611	0.1352	0.0126	105		128
110	LIS (N)	TAN	1	31	0.04049	0.10592	0.0104	82	95	103
110	LIS (N)	TAN	2	29.2	0.03393	0.10022	0.0087	80	93	100
110	LOU	MLN	1	13	0.0203	0.0447	0.0042	105		128
110	LOU	RRU	1	37.5	0.0583	0.129	0.012	105		128
110	LSN	THU	1	10.4	0.0162	0.0358	0.0034	99		125
110	MAL	KBY	1	29.2	0.0184	0.0949	0.0103	178		219
110	MAY	BLK T	1	30.9	0.0322	0.1031	0.0106	136		166
110	MAY	GRI	1	2.2	0.003	0.0087	0.0008	105		128
110	MAY	GRI T	1	2.2	0.0022	0.0069	0.0019	103		120
110	MAY	RNW	1	7.1	0.0082	0.0239	0.0024	103		128
110	MAY	RYB	1	9.01	0.0092	0.0303	0.0052	178		219
110	MCD	NQS	1	2	0.0008	0.0018	0.0358	119		119
110	MCD	WOL	1	1.4	0.0008	0.0016	0.0086	120		131
110	MCE	CDU	1	4.1	0.0027	0.0099	0.0163	99		125

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	ce on 100 I (pu)	MVA Base	Ra	ting (MVA	)
					R X 0.0022 0.0045 0.		В	Summer	Autumn	Winter
110	MHL	RE	1	3	0.0022	0.0045	0.0301	140		140
110	MHL	TRN	1	1.4	0.001	0.0021	0.0141	140		140
110	MID	WHI	1	20.022	0.0303	0.0691	0.0065	99		125
110	MIL	RE	1	4.9	0.0026	0.0047	0.0746	100		100
110	MIL	RE	1	5.55	0.0029	0.0062	0.0338	120		140
110	MIL	TLY	1	5.548	8 0.0029 0.0056 0.0703		100		100	
110	MKL	OMA	1	37.5	0.02777	0.11322	0.0146	139	150	157
110	MOY	GLR	1	13.956	0.0216	0.048	0.0045	99		125
110	MOY	TAW	1	8.4	0.0131	0.0289	0.0027	98		124
110	MOY	TAW	2	8.3	0.0108	0.028	0.0124	187		222
110	MP	TBK T	1	6.6	0.0103	0.0227	0.0022	105		128
110	MR	KBY	1	3.99	0.0041	0.0134	0.0028	99		115
110	MR	KBY	2	3.99	0.0041	0.0134	0.0028	99		115
110	MR	TBG	1	3.25	0.0008	0.0036	0.0358	178		219
110	MR	TBG	2	3.25	0.0008	0.0036	0.0358	178		219
110	MTH	LOU	1	15.1	0.0235	0.052	0.0049	99		125
110	MTN	MUN	1	0.7	0.0011	0.0025	0.0003	105		128
110	MTN	MUN	2	0.7	0.0011	0.0024	0.0002	105		128
110	NEW (I)	BLKT	1	12.2	0.0128	0.0407	0.0042	136		166
110	NEW (I)	PLS	1	43.02	0.0553	0.146	0.0143	105		128
110	NEW (N)	TAN	1	24.1	0.03121	0.0804	0.00814	82	95	103
110	NEW (N)	TAN	2	24	0.03121	0.0804	0.00814	82	95	103
110	NQS	RE	1	2.1	0.0008	0.0019	0.0376	119		119
110	OMA	STR (N)	1	35.5	0.04636	0.12265	0.01177	109	119	124
110	OMA	STR (N)	2	36.1	0.04715	0.12469	0.01197	82	95	102
110	OMA	TRE	1	21.5	0.02532	0.07345	0.00708	186	191	193
110	OUG	OUG T	1	11	0.0171	0.0379	0.0036	105		128
110	PA	STR (I)	1	22.4	0.0349	0.0771	0.0072	105		128
110	PB	RE	1	1.4	0.0002	0.002	0.0463	269		269
110	PB	RE	2	1.4	0.0002	0.002	0.0463	269		269
110	PLS	DALT	1	54.7	0.0344 0.177		0.0193	178		219
110	RAF	RSY	1	2.1	0.0033	0.0073	0.0007	63		99
110	RAF	TBG	1	10.583	0.0163	0.036	0.0045	105		128
110	RAF	TBG	2	9.5	0.006	0.0306	0.0047	178		219

**Table B-2 Characteristics of Existing Transmission Circuits** 

Voltage (kV)	From	То	No.	Length (km)	Impedan	ce on 100 <i>l</i> (pu)	Ra	ting (MVA	)	
					R X		В	Summer	Autumn	Winter
110	RAT (I)	TB	1	33.586	0.035	0.1123	0.0115	136		166
110	RE	PB	1	1.2	0.0005 0.0011		0.0157	112		112
110	RE	WBK	1	0.615			0.02061	125		141
110	REM	TRL	1	12	0.006	0.0179	0.12	106		106
110	RNW	DFR T	1	25.9	0.0202	0.085	0.009	99		125
110	RRU	SKL	1	14.5	0.0226	0.0499	0.0047	99		125
110	SCR	KNY	1	33.33	0.0327	0.10606	0.04201	136		140
110	SH	DALT	1	12	0.0075	0.0388	0.0069	178		219
110	SH	IKE T	1	53.94	0.0339	0.1752	0.019	178		219
110	SH	SOM T	1	13.801	0.0212	0.0468	0.0062	105		128
110	SLI	SRA	1	11.1	0.0173	0.0382	0.0036	99		125
110	SLI	SRA	2	12	0.0187	0.0413	0.0039	99		125
110	SNG	AA	1	5.565	0.0035	0.0179	0.004	178		219
110	SOM	SOM T	1	2	0.0032	0.0069	0.0007	105		128
110	SOR	TLK	1	4.4	0.0069	0.0152	0.0015	105		128
110	SRA	CF	1	49.2	0.0309	0.1599	0.0174	178		219
110	STR (I)	STR T	1	2	0.0032	0.0069	0.0007	105		128
110	TAN	WAR	1	12.9	0.0129	0.04244	0.00452	79	96	113
110	TAN	WAR	2	12.9	0.0129	0.04244	0.00452	79	96	113
110	TB	TRL	1	41.975	0.0629	0.1474	0.0136	99		125
110	TBK	TBK T	1	2.9	0.0046	0.01	0.001	105		128
110	THU	IKE T	1	25.675	0.0162 0.0834		0.0091	178		219
110	TRE	TMN	1	42.9	0.02538 0.08197		0.02452	144	144	144
110	TRL	OUG T	1	11.3	0.0071 0.0368		0.004	178		219
110	TRL	TB	1	45.687	0.028 0.1481		0.0243	178		219

Table B-3 Characteristics of Existing Transformers in Ireland

Station	Transformer	Rating (MVA)	HV/LV (kV)	Impedano MVA Ba		Voltage Rat	
				R	X	+	-
DSN	T4201	500	400/220	0.0002	0.0317	1%	16%
DSN	T4202	500	400/220	0.0003	0.027	10%	7%
MP	T4202	500	400/220	0.0002	0.0329	1%	16%
OST	T4201	500	400/220	0.0003	0.027	10%	8%
WOO	T4201	500	400/220	0.0002	0.0316	1%	16%
WOO	T4202	550	400/220	0.0002	0.027	N,	/A
WOO	T4204	500	400/220	0.0002	0.0316	1%	16%
LOU	AT1	300	275/220	0.0008	0.03	15%	15%
LOU	AT2	600	275/220	0.0008	0.015	15%	15%
LOU	AT3	300	275/220	0.0008	0.0303	15%	15%
AD	T2101	125	220/110	0.001	0.124	10%	18%
ARK	T2101	63	220/110	0.007	0.18	23%	19%
ARK	T2102	125	220/110	0.0021	0.1237	9%	18%
BVS	T2101	250	220/110	0.001	0.064	10%	18%
BVS	T2102	250	220/110	0.001	0.064	10%	18%
BYH	T2101	250	220/110	0.001	0.064	10%	18%
BYH	T2102	250	220/110	0.001	0.064	10%	18%
CLA	T2101	125	220/110	0.001	0.124	10%	18%
CLA	T2102	250	220/110	0.0013	0.0647	10%	18%
CSH	T2101	238	220/110	0.0004	0.0631	10%	18%
CSH	T2102	250	220/110	0.0004	0.0631	10%	18%
CSH	T2104	175	220/110	0.0021	0.1332	22%	18%
CKM	T2101	250	220/110	0.001	0.0646	10%	18%
CKM	T2102	250	220/110	0.001	0.0646	10%	18%
CKM	T2103	250	220/110	0.001	0.0646	10%	18%
CUL	T2101	250	220/110	0.0005	0.064	9%	18%
CDU	T2101	250	220/110	0.00093	0.06152	10%	18%
CDU	T2102	250	220/110	0.00066	0.061	10%	18%
FLA	T2101	125	220/110	0.0027	0.128	10%	18%
FLA	T2102	125	220/110	0.0008	0.1331	10%	18%
FIN (I)	T2101	250	220/110	0.0013	0.0651	10%	18%
FIN (I)	T2102	250	220/110	0.0013	0.0648	10%	18%
FIN (I)	T2103	250	220/110	0.001	0.064	10%	18%
FIN (I)	T2104	250	220/110	0.001	0.0638	10%	18%

Table B-3 Characteristics of Existing Transformers in Ireland

Station	Transformer	Rating (MVA)	HV/LV (kV)	Impedanc MVA Ba		Voltage Ra	
				R	Х	+	-
FIN (I)	T2105	250	220/110	0.001	0.064	10%	18%
GI	T2101	125	220/110	0.0026	0.1331	10%	18%
GI	T2102	125	220/110	0.0023	0.1237	23%	18%
GOR (I)	T2101	250	220/110	0.001	0.064	10%	18%
INC	T2101	250	220/110	0.001	0.0564	10%	18%
INC	T2102	250	220/110	0.001	0.0564	10%	18%
INC	T2103	250	220/110	0.0001	0.06	10%	18%
INC	T2104	250	220/110	0.0001	0.06	10%	18%
KNR	T2101	250	220/110	0.001	0.064	10%	18%
KNR	T2102	250	220/110	0.001	0.064	10%	18%
KRA	T2101	250	220/110	0.0013	0.0647	10%	18%
KRA	T2102	250	220/110	0.0013	0.0652	10%	18%
KRA	T2103	250	220/110	0.0013	0.0652	10%	18%
KLN	T2101	63	220/110	0.0065	0.2453	23%	18%
KLN	T2102	63	220/110	0.0095	0.2473	23%	18%
KLN	T2103	250	220/110	0.0004	0.0631	10%	18%
KLN	T2104	120	220/110	0.001	0.123	10%	18%
KLS	T2101	125	220/110	0.00132	0.1237	10%	18%
KLS	T2102	125	220/110	0.0008	0.1237	10%	18%
LOU	T2101	125	220/110	0.0022	0.1331	23%	18%
LOU	T2102	125	220/110	0.0022	0.1324	23%	18%
LOU	T2103	125	220/110	0.0023	0.1324	23%	18%
LOU	T2104	250	220/110	0.001	0.064	10%	18%
LWD	T2101	250	220/110	0.001	0.064	10%	18%
MAY	T2101	125	220/110	0.0021	0.1339	23%	18%
MAY	T2102	238	220/110	0.001	0.064	10%	18%
MAY	T2103	125	220/110	0.0021	0.1324	23%	18%
MAY	T2104	250	220/110	0.001	0.064	10%	18%
РВ	TF3	250	220/110	0.0013	0.059	9%	17%
РВ	TF4	250	220/110	0.0013	0.0609	9%	17%
RAF	T2101	238	220/110	0.001	0.064	10%	18%
RAF	T2102	250	220/110	0.00045	0.0558	10%	18%
SH	T2101	125	220/110	0.00574	0.1237	10%	18%
SH	T2102	125	220/110	0.00131	0.1237	10%	18%
SRA	T2101	250	220/110	0.001	0.064	10%	18%
ТВ	T2101	238	220/110	0.00099	0.0554	10%	18%
ТВ	T2102	238	220/110	0.00099	0.0554	10%	18%

Table B-4 Characteristics of Existing 3 Winding Transformers in Northern Ireland

Substation/	HV/LV	Ir	npedanc	e pu on :	100 MVA	bas	e e	Rati	ng (M	VA)		minal	No.
Transformer		W1	l-2	W	2-3	\	W3-1				Ratio	(pu)	of Taps
		R	Х	R	Х	R	Х	W1	W2	W3	Upper	Lower	ιαμο
BPS IBTx 1	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	30	1.15	0.85	19
BPS IBTx 2	275/110	0.0018	0.0641	0.0018	0.2059	0	0.128	240	240	30	1.15	0.85	19
CAS IBTx 1	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	60	1.15	0.85	19
CAS IBTx 2	275/110	0.0014	0.0639	0.0014	0.2236	0	0.1449	240	240	30	1.15	0.85	19
CAS IBTx 3	275/110	0.0018	0.0656	0.0018	0.2375	0	0.1593	240	240	30	1.15	0.85	19
CPS IBTx 1	275/110	0.0018	0.0609	0.0018	0.1273	0	0.057	240	240	60	1.15	0.85	19
CPS IBTx 2	275/110	0.0014	0.0639	0.0014	0.2236	0	0.1449	240	240	30	1.15	0.85	19
HAN IBTx 1	275/110	0.0018	0.0591	0.0018	0.1261	0	0.056	240	240	45	1.15	0.85	19
HAN IBTx 2	275/110	0.0018	0.0591	0.0018	0.1261	0	0.056	240	240	45	1.15	0.85	19
HAN IBT x 3	275/110	0.0014	0.0639	0.0014	0.2236	0	0.1449	240	240	60	1.15	0.85	19
KEL IBTx 1	275/110	0.0018	0.0609	0.0018	0.1273	0	0.057	240	240	45	1.15	0.85	19
KEL IBTx 2	275/110	0.0018	0.0607	0.0018	0.1317	0	0.057	240	240	45	1.15	0.85	19
TAN IBTx 1	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	30	1.15	0.85	19
TAN IBTx 2	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	30	1.15	0.85	19
TAN IBTx 3	275/110	0.0014	0.0639	0.0018	0.2375	0	0.1575	240	240	60	1.15	0.85	19
TMN IBTx1	275/110	0.0014	0.0644	0.0037	0.2236	0	0.1514	240	240	60	1.15	0.85	19
TMN IBTx2	275/110	0.0014	0.0644	0.004	0.2315	0	0.15	240	240	60	1.15	0.85	19
KPS IBTx1	275/11.5	0	0.1635	0	0.3040	0	0.1635	110	55	55	1.15	0.938	33

Table B-5 Characteristics of Existing 2 Winding Transformers in Northern Ireland<sup>122</sup>

Station	HV/LV (kV)	Rating (MVA)		pu on rating se	Off nomi	inal ratio	No. of taps
			R	X	Upper	Lower	
AGH	110/33	90	0.0039	0.2464	1.1	0.8	19
ANT	110/33	90	0.0039	0.2464	1.1	0.8	19
ANT	110/33	90	0.0039	0.2473	1.1	0.8	19
ВМА	110/33	90	0.0039	0.2447	1.1	0.8	19
ВМА	110/33	60	0.0065	0.2893	1.1	0.8	19
ВМА	110/33	90	0.0039	0.2463	1.1	0.8	19
ВМА	110/33	60	0.0065	0.2867	1.1	0.8	19
BAN (N)	110/33	30	0.0171	0.4133	1.1	0.8	15
BAN (N)	110/33	30	0.019	0.414	1.1	0.8	15
BAN (N)	110/33	30	0.019	0.4167	1.1	0.8	15
BAN (N)	110/33	30	0.019	0.415	1.1	0.8	15
BNH	110/33	90	0.0037	0.2419	1.1	0.8	19
BNH	110/33	90	0.0038	0.2413	1.1	0.8	19
BNM	110/33	90	0.0039	0.2461	1.1	0.8	19
BNM	110/33	90	0.0039	0.2461	1.1	0.8	19
CAR	110/33	90	0.0039	0.248	1.1	0.8	19
CAR	110/33	90	0.0039	0.248	1.1	0.8	19
CEN	110/33	90	0.0037	0.2422	1.1	0.8	19
CEN	110/33	90	0.0038	0.2419	1.1	0.8	19
COL (N)	110/33	60	0.0074	0.2512	1.1	0.8	19
COL (N)	110/33	60	0.0075	0.2508	1.1	0.8	19
CPS	110/33	90	0.0087	0.2559	1.1	0.8	19
CPS	110/33	90	0.0087	0.2573	1.1	0.8	19
CRG	110/33	60	0.0074	0.2515	1.1	0.8	19
CRG	110/33	60	0.0074	0.2508	1.1	0.8	19
CRE	110/33	75	0.0091	0.1953	1.1	0.8	19
CRE	110/33	75	0.0091	0.1967	1.1	0.8	19
DON	110/33	90	0.004	0.2403	1.1	0.8	19
DON	110/33	60	0.0119	0.3658	1.1	0.8	19
DON	110/33	60	0.0119	0.3607	1.1	0.8	19
DON	110/33	60	0.0119	0.3658	1.1	0.8	19
DRU (N)	110/33	90	0.0061	0.2423	1.1	0.8	19

 $<sup>122\ 110/33\</sup> kV$  transformers in Northern Ireland are included here as these are controlled by SONI.  $110/38\ kV$  transformers in Ireland are not included here as these are controlled by ESB Networks.

Table B-5 Characteristics of Existing 2 Winding Transformers in Northern Ireland

Station	HV/LV (kV)	Rating (MVA)		pu on rating ise	Off nomi	nal ratio	No. of taps
			R	Х	Upper	Lower	
DRU (N)	110/33	90	0.0061	0.2426	1.1	0.8	19
DUN	110/33	90	0.0087	0.2566	1.1	0.8	19
DUN	110/33	90	0.0087	0.2599	1.1	0.8	19
EDE	110/33	45	0.0125	0.2733	1.1	0.8	19
EDE	110/33	45	0.0123	0.2738	1.1	0.8	19
ENN (N)	110/33	45	0.0126	0.272	1.1	0.8	19
ENN (N)	110/33	45	0.0126	0.2733	1.1	0.8	19
ENN (N)	110/33	60	0.0078	0.2512	1.1	0.8	19
FIN (N)	110/33	45	0.0076	0.2533	1.1	0.8	19
FIN (N)	110/33	45	0.0076	0.2549	1.1	0.8	19
GLE (N)	110/33	60	0.0119	0.2692	1.1	0.8	19
GOR (N)	110/33	90	0.0039	0.2461	1.1	0.8	19
KMT	110/33	90	0.0039	0.2461	1.1	0.8	19
KNO	110/33	90	0.0039	0.2461	1.1	0.8	19
KNO	110/33	90	0.0039	0.2461	1.1	0.8	19
LAR	110/33	45	0.0116	0.2778	1.1	0.8	15
LAR	110/33	45	0.0116	0.2771	1.1	0.8	15
LIM (N)	110/33	45	0.0125	0.2809	1.1	0.8	15
LIM (N)	110/33	45	0.0122	0.2764	1.1	0.8	15
LIS (N)	110/33	90	0.0087	0.254	1.1	0.8	19
LIS (N)	110/33	90	0.0086	0.2569	1.1	0.8	19
LMR	110/33	45	0.0076	0.254	1.1	0.8	19
LMR	110/33	45	0.0076	0.2533	1.1	0.8	19
LOG	110/33	45	0.0126	0.2738	1.1	0.8	19
LOG	110/33	45	0.0128	0.28	1.1	0.8	19
MKL	110/33	90	0.0039	0.2502	1.1	0.8	19
MKL	110/33	90	0.0039	0.2502	1.1	0.8	19
NAR	110/33	60	0.0075	0.2505	1.1	0.8	19
NAR	110/33	60	0.0073	0.25	1.1	0.8	19
NEW (N)	110/33	90	0.0038	0.2427	1.1	0.8	19
NEW (N)	110/33	90	0.0038	0.2419	1.1	0.8	19
OMA	110/33	90	0.0039	0.2481	1.1	0.8	19
OMA	110/33	90	0.0039	0.249	1.1	0.8	19

Table B-5 Characteristics of Existing 2 Winding Transformers in Northern Ireland

Station	HV/LV (kV)	Rating (MVA)	Impedance pu on rating base		Off nom	No. of taps	
			R	X	Upper	Lower	
RSK	110/33	90	0.0039	0.2461	1.1	0.8	19
RAT (N)	110/33	90	0.0087	0.2549	1.1	0.8	19
RAT (N)	110/33	90	0.0046	0.2402	1.1	0.8	19
ROS	110/33	90	0.0087	0.2576	1.1	0.8	19
ROS	110/33	90	0.0087	0.2533	1.1	0.8	19
SLK	110/33	52	0.0041	0.1019	1.1	0.9	33
SPR	110/33	90	0.0039	0.247	1.1	0.8	19
SPR	110/33	90	0.0039	0.2471	1.1	0.8	19
STR (N)	110/33	45	0.0076	0.2522	1.1	0.8	19
STR (N)	110/33	45	0.0076	0.2516	1.1	0.8	19
TRE	110/33	90	0.0039	0.2461	1.1	0.8	19
WAR	110/33	90	0.0039	0.2481	1.1	0.8	19

**Table B-6 Characteristics of Existing Power Flow Controllers** 

Station	Voltage (kV)	Circuit	cuit Rating Impedance on 100 MVA Phase Angle Range (MVA) Base (pu) (electrical degrees)				
				R X		+	٠
CKM	220	CKM – PB	350	0.000	0.029	15.3	15.3
ENN (N)	110	ENNK –COR	125	0.000	0.0213	1.2	0.8
STR (N)	110	STRA – LET	125	0.000	0.0213	1.2	8.0

**Table B-7 Characteristics of Existing Reactive Compensation** 

Station	Voltage (kV)	Plant	Capabilit	y (Mvar)
			Generate	Absorb
ARD	110	1 Capacitor	30	
ATH	110	3 Capacitors (1 Mobile)	90	
BAN (I)	110	1 Capacitor	15	
BYC	275	4 Capacitors (4 x 59)	236	
CAH	110	4 Capacitors (4 x 15)	60	
CAS	22	3 Capacitors (3 x 25)	75	
CAS	22	1 Shunt Reactor		30
CBR	110	1 Capacitor	30	
CBR	110	1 Static Var Compensator	60	10
CF	110	1 Capacitor	15	
CGL	20	3 Capacitors (3 x 1)	3	
CKM	38	1 Shunt Reactor		20
CKM	220	1 Shunt Reactor		100
COL (N)	110	1 Capacitor	36	
CPS	110	1 Capacitor	40	
CSH	110	2 Capacitors (2 x 0)	80	
CUN	38	2 Capacitors (2 x 2)	4	
DLN	33	1 Capacitor	5	
DLT	110	1 Capacitor	15	
DMY	110	1 Capacitor	15	
D00	110	1 Capacitor	15	
DRU (I)	110	1 Capacitor	15	
DSN	400	1 Shunt Reactor		80
DYN	20	2 Capacitors (2 x 3.25)	6.5	
ENN (N)	33	4 Capacitors (4 x 6)	24	
FIN (I)	38	1 Shunt Reactor		20
GIL	20	1 Capacitor	12	
GWE	110	1 Capacitor	15	
HAN	22	2 Shunt Reactors (2 x 30)		60
INC	38	2 Shunt Reactors (2 x 20)		40
KEL	22	2 Shunt Reactors (2 x 30)		60
KNY	110	1 Capacitor	30	
KKY	110	2 Capacitor (2 x 15)	30	
KTL	10	1 Capacitor	30	
LET	110	2 Capacitor (1 Mobile)	45	

**Table B-7 Characteristics of Existing Reactive Compensation** 

Station	Voltage (kV)	Plant	Capabilit	ty (Mvar)		
			Generate	Absorb		
LET	110	1 Static Var Compensator	30			
LIS (I)	110	2 Capacitors (2 x 15)	30			
LOU	110	1 Capacitor	30			
LSN	20	1 Capacitor	4			
MOY	110	2 Capacitors (2 x 15)	30			
MUL	20	1 Capacitor	4			
MUL	110	2 Capacitors (2 x 15)	30			
NAV	110	1 Capacitor (1 Mobile)	30			
PB	220	1 Shunt Reactor		50		
POR	400	EWIC HVDC	175	175		
RAF	110	1 Capacitor	60			
RE	38	1 Shunt Reactor		20		
SKL	110	1 Capacitor (1 Mobile)	30			
SLB	20	1 Capacitor	15			
SLI	110	1 Capacitor	15			
SLK	20	1 Capacitor	13			
TAN	22	2 Capacitors (2 x 25)	50			
TAN	22	2 Shunt Reactors (2 x 30)		60		
THU	110	2 Capacitor (2 x 15)	30			
TRI	110	1 Capacitor	30			
TRL	110	1 Capacitor	30			
WEX	110	2 Capacitors (2 x 15)	30			
WOO	400	1 Shunt Reactor		80		

## **B.2.** Transmission System Developments

Future developments of the transmission system are listed in this section according to the year in which they are expected to be completed. The network changes related to each development project are grouped together and collectively headed by a Capital Project (CP) number and title. The physical and electrical characteristics of future transmission plant or changes to the characteristics brought about by planned developments are listed in the tables. These characteristics are indicative at this stage and will be reviewed when the item of plant is commissioned.

**Table B-8 Expected Changes in Circuit Characteristics** 

Action	Voltage (kV)	From	То	No.	Length (km)		ince on 10 Base (pu)		Rating	(MVA)	Year
						R	Х	В	Summer	Winter	
Remove	110	ADM	GCA	1							2017
Remove	110	ADM	INC	1							2017
Remove	110	ATH	CUI	1							2017
Remove	110	AUG	TB	1							2017
Remove	110	BAN	DMY	1							2017
Remove	110	CLG	KLN	1							2017
Remove	110	САН	SUR	1							2017
Remove	110	COL (I)	KLN	1							2017
Remove	110	CTY	C00	1							2017
Remove	220	CDU	WOO	1							2017
Remove	110	FIN (I)	KLN	1							2017
Remove	110	KLN	FIN (I)	1							2017
Remove	110	KNR	ТВ	1							2017
Remove	220	KNR	ТВ	1							2017
Remove	110	KKY	NO	1							2017
Remove	110	RAT (I)	ТВ	1							2017
Remove	110	TB	TRL	1							2017
Remove	110	CTN	TIP	1							2017
Remove	110	TRL	TB	2							2017
Add	110	AUG	KPG	1	32.8	0.0207	0.1067	0.0116	178	219	2017
Add	110	CDL	BYH	1	9.0	0.0021	0.0099	0.0990	209	223	2017
Add	110	BGD	INC	1	6.5	0.0047	0.0097	0.0652	140	140	2017
Add	110	BGD	INC	2	6.5	0.0047	0.0097	0.0652	140	140	2017
Add	110	BAN	DMY	1	25.9	0.0403	0.0891	0.0083	98	124	2017
Add	110	CLG	FIN (I)	1	3.6	0.0035	0.0111	0.0073	124	124	2017
Add	220	CLE	CDU	1	5.1	0.0006	0.0044	0.0067	434	513	2017
Add	220	CLE	WOO	1	13.5	0.0016	0.0116	0.018	393	468	2017
Add	110	CLA	DMY	1	35.0	0.0220	0.1137	0.0124	178	219	2017

**Table B-8 Expected Changes in Circuit Characteristics** 

Action	Voltage (kV)	From	То	No.	Length (km)		ance on 1 Base (pu)		Rating (MVA)		Year
						R	X	В	Summer	Winter	
Add	110	COL (I)	FIN (I)	1	5.0	0.0034	0.0127	0.0373	104	124	2017
Add	110	CTY	FTT	1	1.5	0.0010	0.0009	0.0183	124	132	2017
Add	110	ENN (I)	SLC	1	31.0	0.0082	0.0475	0.3540	228	228	2017
Add	110	FTT	C00	1	4.4	0.0040	0.0106	0.0193	124	132	2017
Add	110	GCA	INC	3	7.7	0.0047	0.0044	0.0939	124	124	2017
Add	110	GLT	BYH	1	9.3	0.0059	0.0303	0.0033	178	219	2017
Add	110	KNR	KPG	1	15.0	0.0152	0.0498	0.0051	136	166	2017
Add	220	KNR	KPG	1	21.4	0.0027	0.0146	0.0543	660	660	2017
Add	110	KCR	GLE	1	11.2	0.0081	0.0171	0.1153	140	140	2017
Add	110	KPG	RAT (I)	1	32.2	0.0333	0.1075	0.0110	136	166	2017
Add	110	KPG	TB	1	1.6	0.0017	0.0056	0.0006	120	128	2017
Add	110	KPG	TRL	1	39.4	0.0602	0.1354	0.0127	105	128	2017
Add	110	KPG	TRL	2	44.4	0.0279	0.1443	0.0157	178	219	2017
Add	110	KPG	TB	2	1.6	0.0017	0.0056	0.0006	120	128	2017
Add	220	KPG	MP	1	5.4	0.0001	0.0017	0.2362	660	660	2017
Add	220	KPG	TB	1	2.8	0.0003	0.0022	0.0257	761	802	2017
Add	110	RE	WBK	1	0.6	0.0003	0.0001	0.0206	125	141	2017
Add	220	TB	KPG	2	2.8	0.0003	0.0020	0.0280	660	660	2017
Add	110	CTN	TIP	1	13.2	0.0083	0.0428	0.0047	105	219	2017
Add	110	BRO	RSK	1	0.0	0.0100	0.0620	0.0200	178	219	2017
Amend	110	ARV	SKL	1	18.6	0.0117	0.0605	0.0066	80	219	2017
Amend	110	BOL	TBKT	1	19.6	0.0124	0.0637	0.0069	105	219	2017
Amend	110	CDU	RYB	1	13.0	0.0119	0.0394	0.0209	103	128	2017
Amend	110	MP	TBKT	1	6.6	0.0042	0.0215	0.0024	105	219	2017
Amend	110	DUN	TMN	1	0.0	0.0043	0.0171	0.0050	139	144	2017
Remove	110	GCA	INC	3							2018
Remove	110	GCA	KUD	1							2018
Remove	110	KNR	TRI	1							2018
Remove	110	KLN	NEN	1							2018
Remove	110	NEW (I)	PLS	1							2018
Remove	110	ATE	KNR	1							2018
Remove	110	ENN (N)	OMA	1							2018
Remove	110	ENN (N)	OMA	2							2018
Add	110	ADM	INC	1	10.5	0.0091	0.0273	0.0237		143	2018
Add	110	ADM	KUD	1		0.0008	0.0016	0.0106		140	2018
Add	110	BLC	CLS	1		0.0004	0.0021	0.0257		228	2018

**Table B-8 Expected Changes in Circuit Characteristics** 

Action	Voltage (kV)	From	То	No.	Length (km)		ince on 10 Base (pu)		Rating	(MVA)	Year
						R	X	В	Summer	Winter	
Add	110	BLC	CLS	2		0.0004	0.0021	0.0257		228	2018
Add	220	BLC	FIN (I)	1	10.0	0.0004	0.0015	0.3320		570	2018
Add	110	BRA	NEW (I)	1	9.3	0.0097	0.0310	0.0032		166	2018
Add	110	BRA	PLS	1	19.3	0.0300	0.0665	0.0062		128	2018
Add	110	KNY	KLH	1	9.9	0.0022	0.0108	0.1095		190	2018
Add	110	MLC	TSB	1	19.2	0.0121	0.0625	0.0068		219	2018
Add	110	KNR	TRI	1	4.4	0.0046	0.0166	0.0015		128	2018
Add	110	KBY	KBY	1	0.2	0.0001	0.0004	0.0015		130	2018
Add	110	KLN	CUR T	1	14.8	0.0109	0.0484	0.0052		166	2018
Add	110	CUR T	NEN	1	18.8	0.0293	0.0648	0.0061		128	2018
Add	110	CUR T	ВКМ	1	17.3	0.0039	0.0189	0.1921		190	2018
Add	110	BKM	CUR	1	7.3	0.0038	0.0069	0.0722		120	2018
Add	110	OMS	CMK	1		0.0072	0.0449	0.0043		188	2018
Add	110	OMS	ENN (N)	1		0.0257	0.0663	0.0067		103	2018
Add	110	OMS	ENN (N)	2		0.0257	0.0663	0.0067		103	2018
Add	110	OMS	OMA	1		0.0183	0.0471	0.0048		103	2018
Add	110	OMS	OMA	2		0.0183	0.0471	0.0048		103	2018
Amend	110	ВК	CBR	1	37.4	0.0533	0.1284	0.0143	98	221	2018
Amend	110	CDY	ARI T	1	13.7	0.0086	0.0445	0.0049	136	219	2018
Amend	110	COS	ARI T	1	20.7	0.0130	0.0673	0.0073	120	219	2018
Amend	110	CDU	RYB	1	13.0	0.0135	0.0434	0.0045	103	219	2018
Amend	110	RAF	TBG	1	10.6	0.0067	0.0345	0.0038	105	219	2018
Amend	110	DUN	TMN	2	0.0	0.0091	0.0234	0.0024	144	144	2018
Remove	110	ATY	PLS	1							2019
Remove	110	BIN	LET	1							2019
Remove	110	CLG	MCE	1							2019
Remove	400	DSN	MP	1							2019
Remove	220	INC	MAY	2							2019
Remove	220	KLN	TB	1							2019
Remove	220	MAY	INC	1							2019
Add	110	ATY	LSE	1	21.9	0.0138	0.0713	0.0078	178	219	2019
Add	110	BIN	TIV	1	23.2	0.0242	0.0774	0.0079	136	166	2019
Add	110	ВК	OWN	1	0.0	0.0000	0.0001	0.0000	999	999	2019
Add	110	AGY	TIV	1	35.0	0.0544	0.1204	0.0112	105	128	2019
Add	400	DSN	LSE	1	44.8	0.0009	0.0100	0.2260	1577	1944	2019
Add	110	CKG	CKG	1	0.0	0.0000	0.0001	0.0000	0	0	2019

**Table B-8 Expected Changes in Circuit Characteristics** 

Action	Voltage (kV)	From	То	No.	Length (km)		nce on 10 Base (pu)		Rating	(MVA)	Year
						R	Х	В	Summer	Winter	
Add	110	CKG	WDU	1	0.8	0.0002	0.0009	0.0083	187	223	2019
Add	220	INC	WDU	2	14.3	0.0020	0.0123	0.0195	761	804	2019
Add	220	KNR	KPG	2	20.0	0.0004	0.0096	0.9709	660	660	2019
Add	220	KLN	KPG	1	70.6	0.0085	0.0609	0.1136	434	534	2019
Add	220	KPG	MP	2	5.4	0.0001	0.0017	0.2362	660	660	2019
Add	220	WDU	MAY	1	11.7	0.0019	0.0115	0.0183	761	804	2019
Add	220	WDU	MAY	2	11.7	0.0016	0.0100	0.0159	761	804	2019
Add	220	WDU	INC	1	14.3	0.0015	0.0091	0.0144	761	804	2019
Add	110	LSE	PLS	1	8.4	0.0051	0.0261	0.0083	178	219	2019
Add	400	LSE	MP	1	170.0	0.0033	0.0378	0.8580	1577	1944	2019
Add	110	LET	TIV	1	45.2	0.0471	0.1508	0.0154	136	166	2019
Add	110	MCE	SBH	1	4.7	0.0047	0.0151	0.0054	98	124	2019
Add	110	MAC	CLA	2	9.0	0.0021	0.0099	0.0993	192	192	2019
Add	110	SBH	CDU	1	4.1	0.0027	0.0099	0.0163	98	124	2019
Add	110	CNN	CLO	1	18.0	0.0114	0.0585	0.0064	178	219	2019
Add	110	CNN	CAG	1	7.0	0.0017	0.0085	0.0772	140	140	2019
Add	110	CTG	BVK	1	31.7	0.0060	0.0358	0.3856	228	228	2019
Add	110	BK	OWN	1	4.0	0.0010	0.0044	0.0440	187	223	2019
Add	110	ВК	ВК	1	3.3	0.0021	0.0108	0.0012	178	219	2019
Amend	220	BVK	BYH	1	14.5	0.0020	0.0126	0.0193	660	804	2019
Amend	220	KNR	BYH	1	47.0	0.0064	0.0402	0.0639	660	804	2019
Amend	110	MOY	GLR	1	14.0	0.0216	0.0480	0.0045	98	128	2019
Amend	110	MOY	TAW	1	8.4	0.0131	0.0289	0.0027	98	128	2019
Amend	110	BPS	EDE	1		0.0228	0.0536	0.0049	69	166	2019
Amend	110	BPS	EDE	1		0.0227	0.0529	0.0049	70	166	2019
Amend	110	CAR	CAS	1		0.0371	0.0875	0.0080	69	166	2019
Amend	110	CAR	EDE	1		0.0187	0.0435	0.0040	70	166	2019
Amend	110	CAR	CAS	1		0.0370	0.0864	0.0080	70	166	2019
Amend	110	CAR	EDE	1		0.0188	0.0440	0.0040	69	166	2019
Amend	110	OMS	OMA	1		0.0183	0.0471	0.0048	186	195	2019
Amend	110	OMS	OMA	2		0.0183	0.0471	0.0048	186	195	2019
Remove	110	CLG	FIN (I)	1							2020
Remove	110	COL (I)	FIN (I)	1							2020
Remove	110	THU	THU	1							2020
Remove	275	TAN	TMN	1							2020
Remove	275	TAN	TMN	2							2020
Add	110	BGT	KKY	1	22.0	0.0139	0.0715	0.0078	178	219	2020

**Table B-8 Expected Changes in Circuit Characteristics** 

Action	Voltage (kV)	From	То	No.	Length (km)		nce on 10 Base (pu)		Rating	(MVA)	Year
						R	Х	В	Summer	Winter	
Add	110	BGT	LSE	1	28.0	0.0176	0.0910	0.0099	178	219	2020
Add	220	CDU	CRH	1		0.0000	0.0002	0.0415	570	570	2020
Add	220	CDU	CRH	2		0.0000	0.0002	0.0415	570	570	2020
Add	110	KPG	СН	1	22.6	0.0236	0.0754	0.0077	136	166	2020
Add	110	CNN	CDF	1	5.5	0.0013	0.0067	0.0607	140	140	2020
Add	110	THU	THU	1	0.0	0.0001	0.0001	0.0001	218	236	2020
Add	400	woo	TUR	1	137	0.0027	0.0311	0.7066	1424	1731	2020
Add	275	TAN	TUR	1		0.0009	0.0086	0.0514	710	881	2020
Add	275	TAN	TUR	2		0.0009	0.0086	0.0514	710	881	2020
Add	275	TMN	TUR	1		0.0002	0.0023	0.0135	710	881	2020
Add	275	TMN	TUR	2		0.0002	0.0023	0.0135	710	881	2020
Amend	110	ВК	MOY	1	27.0	0.0170	0.0877	0.0096	98	219	2020
Amend	110	GI	WEX	1	34.5	0.0217	0.1121	0.0122	98	219	2020
Remove	110	ADM	KUD	1							>2020
Remove	220	CSH	PRO	1							>2020
Remove	220	CSH	TYN	1							>2020
Remove	220	DSN	MAY	2							>2020
Remove	110	CKG	ВКҮ	1							>2020
Remove	220	GOR	MAY	1							>2020
Remove	110	GCA	KUD	2							>2020
Remove	110	INC	ВКҮ	1							>2020
Remove	110	KRA	KRA	1							>2020
Remove	220	LOU	woo	1							>2020
Remove	110	BRO	RSK	1							>2020
Remove	110	COL (N)	COL (N)	1							>2020
Add	110	ADM	GCA	1	2.5	0.0018	0.0038	0.0251	140	140	>2020
Add	110	CLG	FIN (I)	1	3.6	0.0035	0.0111	0.0073	124	124	>2020
Add	220	CSH	CNF	1		0.0010	0.0077	0.0116	392	482	>2020
Add	220	CSH	CNF	2		0.0005	0.0029	0.0046	761	804	>2020
Add	110	CBR	MOY	1	37.0	0.0233	0.1202	0.0131	178	219	>2020
Add	110	COL (I)	FIN (I)	1	5.0	0.0034	0.0127	0.0373	104	124	>2020
Add	220	DSN	MAY	2	30.6	0.0036	0.0265	0.0400	434	534	>2020
Add	400	DSN	WOO	1	58.0	0.0011	0.0129	0.2928	1577	1944	>2020
Add	110	CKG	WDU	2	0.8	0.0002	0.0009	0.0083	187	223	>2020
Add	220	GOR	WOO	1	27.0	0.0032	0.0356	0.1437	434	534	>2020
Add	110	GCA	INC	3	7.7	0.0047	0.0044	0.0939	124	124	>2020
Add	110	KUD	WDU	1	0.8	0.0002	0.0009	0.0083	187	223	>2020

**Table B-8 Expected Changes in Circuit Characteristics** 

Action	Voltage (kV)	From	То	No.	Length (km)		ince on 10 Base (pu)	DO MVA	Rating	(MVA)	Year
						R	Х	В	Summer	Winter	
Add	400	KPG	MP	1	6.0	0.0008	0.0002	0.5489	1210	1210	>2020
Add	110	WDU	BKY	1	1.0	0.0003	0.0011	0.0110	187	223	>2020
Add	110	WDU	BKY	2	0.6	0.0003	0.0011	0.0110	187	223	>2020
Add	220	LOU	ORL	1	14.5	0.0017	0.0126	0.0190	434	534	>2020
Add	220	PRO	CNF	1		0.0093	0.0690	0.1042	392	482	>2020
Add	220	TYN	CNF	1		0.0041	0.0260	0.0413	761	804	>2020
Add	220	WOO	ORL	1	49.2	0.0058	0.0427	0.0644	434	534	>2020
Add	220	ORL	ORL	1	20.1	0.0007	0.0079	0.5502	593	593	>2020
Add	220	ORL	ORL	1	15.9	0.0007	0.0023	0.5279	570	570	>2020
Add	110	AIR	ROS	1		0.0131	0.0341	0.0034	82	103	>2020
Add	110	AIR	ROS	1		0.0131	0.0341	0.0034	82	103	>2020
Add	110	BRO	AGI	1		0.0027	0.0164	0.0047	178	219	>2020
Add	110	AGI	RSK	1		0.0098	0.0590	0.0167	178	219	>2020
Add	110	KEL	KEL C	1		0.0003	0.0013	0.0080	144	144	>2020
Add	110	KEL	RSK	2		0.0217	0.1344	0.0129	188	213	>2020
Amend	220	DSN	MAY	1	30.6	0.0036	0.0265	0.0399	434	534	>2020
Amend	400	DSN	LSE	1		0.0009	0.0030	0.2260	1577	1944	>2020
Amend	110	Gl	KKY	1	49.2	0.0309	0.1599	0.0174	178	219	>2020
Amend	400	LSE	MP	1		0.0033	0.0113	0.8580	1577	1944	>2020
Amend	400	OST	woo	1		0.0024	0.0080	0.6309	1577	1944	>2020
Amend	275	CPS	MAG	1		0.0021	0.0236	0.1404	1000	1000	>2020
Amend	275	CPS	MAG	1		0.0021	0.0236	0.1404	1000	1000	>2020

Table B-9 Characteristics of Transformer Changes in Ireland

Action	Station	Transformer	Rating (MVA)	HV/LV (kV)	Impedano MVA Ba			e Ratio g Range	Year
					R	Х	+	-	
Add	KPG	T2101	250	220/110	0.0004	0.0631	0.09	0.18	2017
Add	KPG	T2102	250	220/110	0.0004	0.0631	0.09	0.18	2017
Add	MP	T4201	500	400/220	0.0003	0.027	0.1	0.07	2017
Add	MP	T2101	250	220/110	0.001	0.064	0.09	0.18	2017
Amend	CLA	T2101	250	220/110	0.0013	0.0647	0.1	0.1	2017
Add	BLC	T2101	250	220/110	0.001	0.0646	0.09	0.17	2018
Add	CKM	T2104	250	220/110	0.0004	0.0631	0.09	0.18	2018
Add	WDU	T2101	250	220/110	0.001	0.0646	0.09	0.17	2019
Add	WDU	T2102	250	220/110	0.001	0.0646	0.1	0.1	2019
Add	WDU	T2103	250	220/110	0.001	0.0646	0.1	0.1	2019
Add	WDU	T2104	250	220/110	0.001	0.0646	0.1	0.1	2019
Add	LSE	T4101	250	400/110	0.00048	0.072	0.15	0.15	2019
Remove	KLN	T2101	250	220/110	0.0065	0.2453	0.09	0.18	2020
Remove	KLN	T2102	250	220/110	0.0095	0.2473	0.09	0.18	2020
Amend	KLN	T2103	250	220/110	0.0004	0.0631	0.09	0.18	2020
Add	KPG	T4101	500	400/220	0.0003	0.027	0.1	0.07	>2020
Add	LSE	T4102	250	400/110	0.00048	0.072	0.15	0.15	>2020
Remove	KRA	T2103	2502	220/110	0.0013	0.0652	0.09	0.17	>2020

Table B-10 Expected Changes in the Characteristics of 3 Winding Transformers in Northern Ireland

Action	Substa-		Impeda	nce on 10	OO MVA B	ase (pu)		Rati	ing (M	VA)		Nom-	No.	Year
	tion/	W1	l <b>-2</b>	W2-3		W:	3-1				in	ıal	of Taps	
	Trans- former	R	Х	R	Х	R	Х	W1	W2	W3	Upr	Lwr	Таро	
Amend	CAS IBTx 1	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	60	1.15	0.85	19	2018
Add	TUR IBTx 1	0.0003	0.026	0.0001	0.18	0.0001	0.23	500	500	60	1.1	0.9	15	2020
Add	TUR IBTx 2	0.0003	0.026	0.0001	0.18	0.0001	0.23	500	500	60	1.1	0.9	15	2020
Add	TUR IBTx 3	0.0003	0.026	0.0001	0.18	0.0001	0.23	500	500	60	1.1	0.9	15	2020


Table B-11 Expected Changes in the Characteristics of 2 Winding Transformers in Northern Ireland

Action	Station	HV/LV (kV)	Rating (MVA)		ce pu on g base	Off nomi	nal ratio	No. of taps	Year
				R	Х	Upper	Lower		
Amend	DON	110/33	60	0.0119	0.3658	1.1	0.8	19	2017
Amend	DON	110/33	90	0.0039	0.2461	1.1	0.8	19	2018
Add	AIR	110/33	60	0.0073	0.25	1.1	0.8	19	>2020
Add	AIR	110/33	60	0.0073	0.25	1.1 0.8		19	>2020

**Table B-12 Expected Changes in the Characteristics of Reactive Compensation** 

Action	Station	Voltage	Plant	Mvar Capability           Generate         Absorb           100           36           150         150           50           120         120		Year
				Generate	Absorb	
Add	PB	220	2 Reactor (2 x 50)		100	2017
Remove	COL (N)	110	1 Capacitor	36		>2019
Add	COL (N)	110	SVC	150	150	>2019
Add	KNR	220	Reactor		50	>2019
Add	OMA	110	SVC	120	120	>2019
Remove	THU	110	2 Capacitor (2 x 15)	30		>2019
Add	THU	110	Statcom	30	30	>2019
Add	TMN	110	SVC	200	200	>2019



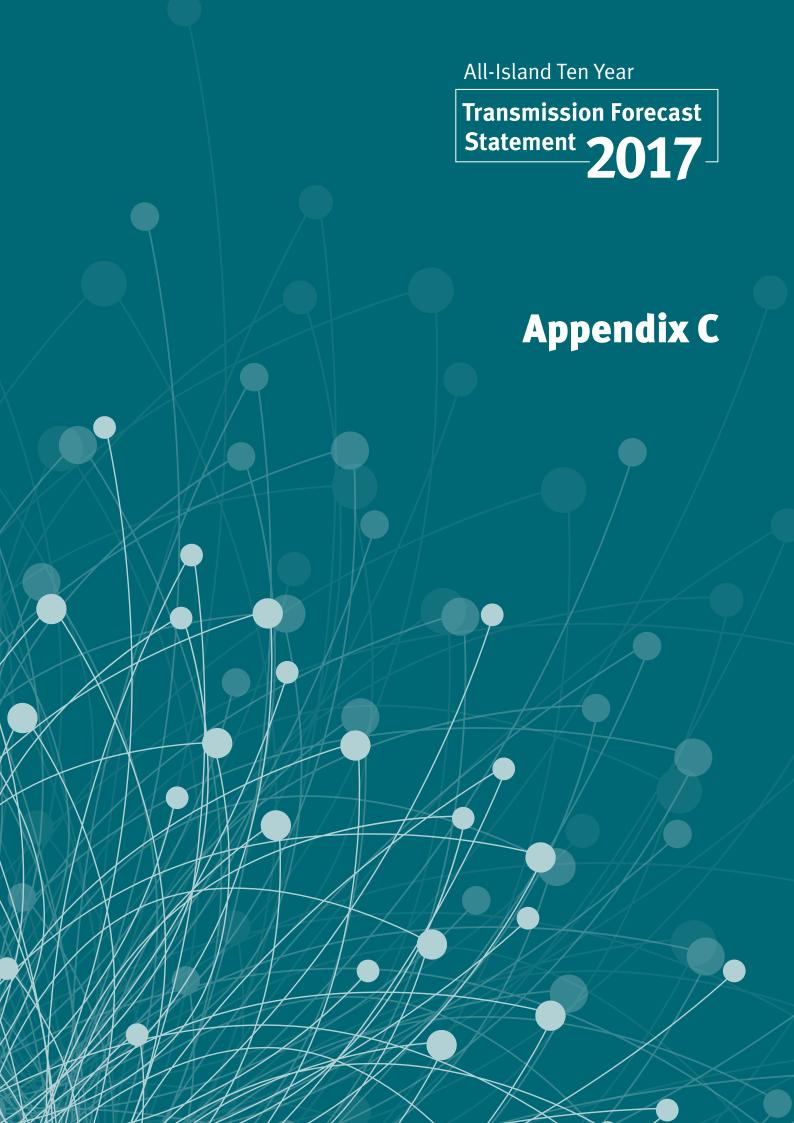



## Appendix C Demand Forecasts at Individual Transmission Interface Stations

Transmission Interface Stations and Bulk Supply Points are connection points to the transmission system. These connection points include transmission system connections to the distribution system or directly-connected customers. Table C-1 to Table C-4 list the demand forecasts at each Transmission Interface Station and Bulk Supply Point. The forecasts are noted for each node between 2017 and 2026 at the winter peak, summer peak, and summer valley. The autumn peak forecasts are also given for Northern Ireland.

The station demand values do not include transmission losses. Demand values at stations that interface with the distribution system do include distribution losses.

Transmission Interface Stations are generally 110 kV stations. The exceptions to this are four 220 kV interface stations that supply the Dublin City networks. These four interface stations, namely Carrickmines, Finglas, Inchicore and Poolbeg, are operated by the DSO of Ireland.

Only stations feeding demand (generation stations are not included) are included in the tables below.

Table C-1 Demand Forecasts at Time of Winter Peak

Bus	Bus Name	Power				De	mand Fo	recast (N	IW)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
AA	Ardnacrusha	0.993	68.4	68.72	70.13	68.35	69.86	69.86	70.18	70.35	70.47	71.5
AGH	Aghyoule	0.990	13.89	13.99	14.1	14.22	14.47	14.47	14.6	14.95	15.08	15.22
AGY	Ardnagappary	0.949	-	-	15.81	15.41	15.75	15.75	15.82	15.86	15.89	16.12
AHA	Ahane	0.991	4.91	4.93	5.03	4.9	5.01	5.01	5.04	5.05	5.06	5.13
AIR	Airport Road (Belfast)	0.990	-	-	-	-	28.12	28.12	28.76	31.04	32.38	33.93
ANR	Anner	0.897	14	14	14	14	14	14	14	14	14	14
ANT	Antrim	0.980	42.04	42.17	42.3	42.5	42.83	42.83	43.02	43.87	44.04	44.22
ARI	Arigna	0.965	2.33	2.35	2.39	2.33	2.38	2.38	2.4	2.4	2.41	2.44
ARK	Arklow	0.999	35.91	26.9	27.45	26.75	27.34	27.34	27.46	27.53	27.58	27.99
ATH	Athlone	0.976	66.16	66.47	67.83	66.11	67.57	67.57	67.87	68.04	68.16	69.16
ATY	Athy	0.989	21.04	21.14	21.57	21.03	21.49	21.49	21.59	21.64	21.68	22
BAL	Baltrasna	0.983	12.94	13	13.27	12.93	13.22	13.22	13.27	13.31	13.33	13.53
BAN (I)	Banoge	0.977	52.57	52.81	53.85	52.54	53.65	53.65	53.89	54.01	54.1	54.86
BAN (N)	Banbridge	0.990	39.41	39.53	39.66	39.84	40.15	40.15	40.31	41.11	41.26	41.43
BAR	Barrymore	0.994	32.08	32.22	32.88	32.05	32.76	32.76	32.9	32.98	33.04	33.53
BDA	Baroda	0.988	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26
BDN	Ballydine	0.971	17.27	17.32	17.55	17.26	17.51	17.51	17.56	17.59	17.61	17.78
BEG	Ballybeg	0.997	14	14.06	14.35	13.99	14.3	14.3	14.36	14.4	14.42	14.63
BGD	Belgard Road	0.950	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2
BGT	Ballyragget	0.950	-	-	-	25.3	25.86	25.86	25.97	26.04	26.08	26.47
BIN	Binbane	0.987	23.87	23.98	13.84	13.49	13.79	13.79	13.85	13.88	13.91	14.11
ВК	Bellacorick	0.979	5.72	5.74	5.86	5.71	5.84	5.84	5.87	5.88	5.89	5.98
ВКҮ	Barnakyle	0.951	9.86	9.9	10.11	9.85	48.07	48.07	48.11	48.14	48.16	48.3
BLI	Ballylickey	0.977	14.32	14.39	14.68	14.31	14.62	14.62	14.69	14.73	14.75	14.97
BLK	Blake	1.000	25.55	12.11	12.36	12.05	12.31	12.31	12.37	12.4	12.42	12.6
ВМА	Ballymena	0.978	84.04	84.3	84.56	84.97	85.62	85.62	85.98	87.68	88.01	88.36
BNH	Ballynahinch	0.990	57.3	57.46	57.63	57.89	58.3	58.3	58.52	59.66	59.87	60.09
BOG	Banoge	0.962	5.4	21.79	22.23	21.67	22.15	22.15	22.25	22.3	22.34	22.67
BRA	Bracklone	0.949	0	13.55	13.83	13.48	13.78	13.78	13.84	13.87	13.9	14.1
BRI	Brinny	0.971	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95
BRY	Barnahely	0.988	29.22	29.35	29.95	29.2	29.84	29.84	29.97	30.05	30.1	30.54
BUT	Butlerstown	0.995	39.21	39.4	40.2	39.18	40.05	40.05	40.23	40.33	40.4	40.99
BVG	Ballyvallagh	0.990	15.22	15.26	15.31	15.38	15.49	15.49	15.55	15.85	15.91	15.97
CAH	Cahir	0.982	26.42	26.54	27.08	26.4	26.98	26.98	27.1	27.17	27.22	27.62
CAR	Carnmoney	0.990	26.86	26.53	26.21	25.93	25.34	25.34	25.05	25.16	24.87	24.58
CAS	Castlereagh	0.990	58.17	58.34	58.51	58.78	59.21	59.21	59.45	60.62	60.83	61.07
CBG	Carrowbeg	0.985	18.28	18.37	18.74	18.27	18.67	18.67	18.76	18.8	18.84	19.11

Table C-1 Demand Forecasts at Time of Winter Peak

Code         Castlebar         Sector         2017         2018         2019         2020         2020         2022         2023         2024         2026	Bus	Bus Name	Power				De	emand For	recast (M\	N)			
CEN         Belfast Central         0.909         53.07         53.32         53.57         53.51         54.55         54.55         54.83         56.63         56.63         56.63           CF         Carbaleen's Fall         0.995         18.27         18.36         18.63         18.66         18.66         18.65         18.75         18.79         18.83         19.1           CFM         Castlefarm         0.901         50.8         60.88         60.8	Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
CF         Cathaleen's fall         0.995         18.27         18.36         18.73         18.26         18.66         18.66         18.75         18.79         18.83         19.1           CFM         Castlefarm         0.901         50.8         56.8         66.88	CBR	Castlebar	0.992	34.02	34.17	34.87	33.99	34.74	34.74	34.89	34.98	35.04	35.56
Fall         Query         Fall         Query         Soult         S	CEN	Belfast Central	0.990	53.07	53.32	53.57	53.91	54.5	54.5	54.83	56	56.3	56.63
CHAM         Charleville         0,980         15,91         15,98         16,31         15,99         16,25         16,25         16,25         16,32         16,36         66,88	CF		0.995	18.27	18.36	18.73	18.26	18.66	18.66	18.75	18.79	18.83	19.1
CKG         Chrkagh         0.950         33.25         66.88         70.00 <th< td=""><td>CFM</td><td>Castlefarm</td><td>0.901</td><td>50.8</td><td>50.8</td><td>50.8</td><td>50.8</td><td>50.8</td><td>50.8</td><td>50.8</td><td>50.8</td><td>50.8</td><td>50.8</td></th<>	CFM	Castlefarm	0.901	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8
CKM         Carrickmines         0.987         366.26         37.6.4         373.79         366.04         372.63         373.99         374.74         375.28         379.8           CLE         Clonee         0.950         43.6         55.48         53.84         63.84         63.84         63.84         63.84         63.84         63.84         63.84         63.84         63.84         64.03         64.03         66.09         66.02         27.01         28.79         28.79         28.79         28.79         28.79         28.79	СНА	Charleville	0.980	15.91	15.98	16.31	15.9	16.25	16.25	16.32	16.36	16.39	16.63
CLE         Clonee         0.950         43.6         55.48         63.84         63.87         63.89         63.87         63.89         63.87         63.81         43.82         43.82         43.82         43.82         43.82         43.82         43.82         4	CKG	Corkagh	0.950	33.25	66.88	66.88	66.88	66.88	66.88	66.88	66.88	66.88	66.88
CLG         Cloghran         0.950         63.84 <t< td=""><td>CKM</td><td>Carrickmines</td><td>0.987</td><td>366.26</td><td>367.64</td><td>373.79</td><td>366.04</td><td>372.63</td><td>372.63</td><td>373.99</td><td>374.74</td><td>375.28</td><td>379.8</td></t<>	CKM	Carrickmines	0.987	366.26	367.64	373.79	366.04	372.63	372.63	373.99	374.74	375.28	379.8
CLN         Cloon         0.977         31.2         31.35         31.99         31.18         31.87         31.27         32.01         32.09         32.15         32.01         CLW         Carlow         0.989         62.26         62.55         63.83         62.21         63.59         63.59         63.87         64.03         64.14         65.08           COL(II)         College Park         0.988         25.84         25.96         26.49         25.82         26.39         26.39         26.51         26.57         26.62         27.01           COL(III)         Coleraine         0.990         42.99         31.12         43.24         43.43         43.75         43.75         43.92         44.78         44.93         45.09           COW         Cow Cross         0.997         18.84         12.89         13.15         12.82         13.1         13.1         13.16         13.19         13.21         13.41           CFS         Cool         0.998         58.55         58.68         58.85         59.13         59.58         59.58         59.84         61.02         13.21         13.41           CFS         Cool         0.998         41.26         42.59         25.27	CLE	Clonee	0.950	43.6	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48
CLW         Carlow         0.989         62.26         62.55         63.83         62.21         63.59         63.59         63.87         64.03         64.14         65.08           COL (I)         College Park         0.988         25.84         25.96         26.49         25.82         26.39         26.39         26.51         26.57         26.62         27.01           COL (N)         Coleraine         0.990         42.99         43.12         43.24         43.43         43.75         43.75         43.92         44.78         44.93         45.09           COW         Cox Cross         0.997         18.84         12.89         13.15         12.82         13.1         13.1         13.16         13.19         13.21         13.14           CPS         Cool         0.985         58.5         58.68         58.85         59.13         59.58         59.58         59.84         61.02         61.52         61.5           CRA         Crane         0.991         41.26         34.26         34.96         34.07         34.82         34.82         34.84         74.84         75.24         75.67           CRA         Craegh         0.990         25.02         25.99	CLG	Cloghran	0.950	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84
COL (I)         College Park         0.988         25.84         25.96         26.49         25.82         26.39         26.39         26.51         26.57         26.62         7.01           COL (N)         Coleraine         0.990         42.99         43.12         43.24         43.43         43.75         43.75         43.92         44.78         44.93         45.09           COS         Carrick-on-Shannon         0.997         18.84         12.89         13.15         12.82         13.1         13.16<	CLN	Cloon	0.977	31.2	31.35	31.99	31.18	31.87	31.87	32.01	32.09	32.15	32.62
COL (N)         Coleraine         0.990         42.99         43.12         43.24         43.43         43.75         43.75         43.72         44.78         44.93         45.90           COS         Carrick-on-Shannon         0.993         28.19         28.32         28.99         28.77         28.79         28.92         28.99         29.05         29.47           COW         Cow Cross         0.997         18.84         12.89         13.15         13.1         13.1         13.16         13.19         13.21         13.41           CPS         Cool         0.998         58.5         58.68         58.85         59.13         59.58         59.58         59.84         61.02         61.25         61.5           CRA         Crane         0.991         41.26         34.26         34.96         34.07         34.82         34.98         35.07         35.13         35.64           CRE         Craegh         0.990         25.02         25.99         25.17         25.29         25.47         25.47         25.57         26.07         26.07         26.27           CRH         Cruiserath         0.996         12.04         12.09         12.34         12.09         12.34	CLW	Carlow	0.989	62.26	62.55	63.83	62.21	63.59	63.59	63.87	64.03	64.14	65.08
COS         Carrick-on-Shannon         0.993         28.19         28.32         28.99         28.17         28.79         28.99         28.99         29.95         29.47           COW         Cow Cross         0.997         18.84         12.89         13.15         12.82         13.1         13.1         13.16         13.19         13.21         13.41           CPS         Cool         0.985         58.5         58.68         58.85         59.13         59.58         59.58         61.02         61.55         61.5           CRA         Crane         0.991         41.26         34.26         34.96         34.07         34.82         34.98         35.07         35.13         35.64           CRE         Cregagh         0.990         86.44         86.75         87.05         87.51         72.84         72.84         73.26         74.84         75.24         75.67           CRG         Creagh         0.990         25.02         25.09         25.17         25.29         25.47         25.47         25.57         26.07         26.07         26.07         26.07         26.07         26.27         26.07         26.17         26.07         26.47         25.46         25.49	COL (I)	College Park	0.988	25.84	25.96	26.49	25.82	26.39	26.39	26.51	26.57	26.62	27.01
Shannon         Low	COL (N)	Coleraine	0.990	42.99	43.12	43.24	43.43	43.75	43.75	43.92	44.78	44.93	45.09
CPS         Cool         0.985         58.5         58.68         58.85         59.13         59.88         59.58         59.84         61.02         61.25         61.5           CRA         Crane         0.991         41.26         34.26         34.96         34.07         34.82         34.82         34.98         35.07         35.13         35.64           CRE         Creagh         0.990         26.02         25.09         25.17         25.29         25.47         25.47         25.47         25.47         25.57         26.07         26.17         26.27           CRH         Cruiserath         0.950            203	cos		0.993	28.19	28.32	28.9	28.17	28.79	28.79	28.92	28.99	29.05	29.47
CRA         Crane         0.991         41.26         34.26         34.96         34.07         34.82         34.82         34.98         35.07         35.13         35.64           CRE         Cregagh         0.990         86.44         86.75         87.05         87.51         72.84         72.84         73.26         74.84         75.24         75.67           CRG         Creagh         0.990         25.02         25.09         25.17         25.29         25.47         25.47         25.57         26.07         26.17         26.27           CRH         Cruiserath         0.950         -         -         -         203 <t< td=""><td>COW</td><td>Cow Cross</td><td>0.997</td><td>18.84</td><td>12.89</td><td>13.15</td><td>12.82</td><td>13.1</td><td>13.1</td><td>13.16</td><td>13.19</td><td>13.21</td><td>13.41</td></t<>	COW	Cow Cross	0.997	18.84	12.89	13.15	12.82	13.1	13.1	13.16	13.19	13.21	13.41
CRE         Cregagh         0.990         86.44         86.75         87.05         87.51         72.84         72.84         73.26         74.84         75.24         75.67           CRG         Creagh         0.990         25.02         25.09         25.17         25.29         25.47         25.47         25.57         26.07         26.17         26.27           CRH         Cruiserath         0.950         1.         .         .         203 <t< td=""><td>CPS</td><td>Cool</td><td>0.985</td><td>58.5</td><td>58.68</td><td>58.85</td><td>59.13</td><td>59.58</td><td>59.58</td><td>59.84</td><td>61.02</td><td>61.25</td><td>61.5</td></t<>	CPS	Cool	0.985	58.5	58.68	58.85	59.13	59.58	59.58	59.84	61.02	61.25	61.5
CRG         Creagh         0.990         25.02         25.09         25.17         25.29         25.47         25.47         25.57         26.07         26.17         26.27           CRH         Cruiserath         0.950         -         -         -         203         204         204         20	CRA	Crane	0.991	41.26	34.26	34.96	34.07	34.82	34.82	34.98	35.07	35.13	35.64
CRH         Cruiserath         0.950         -         -         -         203         204<	CRE	Cregagh	0.990	86.44	86.75	87.05	87.51	72.84	72.84	73.26	74.84	75.24	75.67
CRO         Coolroe         0.986         12.04         12.09         12.34         12.03         12.29         12.29         12.35         12.38         12.4         12.58           CVW         Castleview         0.986         25.34         25.46         25.98         25.32         25.88         25.88         26         26.06         26.11         26.49           DAL         Dallow         0.996         17.5         17.58         17.94         17.48         17.87         17.95         17.99         18.02         18.29           DDK         Dundalk         0.980         72.07         72.4         73.88         72.01         73.6         73.6         73.93         74.11         74.24         75.33           DFR         Dunfirth         0.996         9.89         9.94         10.14         9.88         10.1         10.1         10.14         10.17         10.19         10.34           DGN         Dungarvan         0.987         44.96         45.17         46.09         44.93         45.92         45.92         46.13         46.24         46.32         47           DLT         Dalton         0.986         25.57         25.69         26.21         25.55	CRG	Creagh	0.990	25.02	25.09	25.17	25.29	25.47	25.47	25.57	26.07	26.17	26.27
CVW         Castleview         0.986         25.34         25.46         25.98         25.32         25.88         25.88         26         26.06         26.11         26.49           DAL         Dallow         0.996         17.5         17.58         17.94         17.48         17.87         17.87         17.99         18.02         18.29           DDK         Dundalk         0.980         72.07         72.4         73.88         72.01         73.6         73.6         73.93         74.11         74.24         75.33           DFR         Dunfirth         0.996         9.89         9.94         10.14         9.88         10.1         10.1         10.14         10.17         10.19         10.34           DGN         Dungarvan         0.987         44.96         45.17         46.09         44.93         45.92         45.92         46.13         46.24         46.32         47           DLT         Dalton         0.986         25.57         25.69         26.21         25.55         26.11         26.11         26.23         26.29         26.34         26.73           DNY         Dunmanway         0.978         24.93         25.05         24.91         25.46 <td>CRH</td> <td>Cruiserath</td> <td>0.950</td> <td>-</td> <td>-</td> <td>-</td> <td>203</td> <td>203</td> <td>203</td> <td>203</td> <td>203</td> <td>203</td> <td>203</td>	CRH	Cruiserath	0.950	-	-	-	203	203	203	203	203	203	203
DAL         Dallow         0.996         17.5         17.58         17.94         17.48         17.87         17.87         17.95         17.99         18.02         18.29           DDK         Dundalk         0.980         72.07         72.4         73.88         72.01         73.6         73.6         73.93         74.11         74.24         75.33           DFR         Dunfirth         0.996         9.89         9.94         10.14         9.88         10.1         10.1         10.14         10.17         10.19         10.34           DGN         Dungarvan         0.987         44.96         45.17         46.09         44.93         45.92         45.92         46.13         46.24         46.32         47           DLT         Dalton         0.986         25.57         25.69         26.21         25.55         26.11         26.11         26.23         26.29         26.34         26.73           DMY         Dunmanway         0.978         24.93         25.04         25.55         24.91         25.46         25.46         25.57         25.63         25.68         26.21           DON         Donegall         0.990         148.85         147.58         146.31	CRO	Coolroe	0.986	12.04	12.09	12.34	12.03	12.29	12.29	12.35	12.38	12.4	12.58
DDK         Dundalk         0.980         72.07         72.4         73.88         72.01         73.6         73.6         73.93         74.11         74.24         75.33           DFR         Dunfirth         0.996         9.89         9.94         10.14         9.88         10.1         10.1         10.14         10.17         10.19         10.34           DGN         Dungarvan         0.987         44.96         45.17         46.09         44.93         45.92         45.92         46.13         46.24         46.32         47           DLT         Dalton         0.986         25.57         25.69         26.21         25.55         26.11         26.11         26.23         26.29         26.34         26.73           DMY         Dunmanway         0.978         24.93         25.04         25.55         24.91         25.46         25.46         25.57         25.63         25.68         26.05           DON         Donegall         0.990         148.85         147.58         146.31         145.35         143.23         143.23         142.28         143.57         142.61         141.71           DOO         Doon         0.979         30.59         30.73 <td< td=""><td>CVW</td><td>Castleview</td><td>0.986</td><td>25.34</td><td>25.46</td><td>25.98</td><td>25.32</td><td>25.88</td><td>25.88</td><td>26</td><td>26.06</td><td>26.11</td><td>26.49</td></td<>	CVW	Castleview	0.986	25.34	25.46	25.98	25.32	25.88	25.88	26	26.06	26.11	26.49
DFR         Dunfirth         0.996         9.89         9.94         10.14         9.88         10.1         10.1         10.14         10.17         10.19         10.34           DGN         Dungarvan         0.987         44.96         45.17         46.09         44.93         45.92         45.92         46.13         46.24         46.32         47           DLT         Dalton         0.986         25.57         25.69         26.21         25.55         26.11         26.11         26.23         26.29         26.34         26.73           DMY         Dunmanway         0.978         24.93         25.04         25.55         24.91         25.46         25.46         25.57         25.63         25.68         26.05           DON         Donegall         0.990         148.85         147.58         146.31         145.35         143.23         143.23         142.28         143.57         142.61         141.71           DOO         Doon         0.979         30.59         30.73         31.36         30.57         31.24         31.24         31.38         31.46         31.51         31.98           DRU (N)         Drumline         0.979         29.88         30.01	DAL	Dallow	0.996	17.5	17.58	17.94	17.48	17.87	17.87	17.95	17.99	18.02	18.29
DGN         Dungarvan         0.987         44.96         45.17         46.09         44.93         45.92         45.92         46.13         46.24         46.32         47           DLT         Dalton         0.986         25.57         25.69         26.21         25.55         26.11         26.11         26.23         26.29         26.34         26.73           DMY         Dunmanway         0.978         24.93         25.04         25.55         24.91         25.46         25.46         25.57         25.63         25.68         26.05           DON         Donegall         0.990         148.85         147.58         146.31         145.35         143.23         142.28         143.57         142.61         141.71           DOO         Doon         0.979         30.59         30.73         31.36         30.57         31.24         31.24         31.38         31.46         31.51         31.98           DRU (I)         Drumline         0.979         29.88         30.01         30.63         29.85         30.51         30.51         30.65         30.72         30.78         31.23           DRU (N)         Drumnakelly         0.980         92.05         92.6         92.6	DDK	Dundalk	0.980	72.07	72.4	73.88	72.01	73.6	73.6	73.93	74.11	74.24	75.33
DLT         Dalton         0.986         25.57         25.69         26.21         25.55         26.11         26.11         26.23         26.29         26.34         26.73           DMY         Dunmanway         0.978         24.93         25.04         25.55         24.91         25.46         25.46         25.57         25.63         25.68         26.05           DON         Donegall         0.990         148.85         147.58         146.31         145.35         143.23         142.28         143.57         142.61         141.71           DOO         Doon         0.979         30.59         30.73         31.36         30.57         31.24         31.24         31.38         31.46         31.51         31.98           DRU (I)         Drumline         0.979         29.88         30.01         30.63         29.85         30.51         30.65         30.72         30.78         31.23           DRU (N)         Drumnakelly         0.980         92.05         92.36         92.64         93.1         93.85         93.85         94.27         96.15         96.53         97.07           DRY         Drybridge         0.989         87.07         87.48         89.26         8	DFR	Dunfirth	0.996	9.89	9.94	10.14	9.88	10.1	10.1	10.14	10.17	10.19	10.34
DMY         Dunmanway         0.978         24.93         25.04         25.55         24.91         25.46         25.46         25.57         25.63         25.68         26.05           DON         Donegall         0.990         148.85         147.58         146.31         145.35         143.23         143.23         142.28         143.57         142.61         141.71           DOO         Doon         0.979         30.59         30.73         31.36         30.57         31.24         31.24         31.38         31.46         31.51         31.98           DRU (I)         Drumline         0.979         29.88         30.01         30.63         29.85         30.51         30.51         30.65         30.72         30.78         31.23           DRU (N)         Drumnakelly         0.980         92.05         92.36         92.64         93.1         93.85         93.85         94.27         96.15         96.53         97.07           DRY         Drybridge         0.989         87.07         87.48         89.26         87         88.93         88.93         89.32         89.54         89.7         91.02           DUN         Dungannon         0.990         97.51         9	DGN	Dungarvan	0.987	44.96	45.17	46.09	44.93	45.92	45.92	46.13	46.24	46.32	47
DON         Donegall         0.990         148.85         147.58         146.31         145.35         143.23         143.23         142.28         143.57         142.61         141.71           DOO         Doon         0.979         30.59         30.73         31.36         30.57         31.24         31.24         31.38         31.46         31.51         31.98           DRU (I)         Drumline         0.979         29.88         30.01         30.63         29.85         30.51         30.51         30.65         30.72         30.78         31.23           DRU (N)         Drumnakelly         0.980         92.05         92.36         92.64         93.1         93.85         93.85         94.27         96.15         96.53         97.07           DRY         Drybridge         0.989         87.07         87.48         89.26         87         88.93         88.93         89.32         89.54         89.7         91.02           DUN         Dungannon         0.990         97.51         97.81         98.09         98.56         99.31         99.31         99.73         101.69         102.07         102.48           EDE         Eden         0.980         34.78         34.	DLT	Dalton	0.986	25.57	25.69	26.21	25.55	26.11	26.11	26.23	26.29	26.34	26.73
DOO         Doon         0.979         30.59         30.73         31.36         30.57         31.24         31.24         31.38         31.46         31.51         31.98           DRU (I)         Drumline         0.979         29.88         30.01         30.63         29.85         30.51         30.51         30.65         30.72         30.78         31.23           DRU (N)         Drumnakelly         0.980         92.05         92.36         92.64         93.1         93.85         93.85         94.27         96.15         96.53         97.07           DRY         Drybridge         0.989         87.07         87.48         89.26         87         88.93         88.93         89.32         89.54         89.7         91.02           DUN         Dungannon         0.990         97.51         97.81         98.09         98.56         99.31         99.31         99.73         101.69         102.07         102.48           EDE         Eden         0.980         34.78         34.89         34.99         35.16         35.42         35.42         35.56         36.26         36.39         36.54           ENN (I)         Ennis         0.981         58.45         58.72	DMY	Dunmanway	0.978	24.93	25.04	25.55	24.91	25.46	25.46	25.57	25.63	25.68	26.05
DRU (I)         Drumline         0.979         29.88         30.01         30.63         29.85         30.51         30.51         30.65         30.72         30.78         31.23           DRU (N)         Drumnakelly         0.980         92.05         92.36         92.64         93.1         93.85         93.85         94.27         96.15         96.53         97.07           DRY         Drybridge         0.989         87.07         87.48         89.26         87         88.93         88.93         89.32         89.54         89.7         91.02           DUN         Dungannon         0.990         97.51         97.81         98.09         98.56         99.31         99.31         99.73         101.69         102.07         102.48           EDE         Eden         0.980         34.78         34.89         34.99         35.16         35.42         35.42         35.56         36.26         36.39         36.54           ENN (I)         Ennis         0.981         58.45         58.72         59.92         58.41         59.7         59.7         59.96         60.11         60.22         61.1	DON	Donegall	0.990	148.85	147.58	146.31	145.35	143.23	143.23	142.28	143.57	142.61	141.71
DRU (N)         Drumnakelly         0.980         92.05         92.36         92.64         93.1         93.85         93.85         94.27         96.15         96.53         97.07           DRY         Drybridge         0.989         87.07         87.48         89.26         87         88.93         88.93         89.32         89.54         89.7         91.02           DUN         Dungannon         0.990         97.51         97.81         98.09         98.56         99.31         99.31         99.73         101.69         102.07         102.48           EDE         Eden         0.980         34.78         34.89         34.99         35.16         35.42         35.42         35.56         36.26         36.39         36.54           ENN (I)         Ennis         0.981         58.45         58.72         59.92         58.41         59.7         59.7         59.96         60.11         60.22         61.1	DOO	Doon	0.979	30.59	30.73	31.36	30.57	31.24	31.24	31.38	31.46	31.51	31.98
DRY         Drybridge         0.989         87.07         87.48         89.26         87         88.93         88.93         89.32         89.54         89.7         91.02           DUN         Dungannon         0.990         97.51         97.81         98.09         98.56         99.31         99.31         99.73         101.69         102.07         102.48           EDE         Eden         0.980         34.78         34.89         34.99         35.16         35.42         35.42         35.56         36.26         36.39         36.54           ENN (I)         Ennis         0.981         58.45         58.72         59.92         58.41         59.7         59.7         59.96         60.11         60.22         61.1	DRU (I)	Drumline	0.979	29.88	30.01	30.63	29.85	30.51	30.51	30.65	30.72	30.78	31.23
DUN         Dungannon         0.990         97.51         97.81         98.09         98.56         99.31         99.31         99.73         101.69         102.07         102.48           EDE         Eden         0.980         34.78         34.89         34.99         35.16         35.42         35.42         35.56         36.26         36.39         36.54           ENN (I)         Ennis         0.981         58.45         58.72         59.92         58.41         59.7         59.7         59.96         60.11         60.22         61.1	DRU (N)	Drumnakelly	0.980	92.05	92.36	92.64	93.1	93.85	93.85	94.27	96.15	96.53	97.07
EDE       Eden       0.980       34.78       34.89       34.99       35.16       35.42       35.42       35.56       36.26       36.39       36.54         ENN (I)       Ennis       0.981       58.45       58.72       59.92       58.41       59.7       59.7       59.96       60.11       60.22       61.1	DRY	Drybridge	0.989	87.07	87.48	89.26	87	88.93	88.93	89.32	89.54	89.7	91.02
ENN (I) Ennis 0.981 58.45 58.72 59.92 58.41 59.7 59.7 59.96 60.11 60.22 61.1	DUN	Dungannon	0.990	97.51	97.81	98.09	98.56	99.31	99.31	99.73	101.69	102.07	102.48
	EDE	Eden	0.980	34.78	34.89	34.99	35.16	35.42	35.42	35.56	36.26	36.39	36.54
	ENN (I)	Ennis	0.981	58.45	58.72	59.92	58.41	59.7	59.7	59.96	60.11	60.22	61.1
		Enniskillen											

Table C-1 Demand Forecasts at Time of Winter Peak

Bus	Bus Name	Power				De	emand Fo	recast (M\	N)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
FIN (I)	Finglas	0.984	489.19	491.12	499.62	488.87	498.01	498.01	499.92	500.95	501.7	507.97
FIN (N)	Finaghy	0.990	31.14	31.24	31.33	31.47	31.7	31.7	31.83	32.45	32.57	32.69
FTT	Fortunestown	0.970	10.38	10.43	10.64	10.37	10.6	10.6	10.65	10.67	10.69	10.85
GAL	Galway	0.994	68.55	68.86	70.28	68.49	70.01	70.01	70.33	70.5	70.62	71.66
GI	Great Island	0.950	12.56	12.61	12.87	13.53	13.83	13.83	13.89	13.93	13.95	14.16
GIL	Gilra	0.971	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42
GLE (I)	Glenlara	0.989	16.84	16.92	17.27	16.83	17.2	17.2	17.28	17.32	17.35	17.6
GLE (N)	Glengormley	0.977	32.03	31.99	31.96	31.99	31.98	31.98	32	32.51	32.51	32.52
GOR (N)	Gort	0.990	1.2	1.21	1.21	1.23	1.25	1.25	1.26	1.29	1.3	1.31
GRI	Griffinrath	0.994	57.19	55.87	57.01	55.57	56.79	56.79	57.05	57.19	57.29	58.13
GWE	Gortawee	0.952	31.77	31.82	32.04	31.76	31.99	31.99	32.04	32.07	32.09	32.25
IKE	Ikerrin	0.966	30.07	30.21	30.83	30.05	30.71	30.71	30.85	30.93	30.98	31.43
INC	Inchicore	0.988	264.34	289.92	294.27	288.76	293.46	293.46	294.46	294.97	295.36	298.58
KBY	Kilbarry	0.992	91.61	92.03	93.91	91.54	93.55	93.55	93.98	94.21	94.37	95.75
KER	Knockearagh	0.990	40.07	40.25	41.07	40.03	40.92	40.92	41.1	41.2	41.28	41.88
KIN	Kinnegad	0.973	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19
KKY	Kilkenny	0.970	64.34	64.64	65.96	53.19	54.37	54.37	54.61	54.74	54.84	55.64
KNO	Knock	0.990	51.51	51.67	51.83	52.07	45.85	45.85	46.07	47.02	47.23	47.45
KTL	Kilteel	0.972	49	49.23	50.23	48.96	50.04	50.04	50.27	50.39	50.48	51.22
KTN	Killoteran	0.973	10.9	10.95	11.17	10.89	11.13	11.13	11.18	11.2	11.22	11.39
KUR	Knockumber	0.907	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66
LA	Lanesboro	0.986	16.12	16.19	16.52	16.1	16.46	16.46	16.53	16.57	16.6	16.85
LAR	Larne	0.990	28.81	28.9	28.98	29.11	29.32	29.32	29.44	30.01	30.11	30.22
LET	Letterkenny	0.984	79.45	79.81	76.26	74.33	75.97	75.97	76.32	76.5	76.64	77.76
LIB	Liberty	0.989	20.57	20.66	21.08	20.55	21	21	21.1	21.15	21.19	21.5
LIM (I)	Limerick	0.987	77.09	77.45	79.03	77.03	78.73	78.73	79.08	79.28	79.42	80.58
LIM (N)	Limavady	0.990	24.9	24.96	25.04	25.15	25.33	25.33	25.43	25.92	26	26.11
LIS (I)	Lisdrum	0.969	25.22	25.33	25.85	25.2	25.75	25.75	25.87	25.93	25.98	26.36
LIS (N)	Lisburn	0.990	74.39	74.62	74.86	75.21	75.79	75.79	76.11	77.62	77.91	78.22
LOG	Loguestown	0.980	39.24	39.35	39.47	39.64	39.93	39.93	40.09	40.88	41.02	41.18
MAC	Macroom	0.949	11.91	11.97	12.21	11.9	12.17	12.17	12.22	12.25	12.27	12.45
MAL	Mallow	0.980	22.05	22.15	22.61	22.03	22.52	22.52	22.62	22.68	22.72	23.05
MCE	Macetown	0.979	32.65	32.78	33.36	32.63	33.25	33.25	33.38	33.45	33.5	33.92
MID	Midleton	0.985	40.86	41.04	41.88	40.82	41.73	41.73	41.91	42.01	42.08	42.7
MLN	Mullagharlin	0.958	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46
MON	Monread	0.989	13.15	13.21	13.48	13.14	13.43	13.43	13.49	13.52	13.54	13.74
MOY	Moy	0.990	27.28	27.41	27.97	27.26	27.86	27.86	27.99	28.05	28.1	28.52
MR	Marina	0.997	15.09	15.16	15.47	15.08	15.41	15.41	15.48	15.52	15.54	15.77

Table C-1 Demand Forecasts at Time of Winter Peak

Bus	Bus Name	Power				De	emand Fo	recast (M	N)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
MTH	Meathhill	0.965	53.79	54.04	55.15	53.75	54.94	54.94	55.18	55.32	55.42	56.23
MUL	Mullingar	0.983	45.5	45.71	46.64	45.46	46.46	46.46	46.67	46.79	46.86	47.56
MUN	Mungret	0.871	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5
NAR	Newtownards	0.990	45.64	45.77	45.9	46.11	46.44	46.44	46.62	47.53	47.69	47.87
NAV	Navan	0.980	61.4	61.68	62.95	61.35	62.71	62.71	62.99	63.14	63.25	64.18
NEN	Nenagh	0.967	21.48	21.58	22.02	21.46	21.94	21.94	22.04	22.09	22.13	22.45
NEW (I)	Newbridge	0.992	27.57	27.7	28.27	27.55	28.16	28.16	28.28	28.35	28.4	28.82
NEW (N)	Newry	0.990	80.36	80.61	80.87	81.26	81.9	81.9	82.25	83.89	84.2	84.55
OLD	Oldcourt	0.949	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
OMA	Omagh	0.990	61	61.18	61.36	61.63	62.08	62.08	62.31	63.53	63.75	63.99
OUG	Oughtragh	0.994	25.7	25.82	26.35	25.68	26.25	26.25	26.37	26.43	26.48	26.87
РВ	Poolbeg	0.989	200.37	201.31	205.41	200.21	204.64	204.64	205.55	206.06	206.43	209.45
PLA	Platin	0.960	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65
PLS	Portlaoise	0.996	54.09	54.33	55.45	39.84	40.72	40.72	40.9	41	41.08	41.67
RAT (I)	Rathkeale	0.989	27.82	27.95	28.52	27.8	28.41	28.41	28.54	28.61	28.66	29.08
RIC	Richmond	0.977	35.29	35.46	36.18	35.26	36.04	36.04	36.2	36.29	36.36	36.89
RNW	Rinawade	0.988	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13
ROS	Rosebank	0.990	30.6	30.68	30.76	30.9	27.97	27.97	28.09	28.66	28.76	28.88
RSY	Ringaskiddy	0.996	3.94	3.96	4.04	3.94	4.03	4.03	4.05	4.06	4.06	4.12
RYB	Ryebrook	0.928	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52
SAL	Salthill	0.994	52.92	53.16	54.24	52.87	54.04	54.04	54.28	54.41	54.51	55.31
SBH	Snughborough	0.950	-	-	16.72	16.72	16.72	16.72	16.72	16.72	16.72	16.72
SCR	Screeb	0.957	27.86	27.99	28.56	27.84	28.45	28.45	28.58	28.65	28.7	29.12
SHE	Shelton	0.956	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29
SKL	Shankill	0.966	57.24	57.5	58.68	57.19	58.46	58.46	58.72	58.86	58.97	59.83
SLI	Sligo	0.987	54.87	55.13	56.25	54.83	56.04	56.04	56.29	56.43	56.53	57.36
SNG	Singland	0.976	11.09	11.14	11.37	11.08	11.33	11.33	11.38	11.41	11.43	11.6
SOM	Somerset	0.990	21.37	21.47	21.9	21.35	21.82	21.82	21.92	21.97	22.01	22.33
SPR	Springtown	0.980	47.85	47.98	48.12	48.33	48.67	48.67	48.85	49.8	49.96	50.15
STR	Stratford	0.991	21.01	21.11	21.54	21	21.46	21.46	21.56	21.61	21.65	21.96
STR (N)	Strabane	0.990	42.58	42.7	42.82	43.01	43.32	43.32	43.48	44.32	44.47	44.63
TAN	Tandragee	0.990	66.61	66.79	66.98	67.28	67.76	67.76	68.02	69.34	69.57	69.83
TBG	Trabeg	0.993	72.55	72.89	74.38	72.5	74.1	74.1	74.43	74.61	74.75	75.84
TBK	Tullabrack	0.980	11.1	11.15	11.38	11.09	11.34	11.34	11.39	11.42	11.44	11.61
THU	Thurles	0.976	28.34	28.47	29.05	28.32	28.94	28.94	29.07	29.14	29.2	29.62
TIP	Tipperary	0.979	20.9	21	21.43	20.88	21.34	21.34	21.44	21.49	21.53	21.85

Table C-1 Demand Forecasts at Time of Winter Peak

Bus	Bus Name	Power				De	emand Fo	recast (M	W)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
TLK	Trillick	0.989	20.42	20.52	20.94	20.41	20.86	20.86	20.95	21	21.04	21.35
TON	Tonroe	0.993	15.51	15.59	15.9	15.5	15.84	15.84	15.91	15.95	15.98	16.22
TRI	Trien	0.957	24.35	24.47	24.97	24.34	24.87	24.87	24.98	25.05	25.09	25.46
TRL	Tralee	0.995	56.04	56.3	57.45	55.99	57.23	57.23	57.48	57.62	57.73	58.57
TSB	Thornsberry	0.982	32.29	32.44	33.11	32.27	32.98	32.98	33.13	33.21	33.27	33.76
WAT	Waterford	0.978	56.22	56.48	57.64	55.19	56.41	56.41	56.66	56.8	56.9	57.74
WEX	Wexford	0.968	57.42	57.68	58.86	57.37	58.63	58.63	58.9	59.05	59.15	60.02
WHI	Whitegate	0.870	9	9	9	9	9	9	9	9	9	9

Table C-2 Demand Forecasts at Time of Summer Peak

Bus	Bus Name	Power				De	emand For	recast (M\	N)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
AA	Ardnacrusha	0.993	53.71	53.75	53.75	51.4	52	52.49	52.75	52.88	52.98	53.81
AGH	Aghyoule	0.990	10.91	11	11.08	11.18	11.28	11.37	11.48	11.75	11.85	11.96
AGY	Ardnagappary	0.949	-	-	12.12	11.59	11.72	11.83	11.89	11.92	11.95	12.13
AHA	Ahane	0.991	3.85	3.85	3.85	3.68	3.73	3.76	3.78	3.79	3.8	3.86
AIR	Airport Road (Belfast)	0.990	-	-	-	-	-	-	22.61	24.39	25.45	26.67
ANR	Anner	0.897	14	14	14	14	14	14	14	14	14	14
ANT	Antrim	0.980	33.04	33.15	33.25	33.41	33.57	33.67	33.81	34.48	34.61	34.76
ARI	Arigna	0.967	1.83	1.83	1.83	1.75	1.78	1.79	1.8	1.81	1.81	1.84
ARK	Arklow	1.000	28.19	28.21	21.04	20.12	20.35	20.55	20.65	20.7	20.74	21.07
ATH	Athlone	0.976	51.94	51.99	51.99	49.72	50.3	50.77	51.02	51.15	51.25	52.05
ATY	Athy	0.989	16.52	16.53	16.53	15.81	16	16.15	16.22	16.27	16.3	16.55
BAL	Baltrasna	0.983	10.15	10.16	10.16	9.72	9.83	9.93	9.97	10	10.02	10.18
BAN (I)	Banoge	0.977	41.7	41.73	41.73	40	40.44	40.8	40.99	41.09	41.17	41.78
BAN (N)	Banbridge	0.990	30.98	31.07	31.17	31.32	31.46	31.56	31.69	32.31	32.43	32.56
BAR	Barrymore	0.994	25.18	25.2	25.2	24.1	24.38	24.61	24.73	24.79	24.84	25.23
BDA	Baroda	0.988	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26
BDN	Ballydine	0.970	14.84	14.85	14.85	14.46	14.56	14.64	14.68	14.71	14.72	14.86
BEG	Ballybeg	0.997	10.99	11	11	10.52	10.64	10.74	10.79	10.82	10.84	11.01
BGD	Belgard Road	0.950	1	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2
BGT	Ballyragget	0.950	1	-	-	-	19.25	19.43	19.53	19.58	19.61	19.92
BIN	Binbane	0.987	18.74	18.76	10.61	10.15	10.26	10.36	10.41	10.44	10.46	10.62
ВК	Bellacorick	0.979	4.48	4.49	4.49	4.29	4.34	4.38	4.4	4.41	4.42	4.49
ВКҮ	Barnakyle	0.951	7.74	7.75	7.75	7.41	45.5	45.57	45.6	45.62	45.64	45.76
BLI	Ballylickey	0.977	11.24	11.25	11.25	10.76	10.89	10.99	11.04	11.07	11.09	11.27
BLK	Blake	1.000	20.05	9.47	9.47	9.06	9.16	9.25	9.29	9.32	9.33	9.48
вма	Ballymena	0.978	66.06	66.26	66.47	66.78	67.09	67.29	67.59	68.91	69.18	69.46
BNH	Ballynahinch	0.990	45.04	45.17	45.3	45.5	45.7	45.82	46	46.9	47.05	47.23
BOG	Banoge	0.962	4.24	4.24	17.04	16.3	16.49	16.64	16.73	16.77	16.8	17.06
BRA	Bracklone	0.950	-	-	10.6	10.14	10.26	10.35	10.4	10.43	10.45	10.61
BRI	Brinny	0.971	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95
BRY	Barnahely	0.988	22.94	22.96	22.96	21.95	22.21	22.41	22.52	22.59	22.63	22.98
BUT	Butlerstown	0.995	30.8	30.82	30.83	29.48	29.82	30.1	30.25	30.33	30.39	30.86
BVG	Ballyvallagh	0.990	11.96	12	12.03	12.09	12.14	12.17	12.22	12.46	12.5	12.55
CAH	Cahir	0.982	20.74	20.75	20.75	19.85	20.08	20.27	20.37	20.42	20.46	20.78
CAR	Carnmoney	0.990	21.11	20.85	20.6	20.38	20.17	19.92	19.69	19.78	19.54	19.32
CAS	Castlereagh	0.990	45.72	45.85	45.99	46.2	46.41	46.54	46.73	47.65	47.81	48
CBG	Carrowbeg	0.985	14.35	14.36	14.36	13.74	13.9	14.03	14.09	14.13	14.16	14.38
CBR	Castlebar	0.992	26.7	26.73	26.73	25.56	25.86	26.1	26.23	26.3	26.35	26.76

**Table C-2 Demand Forecasts at Time of Summer Peak** 

Bus	Bus Name	Power				De	emand For	recast (M)	N)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
CEN	Belfast Central	0.990	41.71	41.91	42.11	42.37	42.64	42.84	43.1	44.02	44.26	44.51
CF	Cathaleen's Fall	0.995	14.34	14.35	14.35	13.73	13.89	14.02	14.08	14.12	14.15	14.37
CFM	Castlefarm	0.901	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8
СНА	Charleville	0.980	12.49	12.5	12.5	11.95	12.09	12.2	12.26	12.3	12.32	12.51
CKG	Corkagh	0.950	33.25	33.25	66.88	66.88	66.88	66.88	66.88	66.88	66.88	66.88
CKM	Carrickmines	0.986	302.11	302.29	302.32	292.06	294.68	296.84	297.92	298.53	298.98	302.61
CLE	Clonee	0.950	0	43.6	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48
CLG	Cloghran	0.950	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84
CLN	Cloon	0.977	24.49	24.51	24.52	23.44	23.72	23.94	24.06	24.12	24.17	24.55
CLW	Carlow	0.989	48.89	48.93	48.93	46.79	47.34	47.78	48.01	48.14	48.23	48.99
COL (I)	College Park	0.988	20.29	20.3	20.31	19.42	19.65	19.83	19.93	19.98	20.02	20.33
COL (N)	Coleraine	0.990	33.79	33.89	33.98	34.15	34.29	34.38	34.52	35.2	35.31	35.44
cos	Carrick-on- Shannon	0.993	22.13	22.15	22.15	21.18	21.43	21.63	21.74	21.79	21.83	22.18
COW	Cow Cross	0.998	14.79	10.07	10.07	9.63	9.74	9.84	9.88	9.91	9.93	10.08
CPS	Cool	0.985	45.98	46.12	46.26	46.48	46.7	46.84	47.04	47.97	48.14	48.34
CRA	Crane	0.991	32.39	32.41	26.79	25.62	25.92	26.16	26.29	26.36	26.41	26.82
CRE	Cregagh	0.990	67.94	68.19	68.43	68.78	69.13	57.24	57.58	58.82	59.15	59.48
CRG	Creagh	0.990	19.67	19.72	19.78	19.87	19.97	20.02	20.1	20.49	20.57	20.65
CRH	Cruiserath	0.950	-	-	-	203	203	203	203	203	203	203
CRO	Coolroe	0.986	9.44	9.45	9.45	9.04	9.14	9.23	9.27	9.3	9.31	9.46
CVW	Castleview	0.986	19.89	19.91	19.91	19.04	19.26	19.44	19.54	19.59	19.62	19.93
DAL	Dallow	0.997	13.73	13.74	13.74	13.14	13.29	13.42	13.48	13.52	13.54	13.76
DDK	Dundalk	0.980	56.59	56.63	56.64	54.16	54.79	55.31	55.58	55.72	55.83	56.7
DFR	Dunfirth	0.996	7.77	7.78	7.78	7.44	7.52	7.6	7.63	7.65	7.67	7.79
DGN	Dungarvan	0.987	35.3	35.33	35.33	33.79	34.18	34.5	34.67	34.76	34.83	35.37
DLT	Dalton	0.986	20.07	20.09	20.09	19.21	19.44	19.62	19.72	19.77	19.8	20.12
DMY	Dunmanway	0.978	19.56	19.58	19.58	18.73	18.94	19.12	19.22	19.27	19.3	19.61
DON	Donegall	0.990	117	116.01	115	114.25	113.49	112.58	111.84	112.84	112.1	111.39
DOO	Doon	0.979	24.02	24.04	24.04	22.99	23.25	23.47	23.59	23.65	23.69	24.07
DRU (I)	Drumline	0.979	23.46	23.47	23.48	22.45	22.71	22.93	23.04	23.1	23.14	23.5
DRU (N)	Drumnakelly	0.980	72.35	72.59	72.82	73.17	73.53	73.76	74.1	75.57	75.87	76.3
DRY	Drybridge	0.989	68.36	68.42	68.42	65.43	66.19	66.82	67.14	67.32	67.44	68.5
DUN	Dungannon	0.990	76.65	76.88	77.1	77.46	77.82	78.05	78.39	79.93	80.23	80.55
EDE	Eden	0.980	27.34	27.42	27.5	27.63	27.76	27.84	27.95	28.5	28.61	28.72
ENN (I)	Ennis	0.981	45.89	45.93	45.93	43.93	44.44	44.86	45.07	45.19	45.28	45.99
ENN (N)	Enniskillen	0.990	46.26	46.41	46.55	46.79	47	47.16	47.36	48.31	48.5	48.7
FIN (I)	Finglas	0.983	400.13	400.42	400.43	386.18	389.83	392.82	394.32	395.19	395.8	400.81

Table C-2 Demand Forecasts at Time of Summer Peak

Bus	Bus Name	Power										
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
FIN (N)	Finaghy	0.990	24.48	24.55	24.62	24.74	24.85	24.92	25.02	25.51	25.6	25.7
FTT	Fortunestown	0.970	8.15	8.15	8.15	7.8	7.89	7.96	8	8.02	8.04	8.16
GAL	Galway	0.994	53.82	53.85	53.86	51.51	52.11	52.61	52.86	52.99	53.1	53.93
GI	Great Island	0.950	9.86	9.87	9.87	9.44	10.3	10.39	10.44	10.47	10.49	10.66
GIL	Gilra	0.971	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42
GLE (I)	Glenlara	0.989	13.22	13.23	13.23	12.65	12.8	12.92	12.98	13.02	13.04	13.25
GLE (N)	Glengormley	0.977	25.17	25.15	25.12	25.14	25.16	25.14	25.15	25.55	25.56	25.57
GOR (N)	Gort	0.990	0.94	0.95	0.95	0.96	0.97	0.98	0.99	1.01	1.02	1.03
GRA	Grange	0.949	9	9	9	9	9	9	9	9	9	9
GRI	Griffinrath	0.994	44.89	43.69	43.69	41.78	42.27	42.67	42.88	42.99	43.07	43.75
GWE	Gortawee	0.949	29.47	29.48	29.48	29.11	29.21	29.28	29.32	29.34	29.36	29.49
IKE	Ikerrin	0.966	23.61	23.63	23.63	22.6	22.86	23.08	23.19	23.25	23.29	23.66
INC	Inchicore	0.985	209.92	220.79	257.86	250.56	252.41	253.94	254.72	255.15	255.47	258.05
KBY	Kilbarry	0.992	71.92	71.98	71.99	68.84	69.65	70.3	70.64	70.83	70.96	72.08
KER	Knockearagh	0.990	31.46	31.49	31.49	30.11	30.46	30.75	30.9	30.98	31.04	31.53
KIN	Kinnegad	0.973	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19
KKY	Kilkenny	0.970	50.52	50.56	50.56	48.35	40.47	40.86	41.05	41.16	41.24	41.89
KNO	Knock	0.990	40.49	40.61	40.73	40.93	41.12	36.04	36.21	36.96	37.12	37.3
KTL	Kilteel	0.972	38.47	38.5	38.5	36.82	37.25	37.6	37.78	37.88	37.95	38.55
KTN	Killoteran	0.973	8.56	8.56	8.56	8.19	8.28	8.36	8.4	8.42	8.44	8.57
KUR	Knockumber	0.907	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66
LA	Lanesboro	0.986	12.65	12.66	12.66	12.11	12.25	12.36	12.42	12.46	12.48	12.68
LAR	Larne	0.990	22.65	22.71	22.78	22.88	22.98	23.05	23.14	23.59	23.67	23.76
LET	Letterkenny	0.984	62.38	62.43	58.46	55.91	56.56	57.1	57.37	57.52	57.63	58.54
LIB	Liberty	0.989	16.15	16.17	16.17	15.46	15.64	15.79	15.86	15.91	15.94	16.19
LIM (I)	Limerick	0.987	60.53	60.58	60.58	57.93	58.61	59.16	59.45	59.6	59.72	60.65
LIM (N)	Limavady	0.990	19.57	19.62	19.69	19.77	19.86	19.91	19.98	20.38	20.45	20.52
LIS (I)	Lisdrum	0.969	19.8	19.82	19.82	18.95	19.17	19.35	19.45	19.5	19.53	19.84
LIS (N)	Lisburn	0.990	58.47	58.65	58.84	59.12	59.4	59.57	59.83	61.01	61.23	61.48
LOG	Loguestown	0.980	30.84	30.93	31.02	31.16	31.3	31.39	31.51	32.13	32.24	32.37
MAC	Macroom	0.949	9.35	9.36	9.36	8.95	9.05	9.14	9.18	9.21	9.22	9.37
MAL	Mallow	0.980	17.31	17.33	17.33	16.57	16.77	16.92	17.01	17.05	17.08	17.35
MCE	Macetown	0.979	26.62	26.64	26.64	25.67	25.92	26.12	26.23	26.28	26.32	26.67
MID	Midleton	0.985	32.07	32.09	32.1	30.7	31.06	31.35	31.5	31.59	31.64	32.14
MLN	Mullagharlin	0.958	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46
MON	Monread	0.989	10.32	10.33	10.33	9.87	9.99	10.08	10.13	10.16	10.18	10.34
MOY	Moy	0.990	21.42	21.44	21.44	20.5	20.74	20.94	21.04	21.09	21.13	21.46
MR	Marina	0.997	11.84	11.85	11.86	11.34	11.47	11.58	11.63	11.66	11.69	11.87

**Table C-2 Demand Forecasts at Time of Summer Peak** 

Bus	Bus Name	Power				De	emand For	ecast (M\	N)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
MTH	Meathhill	0.965	42.24	42.27	42.27	40.43	40.9	41.28	41.48	41.59	41.67	42.32
MUL	Mullingar	0.983	35.72	35.75	35.75	34.18	34.58	34.91	35.08	35.17	35.23	35.79
MUN	Mungret	0.871	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5
NAR	Newtownards	0.990	35.87	35.97	36.08	36.24	36.4	36.5	36.64	37.36	37.48	37.62
NAV	Navan	0.980	48.2	48.24	48.25	46.14	46.68	47.12	47.34	47.47	47.56	48.3
NEN	Nenagh	0.967	16.86	16.87	16.87	16.13	16.32	16.48	16.56	16.6	16.63	16.89
NEW (I)	Newbridge	0.992	21.64	21.66	21.66	20.71	20.96	21.15	21.26	21.31	21.35	21.69
NEW (N)	Newry	0.990	63.16	63.36	63.57	63.87	64.18	64.38	64.65	65.93	66.18	66.46
OLD	Oldcourt	0.949	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
OMA	Omagh	0.990	47.95	48.08	48.22	48.45	48.67	48.79	48.98	49.94	50.1	50.29
OUG	Oughtragh	0.994	20.18	20.19	20.19	19.31	19.54	19.72	19.82	19.87	19.91	20.22
РВ	Poolbeg	0.989	157.31	157.44	157.45	150.58	152.33	153.78	154.51	154.92	155.22	157.65
PLA	Platin	0.960	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65
PLS	Portlaoise	0.996	42.46	42.5	42.5	40.64	30.31	30.6	30.74	30.82	30.88	31.37
RAT (I)	Rathkeale	0.989	21.84	21.85	21.86	20.9	21.14	21.34	21.45	21.5	21.54	21.88
RIC	Richmond	0.977	27.7	27.73	27.73	26.51	26.82	27.08	27.21	27.28	27.33	27.76
RNW	Rinawade	0.988	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13
ROS	Rosebank	0.990	24.05	24.11	24.18	24.28	24.39	21.99	22.08	22.52	22.61	22.7
RSY	Ringaskiddy	0.996	3.1	3.1	3.1	2.96	3	3.03	3.04	3.05	3.05	3.1
RYB	Ryebrook	0.928	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52
SAL	Salthill	0.994	41.54	41.58	41.58	39.76	40.22	40.61	40.8	40.91	40.98	41.63
SBH	Snughborough	0.950	-	-	-	16.72	16.72	16.72	16.72	16.72	16.72	16.72
SCR	Screeb	0.958	21.88	21.9	21.9	20.94	21.18	21.38	21.49	21.54	21.58	21.92
SHE	Shelton	0.956	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29
SKL	Shankill	0.966	44.93	44.97	44.97	43.01	43.51	43.92	44.13	44.25	44.33	45.03
SLI	Sligo	0.987	43.08	43.12	43.12	41.23	41.72	42.11	42.31	42.42	42.5	43.17
SNG	Singland	0.976	8.71	8.72	8.72	8.33	8.43	8.51	8.55	8.58	8.59	8.73
SOM	Somerset	0.990	16.77	16.79	16.79	16.06	16.24	16.4	16.47	16.52	16.55	16.81
SPR	Springtown	0.980	37.61	37.72	37.82	37.99	38.16	38.25	38.4	39.14	39.27	39.41
STR	Stratford	0.991	16.5	16.51	16.51	15.79	15.98	16.13	16.2	16.25	16.28	16.53
STR (N)	Strabane	0.990	33.47	33.57	33.65	33.81	33.95	34.05	34.17	34.84	34.96	35.08
TAN	Tandragee	0.990	52.35	52.5	52.65	52.89	53.12	53.26	53.46	54.5	54.69	54.89
TBG	Trabeg	0.993	56.96	57.01	57.01	54.53	55.16	55.67	55.94	56.09	56.2	57.08
ТВК	Tullabrack	0.980	8.72	8.73	8.73	8.34	8.44	8.52	8.56	8.59	8.6	8.74
THU	Thurles	0.976	22.24	22.26	22.26	21.29	21.54	21.74	21.85	21.9	21.95	22.29
TIP	Tipperary	0.979	16.42	16.43	16.43	15.71	15.9	16.05	16.12	16.17	16.2	16.45
TLK	Trillick	0.989	16.03	16.04	16.04	15.34	15.52	15.67	15.74	15.79	15.82	16.06
TON	Tonroe	0.993	12.18	12.19	12.19	11.66	11.79	11.91	11.96	12	12.02	12.21

Table C-2 Demand Forecasts at Time of Summer Peak

Bus	Bus Name	Power	Demand Forecast (MW)										
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	
TRI	Trien	0.957	19.12	19.13	19.13	18.3	18.51	18.69	18.78	18.83	18.86	19.16	
TRL	Tralee	0.995	44	44.03	44.04	42.11	42.6	43.01	43.21	43.33	43.41	44.09	
TSB	Thornsberry	0.983	25.35	25.37	25.37	24.26	24.55	24.78	24.9	24.96	25.01	25.4	
WAT	Waterford	0.978	44.14	44.18	44.18	42.25	41.99	42.39	42.59	42.7	42.79	43.46	
WEX	Wexford	0.968	45.08	45.12	45.12	43.15	43.65	44.06	44.27	44.39	44.47	45.17	
WHI	Whitegate	0.870	9	9	9	9	9	9	9	9	9	9	

Table C-3 Demand Forecasts at Time of Summer Valley

Bus	Bus Name	Power										
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
AA	Ardnacrusha	0.988	20.69	19.79	18.91	15.31	15.22	15.47	15.61	15.68	15.73	16.16
AGH	Aghyoule	0.990	4.07	4.1	4.13	4.17	4.2	4.4	4.28	4.38	4.42	4.46
AGY	Ardnagappary	0.949	-	-	3.29	2.67	2.65	2.7	2.72	2.73	2.74	2.82
AHA	Ahane	0.954	0.77	0.74	0.71	0.57	0.57	0.58	0.58	0.58	0.59	0.6
AIR	Airport Road (Belfast)	0.990	-	-	-	-	-	-	8.42	9.09	9.48	9.94
ANR	Anner	0.897	14	14	14	14	14	14	14	14	14	14
ANT	Antrim	0.980	12.31	12.35	12.39	12.45	12.51	13.04	12.6	12.85	12.9	12.95
ARI	Arigna	0.953	1.08	1.03	0.99	0.8	0.79	0.81	0.81	0.82	0.82	0.84
ARK	Arklow	0.980	5.77	5.52	3.33	2.69	2.68	2.73	2.75	2.76	2.77	2.84
ATH	Athlone	0.998	18.71	17.89	17.09	13.84	13.76	13.99	14.11	14.18	14.22	14.61
ATY	Athy	0.997	4.99	4.77	4.56	3.69	3.67	3.73	3.76	3.78	3.79	3.9
BAL	Baltrasna	0.979	3.31	3.16	3.02	2.45	2.43	2.47	2.49	2.51	2.51	2.58
BAN (I)	Banoge	0.980	17.1	16.44	15.79	13.17	13.11	13.28	13.38	13.44	13.47	13.79
BAN (N)	Banbridge	0.990	11.54	11.58	11.62	11.67	11.73	12.23	11.81	12.04	12.09	12.13
BAR	Barrymore	0.988	9.25	8.84	8.45	6.84	6.8	6.91	6.97	7.01	7.03	7.22
BDA	Baroda	0.988	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26
BDN	Ballydine	0.969	8.23	8.13	8.04	7.65	7.64	7.67	7.68	7.69	7.69	7.74
BEG	Ballybeg	0.997	3.06	2.92	2.79	2.26	2.25	2.29	2.31	2.32	2.32	2.39
BGD	Belgard Road	0.950	-	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2
BGT	Ballyragget	0.950	-	-	-	-	4.35	4.43	4.46	4.48	4.5	4.62
BIN	Binbane	0.997	6.74	6.45	3.94	3.19	3.17	3.23	3.26	3.27	3.28	3.37
ВК	Bellacorick	0.993	1.41	1.35	1.29	1.04	1.04	1.06	1.06	1.07	1.07	1.1
ВКҮ	Barnakyle	0.950	2.31	2.2	2.11	1.71	39.69	39.72	39.74	39.75	39.75	39.8
BLI	Ballylickey	0.961	3.48	3.32	3.18	2.57	2.56	2.6	2.62	2.63	2.64	2.72
BLK	Blake	0.976	7.15	3.82	3.65	2.95	2.94	2.98	3.01	3.02	3.03	3.12
ВМА	Ballymena	0.978	24.62	24.69	24.78	24.88	25.01	26.07	25.18	25.68	25.77	25.88
BNH	Ballynahinch	0.990	16.78	16.83	16.88	16.95	17.03	17.75	17.14	17.48	17.53	17.6
BOG	Banoge	0.965	1.91	1.83	5.22	4.23	4.21	4.28	4.31	4.33	4.35	4.47
BRA	Bracklone	0.949	-	-	2.88	2.33	2.32	2.36	2.38	2.39	2.4	2.46
BRI	Brinny	0.971	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95
BRY	Barnahely	0.984	17.42	16.65	15.9	12.89	12.8	13.02	13.14	13.2	13.24	13.6
BUT	Butlerstown	1.000	8.99	8.59	8.21	6.65	6.61	6.72	6.77	6.81	6.83	7.02
BVG	Ballyvallagh	0.990	4.46	4.47	4.48	4.5	4.52	4.72	4.55	4.64	4.66	4.68
САН	Cahir	0.999	6.26	5.98	5.71	4.63	4.6	4.68	4.72	4.74	4.76	4.89
CAR	Carnmoney	0.990	7.87	7.77	7.68	7.59	7.51	7.72	7.34	7.37	7.28	7.2
CAS	Castlereagh	0.990	17.04	17.09	17.14	17.22	17.3	18.03	17.41	17.76	17.82	17.89
CBG	Carrowbeg	0.992	6.82	6.52	6.22	5.04	5.01	5.1	5.14	5.16	5.18	5.32
CBR	Castlebar	0.987	8.73	8.34	7.97	6.46	6.42	6.52	6.58	6.61	6.63	6.82

Table C-3 Demand Forecasts at Time of Summer Valley

Bus	Bus Name	Power				De	mand Fo	recast (M\	N)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
CEN	Belfast Central	0.990	15.54	15.62	15.69	15.79	15.89	16.6	16.06	16.4	16.49	16.59
CF	Cathaleen's Fall	0.965	4.51	4.32	4.12	3.34	3.32	3.37	3.4	3.42	3.43	3.53
CFM	Castlefarm	0.901	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8
СНА	Charleville	0.998	3.85	3.68	3.52	2.85	2.83	2.88	2.9	2.92	2.93	3.01
CKG	Corkagh	0.950	33.25	33.25	66.88	66.88	66.88	66.88	66.88	66.88	66.88	66.88
CKM	Carrickmines	0.973	140.96	137.75	134.61	121.89	121.54	122.46	122.92	123.19	123.38	124.91
CLE	Clonee	0.950	-	43.6	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48
CLG	Cloghran	0.950	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84
CLN	Cloon	0.995	6.77	6.47	6.18	5.01	4.98	5.06	5.1	5.13	5.14	5.29
CLW	Carlow	0.987	13.45	12.86	12.28	9.95	9.89	10.05	10.14	10.19	10.22	10.5
COL (I)	College Park	0.987	10.51	10.05	9.6	7.78	7.73	7.86	7.93	7.96	7.99	8.21
COL (N)	Coleraine	0.990	12.59	12.63	12.67	12.72	12.78	13.32	12.87	13.11	13.17	13.2
cos	Carrick-on- Shannon	0.994	6.73	6.43	6.14	4.98	4.95	5.03	5.07	5.1	5.11	5.25
COW	Cow Cross	0.969	2.69	1.23	1.17	0.95	0.94	0.96	0.97	0.97	0.98	1
CPS	Cool	0.985	17.14	17.19	17.24	17.32	17.4	18.14	17.52	17.87	17.94	18.01
CRA	Crane	0.999	6.15	5.88	4.08	3.31	3.29	3.34	3.37	3.39	3.4	3.49
CRE	Cregagh	0.990	25.31	25.4	25.5	25.64	25.76	22.17	21.46	21.92	22.04	22.17
CRG	Creagh	0.990	7.33	7.35	7.37	7.41	7.44	7.76	7.49	7.64	7.66	7.69
CRH	Cruiserath	0.950	-	Ī	•	203	203	203	203	203	203	203
CRO	Coolroe	1.000	4.17	3.99	3.81	3.08	3.06	3.12	3.14	3.16	3.17	3.26
CVW	Castleview	0.994	7.05	6.74	6.44	5.22	5.18	5.27	5.32	5.34	5.36	5.51
DAL	Dallow	0.993	3.61	3.45	3.3	2.67	2.65	2.7	2.72	2.73	2.74	2.82
DDK	Dundalk	1.000	13.21	12.63	12.07	9.77	9.71	9.88	9.96	10.01	10.04	10.32
DFR	Dunfirth	1.000	2.26	2.16	2.06	1.67	1.66	1.69	1.7	1.71	1.72	1.76
DGN	Dungarvan	0.999	9.68	9.26	8.84	7.16	7.12	7.24	7.3	7.33	7.36	7.56
DLT	Dalton	1.000	6.36	6.08	5.81	4.7	4.68	4.75	4.8	4.82	4.83	4.97
DMY	Dunmanway	0.961	6.88	6.58	6.28	5.09	5.06	5.14	5.19	5.21	5.23	5.37
DON	Donegall	0.990	43.6	43.22	42.86	42.57	42.3	43.62	41.69	42.06	41.77	41.5
DOO	Doon	0.994	6.75	6.45	6.16	4.99	4.96	5.05	5.09	5.11	5.13	5.27
DRU (I)	Drumline	0.956	9.09	8.69	8.3	6.72	6.68	6.79	6.85	6.88	6.91	7.1
DRU (N)	Drumnakelly	0.980	26.96	27.05	27.14	27.27	27.4	28.58	27.61	28.16	28.27	28.43
DRY	Drybridge	0.995	19.38	18.53	17.7	14.34	14.25	14.49	14.61	14.68	14.73	15.14
DUN	Dungannon	0.990	28.56	28.64	28.73	28.87	29	30.24	29.21	29.78	29.9	30.01
EDE	Eden	0.980	10.19	10.22	10.25	10.3	10.34	10.79	10.42	10.62	10.66	10.7
ENN (I)	Ennis	0.997	14.09	13.47	12.87	10.42	10.36	10.53	10.62	10.67	10.71	11
ENN (N)	Enniskillen	0.990	17.25	17.29	17.35	17.43	17.51	18.27	17.65	18.01	18.07	18.15
FIN (I)	Finglas	0.975	176.25	171.78	167.43	149.82	149.37	150.62	151.27	151.63	151.88	154.02

Table C-3 Demand Forecasts at Time of Summer Valley

Bus	Bus Name	Power										
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
FIN (N)	Finaghy	0.990	9.12	9.15	9.18	9.22	9.26	9.65	9.32	9.51	9.54	9.58
FTT	Fortunestown	0.969	2.43	2.32	2.22	1.79	1.78	1.81	1.83	1.84	1.84	1.89
GAL	Galway	1.000	21.43	20.48	19.57	15.85	15.76	16.01	16.15	16.23	16.28	16.73
GI	Great Island	0.951	3.64	3.48	3.32	2.69	2.85	2.89	2.92	2.93	2.94	3.02
GIL	Gilra	0.971	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42
GLE (I)	Glenlara	0.956	3.82	3.65	3.48	2.82	2.81	2.85	2.88	2.89	2.9	2.98
GLE (N)	Glengormley	0.977	9.38	9.37	9.36	9.37	9.37	9.73	9.37	9.52	9.52	9.52
GOR (N)	Gort	0.990	0.35	0.35	0.36	0.36	0.36	0.38	0.37	0.38	0.38	0.38
GRA	Grange	0.949	9	9	9	9	9	9	9	9	9	9
GRI	Griffinrath	0.948	13.23	12.3	11.75	9.51	9.46	9.61	9.7	9.74	9.77	10.04
GWE	Gortawee	0.942	26.17	25.94	25.73	24.85	24.82	24.89	24.92	24.94	24.95	25.06
IKE	Ikerrin	0.998	5.76	5.51	5.26	4.26	4.24	4.31	4.35	4.37	4.38	4.5
INC	Inchicore	0.970	107.87	114.89	149.2	138.02	137.74	138.54	138.94	139.17	139.33	140.67
KBY	Kilbarry	0.995	13.24	12.66	12.09	9.79	9.74	9.9	9.98	10.03	10.06	10.34
KER	Knockearagh	0.994	10.24	9.79	9.35	7.58	7.53	7.66	7.72	7.76	7.78	8
KIN	Kinnegad	0.973	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19
KKY	Kilkenny	0.999	12.97	12.4	11.84	9.59	7.63	7.75	7.82	7.86	7.88	8.1
KNO	Knock	0.990	15.09	15.13	15.18	15.25	15.32	13.96	13.49	13.77	13.83	13.9
KTL	Kilteel	0.988	11.31	10.81	10.33	8.36	8.31	8.45	8.53	8.57	8.59	8.83
KTN	Killoteran	0.977	3.68	3.51	3.36	2.72	2.7	2.75	2.77	2.78	2.79	2.87
KUR	Knockumber	0.907	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66
LA	Lanesboro	0.978	3.32	3.17	3.03	2.45	2.44	2.48	2.5	2.51	2.52	2.59
LAR	Larne	0.990	8.44	8.46	8.49	8.53	8.57	8.93	8.62	8.79	8.82	8.85
LET	Letterkenny	0.975	14.02	13.4	11.73	9.5	9.44	9.6	9.68	9.73	9.76	10.03
LIB	Liberty	0.981	5.71	5.46	5.22	4.23	4.2	4.27	4.31	4.33	4.34	4.46
LIM (I)	Limerick	1.000	21.94	20.98	20.04	16.23	16.13	16.4	16.54	16.62	16.67	17.13
LIM (N)	Limavady	0.990	7.3	7.31	7.34	7.37	7.4	7.71	7.45	7.59	7.62	7.65
LIS (I)	Lisdrum	0.989	6.94	6.64	6.34	5.13	5.1	5.19	5.23	5.26	5.27	5.42
LIS (N)	Lisburn	0.990	21.79	21.86	21.93	22.03	22.13	23.08	22.29	22.73	22.82	22.91
LOG	Loguestown	0.980	11.49	11.53	11.56	11.61	11.66	12.16	11.74	11.97	12.01	12.06
MAC	Macroom	0.990	6.17	5.9	5.64	4.57	4.54	4.62	4.66	4.68	4.69	4.82
MAL	Mallow	0.990	5.42	5.18	4.95	4.01	3.98	4.05	4.09	4.1	4.12	4.23
MCE	Macetown	0.998	12.44	12.09	11.76	10.39	10.36	10.46	10.51	10.53	10.55	10.72
MID	Midleton	0.988	14.63	13.98	13.36	10.82	10.75	10.93	11.03	11.08	11.12	11.42
MLN	Mullagharlin	0.958	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46
MON	Monread	0.993	3.35	3.2	3.06	2.47	2.46	2.5	2.52	2.53	2.54	2.61
MOY	Moy	1.000	6.12	5.86	5.59	4.53	4.5	4.58	4.62	4.64	4.65	4.78
MR	Marina	1.000	3.42	3.27	3.12	2.53	2.51	2.56	2.58	2.59	2.6	2.67

Table C-3 Demand Forecasts at Time of Summer Valley

Bus	Bus Name	Power				De	emand For	recast (M\	N)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
MTH	Meathhill	0.977	12.29	11.75	11.23	9.09	9.04	9.19	9.27	9.31	9.34	9.6
MUL	Mullingar	0.971	9.27	8.86	8.46	6.86	6.81	6.92	6.99	7.02	7.04	7.23
MUN	Mungret	0.871	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5
NAR	Newtownards	0.990	13.37	13.41	13.44	13.5	13.56	14.14	13.65	13.92	13.97	14.02
NAV	Navan	1.000	11.54	11.03	10.54	8.53	8.48	8.62	8.7	8.74	8.77	9.01
NEN	Nenagh	0.986	7.9	7.55	7.21	5.84	5.81	5.9	5.95	5.98	6	6.17
NEW (I)	Newbridge	0.992	4.12	3.94	3.77	3.05	3.03	3.08	3.11	3.12	3.13	3.22
NEW (N)	Newry	0.990	23.54	23.61	23.69	23.8	23.92	24.94	24.09	24.57	24.66	24.76
OLD	Oldcourt	0.949	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
OMA	Omagh	0.990	17.86	17.91	17.98	18.06	18.13	18.9	18.26	18.62	18.68	18.74
OUG	Oughtragh	0.996	7.26	6.95	6.63	5.37	5.34	5.43	5.48	5.5	5.52	5.67
РВ	Poolbeg	0.995	55.13	52.72	50.36	40.79	40.55	41.23	41.57	41.78	41.9	43.06
PLA	Platin	0.960	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65
PLS	Portlaoise	1.000	11.4	10.9	10.42	8.44	5.94	6.04	6.09	6.12	6.14	6.31
RAT (I)	Rathkeale	0.989	19.71	18.85	18	14.58	14.49	14.74	14.86	14.93	14.98	15.39
RIC	Richmond	1.000	8.12	7.77	7.42	6.01	5.97	6.07	6.13	6.15	6.17	6.34
RNW	Rinawade	0.988	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13
ROS	Rosebank	0.990	8.96	8.99	9.01	9.05	9.09	8.52	8.23	8.39	8.43	8.46
RSY	Ringaskiddy	0.994	0.74	0.7	0.67	0.54	0.54	0.55	0.55	0.56	0.56	0.57
RYB	Ryebrook	0.928	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52
SAL	Salthill	0.997	13.89	13.28	12.68	10.28	10.21	10.38	10.47	10.52	10.56	10.85
SBH	Snughborough	0.950	-	-	-	16.72	16.72	16.72	16.72	16.72	16.72	16.72
SCR	Screeb	0.959	7.62	7.28	6.96	5.63	5.6	5.69	5.74	5.77	5.79	5.95
SHE	Shelton	0.956	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29
SKL	Shankill	0.997	11.76	11.25	10.74	8.7	8.65	8.79	8.87	8.91	8.94	9.19
SLI	Sligo	1.000	13.75	13.14	12.56	10.17	10.11	10.28	10.37	10.41	10.45	10.74
SNG	Singland	0.970	2.74	2.61	2.5	2.02	2.01	2.04	2.06	2.07	2.08	2.14
SOM	Somerset	0.999	3.46	3.31	3.16	2.56	2.55	2.59	2.61	2.62	2.63	2.7
SPR	Springtown	0.980	14.02	14.05	14.09	14.16	14.22	14.82	14.31	14.59	14.63	14.69
STR	Stratford	1.000	3.65	3.49	3.34	2.7	2.69	2.73	2.76	2.77	2.78	2.85
STR (N)	Strabane	0.990	12.46	12.51	12.55	12.6	12.65	13.19	12.75	12.99	13.02	13.08
TAN	Tandragee	0.990	19.51	19.56	19.62	19.71	19.79	20.63	19.92	20.31	20.38	20.45
TBG	Trabeg	0.988	23.44	22.4	21.4	17.33	17.23	17.51	17.67	17.75	17.81	18.3
ТВК	Tullabrack	0.972	3.18	3.04	2.9	2.35	2.34	2.37	2.39	2.41	2.41	2.48
THU	Thurles	0.998	7.73	7.39	7.06	5.72	5.68	5.78	5.83	5.85	5.87	6.03
TIP	Tipperary	0.994	5.42	5.18	4.95	4.01	3.98	4.05	4.09	4.1	4.12	4.23
TLK	Trillick	0.952	4.35	4.15	3.97	3.21	3.19	3.25	3.28	3.29	3.3	3.39
TON	Tonroe	0.975	4.42	4.22	4.04	3.27	3.25	3.3	3.33	3.35	3.36	3.45


Table C-3 Demand Forecasts at Time of Summer Valley

Bus	Bus Name	Power												
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026		
TRI	Trien	0.972	10.63	10.16	9.71	7.86	7.82	7.95	8.02	8.05	8.08	8.3		
TRL	Tralee	0.981	10.68	10.21	9.76	7.9	7.85	7.99	8.05	8.09	8.12	8.34		
TSB	Thornsberry	0.959	7.51	7.18	6.86	5.56	5.52	5.62	5.67	5.69	5.71	5.87		
WAT	Waterford	1.000	19.01	18.18	17.36	14.06	13.81	14.04	14.16	14.23	14.27	14.67		
WEX	Wexford	0.998	14.31	13.68	13.07	10.58	10.52	10.69	10.79	10.84	10.88	11.18		
WHI	Whitegate	0.870	9	9	9	9	9	9	9	9	9	9		

Table C-4 Demand Forecasts at Time of Autumn Valley – Northern Ireland Only

Bus	Bus Name	Power				De	emand For	ecast (M\	N)			
Code		Factor	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
AGH	Aghyoule	0.990	12.07	12.16	12.25	12.36	12.47	12.57	12.69	12.99	13.11	13.22
GOR (N)	Gort	0.990	1.04	1.05	1.06	1.07	1.07	1.08	1.09	1.12	1.13	1.14
ENN (N)	Enniskillen	0.990	51.15	51.3	51.48	51.73	51.97	52.14	52.38	53.41	53.62	53.84
AIR	Airport Road (Belfast)	0.990	•	-	•	·	-	ı	25	26.97	28.13	29.48
ANT	Antrim	0.980	36.53	36.65	36.76	36.94	37.11	37.22	37.38	38.12	38.27	38.43
ВМА	Ballymena	0.978	73.03	73.25	73.49	73.84	74.17	74.39	74.73	76.2	76.48	76.79
BAN (N)	Banbridge	0.990	34.25	34.35	34.46	34.62	34.79	34.89	35.03	35.73	35.86	36
BNH	Ballynahinch	0.990	49.8	49.94	50.08	50.3	50.53	50.66	50.86	51.85	52.02	52.22
CAR	Carnmoney	0.990	23.34	23.05	22.77	22.53	22.29	22.02	21.77	21.86	21.61	21.36
CEN	Belfast Central	0.990	46.12	46.33	46.55	46.85	47.15	47.36	47.65	48.67	48.93	49.21
COL (N)	Coleraine	0.990	37.36	37.46	37.58	37.74	37.91	38.02	38.17	38.9	39.04	39.18
CPS	Cool	0.985	50.83	50.99	51.14	51.38	51.63	51.78	52	53.02	53.23	53.44
CRG	Creagh	0.990	21.74	21.81	21.87	21.97	22.07	22.13	22.22	22.66	22.74	22.83
CRE	Cregagh	0.990	75.12	75.38	75.65	76.05	76.44	63.29	63.67	65.04	65.39	65.76
DON	Donegall	0.990	129.35	128.25	127.15	126.3	125.48	124.47	123.65	124.75	123.92	123.15
DRU (N)	Drumnakelly	0.980	79.99	80.26	80.51	80.9	81.29	81.55	81.92	83.55	83.88	84.36
DUN	Dungannon	0.990	84.73	84.99	85.25	85.65	86.04	86.29	86.67	88.37	88.69	89.05
EDE	Eden	0.980	30.23	30.32	30.41	30.55	30.69	30.78	30.91	31.51	31.63	31.75
FIN (N)	Finaghy	0.990	27.06	27.14	27.22	27.35	27.47	27.55	27.66	28.2	28.3	28.41
GLE (N)	Glengormley	0.977	27.83	27.8	27.77	27.8	27.81	27.79	27.81	28.25	28.25	28.26
KNO	Knock	0.990	44.76	44.9	45.04	45.25	45.46	39.84	40.04	40.86	41.04	41.24
LAR	Larne	0.990	25.04	25.11	25.18	25.3	25.41	25.48	25.58	26.08	26.17	26.27
BVG	Ballyvallagh	0.990	13.23	13.26	13.3	13.36	13.42	13.46	13.51	13.78	13.82	13.87
LIM (N)	Limavady	0.990	21.63	21.7	21.76	21.86	21.95	22.01	22.1	22.53	22.6	22.69
LIS (N)	Lisburn	0.990	64.64	64.85	65.05	65.36	65.67	65.86	66.14	67.45	67.7	67.98
LOG	Loguestown	0.980	34.1	34.2	34.3	34.45	34.6	34.7	34.84	35.52	35.65	35.78
NAR	Newtownards	0.990	39.66	39.77	39.89	40.07	40.24	40.35	40.51	41.3	41.44	41.6
NEW (N)	Newry	0.990	69.83	70.05	70.28	70.62	70.96	71.17	71.48	72.9	73.17	73.47
OMA	Omagh	0.990	53.02	53.18	53.32	53.57	53.8	53.94	54.16	55.21	55.4	55.61
CAS	Castlereagh	0.990	50.55	50.7	50.85	51.08	51.31	51.46	51.67	52.68	52.86	53.07
ROS	Rosebank	0.990	26.59	26.66	26.73	26.85	26.97	24.31	24.41	24.9	25	25.1
SPR	Springtown	0.980	41.59	41.7	41.82	42	42.19	42.29	42.45	43.28	43.42	43.58
STR (N)	Strabane	0.990	37	37.1	37.21	37.38	37.54	37.63	37.78	38.52	38.65	38.79
TAN	Tandragee	0.990	57.88	58.04	58.21	58.47	58.73	58.88	59.11	60.26	60.46	60.68



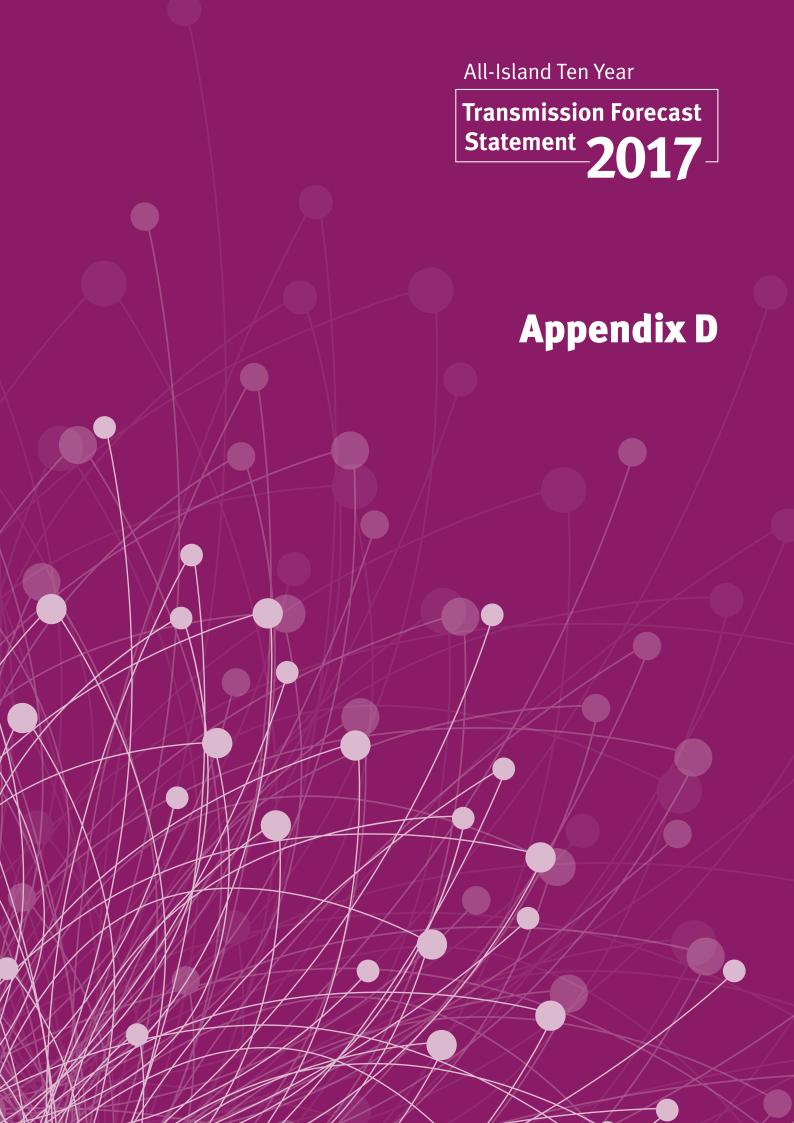



## Appendix D Generation Capacity and Dispatch Details

## D.1. Generation Capacity Details

Table D1 lists existing and committed future transmission connected generation, their connection details and the Registered Capacity<sup>123</sup> of each unit. All generation capacity figures in Table D-1 are expressed in exported terms. Exported terms are given by the generation unit output less the unit's own auxiliary load. The units are grouped in these tables on a geographical basis. Generation capacity figures are rounded to the nearest MW.

Table D-2 lists the existing and committed future wind generation. The wind generation included in this table is wind generation that feeds into each 110 kV transmission station, from the distribution system. The results for each year up to 2026 are included. Table D-2 is based on the wind farms that currently have signed connection agreements with the DSO. The connection agreements are based on the best available knowledge as at July 2017.

Table D-3 lists the existing and committed distribution connected generation in Ireland, excluding wind generation. Their respective MW capacity over the period of the statement is included.

Table D-4 lists the existing and committed distribution connected renewable generation in Northern Ireland, excluding wind generation. Their respective MW capacity over the period of the statement is included.

Table D-5 lists the existing and proposed generating plant contract details in Northern Ireland.

Where dual fuel capability exists, the fuel type highlighted in red is utilised to meet peak demand.

<sup>123</sup> The Registered Capacity of future units will not be known until the unit enters the Single Electricity Market. Therefore, for future units the Maximum Export Capacity of the unit appears in Table D-1.

Table D-1 MEC of Existing and Committed Transmission-Connected Generation

Area	Generation Station	Unit ID	Connected At	Fuel	Туре	Connection Year (if future)	Maximum Export Capacity (MW)
	Carrickaduff		Mulreavy	110 kV	Wind	2022	33
	Carrickaduff (2)		Mulreavy	110 kV	Wind	2022	33
	Cronacarkfree		Mulreavy	110 kV	Wind	2022	72
	Castletownmoor		Castletownmoor	110 kV	Wind	2018	120
	Erne	ER3	Cathaleen's Fall	110 kV	Hydro		23
	Erne	ER4	Cathaleen's Fall	110 kV	Hydro		23
	Erne	ER1	Cliff	110 kV	Hydro		10
	Erne	ER2	Cliff	110 kV	Hydro		10
	Garvagh - Glebe		Garvagh	110 kV	Wind		26
Border	Garvagh - Tullynahaw		Garvagh	110 kV	Wind		22
	Golagh		Golagh	110 kV	Wind		15
	Kingsmountain (1)		Cunghill	110 kV	Wind		24
	Kingsmountain (2)		Cunghill	110 kV	Wind		11
	Meentycat (1)		Meentycat	110 kV	Wind		71
	Meentycat (2)		Meentycat	110 kV	Wind		14
	Mountain Lodge		Ratrussan	110 kV	Wind		31
	Mulreavy		Mulreavy	110 kV	Wind		82
	Mulreavy Ext		Mulreavy	110 kV	Wind		13
	Oriel		Oriel	110 kV	Wind	2022	210
	Ratrussan		Ratrussan	110 kV	Wind		48
			Border Area To	otal			890
	Dublin Bay Power	DB1	Irishtown	220 kV	Gas/DO		415
	Huntstown	HNC	Huntstown A	220 kV	Gas/DO		352
	Huntstown	HN2	Huntstown B	220 kV	Gas/DO		412
Dublin	North Wall	NW5	North Wall	220 kV	Gas/DO		109
	Dublin Waste to Energy	DW1	Whitebank	110 kV	Waste	2017	61
	Poolbeg	PBC	Shellybanks	220 kV	Gas/DO		460
	Poolbeg PBC Shellybanks 220 kV Gas/DO  Dublin Area Total						

Table D-1 MEC of Existing and Committed Transmission-Connected Generation

Area	Generation Station	Unit ID	Connected At	Fuel	Туре	Connection Year (if future)	Maximum Export Capacity (MW)
	Liffey Hydro	LI1	Pollaphuca	110 kV	Hydro		15
	Liffey Hydro	LI2	Pollaphuca	110 kV	Hydro		15
	Liffey Hydro	LI4	Pollaphuca	110 kV	Hydro		4
Mid-East	Turlough Hill	TH1	Turlough Hill	220 kV	Hydro		73
	Turlough Hill	TH2	Turlough Hill	220 kV	Hydro		73
	Turlough Hill	TH3	Turlough Hill	220 kV	Hydro		73
	Turlough Hill	TH4	Turlough Hill	220 kV	Hydro		73
			Mid-East Area	Total			326
	Edenderry Peaking	ED3	Cushaling	110 kV	Distillate		116
	Edenderry Power	ED1	Cushaling	110 kV	Peat		122
Midlands	Lough Ree Power	LR4	Lanesboro	110 kV	Peat		94
	Mountlucas		Mountlucas	110 kV	Wind		79
	Rhode PCP (1)	RP1	Derryiron	110 kV	Distillate		52
	Rhode PCP (2)	RP2	Derryiron	110 kV	Distillate		52
			Midlands Area	Total			514
	Aughinish	SK3	Aughinish	110 kV	Gas/DO		65
	Aughinish	SK4	Aughinish	110 kV	Gas/DO		65
	Ardnacrusha Hydro (1)	AA1	Ardnacrusha	110 kV	Hydro		22
	Ardnacrusha Hydro (2)	AA2	Ardnacrusha	110 kV	Hydro		22
	Ardnacrusha Hydro (3)	AA3	Ardnacrusha	110 kV	Hydro		21
	Ardnacrusha Hydro (4)	AA4	Ardnacrusha	110 kV	Hydro		21
Mid-West	Athea		Athea	110 kV	Wind		34
	Athea B		Athea	110 kV	Wind	2021	19
	Moneypoint WF		Moneypoint	110 kV	Wind		22
	Booltiagh		Booltiagh	110 kV	Wind		19
	Booltiagh Ext.		Booltiagh	110 kV	Wind		12
	Cahernagh Mid Merit		Cahernagh	110 kV	Gas/DO	2022	20
	Dromada (1)		Dromada	110 kV	Wind		29
	Dromada (1a)		Dromada	110 kV	Wind	2020	18
	Kill Hill		Kill Hill	110 kV	Wind		36

Table D-1 MEC of Existing and Committed Transmission-Connected Generation

Area	Generation Station	Unit ID	Connected At	Fuel	Туре	Connection Year (if future)	Maximum Export Capacity (MW)
	Lisheen (1)		Lisheen	110 kV	Wind		36
	Lisheen (1a)		Lisheen	110 kV	Wind		23
Mid-West	Loughaun North		Slievecallan	110 kV	Wind	2017	45
Miu-west	Moneypoint (1)	MP1	Moneypoint	400 kV	Coal		288
	Moneypoint (2)	MP2	Moneypoint	400 kV	Coal		288
	Moneypoint (3)	MP3	Moneypoint	400 kV	Coal		288
			Mid-West Area	Total			1390
	Ballylumford B10	B10	Ballylumford	110 kV	Gas		98
	Ballylumford B4	B4	Ballylumford	275 kV	Gas		144
	Ballylumford B5	B5	Ballylumford	275 kV	Gas		147
	Ballylumford GT7	BGT1	Ballylumford	110 kV	DO		58
	Ballylumford GT8	BGT2	Ballylumford	110 kV	DO		58
	AES Ballylumford Limited	BGT20	Ballylumford	275 kV	Gas		479
	Coolkeeragh GT8	CGT8	Coolkeeragh	110 kV	Oil		53
	Coolkeeragh GT	C30 GT	Coolkeeragh	275 kV	Gas/DO		266
Northern Ireland	Coolkeeragh ST	C30 GS	Coolkeeragh	110 kV	Gas/DO		147
iretailu	Kilroot ST1	K1	Kilroot	275 kV	Coal/Oil		255
	Kilroot ST2	K2	Kilroot	275 kV	Coal/Oil		258
	Kilroot GT1	KGT1	Kilroot	275 kV	DO		29
	Kilroot GT2	KGT2	Kilroot	275 kV	DO		29
	Kilroot GT3	KGT3	Kilroot	275 kV	DO		42
	Kilroot GT4	KGT4	Kilroot	275 kV	DO		42
	Kilroot Battery		Kilroot	275 kV	Battery	>2025	100
	Brockaghboy		Brockaghboy	110 kV	Wind	2017	48
	Slieve Kirk	SLK	Killymallaght	110 kV	Wind		74
			Northern Ireland A	rea Total			2326
	Ballywater		Ballywater	110 kV	Wind		42
South-East	Castledockrell		Castledockrell	110 kV	Wind		41
- South East	Great Island CCGT	GI4	Great Island	220 kV	Gas		431
	Woodhouse		Woodhouse	110 kV	Wind		20
			South-East Area	Total			534

Table D-1 MEC of Existing and Committed Transmission-Connected Generation

Area	Generation Station	Unit ID	Connected At	Fuel	Туре	Connection Year (if future)	Maximum Export Capacity (MW)
	Aghada	AD1	Aghada	220 kV	Gas		258
	Aghada	AT1	Aghada	220 kV	Gas/DO		90
	Aghada	AT2	Aghada	220 kV	Gas/DO		90
	Aghada	AT4	Aghada	220 kV	Gas/DO		90
	Aghada CCGT	AD2	Longpoint	220 kV	Gas		431
	Boggeragh		Boggeragh	110 kV	Wind		57
	Boggeragh (2)		Boggeragh	110 kV	Wind		48
	Killavoy		Boggeragh	110 kV	Wind		18
	Clahane		Clahane	110 kV	Wind		38
	Clahane (2)		Clahane	110 kV	Wind	2021	14
	Coomacheo		Garrow	110 kV	Wind		41
	Coomacheo (2)		Garrow	110 kV	Wind		18
	Coomagearlahy		Coomagearlahy	110 kV	Wind		43
	Coomagearlahy ext.		Coomagearlahy	110 kV	Wind		39
South-West	Cordal		Cordal	110 kV	Wind	2022	90
	Glanlee (1)		Glanlee	110 kV	Wind		30
	Kelwin Power Plant		Kilpaddoge	110 kV	Hybrid	2021	42
	Barnadivane		Barnadivine	110 kV	Wind	2017	60
	Cloghboola		Cloghboola	110 kV	Wind		46
	Lee Hydro	LE1	Carrigadrohid	110 kV	Hydro		15
	Lee Hydro	LE2	Inniscarra	110 kV	Hydro		4
	Lee Hydro	LE3	Inniscarra	110 kV	Hydro		8
	Marina	MRT	Marina	110 kV	Gas/DO		85
	Grousemount		Coomataggart	110 kV	Wind		114
	Tarbert	TB1	Tarbert	110 kV	HFO		54
	Tarbert	TB2	Tarbert	110 kV	HFO		54
	Tarbert	TB3	Tarbert	220 kV	HFO		241
	Tarbert	TB4	Tarbert	220 kV	HFO		241
	Whitegen CCGT	WG	Glanagow	220 kV	Gas/DO		445
	Willegeli CCdi Wd		South-East Area	a Total			2802

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

Area	110 kV Station				Maximu	m Export	Capacit	y (MEC)			
		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
	Ardnagappary	6.0	14.2	14.2	14.2	14.2	14.2	14.2	14.2	14.2	13.1
	Binbane	44.6	44.6	44.6	58.7	95.1	95.1	95.1	95.1	95.1	95.1
	Cathaleen's Fall	29.4	29.4	29.4	29.4	29.4	29.4	29.4	29.4	29.4	29.4
	Corderry	63.3	63.3	63.3	76.8	76.8	76.8	76.8	76.8	76.8	76.8
	Crane	7.5	7.5	7.5	7.5	15.5	15.5	15.5	15.5	15.5	15.5
	Drybridge	6.5	6.5	6.5	10.6	10.6	10.6	10.6	10.6	10.6	10.6
	Dundalk	0.5	0.5	0.5	0.5	15.5	15.5	15.5	15.5	15.5	15.5
	Gortawee	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
Border	Letterkenny	51.4	51.4	51.4	52.9	87.3	87.3	87.3	87.3	87.3	87.3
	Lisdrum	-	-	-	16.1	16.1	62.3	62.3	62.3	62.3	49.2
	Meath Hill	44.0	46.6	46.6	46.6	75.6	75.6	75.6	75.6	75.6	75.6
	Moy	6.0	6.0	6.0	6.5	6.5	6.5	6.5	6.5	6.5	6.5
	Mulreavy	38.5	38.5	38.5	38.5	38.5	38.5	38.5	38.5	38.5	38.5
	Shankill	6.7	6.7	6.7	10.7	10.7	10.7	10.7	10.7	10.7	10.7
	Sligo	13.7	13.7	13.7	13.7	13.7	13.7	13.7	13.7	13.7	13.7
	Sorne Hill	63.9	63.9	63.9	63.9	63.9	63.9	63.9	63.9	63.9	63.9
	Trillick	44.7	44.7	44.7	44.7	44.7	44.7	44.7	44.7	44.7	44.7
	Border Area Total	429.5	440.3	440.3	494.2	616.9	663.1	663.1	663.1	663.1	649.0
Dublin	Glasmore	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
Dubliii	Nangor	-	-	-	8.0	8.0	8.0	8.0	8.0	8.0	13.4
	Dublin Area Total	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	14.2
	Arklow	79.7	79.7	79.7	83.7	89.7	89.7	89.7	89.7	89.7	89.7
	Dunfirth	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
Mid-East	Kilteel	260.0	260.0	260.0	260.0	260.0	260.0	260.0	260.0	260.0	15.0
	Monread	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Newbridge	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Mid-East Area Total	339.7	339.7	339.7	355.7	361.7	361.7	361.7	361.7	361.7	116.7

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

Area	110 kV Station				Maximu	m Export	Capacit	y (MEC)			
		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
	Dallow	21.0	21.0	21.0	21.0	21.0	21.0	21.0	21.0	21.0	21.0
	Lanesboro	4.6	4.6	4.6	4.6	4.6	4.6	4.6	4.6	4.6	4.6
88° d ( d -	Mullingar	-	4.0	4.0	4.0	8.0	8.0	8.0	8.0	8.0	8.0
Midlands	Navan	-	-	-	4.0	9.0	9.0	9.0	9.0	9.0	9.0
	Richmond	-	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0
	Thornsberry	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Midlands Area Total	25.6	29.6	29.6	37.6	50.6	50.6	50.6	50.6	50.6	50.6
	Ardnacrusha	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
	Ballydine	-	-	-	-	4.0	28.0	28.0	28.0	28.0	28.0
	Booltiagh	-	85.4	85.4	85.4	85.4	85.4	85.4	85.4	85.4	85.4
	Bunkimalta	-	-	-	46.5	46.5	46.5	46.5	46.5	46.5	46.5
	Cahir	-	4.0	4.0	4.0	12.0	12.0	12.0	12.0	12.0	12.0
	Cauteen	163.9	177.1	179.1	182.1	182.1	182.1	182.1	182.1	182.1	182.1
	Charleville	46.7	46.7	46.7	46.7	46.7	46.7	46.7	46.7	46.7	46.7
	Cureeny	-	-	-	94.0	94.0	94.0	94.0	94.0	94.0	94.0
Mid-West	Drumline	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
Miq-west	Glenlara	53.0	53.0	53.0	53.0	59.0	59.0	59.0	59.0	59.0	59.0
	Ikerrin	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0
	Limerick	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Lisheen	39.6	39.6	39.6	39.6	39.6	39.6	39.6	39.6	39.6	39.6
	Nenagh	14.0	14.0	14.0	14.0	14.0	14.0	14.0	14.0	14.0	14.0
	Rathkeale	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	Thurles	41.8	41.8	41.8	41.8	41.8	41.8	41.8	41.8	41.8	41.8
	Tipperary	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6
	Tullabrack	31.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0
	Mid-West Area Total	465.7	568.2	570.2	721.7	739.7	763.7	763.7	763.7	763.7	763.7

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

Area	110 kV Station	Maximum Export Capacity (MEC)										
		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	
	Aghyoule	82.5	82.5	82.5	82.5	82.5	82.5	82.5	82.5	82.5	82.5	
	Antrim	6.7	6.7	6.7	6.7	6.7	6.7	6.7	6.7	6.7	6.7	
	Ballymena	61.2	61.2	61.2	63.7	63.7	63.7	63.7	63.7	63.7	63.7	
	Carnmoney	13.8	13.8	13.8	13.8	13.8	13.8	13.8	13.8	13.8	13.8	
	Coleraine	108.0	108.0	108.0	108.0	108.0	108.0	108.0	108.0	108.0	108.0	
	Coolkeeragh	29.6	29.6	29.6	29.6	29.6	29.6	29.6	29.6	29.6	29.6	
	Curraghamulkin	-	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6	88.6	
	Drumquin	-	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	
	Dungannon	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	
	Eden	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	
	Enniskillen	31.9	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	
	Gort	56.5	67.5	67.5	67.5	67.5	67.5	67.5	67.5	67.5	67.5	
	Agivey Cluster	47.5	47.5	47.5	47.5	137.5	137.5	137.5	137.5	137.5	137.5	
Northern Ireland	Kells	-	-	-	-	11.4	11.4	11.4	11.4	11.4	11.4	
	Killymallaght	50.7	50.7	50.7	50.7	50.7	50.7	50.7	50.7	50.7	50.7	
	Larne	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	
	Limavady	37.7	37.7	37.7	37.7	37.7	37.7	37.7	37.7	37.7	37.7	
	Lisburn	17.0	17.0	17.0	17.0	17.0	17.0	17.0	17.0	17.0	17.0	
	Loguestown	9.2	9.2	9.2	9.2	9.2	9.2	9.2	9.2	9.2	9.2	
	Lismore	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	
	Magherakeel	119.2	119.2	119.2	119.2	119.2	119.2	119.2	119.2	119.2	119.2	
	Newry	-	15.3	15.3	15.3	15.3	15.3	15.3	15.3	15.3	15.3	
	Omagh	125.7	125.7	125.7	125.7	125.7	125.7	125.7	125.7	125.7	125.7	
	Rasharkin	84.6	84.6	84.6	84.6	84.6	84.6	84.6	84.6	84.6	84.6	
	Rosebank	-	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	
	Strabane	27.4	27.4	27.4	27.4	27.4	27.4	27.4	27.4	27.4	27.4	
	Tremoge	77.2	77.2	77.2	77.2	77.2	77.2	77.2	77.2	77.2	77.2	
	Northern Ireland Area Total	1038.6	1168.6	1168.6	1171.1	1272.5	1272.5	1272.5	1272.5	1272.5	1272.5	

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

Area	110 kV Station	Maximum Export Capacity (MEC)										
		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	
	Athy	-	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	
	Banoge	-	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	
	Barrymore	39.9	39.9	39.9	39.9	39.9	39.9	39.9	39.9	39.9	39.9	
	Butlerstown	1.7	1.7	1.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	
	Carlow	34.4	34.4	34.4	34.4	39.4	39.4	39.4	39.4	39.4	39.4	
	Doon	-	-	-	-	4.0	29.0	29.0	29.0	29.0	29.0	
South-East	Dungarvan	4.6	38.6	38.6	38.6	38.6	38.6	38.6	38.6	38.6	38.6	
	Great Island	-	-	-	5.0	17.0	17.0	17.0	17.0	17.0	17.0	
	Kilkenny	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	Lodgewood	59.5	60.1	60.1	64.1	64.1	64.1	64.1	64.1	64.1	64.1	
	Portlaoise	9.2	9.2	9.2	9.2	13.2	13.2	13.2	13.2	13.2	13.2	
	Waterford	18.3	18.3	18.3	22.2	22.2	22.2	22.2	22.2	22.2	22.2	
	Wexford	38.9	38.9	38.9	38.9	42.9	46.9	46.9	46.9	46.9	46.9	
	South-East	206.4	245.0	245.0	261.9	298.9	327.9	327.9	327.9	327.9	327.9	
	Area Total											
	Athea	-	-	-	3.6	41.5	41.5	41.5	41.5	41.5	41.5	
	Ballylickey	36.5	36.5	36.5	54.0	54.0	54.0	54.0	54.0	54.0	54.0	
	Bandon	4.5	26.6	26.6	26.6	26.6	30.6	30.6	30.6	30.6	30.6	
	Boggeragh	20.0	20.0	20.0	38.0	44.0	44.0	44.0	44.0	44.0	44.0	
	Castleview	-	-	-	-	-	4.0	4.0	4.0	4.0	4.0	
	Cloghboola	32.0	44.6	44.6	44.6	44.6	44.6	44.6	44.6	44.6	44.6	
	Coomataggart	-	-	70.2	70.2	70.2	70.2	70.2	70.2	70.2	70.2	
	Cordal	40.3	40.3	40.3	40.3	40.3	60.3	60.3	60.3	60.3	60.3	
	Dunmanway	30.8	30.8	30.8	30.8	55.7	58.7	58.7	58.7	58.7	58.7	
	Garrow	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	
	Glentane	-	-	-	38.5	38.5	38.5	38.5	38.5	38.5	38.5	
South-West	Kilbarry	0.8	0.8	0.8	5.8	5.8	5.8	5.8	5.8	5.8	5.8	
	Kilpaddoge	18.0	61.6	61.6	61.6	61.6	61.6	61.6	61.6	61.6	61.6	
	Knockacummer	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	
	Knockeragh	13.9	13.9	13.9	24.5	24.5	24.5	24.5	24.5	24.5	24.5	
	Macroom	34.1	34.1	34.1	34.1	34.1	34.1	34.1	34.1	34.1	34.1	
	Mallow	-	9.9	9.9	9.9	13.9	13.9	13.9	13.9	13.9	13.9	
	Midleton	1.6	1.6	1.6	1.6	1.6	5.6	5.6	5.6	5.6	5.6	
	Oughtragh	9.0	9.0	9.0	13.0	13.0	13.0	13.0	13.0	13.0	13.0	
	Reamore	57.4	57.4	57.4	57.4	70.9	96.2	96.2	96.2	96.2	96.2	
	Trabeg	-	-	-	-	-	5.0	5.0	5.0	5.0	5.0	
	Tralee	45.9	45.9	45.9	51.6	55.6	55.6	55.6	55.6	55.6	55.6	
	Trien	61.7	61.7	61.7	61.7	61.7	61.7	61.7	61.7	61.7	61.7	
	South-West Area Total	526.2	614.3	684.6	787.5	877.8	943.0	943.0	943.0	943.0	943.0	

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

Area	110 kV Station				Maximu	m Export	Capacit	y (MEC)			
		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
	Arigna	15.6	15.6	15.6	15.6	15.6	15.6	15.6	15.6	15.6	15.6
	Bellacorick	6.5	25.8	25.8	25.8	25.8	85.0	85.0	85.0	85.0	85.0
	Carrick on Shannon	-	-	-	4.0	8.3	8.3	8.3	8.3	8.3	8.3
	Castlebar	38.1	38.1	38.1	42.6	42.6	46.0	46.0	46.0	46.0	46.0
	Cloon	4.3	4.3	4.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3
	Dalton	43.2	43.2	43.2	43.2	43.2	43.2	43.2	43.2	43.2	43.2
	Ennis	45.5	45.5	45.5	45.5	45.5	45.5	45.5	45.5	45.5	45.5
West	Garvagh	34.0	34.0	34.0	34.0	34.0	34.0	34.0	34.0	34.0	34.0
	Glenree	34.2	34.2	77.3	77.3	77.3	77.3	77.3	77.3	77.3	77.3
	Knockalough	-	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6	33.6
	Salthill	46.1	46.1	46.1	46.1	46.1	46.1	46.1	46.1	46.1	46.1
	Screeb	-	3.0	3.0	3.0	30.0	30.0	30.0	30.0	30.0	30.0
	Somerset	7.7	19.5	19.5	19.5	19.5	19.5	19.5	19.5	19.5	19.5
	Tawnaghmore	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	Tonroe	9.5	9.5	12.5	14.0	14.0	14.0	14.0	14.0	14.0	14.0
	West Area Total	314.6	382.4	428.6	442.6	473.8	536.4	536.4	536.4	536.4	536.4

Table D-3 Existing and Committed Distribution-Connected Generation in Ireland (Excluding Wind)

Area	110 kV Station	Туре	Maximum Export Capacity (MEC)									
			2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
	Binbane	Hydro	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
	Crane	PV	-	-	-	-	4	4	4	4	4	4
	Drybridge	Waste to Energy	20	20	20	20	20	20	20	20	20	20
Border	Drybridge	LFG	6.229	6.229	6.229	6.229	6.229	6.229	6.229	6.229	6.229	6.229
	Drybridge	Biogas	-	-	-	-	3	3	3	3	3	3
	Meath Hill	СНР	1	1	1	1	1	1	1	1	1	1
	Shankill	LFG	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	Border Total Are	a	32.2	32.2	32.2	32.2	39.2	39.2	39.2	39.2	39.2	39.2
	Ringsend	Waste to Energy	72	72	72	72	72	72	72	72	72	72
	Ringsend	Diesel	2.5	2.5	2.5	2.5	2.5	2.5	72	72	72	2.5
Dublin	Glasmore	CHP	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
	Finglas	СНР	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6
	Blackrock	СНР	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55
	Dublin Total Area	a	78.4	78.4	78.4	78.4	78.4	78.4	147.9	147.9	147.9	78.4
	Kilteel	LFG	9.77	9.77	9.77	9.77	9.77	9.77	9.77	9.77	9.77	9.77
Mid-	Griffinrath	Hydro	4	4	4	4	4	4	4	4	4	4
East	Griffinrath	solar	-	-	-	4	4	4	4	4	4	4
	Arklow	Biomass	1	1	1	1	1	1	1	1	1	1
	Mid-East Total A	rea	14.8	14.8	14.8	18.8	18.8	18.8	18.8	18.8	18.8	18.8
	Athlone	PV	-	-	-	4	4	4	4	4	4	4
	Athlone	LFG	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75
Mid- land	Navan	CHP	13	13	13	13	13	13	13	13	13	13
	Navan	PV	-	-	-	-	4	4	4	4	4	4
	Thornsberry	CHP	-	-	-	-	10	10	10	10	10	10
	Midland Total Ar	rea	13.8	13.8	13.8	17.8	31.8	31.8	31.8	31.8	31.8	31.8
	Ballydine	Biogas	-	-	-	0.44	0.44	0.44	0.44	0.44	0.44	0.44
	Rathkeale	CHP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
Mid- West	Rathkeale	LFG	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2
	Rathkeale	Biogas	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44
	Tullabrack	Wave	-	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4
	Mid-West Total A	Area	10.1	15.5	15.5	16.0	16.0	16.0	16.0	16.0	16.0	16.0

Table D-3 Existing and Committed Distribution-Connected Generation in Ireland (Excluding Wind)

Area	110 kV Station	Туре				Maximuı	m Export	Capacit	y (MEC)			
			2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
	Ballybeg	LFG	4.26	4.26	4.26	4.26	4.26	4.26	4.26	4.26	4.26	4.26
	Barrymore	СНР	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8
	Doon	Hydro	-	-	-	1	1	1	1	1	1	1
South-	Kilkenny	СНР	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5
East	Kilkenny	Biogas	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18
	Portlaoise	PV	-	-	-	4	4	4	4	4	4	4
	Portlaoise	Biogas	1	1	1	1	1	1	1	1	1	1
	Wexford	СНР	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
	South-East Area	Total	17.9	17.9	17.9	22.9	22.9	22.9	22.9	22.9	22.9	22.9
	Castleview	CHP	2	2	2	2	2	2	2	2	2	2
South-	Dunmanway	CHP	6	6	6	6	6	6	6	6	6	6
West	Knockeragh	Biogas	3	3	3	3	3	3	3	3	3	3
	Midleton	PV	-	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95
	South-West Area	a Total	11.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0
	Bellacorick	Wave	-	10	10	10	10	10	10	10	10	10
West	Tawnaghmore	DO	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3
west	Tawnaghmore	DO	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3
	Tawnaghmore	Biomass	-	-	-	-	-	54	54	54	54	54
	West Area Total		104.6	114.6	114.6	114.6	114.6	168.6	168.6	168.6	168.6	168.6

Table D-4 Existing and Committed Distribution-Connected Renewables in Northern Ireland (Excluding Wind)

110 kV Station	Туре				Maximuı	m Export	Capacit	y (MEC)			
		2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
Antrim	PV	11	23	23	23	23	23	23	23	23	23
Ballymena	Biogas	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
Ballymena	PV	-	6	6	6	6	6	6	6	6	6
Coolkeeragh	Biomass	17.6	17.6	17.6	17.6	17.6	17.6	17.6	17.6	17.6	17.6
Dungannon	PV	-	4	4	4	4	4	4	4	4	4
Dungannon	Biogas	2	2	2	2	2	2	2	2	2	2
Lisburn	PV	38	59	59	59	59	59	59	59	59	59
Rasharkin	PV	35.2	35.2	35.2	35.2	35.2	35.2	35.2	35.2	35.2	35.2
Rosebank	Biomass	4.9	4.9	4.9	4.9	4.9	4.9	4.9	4.9	4.9	4.9
Waringstown	PV	8.5	8.5	8.5	8.5	8.5	8.5	8.5	8.5	8.5	8.5
Northern Ireland Total		119.6	162.6	162.6	162.6	162.6	162.6	162.6	162.6	162.6	162.6

Table D-5 Existing and Proposed Northern Ireland Generating Plant Contract Details

Generation Unit	Fuel Type		Contract
		Туре	Details
Ballylumford ST 4	GAS/HFO	IPP	See Note 1
Ballylumford ST 5	GAS/HFO	IPP	See Note 1
Ballylumford CCGT 21	GAS/GASOIL	Power NI (PPB)	See Note 2
Ballylumford CCGT 22	GAS/GASOIL	Power NI (PPB)	See Note 2
Ballylumford CCGT 20	STEAM	Power NI (PPB)	See Note 2
Ballylumford CCGT 10	GAS/GASOIL	Power NI (PPB)	See Note 2
Ballylumford GT 7	GASOIL	IPP	Independent from 01/11/12
Ballylumford GT 8	GASOIL	IPP	Independent from 01/11/12
Kilroot ST 1	COAL/OIL	IPP	Independent from 01/11/10; See Note 3
Kilroot ST 2	COAL/OIL	IPP	Independent from 01/11/10; See Note 3
Kilroot GT 1	GASOIL	IPP	Independent from 01/11/12
Kilroot GT 2	GASOIL	IPP	Independent from 01/11/12
Kilroot GT 3	GASOIL	IPP	Commenced Operation 01/03/2009
Kilroot GT 4	GASOIL	IPP	Commenced Operation 01/03/2009
Coolkeeragh GT8	GASOIL	IPP	Independent from 01/02/2013
Coolkeeragh CCGT	GAS/GASOIL	IPP	Commenced Operation 01/04/2005
Moyle	DC LINK		See Note 4

**NOTE 1:** This is an independent Power Producer (IPP). Ballylumford ST4 and ST5 are contracted to provide a total capacity of 250 MW of local reserve until the end of 2018. There is an option for SONI to extend this by a further two years if deemed required.

**NOTE 2:** In a Generator Unit Agreement (GUA) with Power NI Energy Limited's Power Procurement Business (PPB). The contract expiry date is 23rd September 2018 (with a five year extension option)<sup>124</sup>.

**NOTE 3:** In line with the information available to SONI at the data freeze date of July 2017 Kilroot ST1 and ST2 are due to be decommissioned by the end of 2023.

**NOTE 4:** Capacity is auctioned regularly (daily, monthly, seasonally and annually) to the market participants. Capacity is also available in SEM through implicit auction process.

## D.2. Generation Dispatch Details

Table D-6 through to Table D-8 lists generation dispatch profiles. These dispatch profiles are used for the purposes of the short circuit current level analyses and power flow diagrams. In the tables the SV column represents the dispatch at summer valley, SP denotes the summer peak dispatch and WP denotes the winter peak dispatch.

For the purpose of short circuit current level studies, wind farms were dispatched at 10% of their rated capacity for winter peak cases. Wind farms were not dispatched in summer valley cases. These dispatches are given in Table D-6 and Table D-7.

<sup>124</sup> https://www.uregni.gov.uk/sites/uregni.gov.uk/files/media-files/2014-10-10 GUA Decision Paper.pdf

For the purpose of power flow diagram dispatches, wind farms were dispatched at 30% of their rated capacity for winter peak and summer peak cases. Wind farms were dispatched at 10% for summer valley cases. These dispatches are given in Table D-8.

The values shown are in exported terms. They are the net of each generation unit's own consumption. They indicate the power delivered to the transmission system.

In all instances, a dispatch of 0 MW indicates that the unit is synchronised to the system, but dispatched at 0 MW. This scenario is only used for the winter peak short circuit current level studies. In all other dispatch profiles, unless a MW value is provided for the generator, the unit is not dispatched and not synchronised to the system.

It should be noted that station demand projections are developed from the system demand forecasts on a top-down basis. The projections use a forecast of transmission losses. The transmission loss figures calculated by the network models used in this TYTFS may differ from the forecast figures. Hence the dispatch totals may differ from the system demand forecasts in Table 3-1 in Chapter 3.

Table D-6 Dispatch Profiles – Ireland Short Circuit

Area	Generation Station	Unit ID	20	17	20	20	20	23
			SV	WP	SV	WP	SV	WP
	Clady Hydro	-	-	4	-	4	-	4
	Erne Cliff Hydro (1)	ER1	-	5	-	10	-	10
	Erne Cliff Hydro (2)	ER2	-	5	-	10	-	10
	Erne Cathleen's Fall Hydro (3)	ER3	-	15	-	20	-	20
	Erne Cathleen's Fall Hydro (4)	ER4	-	15	-		-	20
	Raheenagee Solar	-					-	-
Border	Whiteriver Landfill Gas to Energy	-	-	1	-	1	-	1.2
	Rathdrinagh Biogas	-					-	3
	Bailie Foods CHP	-	-	1	-	1	-	1
	Corranure LFG	-	-	0.7	-	0.5	-	0.7
	Meath Waste-Energy	IW1	-	20	•	20	•	17
	Knockharley Landfill (1)	-	-	1	•	1	•	1.4
	Knockharley Landfill (2)	-	-	3	-	2	-	3
	Installed Wind	-	-	241	-	309	-	417
	Border Area Total		0.0	311.7	0.0	378.5	0.0	508.3

Table D-6 Dispatch Profiles – Ireland Short Circuit

Area	Generation Station	Unit	20	17	20	20	2	023
		ID	SV	WP	SV	WP	SV	WP
	Kilbush Nurseries CHP	-	-	1	-	1	-	1.6
	Huntstown	HN1	-	300	-	220	-	214
	Huntstown	HNO	-	200	-	220	-	214
	Huntstown	HN2	300	300	-	350	-	370
	Dublin Bay Power	DB1	300	365	346	350	346	354
	North Wall	NW5	-	-	-		-	0
	Dublin Waste to Energy Facility	-	62	-	-		-	0
Dublin	Dublin Waste to Energy Facility	DW1	-	70	70	70	70	60
	Poolbeg	PB14	-	-	-	120	-	140
	Poolbeg	PB15	-	-	-	120	-	0
	Poolbeg	PB16	-	101	-	150	-	0
	Elm Park Development	-	-	0.22	-	0.2	-	0.22
	Elm Park Development	-	-	0.33	-	0.2	-	0.33
	Keelings CHP	-	-	1	-		-	1.5
	Installed Wind	-	-	0.2	-	5.5	-	5.5
	Dublin Area Total		662.0	1338.8	416.0	1606.9	416.0	1361.2
	Aughrim Energy	-	-	1	-	1	-	0
	Leixlip Hydro	-	-	4	-	4	-	4
	Dollanstown Stud Solar	-					-	0
	Arthurstown LFG	-	-	9	-		-	9
	Liffey Hydro (1)	LI1	-	10	-	15	-	15
	Liffey Hydro (2)	LI2	-	10	-	15	-	15
Mid-East	Liffey Hydro (4)	LI4	-	4	-30	4	-	15
	Turlough Hill (1)	TH1	-30	70	-30	50	-30	36.978
	Turlough Hill (2)	TH2	-30	70	-30	50	-30	37.2037
	Turlough Hill (3)	TH3	-30	70	-30	50	-30	36.978
	Turlough Hill (4)	TH4	-30	70	100	50	-30	37.2037
	East West Interconnector	EW1	100	300	-	100	100	100
	Installed Wind	-	-	24	-	33.2	-	35
	Mid-East Area Total		-20.0	642.0	-20.0	372.2	-20.0	341.4

Table D-6 Dispatch Profiles – Ireland Short Circuit

Area	Generation Station	Unit	2017		20	20	2023	
		ID	SV	WP	SV	WP	SV	WP
	Ballinamudda	-			-	-	-	-
	Edenderry Power	ED1	100	90	80	110	80	101
	Edenderry PCP	ED3	-	-	-	-	-	-
	Edenderry PCP	ED5	-	-	-	-	-	-
	Rhode PCP	RP1	-	-	-	-	-	-
	Rhode PCP	RP2	-	-	-	-	-	-
	Lough Ree Power	LR4	90	85	70	90	70	87
Midland	Kerdiffstown Solar	-					-	-
	Derryclure	-					-	10
	Connaught Regional Residual Landfill	-	-	0.75	-	0.5	-	0.75
	Shamrock Renewable Fuels	-		10	-	10	-	11
	Installed Wind	-	-	51.8	-	55.4	-	59.3
	Midland Area Total		190.0	237.6	150.0	265.9	150.0	269.1
	Ardnacrusha Hydro (2)	AA2	-	15	-	20	-	20
	Ardnacrusha Hydro (3)	AA3	-	15	-	19	-	18
	Ardnacrusha Hydro (4)	AA4	-	15	-	20	-	20
	Moneypoint (1)	MP1	120	240	120	230	120	215
	Moneypoint (2)	MP2	-	240	-	230	-	215
	Moneypoint (3)	MP3	-	240	-	230	-	215
Mid-West	Pfizer Askeaton (Wyeth)	-	-	6	-	6	-	6
Mid-west	Aughinish	SK3	80	75	80	80	80	75
	Aughinish	SK4	80	75	80	80	80	75
	WestWave Killard	-			-	5	-	5
	R & L Dowley Biogas	-			-	0.4	-	0.44
	Gortadroma Landfill Gas	-	-	-	-	2	-	0.44
	McDonnell Farms Biogas	-	-	0.44	-	0.4	-	0.44
	Installed Wind	-	-	187.4	-	289	-	306
	Mid-West Area Total		280.0	1123.8	280.0	1230.8	280.0	1191.3

Table D-6 Dispatch Profiles – Ireland Short Circuit

Area	Generation Station	Unit	2017		20	20	2023	
		ID	SV	WP	SV	WP	SV	WP
	Dairygold Mitchelstown	-	-	4	-	4	-	4
	Glasha hydro	-			-	1	-	1
	Great Island CCGT	GI4	310	400	310	300	310	344
	Glanbia Ballyraggett CHP	-	-	7	-	6	-	7
	Ballytobin Biogas	-	-	-	-		-	7
	Gorteen Lower	-	-	1	-	1	-	1
South-East	Shanderry Solar	-			-		-	0
	Ballyshannon Farms	-	-	0.15	-	0.1	-	0
	Ballynagran (1)	-	-	0.75	-	0.5	-	0
	Ballynagran (2)	-	-	3	-	2	-	3
	Installed Wind	-	-	106.1	-	123.2	-	144.6
	South-East Area Total		310.0	522.0	310.0	437.8	310.0	511.6
	Aghada CCGT	ADC	-	350	-	350	-	361
	Aghada	AT11	-	-	-	-	-	-
	Aghada	AT12	-	-	-	-	-	-
	Aghada	AT14	-	-	-	-	-	-
	Lee Carrigadrohid Hydro	LE1	-	4	-	8	-	8
	FMC Gas Turbine Ext.	-	-	2	-	2	-	1.2
	Carbery Milk Products CHP	-	-	-	-	-	-	6
	Whitegate CCGT	WG	320	350	449	300	300	317
	Lee Inniscarra Hydro (1)	LE2	-	10	-	15	-	14
South-	Lee Inniscarra Hydro (2)	LE3	-	4	-	4	-	14
West	Meelshane Solar	-			-	-	-	-
	Marina	MRT	-	-	-	-	-	-
	Tarbert (1)	TB1	-	-	-	-	-	-
	Tarbert (2)	TB2	-	-	-	-	-	-
	Tarbert (3)	TB3	-	-	-	-	-	-
	Tarbert (4)	TB4	-	-	-	-	-	-
	Adambridge Manufacturers	-	-	3	-	2	-	3
	Cahernagh Mid Merit	-					-	-
	Installed Wind	-	-	312	-	429.3	-	490
	South-West Area Total		320.0	1035.0	449.0	1110.3	300.0	1214.2

Table D-6 Dispatch Profiles – Ireland Short Circuit

Area	Generation Station	Unit	Unit 2017		2020		2023	
		ID	SV	WP	SV	WP	SV	WP
	AMETS Belmullet (1)	-			-	8	-	10
	West Offaly Power	WO4	100	100	80	120	81	117
	Tynagh	TY1	-	-	200	-	220	-
	Tynagh	TY2	-	-	-	120	-	-
West	Tawnaghmore Peaking Plant	TP1	-	-	-	-	-	-
West	Tawnaghmore Peaking Plant	TP3	-	-	-	-	-	-
	Mayo Renewable Power Biomass CHP	MB1					-	45
	Installed Wind	-	-	141	-	230.8	-	274
	West Area Total		100.0	241.0	280.0	478.8	301.0	446.0

Table D-7 Dispatch Profiles – Northern Ireland Short Circuit

Generation Station	Unit ID	2017		20	20	2023	
		SV	WP	SV	WP	SV	WP
Ballylumford CCGT 10	B10	-	-	-	90	-	88
Ballylumford CCGT 20	B20	-	165	-	150	-	156
Ballylumford CCGT 21	B31	115	150	130	155	147	141
Ballylumford CCGT 22	B32	-	150	130	155	147	141
Ballylumford GT7	BGT1	-	-	-	-	-	-
Ballylumford GT8	BGT2	-	-	-	-	-	-
Ballylumford ST4	B4	-	98				
Ballylumford ST5	B5	-	-				
Coolkeeragh GT	C20	170	251	170	230	180	243
Coolkeeragh ST	C10	120	149	130	160	130	157
Kilroot 1	K1	114	170	114	130	110	138
Kilroot 2	K2	-	170		130	-	138
Kilroot auxiliary GT1	KGT1	-	-	-	-	-	-
Kilroot auxiliary GT2	KGT2	-	-	-	-	-	-
Kilroot auxiliary GT3	KGT3	-	-	-	-	-	-
Kilroot auxiliary GT4	KGT4	-	-	-	-	-	-
Moyle Interconnector	MW1	80	150	80	100	100	80
Installed Wind	-	-	319	-	360	-	390.3
Installed PV	-	-	-	-	-	-	-
Northern Ireland Area Total		599.0	1772.0	754.0	1660.0	814.0	1672.3

Table D-8 Dispatch Profiles – Power Flow Diagrams

Area	Generation Station	Unit ID	2017				2026		
			SV	SP	WP	SV	SP	WP	
	Clady Hydro	-			4		2	4	
	Erne Cliff Hydro (1)	ER1			10		5	10	
	Erne Cliff Hydro (2)	ER2			10		5	10	
Border	Erne Cathleen's Fall Hydro (3)	ER3			22		11	22	
	Erne Cathleen's Fall Hydro (4)	ER4			23		11	23	
	Meath Waste-Energy	IW1			20	17	17	17	
	Installed Wind	-	75	224	241	139	417	417	
	Border Area Total		75	224	330	156	468	503	
	Huntstown	HNC		175					
	Huntstown	HN2				194	290	400	
	Dublin Bay Power	DB1	270	360	350	161	290	384	
Dublin	North Wall	NW5							
Daban	Dublin Waste to Energy Facility	DW1	62		70	53	53	61	
	Poolbeg	PBC						177	
	Installed Wind	-	0.1	0.2	0.2	2	6	6	
	Dublin Area Total		332	535	420	410	639	1,028	
	Leixlip Hydro	-			4			4	
	Liffey Hydro (1)	LI1			15		7	15	
	Liffey Hydro (2)	LI2			15		8	15	
Mid-East	Liffey Hydro (4)	LI4			4		2	4	
	Turlough Hill	1,2,3,4	-120		280	-228	72	116	
	East West Interconnector	EW1	100	350	300	80	250	300	
	Installed Wind	-	8	24	24	12	35	35	
	Mid-East Area Total		-12	374	642	-136	374	489	

Table D-8 Dispatch Profiles – Power Flow Diagrams

Area	<b>Generation Station</b>	Unit	2017			2026			
		ID	SV	SP	WP	SV	SP	WP	
	Edenderry Power	ED1	85	130	130	119	119	119	
	Edenderry PCP	ED3							
	Edenderry PCP	ED5							
Midlands	Rhode PCP	RP1							
Midiands	Rhode PCP	RP2							
	Lough Ree Power	LR4	70	100	90				
	West Offaly Power	WO4	90	130	145				
	Installed Wind	-	16	48	52	20	59	59	
	Midlands Area Total		261	408	417	139	178	178	
	Ardnacrusha Hydro (1)	AA1			21		10	21	
	Ardnacrusha Hydro (2)	AA2			22		11	22	
	Ardnacrusha Hydro (3)	AA3			19		10	19	
	Ardnacrusha Hydro (4)	AA4			24		12	24	
Mid-West	Moneypoint (1)	MP1		280	283	113	187	281	
Miu-west	Moneypoint (2)	MP2		280	283		187	281	
	Moneypoint (3)	MP3	100	280	283		187	281	
	Aughinish	SK3	75		81	81	80	80	
	Aughinish	SK4	75		81	81	80	80	
	Installed Wind	-	54	161	215	102	306	306	
	Mid-West Area Total		304	1,001	1,312	377	1,070	1,395	
South-East	Great Island CCGT	GI4	300	329	400	248	290	400	
South-East	Installed Wind	-	31	93	106	44	133	133	
	South-East Area Total		331	422	506	292	423	533	

Table D-8 Dispatch Profiles – Power Flow Diagrams

Area	Generation Station	Unit		2017		2026			
		ID	SV	SP	WP	SV	SP	WP	
	Aghada CCGT	ADC	100	360	400	217	290	390	
	Aghada	AT11							
	Aghada	AT12							
	Aghada	AT14							
	Lee Carrigadrohid Hydro	LE1			8		4	8	
	Whitegate CCGT	WG	110	300	400	109	290	396	
	Lee Inniscarra Hydro (1)	LE2			15		7	15	
South- West	Lee Inniscarra Hydro (2)	LE3			4		2	4	
West	Marina	MRT							
	Tarbert (1)	TB1							
	Tarbert (2)	TB2							
	Tarbert (3)	TB3							
	Tarbert (4)	TB4							
	Cahernagh Mid Merit	-							
	Installed Wind	-	76	219	312	167	502	502	
	South-West Area Total		286	879	1,139	493	1,095	1,315	
	Tynagh	TY1		130	260			157	
	Tynagh	TY2						110	
	Tawnaghmore Peaking Plant	TP1							
West	Tawnaghmore Peaking Plant	TP3							
	Mayo Renewable Power Biomass CHP	MB1							
	Installed Wind	-	44	140	141	91	274	274	
	West Area Total		44	270	401	91	274	541	

Table D-8 Dispatch Profiles – Power Flow Diagrams

Area	Generation Station	Unit		2017			2026	
		ID	SV	SP	WP	SV	SP	WP
	Ballylumford CCGT 10	B10		115	150			
	Ballylumford CCGT 20	B20			100	47	136	146
	Ballylumford CCGT 21	B31	120	130	140	68	136	146
	Ballylumford CCGT 22	B32		130	140		136	156
	Ballylumford GT7	BGT1						
	Ballylumford GT8	BGT2						
	Ballylumford ST4	B4			120			
	Ballylumford ST5	B5						
	Coolkeeragh GT	C20	199	230	250	173	243	243
Northern	Coolkeeragh ST	C10	130	130	150	97	146	156
Ireland	Biomass Maydown					17	17	17
	Biomass Rosebank					9	9	9
	Kilroot 1	K1	130	150	140			
	Kilroot 2	K2		150	140			
	Kilroot auxiliary GT1	KGT1						
	Kilroot auxiliary GT2	KGT2						
	Kilroot auxiliary GT3	KGT3						
	Kilroot auxiliary GT4	KGT4						
	Moyle Interconnector	MW1	100	150	150	80	100	150
	Installed Wind		105	315		130	391	391
	Northern Ireland Area Tota	il	784	1,500	1,480	621	1,314	1,414







# Appendix E Short Circuit Currents

## E.1. Background of Short Circuit Currents

The main driver for calculating short circuit current levels is safety. All transmission system equipment must be capable of carrying very high currents. These high currents typically occur in the event of a short circuit fault. In particular, circuit breakers must be capable of closing onto a fault and opening to isolate a fault.

Their correct operation minimises risk to human life and prevents damage to transmission system equipment. It is also crucial for maintaining transmission system stability, security and quality of supply.

Short circuit current levels also give an indication of the electrical strength of the transmission system at each station. This provides an indication of the suitability of a station for connection of 'voltage sensitive' equipment.

A station with a high short circuit current level will be more attractive to these types of load. This is due to strong generation infeeds minimising distortions in voltage and frequency caused by transmission system disturbances. Similarly, generators will have less difficulty to ride through faults and maintain stability when connected to stations with high short circuit current levels.


Short circuit current levels vary across the transmission system. They are affected by the transmission system topology, system impedance and the available short circuit contribution from rotating machines (i.e. generators and large motors). Changes in the transmission system topology or the addition/retirement of generation units can bring about an increase/reduction in the short circuit current levels on the transmission system. Similarly, seasonal variations in generation dispatches and demand levels combined with possible transmission system sectionalising or plant outages will result in variations of short circuit current levels at different locations. To ensure safe and reliable operation of the transmission system and customer's equipment at all times, two types of short circuit current level calculations are carried out:

- Maximum short circuit current levels are required for the specification of transmission system equipment and for connections to the transmission system. Plant in substations is typically subjected to the most onerous short circuit currents. The high capital costs of HV equipment means that it is important to predict the maximum short circuit current the equipment may see in its lifetime, and this must be specified to a rating above the maximum expected short circuit current level. Also, for customers, the design and specification of equipment at lower voltage levels will depend on the short circuit level at the transmission connection point.
- Minimum short circuit current levels are required to guarantee reliable and coordinated operation of
  protection systems or to assess the suitability of a station for the connection of 'voltage sensitive'
  equipment. Minimum short circuit current levels are also required at the design stage of generation
  plants to ensure fault ride through capabilities are in accordance with Grid Code requirements.

#### E.1.1. The Nature of Short Circuit Currents

The plot in Figure E1 shows a typical short circuit current waveform. Short circuit current is normally made up of a symmetrical AC component, with a decay rate, and a DC offset component, which has a much faster decay rate. The combination of AC and DC components results in an asymmetrical current waveform.

While the AC component is always present in the short circuit current, the DC offset is dependent on the instant that the fault occurs within the voltage waveform. For the purposes of this document, it is assumed that the fault occurs at the instant of maximum DC offset in the short circuit current.

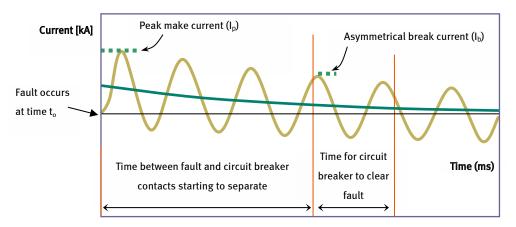

**Figure E-1 Typical Short Circuit Current** 

The DC component of a short circuit current decays exponentially. Its rate of decay is influenced by the individual ratios of the reactance (X) to the resistance (R) of the paths back to the generators feeding power to the fault (the X/R ratio). Transmission nodes where large generators can have high X/R ratios, which may result in a slower decay time for the DC component of the short circuit current.

The AC component of a short circuit current also decays with time. This is due to the changes in the synchronous generators internal reactance and, thus, the AC reduction effect is more pronounced in the vicinity of large generation plants. The internal impedance of a synchronous generator is not constant after the start of the fault. It increases progressively and the short circuit current contribution becomes weaker, passing through three characteristic stages:

- Subtransient: (approx. 0.01 to 0.1 sec). Short-circuit current (RMS value of the AC component) is high: 5 to 10 times permanent rated current. This is called sub-transient short-circuit current, I<sub>\(\beta\)</sub>".
- Transient: (between 0.1 and 1 sec). Short-circuit current (RMS value of the AC component) drops to between 2 and 6 times rated current. This is called transient short-circuit current, I<sub>k</sub>'.
- Continuous: Short-circuit current (RMS value of the AC component) drops to between 0.5 and 2 times rated current. This is called steady-state short-circuit current, I<sub>k</sub>.

## E.1.2. Duty of Circuit Breakers

Over the duration of a fault the switchgear has to be able to withstand two events, namely the fault initiation and then the fault clearance. The short circuit currents at these two instances are referred to as the Make current and the Break current respectively.

- i. The make current (Ip) is the maximum instantaneous current that the circuit breaker is called to withstand. The initiation of a fault causes an instantaneous peak current which results in the generation of electromechanical forces along the busbars and transmission lines. An example of such a fault initiation would be a circuit breaker energising a line that is still earthed following maintenance, hence the term Make Current.
  - Make current is expressed in peak values and is comprised of an AC and a DC component. Essentially, the make current is the maximum instantaneous peak of the short circuit current waveform, and this will occur at approximately 10 milliseconds (ms) after the instant of fault (see Figure E1), whether the fault is energised through a circuit breaker or it spontaneously occurs on the transmission system. Circuit breakers are typically rated approximately 2.5 times higher for make duty than for break duty, as per IEC 62271-100 standard.
- ii. After the fault initiation, there is a time period during which the protection scheme will identify the fault, make a decision and then instruct the relevant circuit breaker to open to interrupt the fault. This could take anything from 10 ms in modern fast protection systems to 60 ms in older systems. At this point the circuit breaker begins to open and it takes a certain time period before the contacts actually separate, normally around two cycles or 40 ms in modern switchgear equipment. The total time from the start of the fault until the breaker opening or fault clearance time can vary from 50 ms to 120 ms, depending on the protection system. In some cases; if main protection fails and back-up main protection is not installed; clearance times can be considerably longer than 120 ms.

At the point of physical separation, the short circuit current forms an arc and the thermal energy generated by this arc has to be dissipated as the short circuit current is interrupted. The short circuit current when this interruption occurs is referred to as the Break Current, Ib. This value is expressed in RMS (root mean square) terms and is comprised of an AC component and a DC component. Circuit breakers designed and tested in accordance with the IEC 62271-100 standard can interrupt any short circuit current up to its rated breaking current containing any AC component up to the rated value and, associated with it, any percentage DC component up to that specified (typically 30%).

The duty of the circuit breaker is calculated from the make and break current as a percentage of the circuit breaker rating.

## E.2. Short Circuit Current Calculation Methodology

Engineering Recommendation G74 has been applied to all short circuit studies reported in this document. Some of the general assumptions applied include:

- Short circuit level contribution from loads has been considered following G74 recommendations. The demand at each node is assumed to contribute 1 MVA of induction motor fault infeed per MW of load. A constant X/R ratio of 2.76 is assumed for all of the loads,
- A break time of 50 ms is assumed typical for the circuit breakers at 110 kV, 220 kV, 275 kV and 400 kV.

**Winter Peak** study results give an indication of the maximum prospective short circuit current levels on the transmission system. For winter peak studies, all generators have been included in the calculations. A merit order economic dispatch has been used and to enable maximum short circuit current level to be calculated, any generators that were not dispatched have been switched in with 0 MW output, thus contributing to short circuit current levels.

**Summer Night Valley** study results give an indication of the minimum short circuit current levels to be expected on the transmission system under normal transmission system operating conditions (i.e. maintenance outages are not considered in this section<sup>125</sup>). For summer night valley studies, only generators dispatched on a merit order are considered in the model.

#### E.3. Short Circuit Currents in Ireland

### E.3.1. Methodology Used in Ireland

Short circuit current levels are calculated in accordance with the UK Engineering Recommendation G74, which is a computer based analysis, based on the International Standard IEC60909. Compliance with G74 includes:

- Short circuit contributions from rotating plant, including induction motors embedded in the general load.
- Comprehensive plant parameters including impedances, transformer winding and earthing configurations,
- Pre-fault voltage levels at each node which should be obtained from a credible, pre-fault load flow study,
- Pre-fault transformer tap settings should also be obtained from the load flow study.

The short circuit current level network model includes the following component parameters:

- Transformer impedance variation with tap position,
- Zero sequence mutual coupling effect,
- Saturated generator reactance values,
- Power station auxiliaries short circuit current level contributions.

The calculation of the X/R ratios, used by EirGrid, is undertaken in accordance with IEC60909-0 Method B. Method B is currently considered to be the most appropriate general purpose method for calculating DC short circuit currents in the transmission system of Ireland. The use of this calculation method is currently under review by EirGrid.

The transmission system of Ireland is designed and operated to maintain RMS break short circuit levels in accordance with EirGrid Grid Code CC.8.6. A summary of these requirements is set out in Table E-1. In designing the system, a 10% safety margin is applied.

It should be noted that the EirGrid Grid Code stipulates that short circuit current levels at designated stations, in Ireland may be allowed to increase to 31.5 kA. If necessary, the equipment at these stations is to be modified or replaced in order to comply with this new rating. The stations currently designated for operation of the 110 kV equipment up to 31.5 kA are: Barnahely, Cloghran, College Park, Corduff, Finglas, Kilbarry, Knockraha, Louth, Marina, Raffeen, Tarbert and Trabeg. EirGrid will annually publish an updated list of designated stations.

<sup>125</sup> Minimum fault levels including maintenance outages are currently provided to generator applicants wishing to connect to the transmission system as part of the connection offer process to allow developers to design the plant in accordance with the Grid Code requirements.

Circuit breakers with a higher rating than the current levels may be necessary for a number of reasons, including, but not limited to the need to provide an adequate safety margin or to cater for a high DC component in the short circuit current.

Table E-1 Ireland Station Equipment Rating Range by Voltage Level

	Voltage Level (kV)	Standard Equipment Short Circuit Current Rating (kA)
	400	50
	220	40
110	Outside the Dublin Area	25
110	Designated sites	31.5

### E.3.2. Analysis

The generation dispatches used in the short circuit analysis are shown in Table D-6 in Appendix D.

The total RMS break current at a busbar is an indication of the short circuit level that one could expect at that point in the transmission system. However, they do not necessarily represent the short circuit current that could flow through each individual breaker, which may be lower.

#### E.3.3. Ireland Short Circuit Currents Level Results

Tables E-2 to E-4 list subtransient ( $I_k$ "), transient ( $I_k$ ") currents and X/R ratios for single-phase to earth and balanced three-phase faults for transmission system busbars of Ireland. These are presented for maximum winter peak and minimum summer valley intact system demand conditions for 2017, 2020 and 2023. From these values, the relevant currents required to assess circuit breaker duty can be derived using the following equations:

Peak Make current (I<sub>D</sub>)

$$I_p = \sqrt{2} \cdot \left[ 1.02 + 0.98 \cdot e^{-3 \cdot \frac{R}{X}} \right] \cdot I_k''$$

• AC component  $(I_{RMS\_AC\_b})$  of short-circuit current at a selected time of break  $(t_b)$ 

$$I_{RMS\_AC\_b} = I_k' + (I_k'' - I_k') \cdot e^{-\frac{t_b}{40ms}}$$

• DC component  $(I_{DC_b})$  of short-circuit current at a selected time of break  $(t_b)$ 

$$I_{DC_b} = \sqrt{2} \cdot I_k'' \cdot e^{-2 \cdot \pi \cdot 50t_b \cdot \frac{R}{X}}$$

Break current (I<sub>b</sub>) at a selected time of break (t<sub>b</sub>)

$$I_b = \sqrt{I_{DC\ b}^2 + I_{RMS\ AC\ b}^2}$$

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sur	nmer					Wir	nter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Agannygal 110 kV	2.83	4.63	4.46	3.88	4.01	3.97	2.97	6.43	5.76	4.25	4.94	4.79
Aghada 110 kV	5.13	7.33	6.81	6.01	8.76	8.50	4.58	10.05	9.54	5.65	11.32	11.10
Aghada A 220 kV	8.88	7.79	7.00	9.60	10.22	9.73	12.29	18.44	16.42	13.52	20.60	19.67
Aghada B 220 kV	11.66	8.92	7.88	11.14	11.49	10.86	13.12	17.75	15.85	11.33	20.05	19.16
Aghada C 220 kV	8.82	7.67	6.90	9.24	10.05	9.57	11.91	17.86	15.95	12.05	20.03	19.15
Aghada D 220 kV	8.82	7.67	6.90	9.24	10.05	9.57	11.91	17.86	15.95	12.05	20.03	19.15
Ahane 110 kV	5.39	9.89	9.03	6.01	8.79	8.55	5.01	14.62	13.53	5.89	11.06	10.84
Anner 110 kV	3.87	5.74	5.39	4.39	4.41	4.33	4.01	7.29	6.76	4.53	5.04	4.95
Ardnacrusha 110 kV	5.97	10.56	9.53	7.07	12.14	11.65	6.51	18.07	16.12	8.20	17.79	17.11
Arigna 110 kV	3.75	5.91	5.63	4.72	4.75	4.69	3.85	8.22	7.45	5.01	5.62	5.49
Arklow 110 kV	10.68	7.32	6.97	11.45	8.98	8.80	10.91	9.44	8.77	11.74	11.05	10.73
Arklow 220 kV	9.23	6.78	6.40	10.55	6.45	6.33	8.93	8.48	8.06	10.38	7.55	7.44
Artane 110 kV	13.43	10.44	9.69	6.12	12.52	12.14	13.32	13.11	11.95	5.71	15.16	14.60
Arva 110 kV	3.83	7.80	7.30	4.84	6.33	6.22	3.82	10.08	9.16	5.07	7.40	7.23
Athea 110 kV	6.71	5.84	5.54	7.87	6.39	6.27	8.32	11.62	10.39	9.11	11.24	10.82
Athlone 110 kV	4.48	7.14	6.69	5.80	5.50	5.41	4.10	8.42	7.81	5.55	5.96	5.85
Athy 110 kV	3.32	5.46	5.23	4.47	4.59	4.53	3.11	6.59	6.21	4.34	5.22	5.14
Aughinish 110 kV	9.21	8.68	7.61	11.18	9.69	9.21	7.90	10.86	9.79	9.90	11.30	10.89
Ballybeg 110 kV	10.27	5.48	5.24	10.61	6.49	6.38	10.37	6.60	6.23	10.72	7.55	7.38
Ballydine 110 kV	3.97	6.41	6.03	3.74	5.28	5.19	3.99	7.96	7.44	3.74	6.00	5.90
Ballylickey 110 kV	2.74	2.50	2.41	3.86	1.71	1.69	2.93	3.71	3.51	4.09	2.11	2.09
Ballynahulla 110 kV	7.73	7.89	7.36	9.05	8.42	8.21	13.13	11.24	10.05	12.28	11.00	10.58
Ballynahulla 220 kV	6.76	5.82	5.37	7.29	6.93	6.70	7.00	10.71	9.78	7.35	11.15	10.78
Ballyvouskill 110 kV	10.79	7.10	6.68	11.14	8.49	8.28	12.59	11.71	10.55	12.38	12.52	12.04
Ballyvouskill 220 kV	6.74	6.15	5.64	7.37	7.79	7.50	6.61	11.84	10.74	7.42	13.38	12.87
Ballywater 110 kV	4.67	4.87	4.72	3.33	5.18	5.12	4.66	6.14	5.80	3.20	6.04	5.92
Baltrasna 110 kV	6.41	9.29	8.67	7.43	7.43	7.29	5.92	10.92	10.34	7.16	8.26	8.14
Bancroft 110 kV	14.14	7.61	7.02	9.15	8.10	7.86	13.87	8.98	8.25	8.83	9.23	8.95
Bandon 110 kV	3.35	5.03	4.68	4.30	5.19	5.06	3.05	7.32	6.74	4.22	6.69	6.52
Banoge 110 kV	6.18	5.31	5.13	6.90	4.90	4.84	6.00	6.45	6.12	6.81	5.52	5.43
Barnahealy A 110 kV	5.46	9.54	8.68	6.00	10.42	10.05	4.50	14.29	13.22	5.32	13.96	13.60
Barnahealy B 110 kV	7.36	9.25	8.43	7.76	10.02	9.67	6.52	14.07	12.96	7.21	13.53	13.16
Barnakyle 110 kV	2.89	4.66	4.46	4.14	4.16	4.11	2.74	5.37	5.04	4.08	4.46	4.38
Baroda 110 kV	4.25	7.44	6.96	5.03	8.68	8.46	3.99	9.32	8.68	4.86	10.33	10.06
Barrymore 110 kV	4.04	6.54	6.13	4.98	4.23	4.17	3.74	8.89	8.40	4.93	4.92	4.87
Belgard 110 kV	-	-	-	-	-	-	12.08	13.61	12.46	6.62	16.32	15.73
Bellacorick A 110 kV	2.84	2.92	2.81	3.56	3.19	3.15	3.78	4.49	4.11	4.88	4.32	4.20

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sur	nmer					Wir	ıter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Binbane 110 kV	3.19	3.41	3.26	4.30	3.38	3.34	3.41	5.15	4.63	4.96	4.32	4.19
Blackrock 110 kV	10.88	10.03	9.22	2.79	10.24	9.95	9.96	14.06	12.59	2.40	12.83	12.40
Blake 110 kV	4.17	7.17	6.76	5.11	5.08	5.00	3.95	8.80	8.27	5.03	5.73	5.65
Boggeragh 110 kV	6.31	5.54	5.25	7.46	6.17	6.04	6.66	8.77	8.09	7.89	8.62	8.38
Booltiagh 110 kV	4.80	3.58	3.45	6.45	3.36	3.32	6.49	8.12	7.55	8.20	6.44	6.31
Brinny A 110 kV	3.22	4.60	4.31	4.18	4.38	4.29	2.94	6.48	6.01	4.09	5.46	5.34
Brinny B 110 kV	3.22	4.61	4.32	4.18	4.41	4.32	2.94	6.51	6.04	4.09	5.50	5.38
Butlerstown 110 kV	6.18	9.17	8.62	5.84	9.52	9.31	5.52	11.36	10.53	5.40	11.13	10.85
Cabra 110 kV	12.42	10.10	9.39	4.97	11.28	10.97	12.19	12.63	11.53	4.63	13.47	13.03
Cahir 110 kV	3.92	7.04	6.54	4.89	6.08	5.95	4.57	10.25	9.29	5.71	7.45	7.27
Carlow 110 kV	5.33	7.25	6.90	6.07	7.99	7.84	5.28	9.40	8.65	6.10	9.66	9.38
Carrickmines 220 kV	14.53	14.85	13.00	9.73	18.32	17.27	13.96	22.07	19.58	8.45	25.37	24.14
Carrickmines A 110 kV	28.41	10.72	9.92	22.71	11.88	11.54	31.65	13.11	12.08	23.57	13.94	13.53
Carrickmines B 110 kV	21.88	8.11	7.47	18.49	8.72	8.46	22.51	9.66	8.85	18.54	10.01	9.70
Carrick-on-Shannon 110 kV	4.37	9.39	8.72	5.03	10.44	10.15	4.14	13.01	11.73	4.99	13.26	12.78
Carrigadrohid 110 kV	6.57	8.64	7.93	7.23	8.22	7.99	6.23	14.14	12.94	6.91	11.52	11.23
Carrowbeg 110 kV	2.61	2.37	2.27	3.51	2.27	2.24	2.72	3.03	2.78	3.77	2.67	2.60
Cashla 110 kV	6.88	11.97	10.93	7.23	15.52	14.90	7.47	18.96	17.17	7.85	22.85	21.93
Cashla 220 kV	7.94	7.49	6.95	8.84	8.31	8.08	8.42	12.40	11.62	9.58	11.91	11.65
Castlebar 110 kV	2.95	3.87	3.67	3.72	4.21	4.12	3.41	5.74	5.05	4.51	5.63	5.39
Castledockrill 110 kV	6.90	6.35	6.12	4.94	7.76	7.64	6.92	8.16	7.69	4.70	9.29	9.07
Castlefarm A 110 kV	8.31	8.40	7.39	9.74	9.08	8.64	7.12	10.44	9.44	8.64	10.50	10.14
Castlefarm B 110 kV	8.33	8.39	7.38	9.75	9.07	8.63	7.13	10.42	9.42	8.66	10.49	10.13
Castleview 110 kV	4.60	9.48	8.65	4.95	7.71	7.52	3.76	14.06	13.03	4.51	9.63	9.46
Cathaleen's Fall 110 kV	4.26	6.22	5.84	4.90	7.13	6.96	5.41	11.74	9.93	6.39	10.93	10.34
Cauteen 110 kV	3.34	5.74	5.43	4.33	3.83	3.78	5.86	9.29	8.50	6.73	5.15	5.06
Central 110 kV	14.55	9.86	9.17	7.90	10.71	10.42	14.40	11.93	11.04	7.56	12.43	12.09
Charleville 110 kV	4.58	6.84	6.41	5.91	6.14	6.01	4.81	7.64	6.95	6.56	6.46	6.28
Cherrywood 110 kV	10.59	9.18	8.56	7.71	9.47	9.24	10.21	10.96	10.19	7.41	10.85	10.59
City West 110 kV	6.25	7.20	6.64	6.15	5.54	5.42	5.95	8.51	7.71	5.99	6.11	5.96
Clahane 110 kV	4.62	6.86	6.41	5.28	6.75	6.60	3.57	5.72	5.09	4.60	5.30	5.11
Clashavoon 220 kV	7.59	6.26	5.74	8.11	7.38	7.12	7.46	12.08	10.96	8.33	13.22	12.73
Clashavoon A 110 kV	7.79	9.53	8.71	8.75	11.00	10.61	8.01	17.90	16.05	8.32	21.59	20.63
Clashavoon B 110 kV	7.79	9.53	8.71	8.75	11.00	10.61	8.01	17.90	16.05	8.32	21.59	20.63

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sun	nmer					Wir	iter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Cliff 110 kV	4.02	5.09	4.84	4.95	5.28	5.18	4.71	8.59	7.55	6.05	7.20	6.93
Cloghboola 110 kV	4.87	5.62	5.32	5.28	6.59	6.45	5.38	9.12	7.88	6.03	9.27	8.80
Clogher 110 kV	3.91	5.20	4.92	4.27	6.02	5.89	4.94	9.94	8.13	5.35	9.40	8.77
Cloghran 110 kV	9.48	17.12	15.04	9.74	19.67	18.67	8.64	21.70	19.59	9.07	23.70	22.80
Clonee 220 kV	-	-	1	-	-	-	12.61	21.91	19.74	10.65	21.16	20.41
Clonkeen A 110 kV	5.81	4.95	4.69	6.87	3.84	3.79	5.57	6.51	6.11	6.75	4.53	4.46
Clonkeen B 110 kV	5.45	5.73	5.44	4.71	6.87	6.73	5.74	9.29	8.29	4.54	10.03	9.60
Cloon 110 kV	4.41	6.50	6.14	5.71	5.87	5.77	4.26	8.42	7.82	5.79	6.92	6.78
College Park 110 kV	9.13	16.27	14.42	6.45	19.11	18.19	8.32	20.47	18.63	5.82	23.11	22.27
Cookstown 110 kV	8.82	5.95	5.59	7.16	5.15	5.06	8.49	6.86	6.42	6.97	5.71	5.60
Coolroe 110 kV	5.55	7.66	7.09	6.74	7.72	7.52	5.02	11.40	10.55	6.56	10.00	9.76
Coomagearlahy 110 kV	5.39	4.69	4.50	5.79	5.69	5.59	6.08	7.66	6.70	6.54	8.42	8.00
Cordal 110 kV	-	-	-	-	-	-	10.50	9.60	8.66	8.20	8.10	7.86
Corderry 110 kV	3.70	6.09	5.79	4.62	6.21	6.10	4.14	9.57	8.34	5.42	7.96	7.65
Corduff 110 kV	10.35	18.42	16.11	11.20	21.93	20.74	9.47	23.75	21.35	10.50	27.02	25.91
Corduff 220 kV	15.91	15.73	13.81	14.47	19.47	18.39	15.88	26.22	23.04	13.70	29.69	28.17
Corkagh 110 kV	15.89	11.26	10.06	9.65	13.55	12.93	15.84	13.84	12.28	9.22	16.10	15.34
Corraclassy 110 kV	4.37	5.73	5.38	5.40	4.70	4.62	4.37	7.11	6.65	5.58	5.24	5.16
Cow Cross 110 kV	5.01	9.54	8.69	5.22	8.77	8.51	4.10	14.29	13.21	4.68	11.29	11.05
Crane 110 kV	6.50	6.88	6.59	6.56	7.54	7.42	6.63	9.15	8.40	6.57	9.16	8.90
Cromcastle A 110 kV	12.23	9.74	8.82	7.57	10.94	10.52	11.96	12.38	10.98	7.15	13.17	12.60
Cromcastle B 110 kV	12.23	9.74	8.82	7.57	10.94	10.52	11.96	12.38	10.98	7.15	13.17	12.60
Crory 110 kV	17.74	11.06	9.92	10.80	12.71	12.17	17.94	13.57	12.08	10.42	14.97	14.32
Cullenagh 110 kV	8.26	11.18	10.41	8.73	13.19	12.81	7.28	14.28	13.19	7.91	16.06	15.57
Cullenagh 220 kV	9.23	8.00	7.52	9.40	8.25	8.06	8.08	10.05	9.57	8.56	9.77	9.61
Cunghill 110 kV	3.05	4.11	3.95	3.52	4.14	4.08	3.25	6.08	5.60	3.82	5.29	5.16
Cushaling 110 kV	5.93	7.17	6.46	7.02	8.85	8.46	7.84	11.08	9.79	9.72	12.14	11.58
Dallow 110 kV	3.54	4.86	4.66	4.67	3.05	3.02	3.52	5.79	5.44	4.72	3.39	3.35
Dalton 110 kV	3.00	3.54	3.38	4.07	3.14	3.09	3.35	4.99	4.49	4.67	3.78	3.68
Dardistown 110 kV	15.40	9.86	8.92	12.19	11.33	10.89	15.61	12.57	11.15	11.95	13.73	13.12
Derrybrien 110 kV	2.68	3.67	3.56	3.75	3.59	3.55	3.00	5.18	4.55	4.45	4.57	4.39
Derryiron 110 kV	5.08	5.58	5.33	6.17	6.17	6.06	6.34	8.12	7.51	7.87	7.98	7.78
Doon 110 kV	4.11	6.23	5.83	4.52	4.93	4.84	4.35	8.07	7.44	4.72	5.70	5.59
Dromada 110 kV	5.63	5.62	5.34	5.07	5.99	5.88	5.88	10.90	9.77	4.44	10.16	9.81
Drumkeen 110 kV	3.54	4.73	4.48	4.20	4.97	4.87	4.00	8.41	7.08	5.02	7.11	6.75
Drumline 110 kV	3.58	6.41	6.00	4.65	5.84	5.72	3.26	9.27	8.57	4.60	7.25	7.10

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sur	nmer					Wir	ıter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Drybridge 110 kV	5.85	11.69	10.71	6.69	10.13	9.87	5.24	14.72	13.55	6.33	11.77	11.50
Dundalk 110 kV	3.81	7.80	7.35	4.76	7.28	7.15	3.42	9.41	8.72	4.47	8.34	8.15
Dunfirth 110 kV	4.74	5.64	5.40	6.31	4.59	4.53	4.63	6.61	6.35	6.32	5.04	4.99
Dungarvan 110 kV	6.07	5.51	5.26	7.75	4.73	4.66	5.81	6.90	6.44	7.70	5.45	5.35
Dunmanway 110 kV	3.45	4.85	4.55	4.55	4.62	4.53	4.14	9.26	8.45	5.46	7.56	7.37
Dunstown 220 kV	12.89	15.04	13.36	11.81	14.85	14.24	10.85	20.71	19.02	10.37	18.74	18.24
Dunstown 400 kV	21.86	4.44	4.19	15.28	3.90	3.83	19.63	5.81	5.62	13.52	4.72	4.68
Ennis 110 kV	4.46	7.60	7.06	5.63	7.52	7.33	5.09	13.71	12.13	6.64	11.00	10.63
Fassaroe East 110 kV	6.50	5.68	5.34	6.37	4.53	4.46	6.20	6.58	6.13	6.21	5.01	4.92
Fassaroe West 110 kV	6.69	5.77	5.42	6.51	4.65	4.57	6.38	6.68	6.23	6.34	5.14	5.05
Finglas 220 kV	15.46	14.97	13.18	14.86	19.06	17.99	17.01	25.79	22.54	15.33	30.06	28.42
Finglas A 110 kV	28.46	11.20	10.07	26.86	12.71	12.19	35.25	14.73	12.91	30.56	15.73	14.97
Finglas B 110 kV	29.22	11.62	10.72	27.28	14.55	14.05	36.30	14.84	13.44	31.48	18.02	17.28
Flagford 110 kV	4.69	9.81	9.09	5.41	11.99	11.61	4.46	13.68	12.31	5.38	15.67	15.02
Flagford 220 kV	7.14	6.04	5.68	9.02	5.92	5.80	7.51	8.17	7.73	9.84	7.22	7.10
Francis Street A 110 kV	11.35	10.03	9.23	5.78	12.30	11.87	10.45	14.07	12.61	5.03	16.21	15.51
Francis Street B 110 kV	13.10	11.01	10.23	6.91	13.47	13.05	12.76	13.62	12.50	6.48	16.23	15.67
Galway 110 kV	4.90	9.41	8.69	4.54	11.56	11.17	5.07	14.34	13.02	4.50	16.13	15.53
Garrow 110 kV	8.60	6.85	6.45	8.93	8.23	8.03	9.61	11.31	10.17	9.68	12.17	11.69
Garvagh 110 kV	3.94	4.79	4.61	5.09	4.72	4.66	4.65	7.23	6.35	6.27	5.94	5.72
Gilra 110 kV	3.25	5.73	5.44	4.05	4.58	4.51	3.01	6.95	6.53	3.96	5.15	5.07
Glanagow 220 kV	12.01	9.19	8.09	12.19	11.89	11.22	13.55	18.36	16.34	13.07	20.85	19.89
Glanlee 110 kV	5.36	4.56	4.38	5.51	5.53	5.44	6.02	7.37	6.47	6.05	8.13	7.72
Glasmore A 110 kV	4.98	6.20	5.77	5.35	4.52	4.44	4.71	7.59	6.83	5.22	5.03	4.91
Glenlara A 110 kV	5.98	6.73	6.32	7.04	5.74	5.64	3.16	3.30	3.02	4.66	2.65	2.59
Glenlara B 110 kV	5.98	6.73	6.32	7.04	5.74	5.64	9.40	8.29	7.38	6.68	7.52	7.24
Glenree 110 kV	2.90	3.10	2.99	3.55	3.21	3.17	3.68	5.13	4.75	4.51	4.39	4.29
Glentanemacelligot 110 kV	-	-	-	-	-	-	8.22	6.97	6.49	8.15	5.26	5.17
Golagh 110 kV	3.59	4.54	4.33	4.05	4.56	4.48	3.99	7.87	6.66	4.58	6.31	6.01
Gorman 110 kV	6.93	12.49	11.40	7.79	14.01	13.53	6.10	15.86	14.56	7.14	16.86	16.34
Gorman 220 kV	9.65	9.74	8.93	10.30	8.44	8.22	8.48	12.47	11.82	9.60	9.88	9.74
Gortawee 110 kV	4.43	5.58	5.23	5.82	4.78	4.69	4.47	6.78	6.31	6.08	5.26	5.16
Grange 110 kV	13.12	9.94	8.99	4.62	10.44	10.06	12.96	12.73	11.25	4.27	12.47	11.95
Grange Castle 110 kV	15.99	11.57	10.33	10.71	14.46	13.76	15.95	14.31	12.66	10.27	17.35	16.47

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sun	nmer					Wir	ıter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Great Island 110 kV	7.97	11.15	10.44	8.74	14.56	14.14	6.92	13.97	12.89	7.74	17.69	17.08
Great Island 220 kV	12.45	10.38	9.69	13.84	12.54	12.19	10.52	12.70	11.98	11.98	14.61	14.27
Griffinrath A 110 kV	7.26	9.27	8.73	7.56	9.53	9.33	6.76	11.29	10.66	7.21	11.09	10.88
Griffinrath B 110 kV	8.46	9.90	9.29	8.55	10.61	10.37	7.92	12.16	11.45	8.15	12.48	12.22
Harolds 110 kV	11.52	10.06	9.25	5.48	12.27	11.84	10.64	14.10	12.64	4.75	16.14	15.45
Heuston 110 kV	14.11	11.21	10.40	8.28	13.84	13.41	13.86	13.90	12.74	7.82	16.76	16.16
Huntstown A 220 kV	14.74	14.47	12.79	13.24	18.43	17.43	16.26	24.82	21.78	13.13	28.96	27.42
Huntstown B 220 kV	15.76	14.82	13.13	12.01	18.37	17.41	15.10	23.29	20.77	10.49	26.75	25.53
Ikerrin 110 kV	5.19	4.13	3.92	6.00	3.19	3.15	5.77	5.75	5.24	6.48	3.82	3.74
Inchicore 220 kV	14.62	16.97	14.59	11.35	21.02	19.65	13.85	26.90	23.36	9.92	30.78	29.04
Inchicore A 110 kV	27.32	12.24	11.29	24.64	15.45	14.92	30.44	15.42	14.02	26.19	19.05	18.29
Inchicore B 110 kV	39.11	12.35	11.00	32.29	15.78	14.99	49.05	15.46	13.65	36.50	19.21	18.20
Inniscarra 110 kV	5.14	7.37	6.84	6.19	7.28	7.10	4.66	10.96	10.15	6.03	9.36	9.15
Irishtown 220 kV	15.31	16.06	13.89	12.53	20.22	18.94	15.31	25.05	21.88	11.48	29.24	27.62
Kellis 110 kV	6.39	7.78	7.39	7.35	9.34	9.15	6.17	9.95	9.20	7.24	11.39	11.05
Kellis 220 kV	8.21	7.10	6.73	9.94	6.23	6.13	7.67	8.60	8.24	9.58	7.12	7.04
Kilbarry 110 kV	7.53	12.92	11.41	8.08	14.57	13.87	7.06	24.11	20.96	7.92	22.68	21.65
Kilkenny 110 kV	3.03	4.67	4.49	4.25	4.29	4.24	2.97	5.64	5.23	4.28	4.80	4.70
Kill Hill 110 kV	4.52	4.94	4.66	5.55	4.57	4.48	5.71	7.64	6.84	6.87	5.94	5.76
Killonan 110 kV	6.75	12.99	11.55	7.83	15.04	14.34	6.97	22.09	19.72	8.57	22.27	21.40
Killonan 220 kV	7.82	7.33	6.70	9.61	7.64	7.39	7.77	12.05	11.33	10.26	10.69	10.49
Killoteran 110 kV	6.37	9.73	9.12	5.43	10.86	10.60	5.64	12.14	11.21	4.95	12.88	12.51
Kilmahud 110 kV	15.49	11.35	10.14	9.36	14.02	13.35	15.39	13.97	12.39	8.91	16.73	15.91
Kilmore 110 kV	14.92	10.16	9.16	9.73	11.47	11.01	15.05	13.04	11.50	9.33	13.92	13.28
Kilpaddoge 110 kV	-	-	-	-	-	-	9.74	21.65	19.36	10.59	25.24	24.12
Kilpaddoge 220 kV	-	-	-	-	-	-	12.62	20.58	18.41	11.81	23.50	22.46
Kilteel 110 kV	4.51	6.89	6.52	5.54	6.41	6.30	4.33	8.47	7.91	5.45	7.30	7.15
Kinnegad 110 kV	4.67	6.30	5.97	5.94	6.03	5.92	4.87	8.12	7.63	6.36	7.08	6.95
Knockacummer 110 kV	-	-	-	-	-	-	6.22	6.88	6.15	6.31	6.78	6.53
Knockanure 110 kV	5.95	7.63	7.10	6.29	7.39	7.21	5.88	13.32	11.99	6.10	10.22	9.93
Knockanure 220 kV	7.36	5.86	5.42	8.00	7.00	6.77	8.07	13.70	12.51	5.86	16.29	15.68
Knockearagh 110 kV	5.47	4.68	4.42	7.13	4.20	4.13	5.37	6.11	5.57	7.25	5.00	4.87
Knocknagoshel 110 kV	4.87	5.62	5.32	5.28	6.59	6.45	5.38	9.12	7.88	6.03	9.27	8.80
Knockraha A 110 kV	8.77	13.91	12.28	9.37	15.12	14.42	8.08	24.84	22.05	9.03	22.64	21.79
Knockraha A 220 kV	10.16	9.42	8.34	10.51	11.34	10.76	10.71	20.07	17.92	10.87	20.20	19.40
Knockraha B 110 kV	8.77	13.91	12.28	9.37	15.12	14.42	8.08	24.84	22.05	9.03	22.64	21.79

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sun	nmer					Wir	ıter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	nree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Knockraha B 220 kV	10.16	9.42	8.34	10.51	11.34	10.76	10.71	20.07	17.92	10.87	20.20	19.40
Knockranny 110 kV	5.27	6.09	5.77	4.92	7.96	7.78	6.10	8.73	8.20	5.33	10.86	10.58
Knockranny A 110 kV	5.27	6.09	5.77	4.92	7.96	7.78	6.10	8.73	8.20	5.33	10.86	10.58
Knockranny B 110 kV	3.99	4.29	4.10	2.77	3.57	3.53	3.90	5.21	4.92	2.67	3.95	3.89
Knockumber 110 kV	3.94	7.62	7.12	4.71	5.85	5.75	3.59	8.91	8.38	4.51	6.44	6.34
Lanesboro 110 kV	4.18	9.74	8.91	5.30	10.32	9.99	3.80	12.08	10.86	5.03	11.92	11.49
Letterkenny110 kV	3.84	5.44	5.10	4.45	6.35	6.19	4.37	10.06	8.34	5.42	9.75	9.14
Liberty A 110 kV	6.37	11.52	10.28	5.52	13.61	12.98	5.68	20.27	17.90	4.81	20.74	19.83
Liberty B 110 kV	6.28	11.51	10.27	5.38	13.58	12.96	5.57	20.24	17.88	4.65	20.67	19.77
Limerick 110 kV	5.58	11.61	10.34	6.27	11.77	11.30	5.17	18.64	16.69	6.16	16.02	15.50
Lisdrum 110 kV	2.89	4.66	4.46	4.14	4.16	4.11	2.74	5.37	5.04	4.08	4.46	4.38
Lisheen 110 kV	3.88	3.26	3.07	3.89	4.88	4.74	4.97	5.30	4.63	4.98	7.95	7.40
Lodgewood 110 kV	8.56	7.17	6.88	8.95	9.03	8.87	8.86	9.41	8.78	9.07	11.06	10.76
Lodgewood 220 kV	8.99	6.56	6.24	10.15	6.49	6.38	8.75	8.14	7.76	9.94	7.55	7.44
Longpoint 220 kV	8.76	7.70	6.92	9.13	10.05	9.57	12.00	18.14	16.18	11.88	20.11	19.23
Louth 220 kV	10.91	13.11	11.62	11.77	15.56	14.79	9.25	19.19	17.75	10.52	20.74	20.14
Louth A 110 kV	7.39	11.10	10.30	8.35	13.54	13.13	6.58	13.85	12.88	7.67	16.28	15.81
Louth B 110 kV	8.01	11.96	11.03	8.80	14.93	14.43	7.01	15.04	13.98	7.92	18.14	17.60
Macetown 110 kV	7.84	15.00	13.38	7.63	15.66	15.03	7.09	18.63	17.04	7.09	18.43	17.88
Macroom 110 kV	6.66	9.26	8.44	7.23	9.31	9.01	6.36	15.95	14.41	6.83	13.97	13.54
Mallow 110 kV	5.42	6.12	5.75	6.99	5.39	5.30	5.24	7.51	7.01	7.10	6.11	5.99
Marina 110 kV	7.31	12.42	10.99	8.05	14.84	14.10	7.05	23.07	20.07	8.21	23.57	22.41
Maynooth A 110 kV	11.12	11.41	10.62	11.74	14.08	13.66	10.59	14.31	13.38	11.30	17.14	16.67
Maynooth A 220 kV	11.32	14.19	12.59	10.69	13.96	13.39	9.59	19.57	17.91	9.51	17.55	17.07
Maynooth B 110 kV	8.89	15.14	13.68	10.10	14.99	14.48	7.87	18.66	17.40	9.35	17.51	17.12
Maynooth B 220 kV	11.84	15.80	13.91	10.94	15.66	14.97	9.69	22.86	20.79	9.50	20.37	19.77
McDermott 110 kV	16.20	10.76	9.96	6.23	12.61	12.22	16.53	13.60	12.33	5.81	15.29	14.72
Meath Hill 110 kV	4.14	7.92	7.45	5.24	6.77	6.65	3.86	9.78	9.09	5.12	7.71	7.56
Meentycat 110 kV	3.28	4.07	3.88	4.10	4.16	4.09	3.71	6.90	5.90	5.02	5.75	5.49
Midleton 110 kV	4.16	8.25	7.59	5.01	7.09	6.92	3.45	11.61	10.83	4.60	8.67	8.51
Milltown A 110 kV	15.20	10.73	9.83	7.48	13.33	12.84	14.87	15.34	13.67	6.57	17.92	17.10
Milltown B 110 kV	9.20	10.02	9.35	4.30	12.05	11.71	8.74	12.25	11.29	3.99	14.32	13.86
Misery Hill 110 kV	13.83	10.52	9.65	8.17	13.17	12.68	13.22	14.97	13.35	7.26	17.67	16.86
Moneteen 110 kV	5.76	9.11	8.24	6.49	7.37	7.16	5.32	12.43	11.47	6.30	8.75	8.58
Moneypoint 110 kV	3.33	2.17	2.12	4.48	1.55	1.54	14.64	10.05	9.50	14.93	9.54	9.37
Moneypoint 220 kV	8.27	5.22	4.89	8.05	6.15	5.99	16.30	16.49	15.43	13.23	18.52	18.04

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sun	nmer					Wir	ıter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Moneypoint G1 400 kV	19.78	4.93	4.58	17.82	5.46	5.31	23.99	10.22	9.58	25.21	11.12	10.86
Moneypoint G2 400 kV	13.04	1.90	1.82	13.41	2.39	2.34	44.92	4.60	4.38	39.09	5.14	5.05
Moneypoint G3 400 kV	19.78	4.93	4.58	17.82	5.46	5.31	23.99	10.22	9.58	25.21	11.12	10.86
Monread 110 kV	4.25	6.75	6.37	5.10	6.87	6.73	4.02	8.27	7.74	4.96	7.91	7.74
Mount Lucas 110 kV	4.43	4.25	3.98	5.61	4.11	4.02	5.02	5.98	5.54	6.51	5.13	5.02
Moy 110 kV	2.87	2.94	2.82	3.37	3.61	3.55	4.47	5.41	4.91	5.48	5.66	5.47
Mullagharlin 110 kV	3.93	7.94	7.48	4.92	7.79	7.64	3.52	9.45	8.85	4.61	8.84	8.66
Mullingar 110 kV	3.59	6.19	5.88	4.88	6.04	5.94	3.48	7.39	6.93	4.87	6.81	6.68
Mulreavy 110 kV	3.61	4.66	4.43	4.11	5.54	5.43	4.53	8.70	7.12	5.42	8.64	8.04
Mungret A 110 kV	5.44	8.72	7.91	6.17	6.89	6.70	4.97	11.73	10.86	5.97	8.10	7.96
Mungret B 110 kV	5.43	8.73	7.92	6.17	6.89	6.71	4.96	11.75	10.88	5.97	8.11	7.97
Nangor 110 kV	14.16	11.31	10.11	8.70	14.04	13.38	13.92	13.92	12.35	8.25	16.77	15.95
Navan 110 kV	5.87	11.08	10.18	6.57	11.10	10.78	5.24	13.88	12.77	6.14	13.03	12.69
Nenagh 110 kV	2.70	3.24	3.10	3.82	1.95	1.93	2.65	3.92	3.69	3.87	2.12	2.10
Newbridge 110 kV	4.52	8.51	7.88	5.20	8.55	8.32	4.26	11.12	10.22	5.07	10.29	10.01
Newbury 110 kV	14.10	10.08	9.09	7.34	11.14	10.71	14.08	12.91	11.39	6.91	13.45	12.85
North Kerry 220 kV	7.36	5.86	5.42	8.00	7.00	6.77	8.07	13.70	12.51	5.86	16.29	15.68
North Kerry A 110 kV	7.80	8.62	7.98	8.55	9.89	9.60	10.12	15.77	13.95	9.43	16.49	15.76
North Kerry B 110 kV	5.95	7.63	7.10	6.29	7.39	7.21	5.88	13.32	11.99	6.10	10.22	9.93
North Mayo 110 kV	2.84	2.92	2.81	3.56	3.19	3.15	3.78	4.49	4.11	4.88	4.32	4.20
North Quays 110 kV	18.02	10.92	9.99	7.00	13.35	12.86	18.59	15.69	13.96	6.11	17.93	17.11
North Wall 220 kV	14.35	13.77	12.24	9.68	16.17	15.39	15.20	23.15	20.45	8.49	24.13	23.03
Oldcourt A 110 kV	4.37	8.27	7.62	4.77	6.89	6.73	3.61	11.73	10.99	4.36	8.48	8.34
Oldcourt B 110 kV	4.41	8.31	7.66	4.80	6.96	6.79	3.65	11.81	11.07	4.38	8.57	8.43
Oldstreet 220 kV	13.19	6.81	6.44	11.88	8.01	7.83	15.58	11.36	10.75	12.48	11.96	11.73
Oldstreet 400 kV	15.79	5.34	4.98	11.24	5.49	5.36	16.91	8.53	8.14	10.17	7.78	7.67
Oughtragh 110 kV	3.75	3.94	3.76	4.78	2.77	2.74	3.64	4.82	4.41	4.80	3.03	2.97
Pelletstown 110 kV	13.74	10.17	9.46	7.94	11.04	10.75	13.71	12.72	11.62	7.57	13.18	12.76
Platin 110 kV	5.28	10.90	10.04	5.84	8.58	8.39	4.67	13.33	12.40	5.49	9.71	9.53
Pollaphuca 110 kV	2.77	2.39	2.35	3.98	2.23	2.22	3.30	3.13	3.00	4.72	2.60	2.57
Poolbeg A 110 kV	24.38	11.39	10.40	20.91	14.56	13.99	28.38	16.43	14.61	22.14	19.93	18.96
Poolbeg A 220 kV	15.00	13.85	12.30	8.43	15.46	14.74	16.06	23.29	20.58	7.14	22.68	21.71
Poolbeg B 110 kV	24.36	11.36	10.38	20.90	14.54	13.97	28.34	16.39	14.58	22.13	19.89	18.93
Poolbeg B 220 kV	14.02	15.93	13.80	10.74	18.62	17.52	13.42	24.85	21.78	9.54	26.43	25.13
Poolbeg C 110 kV	19.88	11.11	10.15	8.07	13.62	13.11	21.30	16.05	14.26	7.12	18.40	17.54

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sun	nmer					Wir	nter		
	Th	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Poppintree 110 kV	15.75	10.40	9.39	9.92	11.73	11.27	16.07	13.42	11.85	9.52	14.30	13.65
Portan 260 kV	24.11	8.11	7.59	89.32	2.92	2.89	23.69	11.37	10.95	106.96	3.13	3.12
Portan 400 kV	20.44	6.43	5.96	19.39	7.44	7.21	19.14	9.26	8.83	18.43	10.27	10.09
Portlaoise 110 kV	4.16	7.29	6.84	5.50	6.25	6.14	4.08	9.68	8.89	5.72	8.15	7.95
Pottery 110 kV	17.31	10.18	9.45	5.86	10.52	10.24	17.50	12.36	11.42	5.54	12.17	11.85
Prospect 220 kV	7.79	6.24	5.77	7.94	7.56	7.31	12.49	18.71	17.21	8.48	18.63	18.09
Raffeen 220 kV	11.10	8.94	7.90	11.13	11.59	10.95	11.86	19.18	17.03	11.36	21.57	20.56
Raffeen A 110 kV	6.59	10.75	9.69	7.25	13.18	12.60	5.55	17.03	15.57	6.47	19.08	18.43
Raffeen B 110 kV	8.93	10.41	9.39	9.61	12.79	12.24	8.40	16.74	15.22	9.36	18.73	18.05
Rathkeale 110 kV	3.62	5.71	5.33	4.74	4.93	4.83	3.43	8.13	7.60	4.78	6.08	5.98
Ratrussan 110 kV	3.14	5.76	5.50	3.91	6.58	6.46	3.70	8.08	6.92	4.85	8.38	7.92
Reamore 110 kV	4.36	5.64	5.31	3.54	5.32	5.22	4.52	7.39	6.48	3.56	6.22	5.98
Richmond A 110 kV	3.29	6.62	6.21	4.42	6.06	5.94	3.04	7.83	7.21	4.26	6.80	6.64
Richmond B 110 kV	3.29	6.62	6.21	4.42	6.06	5.94	3.04	7.83	7.21	4.26	6.80	6.64
Rinawade 110 kV	5.20	9.74	9.09	6.07	7.24	7.11	4.78	11.46	10.92	5.84	8.06	7.97
Ringaskiddy 110 kV	6.54	9.02	8.24	6.68	9.38	9.08	5.61	13.57	12.54	6.07	12.45	12.15
Ringsend 110 kV	24.34	11.38	10.38	21.62	14.57	13.99	28.89	16.61	14.70	23.45	20.13	19.12
Ryebrook 110 kV	5.95	13.11	11.70	6.65	12.06	11.63	5.32	15.61	14.38	6.21	13.52	13.19
Salthill 110 kV	4.93	8.73	8.09	4.00	10.57	10.24	5.09	12.89	11.75	3.83	14.32	13.82
Screeb 110 kV	3.61	2.34	2.25	2.85	2.42	2.39	3.54	2.68	2.51	2.79	2.64	2.58
Seal Rock A 110 kV	8.90	8.57	7.52	10.59	9.58	9.11	7.59	10.66	9.63	9.31	11.14	10.74
Seal Rock B 110 kV	8.93	8.57	7.52	10.61	9.59	9.11	7.61	10.67	9.63	9.32	11.15	10.74
Shankill 110 kV	3.50	6.93	6.52	4.48	6.59	6.46	3.74	9.30	8.21	4.95	8.01	7.72
Shannonbridge 110 kV	7.05	14.28	12.70	8.67	16.27	15.53	5.94	17.72	15.96	7.59	19.04	18.32
Shannonbridge 220 kV	8.15	6.27	5.90	10.53	5.62	5.52	7.19	7.67	7.40	9.81	6.43	6.36
Shellybanks A 220 kV	14.75	13.82	12.28	8.37	17.04	16.18	15.76	23.25	20.54	6.95	26.04	24.77
Shellybanks B 220 kV	14.56	15.48	13.46	10.97	19.28	18.11	14.73	24.14	21.15	9.88	27.75	26.28
Shelton Abbey 110 kV	7.82	6.58	6.30	7.81	7.05	6.94	7.55	8.30	7.77	7.61	8.38	8.19
Singland 110 kV	6.35	11.07	9.97	7.25	11.67	11.23	6.60	17.94	16.22	7.79	16.11	15.61
Sliabh Bawn 110 kV	3.51	8.09	7.56	4.47	7.86	7.69	3.48	10.50	9.50	4.62	9.27	9.00
Slievecallan 110 kV	_	-	-	-	-	-	6.30	7.45	6.59	3.61	6.85	6.58
Sligo 110 kV	3.83	6.94	6.52	4.40	7.08	6.93	3.71	10.55	9.43	4.49	9.30	8.98
Somerset 110 kV	3.16	6.95	6.56	4.10	4.63	4.57	2.89	8.19	7.73	3.96	5.10	5.04
Sorne Hill 110 kV	2.70	2.22	2.14	3.33	2.57	2.53	3.46	3.71	3.26	4.36	3.62	3.46

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2017

			Sur	nmer					Wir	nter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]
Srananagh 110 kV	4.62	7.89	7.38	5.28	9.11	8.88	4.73	12.51	11.05	5.69	12.73	12.18
Srananagh 220 kV	6.57	3.88	3.70	8.59	3.35	3.31	7.55	5.08	4.83	9.87	3.93	3.88
Stevenstown 110 kV	4.80	5.23	4.93	5.16	3.59	3.54	4.56	6.13	5.68	5.05	3.91	3.85
Stratford 110 kV	3.17	3.65	3.54	4.14	2.97	2.94	3.35	4.61	4.34	4.36	3.38	3.33
Taney 110 kV	9.09	8.87	8.31	3.37	8.89	8.69	8.69	10.58	9.87	3.18	10.12	9.89
Tarbert 110 kV	6.89	8.68	8.02	8.26	9.30	9.04	30.76	16.48	15.30	32.29	15.65	15.27
Tarbert 220 kV	7.91	6.70	6.15	8.62	8.84	8.50	13.40	21.16	18.92	12.89	24.40	23.31
Tawnaghmore A 110 kV	2.75	2.50	2.42	3.39	2.84	2.80	4.29	4.54	4.17	5.49	4.24	4.12
Tawnaghmore B 110 kV	2.83	2.52	2.44	3.35	3.10	3.05	4.35	4.49	4.14	5.46	4.74	4.61
Thornsberry 110 kV	3.29	3.15	3.04	4.30	3.25	3.21	3.28	4.05	3.79	4.45	3.99	3.90
Thurles 110 kV	4.90	4.21	3.95	5.30	4.84	4.72	6.23	6.90	6.01	6.52	6.95	6.61
Tipperary 110 kV	3.67	5.67	5.35	4.74	3.95	3.89	5.27	8.35	7.71	6.33	4.94	4.86
Tonroe 110 kV	2.69	3.07	2.98	3.74	1.95	1.94	2.70	3.72	3.44	3.82	2.13	2.10
Trabeg 110 kV	7.32	12.35	10.94	7.92	14.58	13.87	6.99	22.71	19.81	7.91	22.90	21.81
Tralee 110 kV	4.88	7.02	6.52	5.77	6.63	6.47	4.99	9.43	8.12	6.10	7.80	7.47
Trien A 110 kV	6.49	8.25	7.63	6.83	9.36	9.08	3.24	4.49	4.00	4.43	4.16	4.01
Trien B 110 kV	6.49	8.25	7.63	6.83	9.36	9.08	7.38	14.32	12.54	6.97	12.85	12.32
Trillick 110 kV	2.74	2.38	2.29	3.41	2.59	2.56	3.55	4.07	3.53	4.47	3.62	3.47
Trinity 110 kV	12.41	10.28	9.44	6.89	12.75	12.29	11.60	14.52	12.98	6.05	16.97	16.21
Tullabrack 110 kV	3.43	2.31	2.24	4.58	1.68	1.67	6.72	7.69	7.30	7.24	5.67	5.60
Turlough 220 kV	12.18	10.92	9.85	13.39	9.97	9.65	10.56	13.07	12.13	12.19	11.19	10.94
Tynagh 220 kV	10.43	6.57	6.21	11.43	8.21	8.02	15.09	12.73	11.78	16.70	13.70	13.30
Uggool 110 kV	5.28	5.83	5.55	5.13	7.67	7.49	6.19	8.36	7.87	5.73	10.46	10.20
Waterford 110 kV	7.56	10.56	9.86	7.66	11.91	11.60	6.64	13.36	12.26	6.96	14.30	13.86
West Galway A 110 kV	3.99	4.29	4.10	2.77	3.57	3.53	3.90	5.21	4.92	2.67	3.95	3.89
West Galway B 110 kV	5.27	6.09	5.77	4.92	7.96	7.78	6.10	8.73	8.20	5.33	10.86	10.58
Wexford 110 kV	3.97	5.61	5.38	5.08	5.25	5.18	4.06	7.33	6.58	5.32	6.16	5.97
Whitebank 110 kV	21.53	11.34	10.35	18.81	14.50	13.93	25.26	16.54	14.64	20.13	20.01	19.01
Whitegate 110 kV	4.88	7.82	7.23	5.52	8.40	8.16	4.25	10.90	10.28	5.09	10.70	10.49
Wolfe Tone 110 kV	14.37	10.54	9.77	5.69	12.22	11.85	14.38	13.27	12.06	5.30	14.76	14.22
Woodhouse 110 kV	6.05	5.43	5.19	7.30	4.20	4.15	5.85	6.84	6.42	7.29	4.80	4.73
Woodland 220 kV	14.59	16.09	14.23	13.88	18.12	17.25	12.36	24.60	22.32	12.17	25.70	24.80
Woodland 400 kV	21.71	6.46	5.98	20.89	7.47	7.25	20.80	9.31	8.87	20.27	10.36	10.17

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sur	nmer					Wir	ıter		
	Tł	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Adamstown 110 kV	15.79	11.09	9.65	10.45	12.41	11.74	15.69	13.71	11.90	10.01	14.60	13.84
Agannygal 110 kV	2.79	4.99	4.82	3.88	4.20	4.16	2.94	6.47	5.81	4.23	4.95	4.81
Aghada 110 kV	5.02	7.69	7.22	5.92	9.16	8.93	4.60	10.18	9.70	5.67	11.46	11.25
Aghada A 220 kV	8.76	8.25	7.51	9.51	10.76	10.30	15.49	22.35	19.71	16.49	26.40	25.03
Aghada B 220 kV	11.59	9.38	8.40	11.02	12.01	11.43	15.49	22.35	19.71	16.49	26.40	25.03
Aghada C 220 kV	8.69	8.12	7.40	9.13	10.58	10.14	14.39	21.38	18.94	13.11	25.31	24.05
Aghada D 220 kV	8.69	8.12	7.40	9.13	10.58	10.14	15.49	22.35	19.71	16.49	26.40	25.03
Ahane 110 kV	5.67	10.79	9.98	6.16	9.45	9.23	5.00	15.45	14.27	5.82	9.42	9.26
Anner 110 kV	4.12	5.91	5.59	4.56	4.52	4.46	4.01	7.35	6.83	4.53	5.00	4.91
Ardnacrusha 110 kV	6.43	11.77	10.77	7.63	13.16	12.72	6.47	18.95	16.94	8.54	17.53	16.91
Ardnagappary 110 kV	2.77	1.89	1.84	3.93	1.23	1.22	2.88	2.48	2.27	4.20	1.33	1.31
Arigna 110 kV	4.45	6.16	5.88	5.46	5.17	5.10	4.73	8.54	7.78	5.89	6.13	5.99
Arklow 110 kV	10.44	7.46	7.12	11.17	9.14	8.97	10.39	9.74	9.09	11.45	11.38	11.07
Arklow 220 kV	9.27	6.79	6.40	10.58	6.46	6.33	8.92	8.58	8.17	10.44	7.61	7.50
Artane 110 kV	12.92	9.29	8.53	6.41	11.37	10.97	13.26	13.23	12.05	5.67	15.29	14.73
Arva 110 kV	3.92	7.92	7.43	4.99	6.51	6.39	3.85	10.30	9.36	5.13	7.46	7.29
Athea 110 kV	9.14	8.69	8.25	9.74	9.29	9.12	10.42	9.30	8.11	11.26	8.92	8.52
Athlone 110 kV	4.45	7.26	6.83	5.79	5.58	5.49	4.09	8.47	7.88	5.55	5.98	5.87
Athy 110 kV	4.98	6.68	6.41	5.99	5.68	5.62	4.67	7.94	7.57	5.81	6.38	6.30
Aughinish 110 kV	9.03	9.71	8.60	11.01	10.69	10.20	7.98	10.95	9.91	10.03	11.35	10.95
Ballybeg 110 kV	9.81	5.88	5.65	10.02	7.02	6.90	9.76	7.13	6.78	10.06	8.21	8.05
Ballydine 110 kV	4.14	6.55	6.22	3.83	5.38	5.30	3.97	8.07	7.56	3.72	6.02	5.92
Ballylickey 110 kV	2.87	3.00	2.91	3.97	1.96	1.95	2.95	3.80	3.61	4.10	2.13	2.11
Ballynahulla 110 kV	12.70	7.68	7.31	12.31	8.37	8.22	13.61	11.76	10.51	12.57	11.03	10.63
Ballynahulla 220 kV	7.67	6.87	6.41	8.01	7.87	7.66	7.27	11.72	10.77	7.79	11.46	11.13
Ballyragget 110 kV	-	-	-	-	-	-	4.88	7.22	6.85	6.07	4.93	4.87
Ballyvouskill 110 kV	12.27	7.81	7.41	12.32	9.25	9.06	12.80	12.87	11.47	12.54	13.25	12.71
Ballyvouskill 220 kV	7.26	7.14	6.62	7.91	8.91	8.63	6.79	12.90	11.76	7.76	14.12	13.63
Ballywater 110 kV	4.65	4.88	4.73	3.32	5.19	5.13	4.90	6.27	5.94	3.26	6.14	6.03
Baltrasna 110 kV	6.32	9.17	8.48	7.33	7.40	7.25	5.88	10.94	10.36	7.11	8.29	8.17
Bancroft 110 kV	12.67	10.91	9.98	7.26	12.84	12.38	12.17	13.21	12.23	6.78	15.08	14.63
Bandon 110 kV	3.42	5.74	5.42	4.44	5.70	5.58	3.12	7.66	7.08	4.35	6.88	6.71
Banoge 110 kV	6.13	5.35	5.17	6.86	4.93	4.88	6.12	6.65	6.27	6.93	5.67	5.57
Barnahealy A 110 kV	6.05	10.18	9.39	6.55	11.01	10.68	5.31	14.74	13.72	6.04	14.30	13.96
Barnahealy B 110 kV	7.20	9.87	9.13	7.64	10.58	10.28	6.50	14.37	13.32	7.17	13.73	13.40
Barnakyle 110 kV	2.92	4.71	4.53	4.18	4.18	4.13	2.73	5.42	5.09	4.08	4.50	4.42

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sur	nmer					Wir	iter		
	Th	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Baroda 110 kV	4.24	8.09	7.58	5.02	9.34	9.10	3.90	10.15	9.56	4.76	11.10	10.86
Barrymore 110 kV	4.01	6.82	6.47	4.98	4.40	4.34	3.71	8.95	8.48	4.91	4.92	4.87
Belcamp 110 kV	28.43	6.30	5.88	28.80	7.85	7.63	37.74	7.56	7.23	36.89	9.26	9.09
Belcamp 220 kV	11.48	12.19	10.52	10.14	15.51	14.50	11.72	23.71	20.86	9.50	27.08	25.70
Belgard 110 kV	12.46	11.21	10.16	7.06	13.76	13.20	12.06	13.58	12.44	6.60	16.29	15.70
Bellacorick A 110 kV	2.89	2.98	2.89	3.21	3.78	3.73	5.08	6.75	5.78	5.63	7.22	6.81
Binbane 110 kV	3.19	3.48	3.35	4.30	3.45	3.41	3.46	5.54	4.96	5.10	4.51	4.37
Blackrock 110 kV	10.40	11.48	10.49	2.57	11.23	10.89	9.96	14.02	12.57	2.40	12.79	12.36
Blake 110 kV	4.16	7.57	7.14	5.12	5.29	5.22	3.87	9.23	8.78	4.99	5.94	5.88
Boggeragh 110 kV	6.23	6.29	6.00	7.30	6.87	6.75	6.60	9.22	8.49	7.91	8.89	8.65
Booltiagh 110 kV	6.42	6.44	6.17	7.97	5.65	5.57	6.90	9.31	8.49	8.77	6.93	6.76
Bracklone 110 kV	4.09	8.22	7.73	5.08	7.69	7.54	3.68	10.31	9.74	4.82	8.89	8.75
Brinny A 110 kV	3.27	5.21	4.94	4.28	4.77	4.70	2.99	6.74	6.29	4.18	5.58	5.47
Brinny B 110 kV	3.27	5.23	4.96	4.28	4.80	4.73	2.99	6.78	6.32	4.18	5.62	5.51
Bunkimalta 110 kV	5.33	5.15	4.94	5.56	5.40	5.32	6.59	8.09	7.14	6.62	7.22	6.94
Butlerstown 110 kV	6.19	9.24	8.74	5.84	9.60	9.41	5.55	11.73	10.93	5.41	11.37	11.11
Cabra 110 kV	12.11	9.02	8.30	5.26	10.34	10.00	12.14	12.74	11.62	4.60	13.58	13.12
Cahernagh 110 kV	-	-	-	-	-	-	3.94	5.32	5.19	5.05	5.63	5.58
Cahir 110 kV	4.50	7.34	6.92	5.47	6.30	6.19	4.57	10.34	9.41	5.73	7.35	7.18
Carlow 110 kV	5.77	7.65	7.29	6.49	8.33	8.19	5.65	10.04	9.33	6.45	10.16	9.90
Carrickmines 220 kV	14.52	15.02	12.98	10.18	18.69	17.50	13.77	22.48	19.95	8.83	26.14	24.88
Carrickmines A 110 kV	28.27	10.74	9.90	23.43	11.93	11.57	31.50	13.14	12.12	24.54	14.01	13.60
Carrickmines B 110 kV	23.53	12.00	10.94	20.11	14.51	13.96	24.99	14.77	13.61	20.59	17.32	16.76
Carrick-on-Shannon 110 kV	4.45	9.61	8.96	5.13	10.68	10.40	4.26	13.26	12.04	5.12	13.48	13.02
Carrigadrohid 110 kV	7.09	10.20	9.46	7.22	10.49	10.21	6.65	15.84	14.53	6.92	13.78	13.43
Carrowbeg 110 kV	2.61	2.41	2.33	3.44	2.31	2.29	2.69	3.20	2.94	3.70	2.76	2.69
Cashla 110 kV	7.50	13.18	12.08	7.85	16.90	16.27	7.30	19.77	17.87	7.73	23.69	22.72
Cashla 220 kV	8.63	8.83	8.13	9.59	9.40	9.12	8.39	12.75	11.96	9.58	12.14	11.89
Castlebar 110 kV	2.95	3.99	3.82	3.50	4.52	4.44	3.41	6.40	5.61	4.18	6.18	5.91
Castledockrill 110 kV	6.88	6.35	6.13	4.93	7.76	7.65	7.32	8.34	7.88	4.83	9.47	9.26
Castlefarm A 110 kV	8.09	9.36	8.32	9.51	9.95	9.52	7.17	10.52	9.55	8.72	10.55	10.20
Castlefarm B 110 kV	8.10	9.35	8.30	9.52	9.93	9.51	7.19	10.50	9.53	8.74	10.54	10.19
Castleview 110 kV	4.44	9.99	9.26	4.85	8.07	7.90	3.71	14.26	13.29	4.48	9.71	9.55
Cathaleen's Fall 110 kV	4.28	6.29	5.94	4.93	7.19	7.03	5.45	12.95	10.92	6.52	11.61	10.99

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sur	nmer					Wir	iter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Cauteen 110 kV	5.47	6.41	6.11	6.37	4.42	4.37	5.95	9.62	8.79	6.72	5.01	4.93
Central 110 kV	14.55	9.87	9.16	7.99	10.75	10.45	14.34	11.95	11.08	7.61	12.48	12.14
Charleville 110 kV	4.59	5.52	5.28	5.97	5.23	5.16	4.80	7.75	7.08	6.60	6.47	6.30
Cherrywood 110 kV	10.60	9.19	8.54	7.77	9.50	9.26	10.17	10.97	10.22	7.45	10.88	10.62
City West 110 kV	6.27	7.23	6.59	6.16	5.51	5.37	5.88	8.61	7.72	5.95	6.08	5.92
Clahane 110 kV	3.43	4.09	3.92	4.33	4.33	4.26	4.01	8.65	7.97	5.13	7.22	7.05
Clashavoon 220 kV	8.07	7.27	6.73	8.75	8.94	8.65	7.35	13.09	11.94	8.34	13.98	13.51
Clashavoon A 110 kV	7.96	11.54	10.61	8.27	15.12	14.55	7.84	19.44	17.49	8.18	23.16	22.17
Clashavoon B 110 kV	7.96	11.54	10.61	8.27	15.12	14.55	7.84	19.44	17.49	8.18	23.16	22.17
Cliff 110 kV	4.04	5.18	4.94	4.98	5.35	5.27	4.67	9.21	8.11	6.09	7.49	7.22
Cloghboola 110 kV	5.19	6.47	6.22	5.70	7.27	7.16	7.33	8.14	6.82	7.85	8.43	7.89
Clogher 110 kV	3.92	5.25	5.00	4.27	6.08	5.96	5.59	12.29	9.68	5.86	10.72	9.92
Cloghran 110 kV	8.75	16.40	14.11	8.78	19.15	18.00	8.50	21.73	19.62	8.64	23.90	22.98
Clonee 220 kV	12.52	12.84	11.08	11.11	14.25	13.43	12.56	23.24	20.79	10.60	22.14	21.32
Clonkeen A 110 kV	5.73	5.32	5.09	6.78	4.12	4.07	5.55	6.77	6.42	6.76	4.61	4.55
Clonkeen B 110 kV	5.50	6.25	5.99	4.68	7.44	7.31	5.33	9.89	8.79	4.31	10.41	9.97
Cloon 110 kV	4.46	6.80	6.46	5.79	6.08	5.99	4.13	8.64	8.03	5.70	7.02	6.88
College Park 110 kV	8.51	15.71	13.64	6.19	18.97	17.85	8.22	20.68	18.79	5.69	23.85	22.95
Cookstown 110 kV	7.51	7.81	7.33	6.07	6.74	6.62	7.08	9.10	8.62	5.84	7.54	7.42
Coolroe 110 kV	5.44	8.36	7.83	6.61	8.28	8.10	4.94	11.80	10.99	6.45	10.26	10.05
Coomagearlahy 110 kV	5.42	5.08	4.91	5.84	6.11	6.03	5.73	8.00	7.01	6.28	8.63	8.21
Coomataggart 110 kV	9.03	5.20	5.02	6.79	3.60	3.57	9.04	7.95	7.22	6.47	4.16	4.09
Cordal 110 kV	10.52	6.76	6.47	8.64	6.53	6.43	10.57	9.92	8.95	8.22	8.05	7.81
Corderry 110 kV	4.06	6.29	6.00	5.00	6.26	6.16	4.49	9.89	8.68	5.78	8.21	7.90
Corduff 110 kV	9.40	17.72	15.14	10.08	21.79	20.36	9.33	24.05	21.59	10.30	28.08	26.88
Corduff 220 kV	13.23	13.68	11.64	12.47	17.41	16.16	15.73	27.92	24.27	13.71	31.49	29.75
Corkagh 110 kV	17.93	11.29	9.80	12.37	12.54	11.86	18.20	14.00	12.12	12.01	14.78	14.01
Corraclassy 110 kV	4.38	5.77	5.44	5.41	4.76	4.68	4.38	7.25	6.81	5.60	5.30	5.22
Cow Cross 110 kV	5.08	10.10	9.34	5.28	9.21	8.98	4.31	14.57	13.57	4.83	11.42	11.20
Crane 110 kV	6.47	6.88	6.60	6.54	7.56	7.44	7.52	9.42	8.67	7.19	9.39	9.13
Cromcastle A 110 kV	11.82	9.17	8.28	7.57	10.46	10.05	11.86	12.41	11.06	7.10	13.24	12.68
Cromcastle B 110 kV	11.82	9.17	8.28	7.57	10.46	10.05	11.86	12.41	11.06	7.10	13.24	12.68
Cronacarkfree 220 kV	4.28	3.38	3.27	5.15	2.82	2.80	7.53	7.71	6.02	7.07	3.97	3.78
Crory 110 kV	19.09	11.23	9.78	12.44	12.30	11.66	19.51	13.91	12.09	12.06	14.46	13.74
Cullenagh 110 kV	8.35	11.30	10.60	8.81	13.33	12.98	7.36	14.79	13.72	8.00	16.49	16.02
Cullenagh 220 kV	9.23	8.08	7.62	9.40	8.33	8.15	8.14	10.23	9.79	8.61	9.89	9.74

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sur	nmer					Wir	ıter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Cunghill 110 kV	3.08	4.19	4.04	3.55	4.23	4.18	3.24	6.49	5.98	3.86	5.53	5.40
Cureeny 110 kV	4.76	4.81	4.63	5.36	5.16	5.09	5.95	7.60	6.69	6.89	6.99	6.71
Cushaling 110 kV	5.95	9.08	8.23	7.21	10.76	10.33	6.89	13.45	12.12	8.76	14.11	13.59
Dallow 110 kV	3.54	5.02	4.83	4.67	3.14	3.11	3.52	5.88	5.55	4.72	3.42	3.38
Dalton 110 kV	3.00	3.65	3.51	4.02	3.23	3.20	3.27	5.21	4.71	4.56	3.87	3.77
Dardistown 110 kV	14.51	9.28	8.38	11.80	10.83	10.39	15.48	12.60	11.22	11.87	13.81	13.21
Derrybrien 110 kV	2.64	3.92	3.81	3.74	3.72	3.69	2.98	5.21	4.58	4.43	4.59	4.41
Derryiron 110 kV	4.95	7.20	6.81	6.17	7.47	7.33	5.63	10.27	9.62	7.28	9.42	9.23
Doon 110 kV	4.42	6.41	6.06	4.73	5.06	4.98	4.35	8.14	7.53	4.72	5.64	5.53
Dromada 110 kV	6.54	8.23	7.84	4.92	8.51	8.37	7.47	8.87	7.76	5.52	8.28	7.92
Drumkeen 110 kV	3.53	4.78	4.55	4.20	5.04	4.95	3.88	9.08	7.65	4.97	7.44	7.07
Drumline 110 kV	3.60	7.25	6.85	4.75	6.35	6.25	3.19	9.54	8.85	4.62	7.33	7.18
Drybridge 110 kV	5.81	11.58	10.56	6.63	10.11	9.83	5.16	14.81	13.65	6.29	11.79	11.53
Dundalk 110 kV	3.83	7.85	7.40	4.77	7.34	7.20	3.44	9.65	8.93	4.53	8.40	8.21
Dunfirth 110 kV	4.75	5.84	5.58	6.35	4.68	4.62	4.52	6.83	6.60	6.29	5.13	5.08
Dungarvan 110 kV	6.04	5.62	5.41	7.73	4.79	4.74	5.93	7.48	6.89	7.93	5.73	5.61
Dunmanway 110 kV	4.41	6.72	6.34	5.46	6.32	6.21	4.12	9.54	8.77	5.43	7.71	7.53
Dunstown 220 kV	13.38	15.75	13.79	12.85	18.38	17.38	10.84	22.10	20.34	10.81	24.30	23.54
Dunstown 400 kV	17.57	6.51	5.94	19.22	7.32	7.06	15.52	8.54	8.13	17.60	9.11	8.95
Ennis 110 kV	5.06	9.43	8.82	6.31	8.81	8.62	5.06	14.35	12.72	6.70	11.25	10.88
Fassaroe East 110 kV	5.40	7.33	6.90	5.46	5.72	5.63	5.05	8.56	8.09	5.27	6.35	6.26
Fassaroe West 110 kV	5.55	7.48	7.03	5.57	5.90	5.80	5.19	8.75	8.26	5.37	6.57	6.47
Finglas 220 kV	13.26	13.13	11.22	12.94	17.15	15.93	16.75	27.22	23.58	15.46	32.02	30.13
Finglas A 110 kV	23.91	10.49	9.39	23.30	12.11	11.58	34.87	14.80	13.02	30.47	15.84	15.09
Finglas B 110 kV	23.92	10.27	9.37	23.03	13.11	12.59	36.37	15.01	13.58	31.75	18.23	17.48
Flagford 110 kV	4.77	10.05	9.34	5.51	12.27	11.91	4.55	13.94	12.63	5.49	15.92	15.31
Flagford 220 kV	7.21	6.28	5.90	9.16	6.10	5.97	7.49	8.27	7.87	9.86	7.27	7.16
Francis Street A 110 kV	10.88	11.48	10.49	5.37	13.76	13.25	10.44	14.04	12.59	5.02	16.17	15.48
Francis Street B 110 kV	13.09	11.19	10.18	6.92	13.67	13.14	12.73	13.59	12.48	6.46	16.20	15.65
Galway 110 kV	5.01	10.16	9.43	4.60	12.44	12.06	5.10	15.00	13.54	4.51	16.91	16.24
Garrow 110 kV	9.28	7.53	7.15	9.48	8.97	8.78	9.27	12.35	11.01	9.48	12.84	12.31
Garvagh 110 kV	4.26	4.94	4.76	5.45	4.80	4.74	4.95	7.38	6.52	6.59	6.03	5.82
Gilra 110 kV	3.26	5.86	5.58	4.07	4.67	4.61	3.02	7.00	6.61	3.97	5.16	5.09
Glanagow 220 kV	11.95	9.65	8.61	12.11	12.42	11.79	15.24	21.46	19.00	14.43	25.38	24.11
Glanlee 110 kV	5.40	4.94	4.77	5.54	5.94	5.86	5.69	7.67	6.74	5.82	8.32	7.91

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sun	nmer					Wir	iter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Glasmore A 110 kV	5.07	5.96	5.54	5.39	4.45	4.37	4.64	7.58	6.85	5.18	5.05	4.93
Glenlara A 110 kV	2.96	2.61	2.55	4.21	2.30	2.29	3.14	3.31	3.05	4.66	2.66	2.60
Glenlara B 110 kV	9.06	5.76	5.55	6.99	5.85	5.77	9.34	8.50	7.57	6.60	7.53	7.27
Glenree 110 kV	2.93	3.16	3.06	3.57	3.28	3.25	3.97	6.08	5.55	4.96	4.94	4.82
Glentanemacelligot 110 kV	8.82	5.44	5.25	8.53	4.61	4.56	8.32	7.40	6.83	8.23	5.31	5.20
Golagh 110 kV	3.59	4.61	4.41	4.06	4.64	4.57	4.13	9.26	7.65	4.73	6.88	6.53
Gorman 110 kV	6.97	12.47	11.35	7.81	14.01	13.51	6.04	15.98	14.71	7.10	16.94	16.44
Gorman 220 kV	9.67	9.82	8.97	10.28	8.50	8.27	8.41	12.62	11.98	9.54	9.94	9.80
Gortawee 110 kV	4.46	5.64	5.30	5.86	4.82	4.73	4.48	6.88	6.42	6.12	5.32	5.22
Grange 110 kV	12.59	9.35	8.43	4.72	10.01	9.63	12.84	12.77	11.33	4.24	12.55	12.04
Grange Castle 110 kV	16.58	11.22	9.75	11.50	12.57	11.89	16.81	13.94	12.08	11.15	14.85	14.07
Great Island 110 kV	7.99	11.20	10.55	8.77	14.63	14.24	7.32	14.73	13.68	8.19	18.51	17.93
Great Island 220 kV	12.53	10.41	9.73	13.92	12.60	12.25	10.63	12.97	12.29	12.12	14.86	14.54
Griffinrath A 110 kV	7.23	9.47	8.89	7.53	9.69	9.48	6.61	11.55	10.97	7.10	11.26	11.07
Griffinrath B 110 kV	8.44	10.12	9.48	8.53	10.81	10.55	7.74	12.47	11.81	8.02	12.71	12.47
Harolds 110 kV	11.06	11.52	10.52	5.08	13.72	13.21	10.63	14.07	12.62	4.74	16.10	15.42
Heuston 110 kV	14.09	11.39	10.36	8.27	14.07	13.50	13.82	13.87	12.72	7.79	16.73	16.14
Huntstown A 220 kV	12.86	12.74	10.93	11.88	16.64	15.48	15.98	26.11	22.73	13.06	30.73	28.98
Huntstown B 220 kV	12.78	12.51	10.77	10.61	15.97	14.91	14.94	24.54	21.70	10.32	28.10	26.72
Ikerrin 110 kV	5.29	4.19	4.04	6.07	3.26	3.23	5.76	5.72	5.22	6.47	3.76	3.68
Inchicore 220 kV	14.54	17.08	14.42	11.03	21.23	19.66	13.72	27.10	23.54	9.56	31.16	29.40
Inchicore A 110 kV	26.95	12.48	11.26	24.14	15.78	15.08	30.22	15.39	14.01	25.91	19.02	18.28
Inchicore B 110 kV	38.21	12.76	11.06	31.41	16.21	15.21	47.71	16.18	13.98	35.52	19.91	18.70
Inniscarra 110 kV	5.03	8.08	7.59	6.05	7.85	7.69	4.59	11.39	10.62	5.92	9.66	9.47
Irishtown 220 kV	15.27	16.20	13.82	12.48	20.52	19.07	15.12	25.40	22.19	11.38	29.88	28.23
Kellis 110 kV	6.82	8.12	7.74	7.82	9.69	9.50	6.55	10.65	9.94	7.68	12.03	11.71
Kellis 220 kV	8.55	7.14	6.76	10.15	6.29	6.19	7.95	8.77	8.44	9.77	7.25	7.17
Kilbarry 110 kV	7.69	13.95	12.54	8.22	15.56	14.93	7.25	25.09	22.02	8.07	23.38	22.40
Kilgarvan 110 kV	9.03	5.20	5.02	6.79	3.60	3.57	9.04	7.95	7.22	6.47	4.16	4.09
Kilkenny 110 kV	3.03	4.72	4.56	4.27	4.33	4.28	3.72	7.97	7.48	5.18	6.41	6.30
Kill Hill 110 kV	4.89	5.05	4.85	5.91	4.67	4.61	5.71	7.65	6.88	6.88	5.87	5.71
Killonan 110 kV	7.62	14.38	12.99	8.60	16.61	15.95	7.22	24.08	21.38	7.49	16.53	16.06
Killonan 220 kV	8.58	8.42	7.76	10.50	8.51	8.27	7.94	12.51	11.82	10.70	10.01	9.86
Killoteran 110 kV	6.38	9.80	9.25	5.43	10.94	10.70	5.70	12.59	11.68	4.96	13.22	12.87
Kilmahud 110 kV	17.74	11.33	9.82	12.54	12.73	12.03	17.99	14.06	12.17	12.19	15.02	14.22
Kilmore 110 kV	14.09	9.54	8.58	9.58	10.94	10.49	14.93	13.06	11.58	9.27	13.99	13.37

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sun	nmer					Wir	ıter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	nree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Kilpaddoge 110 kV	11.33	14.62	13.32	11.92	18.58	17.84	12.22	21.48	19.43	12.86	25.40	24.38
Kilpaddoge 220 kV	13.36	11.73	10.58	12.92	15.72	14.98	15.85	25.78	23.08	13.71	30.94	29.52
Kilteel 110 kV	4.49	7.06	6.68	5.53	6.48	6.37	4.30	8.79	8.28	5.46	7.45	7.32
Kinnegad 110 kV	4.61	7.14	6.73	5.98	6.53	6.42	4.58	9.01	8.55	6.18	7.53	7.42
Knockacummer 110 kV	6.03	4.87	4.72	6.17	5.25	5.19	6.08	7.00	6.28	6.24	6.80	6.56
Knockalough 110 kV	4.05	4.11	3.97	3.66	4.17	4.12	4.45	5.34	4.87	3.78	4.88	4.74
Knockanure 110 kV	6.74	9.73	9.17	6.57	8.64	8.48	4.59	9.73	9.02	5.70	7.44	7.29
Knockanure 220 kV	11.91	10.14	9.26	8.63	13.48	12.92	12.58	19.45	17.65	7.19	23.59	22.63
Knockearagh 110 kV	5.37	4.79	4.58	7.07	4.34	4.28	5.41	6.51	6.01	7.41	5.17	5.06
Knocknagoshel 110 kV	5.19	6.47	6.22	5.70	7.27	7.16	7.33	8.14	6.82	7.85	8.43	7.89
Knockraha A 110 kV	8.62	14.81	13.31	9.24	16.03	15.40	7.85	25.51	22.85	8.84	23.16	22.36
Knockraha A 220 kV	10.19	10.13	9.10	10.51	12.12	11.58	10.50	20.73	18.65	10.71	20.69	19.93
Knockraha B 110 kV	8.62	14.81	13.31	9.24	16.03	15.40	7.85	25.51	22.85	8.84	23.16	22.36
Knockraha B 220 kV	10.19	10.13	9.10	10.51	12.12	11.58	10.50	20.73	18.65	10.71	20.69	19.93
Knockranny 110 kV	5.37	6.45	6.14	4.93	8.40	8.23	6.13	8.93	8.38	5.27	11.11	10.81
Knockranny A 110 kV	5.37	6.45	6.14	4.93	8.40	8.23	6.13	8.93	8.38	5.27	11.11	10.81
Knockranny B 110 kV	3.99	4.47	4.30	3.61	4.46	4.40	4.32	5.83	5.32	3.71	5.22	5.07
Knockumber 110 kV	3.96	7.64	7.13	4.72	5.88	5.78	3.57	8.94	8.42	4.50	6.44	6.34
Lanesboro 110 kV	4.14	9.85	9.05	5.27	10.36	10.05	3.75	12.19	11.01	4.98	11.99	11.58
Laois 110 kV	7.92	11.08	10.39	8.21	14.06	13.68	7.06	15.17	14.31	7.48	18.50	18.06
Laois 400 kV	15.67	6.09	5.59	11.07	6.10	5.92	14.08	8.09	7.74	9.96	7.49	7.39
Letterkenny110 kV	3.83	5.46	5.15	4.45	6.40	6.25	4.23	10.85	9.01	5.34	10.26	9.63
Liberty A 110 kV	6.52	12.36	11.23	5.56	14.46	13.90	5.91	20.95	18.65	4.90	21.38	20.51
Liberty B 110 kV	6.43	12.36	11.22	5.40	14.43	13.88	5.78	20.92	18.63	4.73	21.31	20.45
Limerick 110 kV	5.90	12.87	11.66	6.53	12.75	12.32	5.11	19.67	17.64	6.41	15.00	14.57
Lisdrum 110 kV	2.92	4.71	4.53	4.18	4.18	4.13	2.73	5.42	5.09	4.08	4.50	4.42
Lisheen 110 kV	3.97	3.24	3.15	3.98	4.86	4.79	4.96	5.30	4.64	4.97	7.94	7.41
Lodgewood 110 kV	8.53	7.17	6.89	8.92	9.03	8.88	9.72	9.64	9.03	9.88	11.30	11.01
Lodgewood 220 kV	9.01	6.56	6.23	10.17	6.48	6.37	8.80	8.26	7.89	10.03	7.63	7.52
Longpoint 220 kV	8.63	8.15	7.42	9.01	10.58	10.14	14.71	21.87	19.33	12.42	25.41	24.14
Louth 220 kV	11.11	13.19	11.69	11.91	15.55	14.79	9.24	19.55	18.08	10.49	21.07	20.46
Louth A 110 kV	7.44	11.16	10.34	8.40	13.62	13.20	6.44	14.00	13.03	7.54	16.40	15.94
Louth B 110 kV	8.12	12.03	11.10	8.90	15.03	14.52	6.88	15.24	14.17	7.80	18.31	17.77
Macetown 110 kV	7.34	14.20	12.46	7.15	15.25	14.52	6.88	18.29	16.77	6.82	18.43	17.88
Macroom 110 kV	7.37	11.16	10.28	7.28	12.86	12.45	6.99	18.40	16.62	6.91	18.27	17.64
Mallow 110 kV	5.31	5.88	5.61	6.90	5.28	5.20	5.30	7.68	7.21	7.20	6.17	6.07

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sun	nmer					Wir	ıter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Marina 110 kV	7.63	13.36	12.05	8.45	15.79	15.13	7.52	23.95	21.01	8.72	24.38	23.27
Maynooth A 110 kV	11.18	11.71	10.86	11.78	14.42	13.98	10.33	14.74	13.87	11.09	17.59	17.16
Maynooth A 220 kV	11.38	14.89	13.02	10.66	14.75	14.06	9.30	20.90	19.18	9.28	18.75	18.25
Maynooth B 110 kV	8.86	15.03	13.42	10.08	14.91	14.34	7.76	18.81	17.61	9.35	17.57	17.21
Maynooth B 220 kV	11.94	16.21	13.97	10.70	16.40	15.52	9.68	24.65	22.41	9.21	22.08	21.42
McDermott 110 kV	14.83	9.52	8.73	6.51	11.43	11.02	16.46	13.73	12.45	5.78	15.43	14.85
Meath Hill 110 kV	4.15	7.94	7.48	5.25	6.81	6.70	3.82	9.83	9.15	5.09	7.71	7.56
Meentycat 110 kV	3.27	4.13	3.96	4.10	4.22	4.16	3.60	7.32	6.27	4.96	5.95	5.69
Midleton 110 kV	4.02	8.66	8.07	5.04	7.86	7.69	3.41	11.75	11.02	4.67	9.43	9.26
Milltown A 110 kV	15.04	12.41	11.27	6.98	15.06	14.46	14.85	15.31	13.66	6.56	17.88	17.07
Milltown B 110 kV	9.22	10.15	9.31	4.31	12.19	11.75	8.73	12.21	11.27	3.99	14.29	13.83
Misery Hill 110 kV	13.52	12.12	11.03	7.67	14.84	14.26	13.21	14.94	13.33	7.25	17.64	16.83
Moneteen 110 kV	5.95	9.90	9.08	6.61	7.80	7.62	5.28	12.78	11.83	6.40	8.56	8.41
Moneypoint 110 kV	14.41	8.10	7.72	16.96	8.46	8.31	15.68	10.85	10.28	18.61	10.27	10.10
Moneypoint 220 kV	13.65	11.79	10.63	13.19	15.79	15.04	16.22	25.47	22.89	14.04	30.67	29.30
Moneypoint G1 400 kV	17.67	7.63	6.86	18.89	9.56	9.12	23.60	14.39	13.29	24.09	16.03	15.54
Moneypoint G2 400 kV	17.67	7.63	6.86	18.89	9.56	9.12	23.60	14.39	13.29	24.09	16.03	15.54
Moneypoint G3 400 kV	17.67	7.63	6.86	18.89	9.56	9.12	23.60	14.39	13.29	24.09	16.03	15.54
Monread 110 kV	4.22	7.03	6.65	5.08	7.07	6.94	3.98	8.70	8.22	4.94	8.18	8.03
Mount Lucas 110 kV	4.48	6.35	5.96	5.67	5.94	5.82	4.69	8.73	8.16	6.14	7.30	7.16
Moy 110 kV	2.91	2.99	2.89	3.38	3.70	3.65	5.25	6.66	5.93	6.47	6.74	6.47
Mullagharlin 110 kV	3.94	7.99	7.53	4.93	7.85	7.70	3.50	9.61	9.00	4.62	8.90	8.72
Mullingar 110 kV	3.62	6.44	6.11	4.96	6.17	6.06	3.46	7.64	7.21	4.89	6.95	6.83
Mulreavy 110 kV	3.61	4.72	4.51	4.12	5.60	5.50	4.72	10.32	8.24	5.73	9.67	8.95
Mungret A 110 kV	5.56	9.45	8.69	6.26	7.28	7.12	4.93	12.04	11.19	6.06	7.94	7.81
Mungret B 110 kV	5.56	9.46	8.71	6.26	7.28	7.12	4.92	12.07	11.21	6.06	7.94	7.81
Nangor 110 kV	14.74	10.96	9.55	9.49	12.25	11.60	14.75	13.57	11.80	9.10	14.42	13.69
Navan 110 kV	5.91	11.07	10.15	6.59	11.11	10.78	5.21	13.98	12.90	6.12	13.08	12.74
Nenagh 110 kV	3.35	3.54	3.42	4.07	2.49	2.47	3.30	4.55	4.19	4.13	2.73	2.68
Newbridge 110 kV	4.58	9.71	9.00	5.26	9.78	9.52	4.14	12.69	11.81	4.99	11.78	11.51
Newbury 110 kV	13.41	9.47	8.52	7.35	10.64	10.21	13.97	12.94	11.47	6.86	13.52	12.94
North Kerry 220 kV	11.91	10.14	9.26	8.63	13.48	12.92	12.58	19.45	17.65	7.19	23.59	22.63
North Kerry A 110 kV	11.96	11.30	10.58	11.36	13.18	12.84	23.13	15.01	13.04	16.05	16.01	15.19
North Kerry B 110 kV	6.74	9.73	9.17	6.57	8.64	8.48	4.59	9.73	9.02	5.70	7.44	7.29
North Mayo 110 kV	2.89	2.98	2.89	3.21	3.78	3.73	5.08	6.75	5.78	5.63	7.22	6.81

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sur	nmer					Wir	ıter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
North Quays 110 kV	18.30	12.66	11.48	6.52	15.09	14.49	18.57	15.65	13.95	6.11	17.89	17.08
North Wall 220 kV	12.94	12.29	10.61	9.30	14.78	13.87	14.91	24.21	21.26	8.19	25.11	23.91
Oldcourt A 110 kV	4.39	8.74	8.16	4.80	7.22	7.08	3.74	11.92	11.24	4.45	8.55	8.43
Oldcourt B 110 kV	4.43	8.78	8.20	4.83	7.28	7.14	3.78	12.01	11.31	4.47	8.64	8.52
Oldstreet 220 kV	15.94	8.64	7.99	13.05	9.67	9.38	15.62	11.82	11.21	12.32	12.35	12.11
Oldstreet 400 kV	16.84	6.48	5.92	10.68	6.41	6.21	15.44	9.71	9.28	9.29	8.50	8.39
Oughtragh 110 kV	3.73	3.84	3.69	4.79	2.78	2.75	3.61	5.13	4.79	4.81	3.12	3.07
Oweniney 110 kV	2.92	2.91	2.82	3.24	3.71	3.66	5.18	6.58	5.64	5.79	7.12	6.71
Pelletstown 110 kV	13.29	9.09	8.37	8.15	10.16	9.84	13.65	12.84	11.72	7.54	13.28	12.85
Platin 110 kV	5.25	10.81	9.89	5.80	8.57	8.36	4.61	13.37	12.46	5.46	9.71	9.54
Pollaphuca 110 kV	2.79	2.44	2.40	4.02	2.25	2.24	3.28	3.19	3.07	4.73	2.65	2.62
Poolbeg A 110 kV	25.97	13.18	11.93	21.27	16.52	15.82	28.33	16.40	14.60	22.07	19.90	18.94
Poolbeg A 220 kV	13.51	12.39	10.70	8.32	14.21	13.36	15.75	24.36	21.39	6.90	23.51	22.46
Poolbeg B 110 kV	25.95	13.17	11.91	21.26	16.50	15.80	28.29	16.36	14.57	22.06	19.86	18.91
Poolbeg B 220 kV	14.08	16.14	13.73	10.63	18.88	17.62	13.37	25.06	21.98	9.39	26.72	25.40
Poolbeg C 110 kV	20.56	12.91	11.69	7.55	15.43	14.80	21.27	16.02	14.24	7.11	18.37	17.52
Poppintree 110 kV	14.76	9.77	8.78	9.75	11.20	10.73	16.01	13.48	11.94	9.47	14.40	13.76
Portan 260 kV	22.29	8.29	7.64	81.56	2.94	2.91	21.77	13.81	13.25	119.74	3.29	3.28
Portan 400 kV	18.90	6.61	6.01	17.93	7.63	7.34	16.61	12.04	11.41	15.23	12.91	12.66
Portlaoise 110 kV	6.11	10.81	10.08	6.94	10.69	10.44	5.49	14.67	13.70	6.58	13.13	12.86
Pottery 110 kV	17.30	10.19	9.43	5.90	10.56	10.27	17.43	12.38	11.46	5.57	12.22	11.90
Prospect 220 kV	12.24	10.54	9.60	9.37	12.28	11.82	12.61	20.19	18.53	8.23	19.74	19.16
Raffeen 220 kV	11.03	9.46	8.49	11.04	12.20	11.61	12.50	19.85	17.73	10.42	22.79	21.76
Raffeen A 110 kV	7.75	11.51	10.53	8.46	14.05	13.53	7.23	17.67	16.24	8.14	19.73	19.10
Raffeen B 110 kV	8.81	11.15	10.21	9.53	13.60	13.11	8.42	17.16	15.72	9.32	19.13	18.50
Rathkeale 110 kV	3.65	6.61	6.25	4.82	5.44	5.35	3.43	8.18	7.69	4.81	6.07	5.97
Ratrussan 110 kV	3.23	5.86	5.59	4.02	6.64	6.52	3.67	8.21	7.02	4.85	8.46	8.00
Reamore 110 kV	4.30	5.16	4.92	3.64	5.10	5.02	4.45	8.18	7.37	3.44	6.64	6.45
Richmond A 110 kV	3.26	6.70	6.31	4.40	6.10	5.98	3.02	7.88	7.28	4.24	6.82	6.67
Richmond B 110 kV	3.26	6.70	6.31	4.40	6.10	5.98	3.02	7.88	7.28	4.24	6.82	6.67
Rinawade 110 kV	5.24	9.76	9.03	6.11	7.26	7.11	4.73	11.56	11.06	5.83	8.08	8.00
Ringaskiddy 110 kV	6.36	9.62	8.92	6.55	9.91	9.64	5.58	13.84	12.88	6.02	12.63	12.35
Ringsend 110 kV	26.40	13.28	11.99	22.37	16.64	15.92	28.83	16.58	14.69	23.37	20.10	19.10
Ryebrook 110 kV	5.78	12.67	11.17	6.57	11.67	11.20	5.14	15.34	14.17	6.15	13.17	12.87
Salthill 110 kV	5.04	9.37	8.74	4.09	11.36	11.04	5.17	13.56	12.26	3.91	15.11	14.53
Screeb 110 kV	3.60	2.41	2.34	3.38	2.83	2.80	3.76	2.87	2.64	3.45	3.20	3.10
Seal Rock A 110 kV	8.67	9.56	8.48	10.34	10.55	10.07	7.66	10.75	9.74	9.41	11.19	10.80

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sur	nmer					Wir	ıter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Seal Rock B 110 kV	8.71	9.57	8.48	10.36	10.56	10.08	7.68	10.76	9.74	9.42	11.20	10.80
Shankill 110 kV	3.74	7.07	6.66	4.75	6.72	6.60	3.79	9.64	8.46	5.05	8.16	7.85
Shannonbridge 110 kV	6.99	14.63	13.10	8.63	16.59	15.88	5.90	17.91	16.24	7.57	19.13	18.45
Shannonbridge 220 kV	8.18	6.45	6.07	10.57	5.75	5.65	7.17	7.75	7.50	9.82	6.45	6.39
Shellybanks A 220 kV	13.29	12.37	10.68	8.29	15.60	14.59	15.45	24.31	21.35	6.73	27.35	25.94
Shellybanks B 220 kV	14.54	15.61	13.38	10.90	19.54	18.22	14.55	24.45	21.44	9.74	28.31	26.80
Shelton Abbey 110 kV	7.66	6.70	6.42	7.66	7.16	7.05	7.26	8.53	8.03	7.45	8.57	8.39
Singland 110 kV	6.93	12.21	11.17	7.75	12.64	12.24	6.66	19.02	17.19	7.81	14.55	14.16
Sliabh Bawn 110 kV	3.49	8.23	7.71	4.46	7.99	7.82	3.45	10.57	9.61	4.59	9.32	9.05
Slievecallan 110 kV	5.37	5.19	4.99	3.71	5.43	5.35	6.28	7.60	6.73	3.60	6.92	6.66
Sligo 110 kV	3.89	7.09	6.70	4.47	7.24	7.09	3.66	10.94	9.85	4.47	9.51	9.21
Somerset 110 kV	3.12	7.15	6.78	4.08	4.74	4.69	2.86	8.30	7.87	3.95	5.13	5.08
Sorne Hill 110 kV	2.69	2.27	2.21	3.33	2.64	2.61	3.39	3.78	3.33	4.30	3.67	3.52
Srananagh 110 kV	4.79	8.08	7.60	5.47	9.32	9.09	4.71	12.99	11.57	5.70	13.09	12.57
Srananagh 220 kV	6.67	3.98	3.81	8.73	3.43	3.39	7.56	5.16	4.93	9.92	3.96	3.91
Stevenstown 110 kV	4.88	5.08	4.78	5.20	3.56	3.50	4.52	6.21	5.73	5.02	3.94	3.87
Stratford 110 kV	3.21	3.75	3.66	4.19	3.02	3.00	3.36	4.75	4.50	4.38	3.44	3.39
Taney 110 kV	9.10	8.88	8.29	3.39	8.91	8.70	8.66	10.60	9.89	3.18	10.15	9.92
Tarbert 110 kV	22.00	10.71	10.09	24.86	11.87	11.61	35.25	17.27	16.12	36.03	16.35	15.99
Tarbert 220 kV	12.83	11.36	10.28	12.84	14.98	14.30	15.36	24.80	22.25	14.24	28.87	27.61
Tawnaghmore A 110 kV	2.78	2.55	2.48	3.41	2.90	2.87	4.56	5.31	4.83	5.88	4.77	4.62
Tawnaghmore B 110 kV	2.86	2.57	2.50	3.37	3.16	3.12	4.70	5.25	4.79	6.02	5.37	5.20
Thornsberry 110 kV	4.14	5.71	5.42	5.33	5.43	5.34	4.13	7.56	7.11	5.53	6.62	6.51
Thurles 110 kV	5.11	4.22	4.06	5.50	4.86	4.79	6.23	6.95	6.07	6.52	6.94	6.62
Tievebrack 110 kV	3.39	3.32	3.19	4.51	2.66	2.64	3.60	5.00	4.51	5.02	3.18	3.11
Tipperary 110 kV	5.11	6.16	5.87	6.09	4.33	4.28	5.30	8.50	7.86	6.33	4.86	4.78
Tonroe 110 kV	2.69	3.13	3.04	3.74	1.99	1.98	2.72	3.75	3.49	3.85	2.14	2.11
Trabeg 110 kV	7.71	13.29	11.98	8.39	15.54	14.90	7.55	23.56	20.73	8.51	23.71	22.66
Tralee 110 kV	4.73	6.27	5.93	5.76	6.21	6.09	5.01	10.82	9.60	6.17	8.51	8.24
Trien A 110 kV	3.11	3.29	3.17	4.09	3.42	3.38	4.36	9.08	8.35	5.69	7.47	7.29
Trien B 110 kV	8.08	10.00	9.41	7.53	10.28	10.07	12.06	11.15	9.60	9.08	10.30	9.80
Trillick 110 kV	2.74	2.43	2.36	3.41	2.66	2.63	3.48	4.15	3.61	4.41	3.68	3.52

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2020

			Sur	nmer					Wir	iter		
	Tł	ree Pha	se	Si	ngle Pha	se	Th	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Trinity 110 kV	12.00	11.80	10.76	6.43	14.32	13.77	11.59	14.49	12.96	6.04	16.94	16.18
Tullabrack 110 kV	6.95	6.31	6.06	7.53	5.18	5.12	6.72	8.24	7.83	7.46	5.93	5.86
Turlough 220 kV	12.27	11.16	10.00	13.20	10.27	9.90	10.40	13.40	12.48	11.86	11.54	11.29
Tynagh 220 kV	14.22	9.13	8.34	15.54	10.77	10.37	14.89	13.08	12.13	16.50	14.00	13.61
Uggool 110 kV	5.38	6.17	5.89	5.16	8.08	7.91	6.22	8.54	8.04	5.67	10.68	10.40
Waterford 110 kV	7.59	10.62	9.99	7.69	11.99	11.70	6.82	13.91	12.85	7.10	14.72	14.30
West Dublin 110 kV	21.01	16.68	15.08	22.05	11.16	10.90	21.36	20.84	19.64	22.34	12.71	12.56
West Dublin 220 kV	12.86	16.92	14.43	10.50	18.53	17.39	10.85	25.95	23.11	8.95	25.58	24.56
West Galway A 110 kV	3.99	4.47	4.30	3.61	4.46	4.40	4.32	5.83	5.32	3.71	5.22	5.07
West Galway B 110 kV	5.37	6.45	6.14	4.93	8.40	8.23	6.13	8.93	8.38	5.27	11.11	10.81
Wexford 110 kV	3.96	5.61	5.40	5.06	5.47	5.41	5.71	7.74	6.96	7.11	6.79	6.57
Whitebank 110 kV	23.82	13.24	11.96	19.71	16.56	15.85	25.22	16.51	14.63	20.07	19.98	18.98
Whitegate 110 kV	4.78	8.21	7.68	5.44	8.78	8.57	4.25	11.03	10.45	5.10	10.83	10.63
Wolfe Tone 110 kV	13.54	9.35	8.58	5.98	11.11	10.72	14.32	13.39	12.17	5.27	14.88	14.34
Woodhouse 110 kV	6.00	5.56	5.35	7.28	4.28	4.24	5.90	7.24	6.75	7.38	4.96	4.88
Woodland 220 kV	13.93	15.22	13.10	13.18	17.54	16.48	12.79	26.95	24.32	12.43	27.70	26.69
Woodland 400 kV	19.97	6.63	6.03	19.22	7.67	7.38	18.36	12.13	11.49	17.18	13.08	12.82

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

			Sun	nmer					Wir	ıter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	lk' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Adamstown 110 kV	12.01	10.72	9.77	6.59	13.00	12.50	11.52	13.32	12.07	6.12	15.56	14.94
Agannygal 110 kV	2.78	4.95	4.79	3.87	4.18	4.14	2.94	6.48	5.82	4.23	4.95	4.82
Aghada 110 kV	5.12	7.70	7.24	6.05	9.14	8.92	4.57	10.21	9.75	5.64	11.49	11.28
Aghada A 220 kV	11.00	9.97	8.92	11.79	13.35	12.67	15.12	22.53	19.92	16.25	26.53	25.19
Aghada B 220 kV	11.00	9.97	8.92	11.79	13.35	12.67	15.12	22.53	19.92	16.25	26.53	25.19
Aghada C 220 kV	10.80	9.76	8.75	10.84	13.05	12.39	14.07	21.54	19.14	12.95	25.43	24.20
Aghada D 220 kV	11.00	9.97	8.92	11.79	13.35	12.67	15.12	22.53	19.92	16.25	26.53	25.19
Ahane 110 kV	5.62	10.85	10.08	6.07	7.92	7.78	4.96	15.54	14.39	5.80	9.44	9.28
Anner 110 kV	4.11	5.86	5.56	4.55	4.47	4.40	4.04	7.77	7.21	4.59	5.12	5.04
Ardnacrusha 110 kV	6.37	11.88	10.92	7.82	12.82	12.42	6.42	19.06	17.10	8.49	17.57	16.96
Ardnagappary 110 kV	2.76	1.88	1.84	3.92	1.22	1.22	2.87	2.53	2.32	4.21	1.34	1.32
Arigna 110 kV	4.42	6.19	5.91	5.44	5.17	5.11	4.68	8.57	7.83	5.86	6.13	5.99
Arklow 110 kV	10.82	7.54	7.20	11.52	9.23	9.06	10.09	9.87	9.22	11.27	11.51	11.20
Arklow 220 kV	9.42	6.88	6.49	10.72	6.52	6.40	8.76	8.67	8.28	10.36	7.66	7.56
Artane 110 kV	13.02	9.50	8.74	6.38	11.62	11.22	13.16	13.37	12.18	5.64	15.42	14.85
Arva 110 kV	3.91	7.95	7.46	4.98	6.50	6.39	3.82	10.41	9.46	5.12	7.49	7.32
Athea 110 kV	9.05	8.93	8.51	9.69	9.41	9.25	10.84	10.19	8.81	11.61	9.47	9.03
Athlone 110 kV	4.44	7.26	6.84	5.78	5.56	5.47	4.08	8.49	7.90	5.54	5.98	5.88
Athy 110 kV	5.13	6.86	6.59	6.12	5.77	5.71	4.66	8.15	7.80	5.86	6.47	6.40
Aughinish 110 kV	8.88	9.72	8.65	10.88	10.55	10.09	7.90	11.03	10.01	9.95	11.41	11.02
Ballybeg 110 kV	9.91	5.93	5.70	10.11	7.05	6.94	9.62	7.17	6.83	9.97	8.26	8.10
Ballydine 110 kV	4.14	6.53	6.20	3.82	5.35	5.27	4.03	8.60	8.01	3.75	6.21	6.10
Ballylickey 110 kV	2.86	2.90	2.82	3.96	1.89	1.88	2.94	3.85	3.66	4.10	2.14	2.12
Ballynahulla 110 kV	12.68	7.26	6.93	12.29	7.88	7.75	13.95	12.96	11.54	12.68	11.70	11.27
Ballynahulla 220 kV	7.52	6.86	6.41	7.90	7.77	7.56	7.36	12.33	11.37	7.87	11.84	11.52
Ballyragget 110 kV	5.84	6.29	6.05	6.71	4.56	4.52	5.47	7.41	7.05	6.52	5.01	4.95
Ballyvouskill 110 kV	12.26	7.39	7.03	12.31	8.73	8.56	12.97	13.04	11.66	12.66	13.38	12.85
Ballyvouskill 220 kV	7.14	7.10	6.60	7.82	8.80	8.53	6.79	13.34	12.21	7.80	14.47	13.99
Ballywater 110 kV	5.06	4.98	4.83	3.45	5.28	5.22	4.82	6.34	6.01	3.24	6.19	6.08
Baltrasna 110 kV	6.32	9.25	8.56	7.34	7.45	7.30	5.83	11.02	10.45	7.08	8.31	8.20
Bancroft 110 kV	12.67	11.04	10.12	7.22	12.97	12.52	11.96	13.32	12.36	6.71	15.19	14.75
Bandon 110 kV	3.39	5.62	5.31	4.42	5.60	5.49	3.09	7.80	7.23	4.36	6.95	6.79
Banoge 110 kV	6.51	5.43	5.25	7.15	4.98	4.93	5.94	6.75	6.39	6.88	5.72	5.63
Barnahealy A 110 kV	5.96	10.14	9.37	6.46	10.91	10.60	5.25	14.82	13.81	6.01	14.34	14.01
Barnahealy B 110 kV	7.09	9.80	9.08	7.52	10.46	10.17	6.40	14.46	13.45	7.11	13.79	13.47
Barnakyle 110 kV	2.91	4.73	4.55	4.18	4.18	4.14	2.79	5.73	5.30	4.22	4.60	4.50

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

			Sur	nmer					Wir	ıter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Baroda 110 kV	4.19	8.24	7.73	4.97	9.47	9.24	3.87	10.23	9.65	4.73	11.17	10.93
Barrymore 110 kV	3.98	6.74	6.40	4.96	4.30	4.25	3.68	9.00	8.55	4.90	4.93	4.88
Belcamp 110 kV	29.23	6.40	5.99	29.70	7.97	7.75	37.47	7.59	7.26	36.65	9.29	9.12
Belcamp 220 kV	11.61	12.84	11.07	10.21	16.34	15.27	11.34	24.30	21.44	9.24	27.65	26.27
Belgard 110 kV	12.42	11.35	10.31	7.01	13.91	13.36	11.89	13.70	12.57	6.53	16.40	15.83
Bellacorick A 110 kV	3.03	3.06	2.96	3.30	4.03	3.97	6.03	8.53	7.04	6.61	9.23	8.56
Binbane 110 kV	3.18	3.49	3.36	4.29	3.43	3.39	3.59	6.01	5.32	5.39	4.72	4.56
Blackrock 110 kV	10.35	11.60	10.62	2.55	11.33	10.99	9.85	14.13	12.68	2.38	12.85	12.42
Blake 110 kV	4.12	7.68	7.26	5.10	5.33	5.26	3.84	9.28	8.84	4.97	5.95	5.89
Boggeragh 110 kV	6.18	6.13	5.86	7.26	6.76	6.65	6.60	9.37	8.61	7.94	8.99	8.74
Booltiagh 110 kV	6.38	6.46	6.21	7.96	5.63	5.56	6.87	9.35	8.54	8.75	6.94	6.78
Bracklone 110 kV	4.02	8.45	7.96	5.03	7.83	7.68	3.65	10.42	9.87	4.80	8.95	8.81
Brinny A 110 kV	3.24	5.09	4.83	4.26	4.68	4.60	2.96	6.85	6.40	4.19	5.63	5.53
Brinny B 110 kV	3.24	5.11	4.85	4.26	4.71	4.63	2.96	6.88	6.44	4.19	5.67	5.57
Bunkimalta 110 kV	5.30	5.09	4.90	5.67	5.23	5.16	6.57	8.11	7.16	6.61	7.23	6.95
Butlerstown 110 kV	6.45	9.43	8.93	5.99	9.71	9.53	5.62	12.00	11.17	5.46	11.54	11.27
Cabra 110 kV	12.18	9.21	8.49	5.22	10.54	10.21	12.04	12.87	11.74	4.58	13.67	13.22
Cahernagh 110 kV	4.14	4.76	4.62	5.19	5.22	5.16	4.39	5.94	5.70	5.63	5.98	5.90
Cahir 110 kV	4.48	7.28	6.88	5.46	6.22	6.12	4.60	10.71	9.77	5.81	7.47	7.31
Carlow 110 kV	5.93	8.01	7.64	6.65	8.63	8.48	5.71	10.29	9.57	6.54	10.33	10.08
Carrickmines 220 kV	14.39	15.53	13.43	10.03	19.28	18.07	12.98	23.13	20.60	8.46	26.75	25.51
Carrickmines A 110 kV	28.43	10.87	10.04	23.49	12.05	11.70	30.69	13.24	12.23	24.11	14.08	13.67
Carrickmines B 110 kV	23.80	12.16	11.11	20.26	14.68	14.14	24.29	14.91	13.77	20.19	17.46	16.91
Carrick-on-Shannon 110 kV	4.44	9.65	9.00	5.12	10.70	10.42	4.21	13.38	12.16	5.08	13.55	13.10
Carrigadrohid 110 kV	7.01	10.08	9.37	7.16	10.29	10.03	6.60	16.11	14.81	6.90	13.92	13.58
Carrowbeg 110 kV	2.61	2.52	2.43	3.45	2.41	2.39	2.74	3.66	3.38	3.84	3.01	2.94
Cashla 110 kV	7.47	13.45	12.34	7.82	17.17	16.54	7.13	20.41	18.56	7.58	24.30	23.37
Cashla 220 kV	8.50	9.13	8.41	9.50	9.60	9.31	8.26	13.10	12.35	9.50	12.35	12.12
Castlebar 110 kV	2.99	4.30	4.10	3.49	4.98	4.89	4.02	8.57	7.46	4.84	7.92	7.57
Castledockrill 110 kV	7.60	6.47	6.25	5.19	7.89	7.78	7.18	8.43	7.98	4.79	9.55	9.35
Castlefarm A 110 kV	7.96	9.36	8.36	9.41	9.82	9.42	7.11	10.60	9.64	8.66	10.60	10.26
Castlefarm B 110 kV	7.97	9.35	8.35	9.42	9.81	9.41	7.12	10.58	9.62	8.68	10.59	10.25
Castleview 110 kV	4.40	9.95	9.24	4.82	7.93	7.77	3.66	14.37	13.44	4.46	9.72	9.57
Cathaleen's Fall 110 kV	4.25	6.33	5.99	4.90	7.21	7.06	5.32	13.26	11.23	6.42	11.80	11.19

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

			Sur	nmer					Wir	iter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Cauteen 110 kV	5.45	6.35	6.07	6.34	4.21	4.17	5.95	9.68	8.86	6.73	5.02	4.94
Central 110 kV	14.50	9.98	9.27	7.94	10.85	10.55	14.12	12.04	11.17	7.54	12.55	12.22
Charleville 110 kV	4.56	5.44	5.21	5.97	5.13	5.06	4.80	7.80	7.12	6.61	6.49	6.32
Cherrywood 110 kV	10.55	9.28	8.65	7.74	9.58	9.34	10.05	11.06	10.31	7.39	10.94	10.69
City West 110 kV	6.24	7.13	6.66	6.15	5.51	5.41	5.84	8.53	7.80	5.94	6.10	5.97
Clahane 110 kV	3.39	4.05	3.88	4.29	4.30	4.24	3.96	8.93	8.23	5.12	7.33	7.16
Clashavoon 220 kV	7.88	7.24	6.71	8.58	8.81	8.54	7.25	13.51	12.38	8.29	14.30	13.84
Clashavoon A 110 kV	7.86	11.44	10.55	8.18	14.92	14.39	7.80	19.88	17.95	8.17	23.60	22.62
Clashavoon B 110 kV	7.86	11.44	10.55	8.18	14.92	14.39	7.80	19.88	17.95	8.17	23.60	22.62
Cliff 110 kV	4.01	5.20	4.97	4.96	5.36	5.27	4.59	9.36	8.27	6.03	7.57	7.30
Cloghboola 110 kV	5.09	6.55	6.31	5.63	7.31	7.21	7.11	8.34	7.01	7.69	8.61	8.07
Clogher 110 kV	3.89	5.28	5.03	4.25	6.08	5.97	5.45	12.56	9.93	5.76	10.87	10.08
Cloghran 110 kV	8.86	16.73	14.41	8.90	19.50	18.35	8.39	22.00	19.91	8.55	24.12	23.22
Clonee 220 kV	12.87	13.65	11.75	11.30	15.06	14.19	12.18	23.98	21.49	10.36	22.63	21.81
Clonkeen A 110 kV	5.68	5.21	5.00	6.75	4.01	3.96	5.54	6.84	6.50	6.77	4.63	4.58
Clonkeen B 110 kV	5.45	5.88	5.64	4.65	6.99	6.88	5.32	10.00	8.90	4.30	10.50	10.06
Cloon 110 kV	4.43	6.88	6.54	5.77	6.11	6.01	4.05	8.92	8.34	5.64	7.13	7.00
College Park 110 kV	8.61	16.02	13.92	6.21	19.32	18.20	8.12	20.92	19.05	5.63	24.07	23.19
Cookstown 110 kV	7.48	7.88	7.40	6.05	6.78	6.66	7.00	9.16	8.69	5.80	7.57	7.46
Coolroe 110 kV	5.38	8.24	7.74	6.56	8.16	7.99	4.89	11.89	11.09	6.42	10.30	10.09
Coomagearlahy 110 kV	5.39	4.76	4.60	5.80	5.76	5.68	5.72	8.07	7.08	6.27	8.72	8.29
Coomataggart 110 kV	8.99	4.87	4.71	6.78	3.34	3.31	9.06	8.01	7.29	6.47	4.17	4.10
Cordal 110 kV	10.47	6.37	6.12	8.60	6.11	6.03	11.18	11.15	9.99	8.28	8.56	8.31
Corderry 110 kV	4.02	6.34	6.05	4.97	6.28	6.18	4.42	9.94	8.75	5.72	8.22	7.92
Corduff 110 kV	9.55	18.11	15.49	10.29	22.24	20.79	9.20	24.38	21.94	10.18	28.40	27.22
Corduff 220 kV	13.61	14.52	12.33	12.81	18.49	17.14	15.15	28.82	25.11	13.27	32.31	30.57
Corkagh 110 kV	20.34	17.70	15.49	21.51	13.03	12.59	19.90	21.80	19.96	21.35	14.65	14.35
Corraclassy 110 kV	4.35	5.77	5.45	5.39	4.75	4.68	4.37	7.23	6.79	5.59	5.28	5.20
Cow Cross 110 kV	5.03	10.09	9.33	5.24	9.09	8.87	4.26	14.65	13.67	4.81	11.45	11.24
Crane 110 kV	7.77	7.07	6.79	7.46	7.72	7.60	7.34	9.57	8.85	7.15	9.50	9.25
Cromcastle A 110 kV	11.88	9.38	8.47	7.55	10.69	10.27	11.75	12.51	11.16	7.05	13.32	12.76
Cromcastle B 110 kV	11.88	9.38	8.47	7.55	10.69	10.27	11.75	12.51	11.16	7.05	13.32	12.76
Cronacarkfree 220 kV	4.26	3.38	3.28	5.14	2.82	2.79	7.42	7.85	6.15	7.03	4.02	3.84
Crory 110 kV	19.61	17.57	15.39	20.57	12.90	12.47	19.06	21.62	19.82	20.35	14.49	14.20
Cullenagh 110 kV	8.77	11.51	10.80	9.19	13.49	13.15	7.40	15.19	14.09	8.08	16.82	16.35
Cullenagh 220 kV	9.40	8.17	7.71	9.52	8.37	8.20	8.19	10.34	9.90	8.66	9.95	9.81

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

			Sur	nmer					Wir	ıter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Cunghill 110 kV	3.09	4.48	4.31	3.58	4.39	4.33	3.13	6.84	6.33	3.79	5.70	5.57
Cureeny 110 kV	4.74	4.76	4.59	5.53	5.01	4.94	5.93	7.62	6.71	6.88	7.00	6.72
Cushaling 110 kV	5.86	9.31	8.44	7.12	11.01	10.57	6.85	13.59	12.27	8.73	14.22	13.70
Dallow 110 kV	3.53	5.02	4.83	4.67	3.12	3.10	3.51	5.89	5.56	4.71	3.42	3.39
Dalton 110 kV	2.99	3.77	3.63	4.02	3.31	3.27	3.25	5.74	5.23	4.62	4.09	4.00
Dardistown 110 kV	14.67	9.49	8.57	11.87	11.07	10.62	15.34	12.71	11.33	11.78	13.89	13.30
Derrybrien 110 kV	2.64	3.88	3.78	3.74	3.71	3.68	2.98	5.21	4.59	4.43	4.59	4.41
Derryiron 110 kV	4.92	7.26	6.88	6.15	7.52	7.38	5.60	10.40	9.77	7.26	9.49	9.31
Doon 110 kV	4.41	6.37	6.02	4.73	5.00	4.93	4.42	8.66	7.98	4.79	5.80	5.69
Dromada 110 kV	6.42	8.44	8.05	4.83	8.59	8.45	7.42	9.67	8.39	5.42	8.74	8.35
Drumkeen 110 kV	3.51	4.79	4.57	4.18	5.04	4.95	3.84	9.35	7.89	4.95	7.55	7.19
Drumline 110 kV	3.57	7.23	6.86	4.75	6.27	6.17	3.18	9.57	8.89	4.61	7.33	7.19
Drybridge 110 kV	5.79	11.67	10.65	6.63	10.16	9.89	5.09	15.05	13.88	6.24	11.93	11.67
Dundalk 110 kV	3.82	7.90	7.45	4.76	7.37	7.24	3.43	9.93	9.16	4.54	8.58	8.38
Dunfirth 110 kV	4.74	5.89	5.62	6.35	4.70	4.65	4.51	6.85	6.63	6.29	5.13	5.09
Dungarvan 110 kV	6.06	5.59	5.38	7.77	4.77	4.72	5.91	7.52	6.94	7.93	5.75	5.62
Dunmanway 110 kV	4.37	6.58	6.22	5.43	6.18	6.07	4.15	9.87	9.07	5.51	7.86	7.68
Dunstown 220 kV	12.89	17.27	15.03	12.44	19.83	18.73	9.85	24.93	22.95	10.04	26.60	25.79
Dunstown 400 kV	11.26	8.19	7.34	13.04	8.82	8.46	8.19	11.88	11.22	10.41	11.63	11.41
Ennis 110 kV	5.02	9.49	8.89	6.32	8.80	8.63	5.03	14.41	12.80	6.68	11.27	10.91
Fassaroe East 110 kV	5.37	7.39	6.97	5.45	5.75	5.66	5.01	8.62	8.15	5.25	6.37	6.28
Fassaroe West 110 kV	5.53	7.54	7.10	5.55	5.93	5.84	5.14	8.80	8.32	5.34	6.59	6.49
Finglas 220 kV	13.57	13.87	11.84	13.28	18.16	16.85	16.09	28.01	24.32	14.92	32.81	30.92
Finglas A 110 kV	24.76	10.75	9.63	24.10	12.39	11.86	34.50	14.95	13.16	30.20	15.95	15.21
Finglas B 110 kV	24.78	10.52	9.61	23.88	13.42	12.90	35.94	15.18	13.74	31.42	18.41	17.65
Flagford 110 kV	4.75	10.10	9.39	5.50	12.30	11.94	4.50	14.05	12.75	5.44	16.01	15.41
Flagford 220 kV	7.22	6.30	5.92	9.17	6.10	5.97	7.44	8.35	7.95	9.81	7.31	7.20
Francis Street A 110 kV	10.84	11.61	10.62	5.33	13.89	13.39	10.33	14.15	12.70	4.99	16.27	15.58
Francis Street B 110 kV	13.05	11.32	10.33	6.87	13.83	13.30	12.55	13.70	12.61	6.40	16.32	15.77
Galway 110 kV	4.96	10.29	9.57	4.57	12.55	12.17	5.04	15.43	13.99	4.46	17.27	16.63
Garrow 110 kV	9.23	7.11	6.78	9.45	8.46	8.29	9.32	12.51	11.18	9.52	12.96	12.44
Garvagh 110 kV	4.23	4.96	4.78	5.43	4.79	4.74	4.89	7.40	6.56	6.54	6.04	5.83
Gilra 110 kV	3.25	5.86	5.58	4.06	4.67	4.61	3.00	7.02	6.64	3.96	5.16	5.09
Glanagow 220 kV	11.45	10.05	8.97	11.69	13.39	12.69	14.89	21.63	19.20	14.25	25.50	24.26
Glanlee 110 kV	5.36	4.62	4.48	5.51	5.59	5.52	5.68	7.74	6.81	5.81	8.40	7.99

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

	Summer								Wir	nter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Glasmore A 110 kV	5.04	6.06	5.64	5.37	4.51	4.42	4.66	7.64	6.91	5.18	5.07	4.95
Glenlara A 110 kV	2.95	2.56	2.49	4.20	2.26	2.25	3.14	3.32	3.05	4.66	2.66	2.60
Glenlara B 110 kV	9.00	5.40	5.22	6.95	5.60	5.53	9.18	9.06	8.07	6.49	7.81	7.54
Glenree 110 kV	3.00	3.67	3.54	3.69	3.65	3.61	3.74	7.27	6.63	4.81	5.48	5.35
Glentanemacelligot 110 kV	8.77	5.09	4.93	8.50	4.28	4.24	8.20	7.84	7.24	8.17	5.46	5.35
Golagh 110 kV	3.56	4.62	4.43	4.04	4.64	4.57	4.05	9.41	7.81	4.68	6.94	6.60
Gorman 110 kV	6.95	12.57	11.44	7.79	14.10	13.60	6.01	16.34	15.03	7.09	17.21	16.70
Gorman 220 kV	9.64	9.95	9.08	10.23	8.58	8.35	8.37	12.98	12.31	9.50	10.09	9.95
Gortawee 110 kV	4.43	5.64	5.31	5.84	4.83	4.75	4.47	6.88	6.42	6.11	5.28	5.19
Grange 110 kV	12.67	9.56	8.63	4.68	10.22	9.83	12.72	12.88	11.44	4.21	12.62	12.12
Grange Castle 110 kV	14.41	11.35	10.30	9.52	14.12	13.54	14.16	14.28	12.86	8.99	17.16	16.42
Great Island 110 kV	9.41	11.76	11.07	10.29	15.26	14.86	8.12	15.29	14.14	9.11	19.10	18.48
Great Island 220 kV	12.82	10.59	9.90	14.22	12.75	12.40	10.68	13.12	12.44	12.24	14.95	14.65
Griffinrath A 110 kV	7.18	9.59	9.02	7.49	9.79	9.58	6.56	11.65	11.08	7.06	11.32	11.13
Griffinrath B 110 kV	8.38	10.27	9.62	8.48	10.93	10.68	7.67	12.59	11.94	7.97	12.79	12.56
Harolds 110 kV	11.02	11.64	10.65	5.04	13.85	13.36	10.51	14.18	12.73	4.71	16.20	15.52
Heuston 110 kV	14.06	11.53	10.51	8.23	14.23	13.68	13.61	13.99	12.86	7.71	16.85	16.27
Huntstown A 220 kV	13.12	13.45	11.52	12.10	17.59	16.36	15.37	26.82	23.41	12.63	31.45	29.70
Huntstown B 220 kV	13.08	13.21	11.36	10.74	16.88	15.75	14.44	25.20	22.34	10.03	28.72	27.35
Ikerrin 110 kV	5.28	4.14	3.99	6.07	3.20	3.17	5.76	5.73	5.24	6.47	3.76	3.68
Inchicore 220 kV	14.47	17.70	14.96	10.93	21.98	20.37	12.91	27.92	24.35	9.17	31.95	30.20
Inchicore A 110 kV	27.18	12.65	11.43	24.34	15.98	15.29	29.48	15.54	14.17	25.42	19.18	18.45
Inchicore B 110 kV	38.88	12.19	11.03	31.59	15.54	14.87	46.25	15.52	13.93	34.32	19.17	18.30
Inniscarra 110 kV	4.97	7.96	7.49	6.00	7.74	7.59	4.55	11.47	10.72	5.89	9.70	9.51
Irishtown 220 kV	15.14	16.75	14.31	12.34	21.20	19.72	14.22	26.08	22.88	10.86	30.56	28.92
Kellis 110 kV	7.18	8.60	8.20	8.22	10.16	9.96	6.68	10.91	10.21	7.86	12.26	11.96
Kellis 220 kV	8.62	7.36	6.97	10.23	6.42	6.31	7.81	8.96	8.64	9.70	7.34	7.26
Kilbarry 110 kV	7.57	14.01	12.62	8.12	15.53	14.91	7.12	25.36	22.33	7.99	23.50	22.54
Kilgarvan 110 kV	8.99	4.87	4.71	6.78	3.34	3.31	9.06	8.01	7.29	6.47	4.17	4.10
Kilkenny 110 kV	5.06	6.87	6.60	6.50	5.97	5.90	4.74	8.34	7.83	6.34	6.69	6.57
Kill Hill 110 kV	4.87	4.99	4.79	5.90	4.60	4.55	5.72	7.76	6.99	6.92	5.91	5.75
Killonan 110 kV	7.56	14.63	13.27	7.67	12.59	12.23	7.13	24.30	21.65	7.46	16.59	16.14
Killonan 220 kV	8.48	8.60	7.94	10.69	7.94	7.74	7.84	12.66	12.00	10.63	10.07	9.92
Killoteran 110 kV	6.73	10.04	9.48	5.59	11.12	10.88	5.82	12.90	11.97	5.01	13.45	13.09
Kilmahud 110 kV	19.96	17.59	15.41	21.23	12.99	12.55	19.46	21.64	19.83	21.06	14.59	14.30
Kilmore 110 kV	14.24	9.76	8.78	9.59	11.19	10.73	14.79	13.18	11.69	9.19	14.08	13.46

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

			Sur	nmer					Wir	iter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Kilpaddoge 110 kV	11.44	15.49	14.13	11.99	19.53	18.77	12.39	22.77	20.66	13.02	26.58	25.55
Kilpaddoge 220 kV	13.01	13.75	12.31	12.56	18.06	17.16	14.87	29.39	26.47	12.95	34.32	32.87
Kilpaddoge 400 kV	8.93	9.21	8.16	7.54	10.16	9.69	7.56	17.24	15.85	6.30	15.78	15.35
Kilteel 110 kV	4.45	7.14	6.77	5.50	6.53	6.42	4.27	8.86	8.35	5.43	7.48	7.36
Kinnegad 110 kV	4.59	7.19	6.79	5.97	6.57	6.45	4.57	9.09	8.65	6.18	7.56	7.46
Knockacummer 110 kV	5.98	4.55	4.42	6.13	5.03	4.98	5.88	7.34	6.59	6.11	7.01	6.76
Knockalough 110 kV	4.03	4.10	3.96	3.65	4.15	4.10	4.62	5.57	5.08	3.83	5.01	4.87
Knockearagh 110 kV	5.32	4.71	4.51	7.04	4.26	4.21	5.42	6.60	6.11	7.45	5.21	5.11
Knocknagoshel 110 kV	5.09	6.55	6.31	5.63	7.31	7.21	7.11	8.34	7.01	7.69	8.61	8.07
Knockraha A 110 kV	8.53	14.93	13.43	9.09	15.91	15.30	7.67	25.78	23.17	8.65	23.10	22.35
Knockraha A 220 kV	10.12	10.37	9.31	10.28	12.06	11.54	10.29	20.97	18.94	10.31	20.26	19.57
Knockraha B 110 kV	8.53	14.93	13.43	9.09	15.91	15.30	7.67	25.78	23.17	8.65	23.10	22.35
Knockraha B 220 kV	10.12	10.37	9.31	10.28	12.06	11.54	10.29	20.97	18.94	10.31	20.26	19.57
Knockranny 110 kV	5.35	6.47	6.17	4.90	8.42	8.25	6.09	9.07	8.54	5.23	11.24	10.96
Knockumber 110 kV	3.95	7.67	7.17	4.71	5.90	5.80	3.54	9.04	8.52	4.48	6.46	6.37
Lanesboro 110 kV	4.13	9.94	9.12	5.26	10.50	10.18	3.74	12.23	11.08	4.98	11.91	11.52
Laois 110 kV	8.42	12.61	11.77	8.69	15.75	15.29	7.38	15.98	15.12	7.82	19.31	18.88
Laois 400 kV	10.78	8.32	7.45	10.26	8.26	7.95	7.93	12.46	11.74	8.37	10.89	10.69
Letterkenny110 kV	3.80	5.48	5.19	4.43	6.41	6.27	4.24	11.37	9.43	5.41	10.58	9.94
Liberty A 110 kV	6.42	12.37	11.25	5.48	14.43	13.89	5.81	21.11	18.85	4.86	21.44	20.60
Liberty B 110 kV	6.32	12.36	11.24	5.33	14.41	13.87	5.69	21.08	18.83	4.69	21.37	20.54
Limerick 110 kV	5.83	13.05	11.86	6.75	11.77	11.42	5.06	19.84	17.84	6.38	15.06	14.64
Lisdrum 110 kV	2.91	4.73	4.55	4.18	4.18	4.14	2.79	5.73	5.30	4.22	4.60	4.50
Lisheen 110 kV	3.96	3.19	3.10	3.97	4.78	4.71	4.95	5.32	4.66	4.96	7.97	7.44
Lodgewood 110 kV	9.87	7.32	7.04	10.13	9.20	9.04	9.50	9.76	9.16	9.81	11.42	11.14
Lodgewood 220 kV	9.28	6.65	6.32	10.40	6.55	6.44	8.70	8.34	7.99	10.01	7.68	7.57
Longpoint 220 kV	10.73	9.82	8.79	10.49	13.02	12.36	14.37	22.04	19.54	12.28	25.53	24.29
Louth 220 kV	11.27	13.56	12.03	11.75	16.10	15.31	9.49	21.06	19.23	10.44	22.68	21.92
Louth A 110 kV	7.45	11.26	10.44	8.40	13.73	13.31	6.38	14.29	13.28	7.49	16.68	16.20
Louth B 110 kV	8.16	12.16	11.24	8.92	15.17	14.67	6.85	15.80	14.64	7.78	18.88	18.31
Macetown 110 kV	7.39	14.45	12.71	7.19	15.48	14.75	6.80	18.48	16.97	6.77	18.58	18.04
Macroom 110 kV	7.27	11.05	10.21	7.20	12.66	12.26	6.94	18.78	17.02	6.89	18.53	17.92
Mallow 110 kV	5.27	5.79	5.53	6.88	5.20	5.12	5.34	7.79	7.29	7.26	6.22	6.11
Marina 110 kV	7.50	13.40	12.10	8.33	15.81	15.16	7.38	24.15	21.27	8.63	24.47	23.38
Maynooth A 110 kV	11.10	11.90	11.05	11.72	14.64	14.19	10.23	14.91	14.06	11.00	17.76	17.34
Maynooth A 220 kV	11.18	15.52	13.54	10.54	15.23	14.51	8.89	21.89	20.11	9.03	19.32	18.82

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

			Sur	nmer					Wir	iter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	lk' [kA]
Maynooth B 110 kV	8.88	15.33	13.70	10.13	15.14	14.57	7.68	19.02	17.84	9.28	17.70	17.35
Maynooth B 220 kV	12.00	17.07	14.66	10.73	17.10	16.18	9.29	25.75	23.42	8.97	22.73	22.07
McDermott 110 kV	15.01	9.74	8.94	6.47	11.68	11.27	16.32	13.88	12.58	5.74	15.56	14.97
Meath Hill 110 kV	4.14	7.99	7.53	5.24	6.84	6.72	3.87	10.21	9.49	5.18	7.91	7.75
Meentycat 110 kV	3.25	4.14	3.97	4.09	4.22	4.16	3.55	7.48	6.43	4.93	6.01	5.75
Midleton 110 kV	4.00	8.61	8.05	5.03	7.80	7.64	3.39	11.82	11.11	4.66	9.45	9.29
Milltown A 110 kV	15.02	12.55	11.43	6.94	15.22	14.63	14.65	15.43	13.78	6.50	18.01	17.19
Milltown B 110 kV	9.18	10.26	9.43	4.28	12.31	11.89	8.63	12.31	11.38	3.95	14.38	13.94
Misery Hill 110 kV	13.49	12.26	11.18	7.63	15.00	14.42	13.04	15.06	13.45	7.18	17.75	16.95
Moneteen 110 kV	5.88	9.95	9.16	6.69	7.49	7.33	5.24	12.86	11.93	6.38	8.58	8.43
Moneypoint 110 kV	14.68	8.27	7.90	17.28	8.52	8.38	15.71	10.98	10.44	18.67	10.35	10.18
Moneypoint 220 kV	13.19	13.70	12.27	12.75	18.00	17.11	15.03	28.63	25.89	13.17	33.66	32.28
Moneypoint G1 400 kV	13.57	9.37	8.29	15.10	11.35	10.77	15.45	17.71	16.25	17.45	18.60	18.02
Moneypoint G2 400 kV	13.57	9.37	8.29	15.10	11.35	10.77	15.45	17.71	16.25	17.45	18.60	18.02
Moneypoint G3 400 kV	13.57	9.37	8.29	15.10	11.35	10.77	15.45	17.71	16.25	17.45	18.60	18.02
Monread 110 kV	4.18	7.12	6.75	5.05	7.14	7.01	3.95	8.76	8.29	4.92	8.22	8.07
Mount Lucas 110 kV	4.44	6.44	6.06	5.63	5.99	5.88	4.73	8.85	8.28	6.19	7.35	7.22
Moy 110 kV	3.06	3.70	3.56	3.57	4.52	4.45	5.81	9.48	8.23	7.14	8.95	8.54
Mullagharlin 110 kV	3.93	8.04	7.58	4.93	7.89	7.74	3.47	9.81	9.17	4.60	9.04	8.85
Mullingar 110 kV	3.62	6.48	6.15	4.95	6.19	6.09	3.48	7.73	7.31	4.93	6.99	6.87
Mulreavy 110 kV	3.58	4.74	4.53	4.10	5.60	5.50	4.62	10.50	8.41	5.64	9.78	9.07
Mungret A 110 kV	5.50	9.48	8.76	6.34	7.00	6.86	4.90	12.11	11.28	6.04	7.95	7.83
Mungret B 110 kV	5.49	9.50	8.77	6.33	7.01	6.86	4.89	12.13	11.30	6.04	7.96	7.84
Nangor 110 kV	12.93	11.09	10.08	7.92	13.73	13.18	12.60	13.90	12.54	7.42	16.61	15.92
Navan 110 kV	5.89	11.15	10.22	6.58	11.17	10.84	5.18	14.26	13.15	6.11	13.23	12.89
Nenagh 110 kV	3.33	3.48	3.37	4.06	2.41	2.39	3.30	4.55	4.19	4.12	2.73	2.69
Newbridge 110 kV	4.50	9.95	9.23	5.21	9.95	9.69	4.10	12.83	11.96	4.96	11.86	11.60
Newbury 110 kV	13.53	9.68	8.72	7.33	10.88	10.44	13.83	13.05	11.58	6.81	13.60	13.02
North Kerry 220 kV	11.66	11.41	10.38	8.25	14.91	14.28	12.10	21.30	19.48	6.85	25.37	24.44
North Kerry A 110 kV	11.99	11.83	11.10	11.36	13.58	13.24	22.64	15.99	13.92	15.66	16.74	15.90
North Kerry B 110 kV	6.61	10.06	9.50	6.50	8.71	8.56	4.52	10.00	9.30	5.67	7.54	7.40
North Mayo 110 kV	3.03	3.06	2.96	3.30	4.03	3.97	6.03	8.53	7.04	6.61	9.23	8.56
North Quays 110 kV	18.32	12.80	11.64	6.48	15.25	14.65	18.27	15.79	14.08	6.05	18.02	17.21
North Wall 220 kV	13.15	12.92	11.15	9.29	15.51	14.55	14.38	24.80	21.83	7.98	25.57	24.38
Oldcourt A 110 kV	4.35	8.69	8.12	4.77	7.10	6.96	3.71	11.97	11.31	4.43	8.57	8.45

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

			Sur	nmer					Wir	iter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Oldcourt B 110 kV	4.39	8.73	8.16	4.80	7.16	7.03	3.74	12.06	11.39	4.46	8.66	8.54
Oldstreet 220 kV	15.70	9.51	8.78	12.78	10.38	10.06	14.99	12.66	12.04	11.92	12.92	12.70
Oldstreet 400 kV	12.64	8.57	7.67	8.94	7.64	7.37	10.71	12.62	11.96	7.78	9.72	9.58
Oriel 220 kV	10.08	10.47	9.53	8.47	10.86	10.49	9.35	15.93	14.59	7.71	14.53	14.13
Oughtragh 110 kV	3.70	3.79	3.64	4.77	2.71	2.69	3.60	5.23	4.88	4.82	3.14	3.10
Oweniney 110 kV	3.05	2.99	2.89	3.33	3.91	3.85	6.08	8.20	6.79	6.64	8.79	8.18
Pelletstown 110 kV	13.40	9.29	8.56	8.13	10.36	10.04	13.54	12.96	11.84	7.50	13.37	12.95
Platin 110 kV	5.23	10.89	9.97	5.79	8.61	8.41	4.55	13.55	12.64	5.42	9.78	9.61
Pollaphuca 110 kV	2.78	2.48	2.44	4.02	2.28	2.27	3.27	3.20	3.08	4.72	2.63	2.61
Poolbeg A 110 kV	26.16	13.34	12.10	21.39	16.71	16.01	27.74	16.54	14.74	21.73	20.05	19.09
Poolbeg A 220 kV	13.75	13.03	11.24	8.27	14.87	13.99	15.18	24.94	21.96	6.75	23.91	22.87
Poolbeg B 110 kV	26.13	13.33	12.08	21.37	16.69	16.00	27.71	16.51	14.71	21.72	20.01	19.06
Poolbeg B 220 kV	14.03	16.70	14.23	10.54	19.47	18.19	12.65	25.76	22.67	9.04	27.29	25.99
Poolbeg C 110 kV	20.62	13.06	11.85	7.51	15.60	14.98	20.91	16.16	14.38	7.05	18.49	17.65
Poppintree 110 kV	14.94	10.00	9.00	9.77	11.45	10.98	15.85	13.60	12.06	9.39	14.49	13.85
Portan 260 kV	18.79	10.78	9.76	87.61	3.20	3.17	17.09	15.11	14.47	104.56	3.37	3.36
Portan 400 kV	15.09	9.16	8.12	14.20	10.31	9.83	12.55	13.80	13.01	12.44	14.38	14.08
Portlaoise 110 kV	6.21	11.62	10.83	7.07	11.21	10.96	5.56	15.11	14.16	6.67	13.36	13.11
Pottery 110 kV	17.27	10.31	9.56	5.86	10.65	10.37	17.13	12.47	11.56	5.52	12.28	11.97
Prospect 220 kV	11.80	11.96	10.85	8.96	13.46	12.95	11.85	22.06	20.39	7.87	20.89	20.35
Raffeen 220 kV	10.70	9.64	8.65	10.08	12.54	11.94	12.25	20.01	17.92	10.31	22.90	21.90
Raffeen A 110 kV	7.63	11.51	10.55	8.31	13.99	13.49	7.12	17.77	16.38	8.07	19.82	19.21
Raffeen B 110 kV	8.65	11.11	10.20	9.33	13.51	13.03	8.25	17.29	15.89	9.20	19.24	18.63
Rathkeale 110 kV	3.60	6.63	6.28	4.82	5.43	5.35	3.40	8.26	7.78	4.79	6.09	6.00
Ratrussan 110 kV	3.22	5.87	5.61	4.02	6.65	6.53	3.63	8.29	7.09	4.81	8.52	8.05
Reamore 110 kV	4.24	5.13	4.91	3.60	5.04	4.97	4.60	8.71	7.78	3.46	6.88	6.67
Richmond A 110 kV	3.26	6.73	6.33	4.40	6.15	6.03	3.02	7.91	7.32	4.25	6.82	6.67
Richmond B 110 kV	3.26	6.73	6.33	4.40	6.15	6.03	3.02	7.91	7.32	4.25	6.82	6.67
Rinawade 110 kV	5.22	9.89	9.16	6.10	7.31	7.17	4.70	11.64	11.14	5.81	8.10	8.02
Ringaskiddy 110 kV	6.27	9.55	8.87	6.46	9.77	9.52	5.51	13.93	13.00	5.98	12.68	12.41
Ringsend 110 kV	26.59	13.44	12.16	22.51	16.83	16.12	28.22	16.73	14.83	22.99	20.25	19.25
Ryebrook 110 kV	5.77	12.87	11.37	6.57	11.80	11.34	5.09	15.47	14.31	6.11	13.29	12.99
Salthill 110 kV	5.00	9.47	8.85	4.05	11.44	11.12	5.13	13.96	12.67	3.86	15.44	14.87
Screeb 110 kV	3.59	2.40	2.33	3.37	2.81	2.78	4.26	3.18	2.89	3.72	3.45	3.33
Seal Rock A 110 kV	8.53	9.56	8.52	10.22	10.41	9.96	7.58	10.83	9.84	9.34	11.25	10.87
Seal Rock B 110 kV	8.56	9.57	8.53	10.24	10.41	9.96	7.61	10.84	9.84	9.35	11.25	10.87
Shankill 110 kV	3.73	7.09	6.69	4.74	6.70	6.58	3.75	9.79	8.58	5.03	8.23	7.92

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

	Summer						Winter							
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se		
Station	X/R Ratio	Ik" [kA]	Ik' [kA]											
Shannonbridge 110 kV	6.95	14.82	13.27	8.60	16.78	16.06	5.86	17.98	16.33	7.53	19.18	18.51		
Shannonbridge 220 kV	8.14	6.48	6.11	10.59	5.75	5.65	7.13	7.77	7.53	9.79	6.46	6.40		
Shellybanks A 220 kV	13.52	13.00	11.22	8.24	16.40	15.34	14.90	24.90	21.92	6.55	27.89	26.49		
Shellybanks B 220 kV	14.41	16.13	13.84	10.76	20.16	18.81	13.73	25.07	22.07	9.33	28.89	27.41		
Shelton Abbey 110 kV	7.82	6.77	6.49	7.78	7.21	7.11	7.09	8.63	8.13	7.37	8.64	8.47		
Singland 110 kV	6.88	12.34	11.33	7.74	11.31	11.01	6.60	19.15	17.36	7.77	14.59	14.22		
Sliabh Bawn 110 kV	3.49	8.26	7.74	4.45	7.98	7.81	3.44	10.60	9.66	4.58	9.31	9.05		
Slievecallan 110 kV	5.35	5.16	4.97	3.70	5.38	5.31	6.26	7.60	6.75	3.59	6.92	6.66		
Sligo 110 kV	3.87	7.27	6.86	4.46	7.34	7.19	3.58	11.14	10.07	4.41	9.60	9.31		
Somerset 110 kV	3.11	7.15	6.79	4.07	4.72	4.66	2.85	8.32	7.90	3.94	5.14	5.08		
Sorne Hill 110 kV	2.68	2.27	2.21	3.32	2.63	2.60	3.36	3.82	3.37	4.28	3.70	3.55		
Srananagh 110 kV	4.74	8.21	7.72	5.43	9.42	9.20	4.60	13.17	11.77	5.60	13.20	12.70		
Srananagh 220 kV	6.68	4.00	3.83	8.75	3.43	3.39	7.50	5.19	4.97	9.87	3.97	3.92		
Stevenstown 110 kV	4.85	5.16	4.85	5.18	3.59	3.54	4.51	6.24	5.76	5.02	3.95	3.88		
Stratford 110 kV	3.21	3.84	3.75	4.20	3.06	3.04	3.34	4.79	4.55	4.38	3.44	3.40		
Taney 110 kV	9.05	8.97	8.39	3.36	8.98	8.78	8.56	10.68	9.98	3.16	10.21	9.98		
Tarbert 110 kV	22.60	11.30	10.66	25.58	12.34	12.08	35.11	17.81	16.72	35.95	16.69	16.35		
Tarbert 220 kV	12.44	13.21	11.87	12.50	17.06	16.25	14.30	27.94	25.24	13.45	31.65	30.38		
Tawnaghmore A 110 kV	2.87	3.05	2.95	3.57	3.34	3.30	4.38	6.75	6.08	5.80	5.57	5.41		
Tawnaghmore B 110 kV	2.97	3.08	2.97	3.55	3.67	3.62	5.20	7.21	6.45	6.78	6.79	6.54		
Thornsberry 110 kV	4.11	5.76	5.48	5.30	5.46	5.38	4.22	7.78	7.32	5.66	6.73	6.62		
Thurles 110 kV	5.10	4.17	4.02	5.49	4.79	4.73	6.22	6.99	6.11	6.53	6.97	6.65		
Tievebrack 110 kV	3.37	3.32	3.20	4.50	2.66	2.63	3.65	5.22	4.70	5.10	3.24	3.17		
Tipperary 110 kV	5.09	6.09	5.82	6.08	4.20	4.15	5.31	8.61	7.98	6.36	4.88	4.81		
Tonroe 110 kV	2.68	3.12	3.04	3.74	1.98	1.97	2.72	3.75	3.49	3.84	2.13	2.10		
Trabeg 110 kV	7.59	13.32	12.04	8.27	15.54	14.92	7.41	23.77	20.98	8.42	23.81	22.78		
Tralee 110 kV	4.65	6.28	5.94	5.70	6.17	6.06	5.10	11.42	10.10	6.30	8.76	8.47		
Trien A 110 kV	3.07	3.25	3.13	4.07	3.39	3.34	4.30	9.33	8.60	5.66	7.58	7.41		
Trien B 110 kV	7.97	10.36	9.78	7.45	10.45	10.25	11.65	11.61	10.02	8.89	10.57	10.07		
Trillick 110 kV	2.72	2.43	2.36	3.40	2.66	2.63	3.44	4.20	3.66	4.39	3.71	3.55		
Trinity 110 kV	11.96	11.93	10.90	6.39	14.47	13.93	11.46	14.60	13.07	5.99	17.05	16.29		
Tullabrack 110 kV	6.90	6.36	6.12	7.50	5.14	5.09	6.69	8.30	7.90	7.44	5.95	5.88		

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2023

		Summer							Winter						
	Three Phase			Single Phase			Three Phase			Single Phase					
Station	X/R Ratio	Ik" [kA]	lk' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]			
Turlough 220 kV	11.90	11.63	10.42	12.94	10.56	10.19	9.92	13.95	13.03	11.50	11.81	11.58			
Tynagh 220 kV	13.81	9.75	8.90	15.24	11.36	10.95	14.23	13.68	12.73	15.96	14.45	14.07			
Uggool 110 kV	5.36	6.19	5.92	5.13	8.09	7.93	6.18	8.66	8.17	5.63	10.80	10.54			
Waterford 110 kV	8.26	10.94	10.29	8.19	12.23	11.95	7.10	14.30	13.19	7.34	15.01	14.58			
West Dublin 110 kV	21.16	17.91	15.66	22.97	13.24	12.79	20.85	22.10	20.23	22.96	14.90	14.60			
West Dublin 220 kV	12.77	17.83	15.12	10.58	19.53	18.28	10.30	27.25	24.20	8.78	26.76	25.67			
West Galway A 110 kV	3.97	4.46	4.30	3.60	4.44	4.38	4.50	6.12	5.57	3.76	5.37	5.22			
West Galway B 110 kV	5.35	6.47	6.17	4.90	8.42	8.25	6.09	9.07	8.54	5.23	11.24	10.96			
Wexford 110 kV	5.85	5.92	5.70	7.05	5.75	5.68	5.73	7.86	7.10	7.17	6.86	6.65			
Whitegate 110 kV	4.82	8.22	7.70	5.49	8.74	8.53	4.22	11.08	10.51	5.08	10.86	10.67			
Wolfe Tone 110 kV	13.66	9.56	8.78	5.94	11.34	10.96	14.20	13.54	12.29	5.24	15.00	14.45			
Woodhouse 110 kV	6.01	5.51	5.31	7.29	4.24	4.19	5.88	7.27	6.78	7.37	4.96	4.88			
Woodland 220 kV	14.97	16.69	14.28	13.97	19.14	17.94	12.44	28.50	25.70	12.13	28.92	27.87			
Woodland 400 kV	16.12	9.21	8.16	15.53	10.40	9.91	13.71	13.92	13.12	13.88	14.58	14.27			

### E.4. Short Circuit Currents in Northern Ireland

### E.4.1. Methodology Used in Northern Ireland

Short circuit current levels are calculated in accordance with the UK Engineering Recommendation G74, which is a computer based analysis, based on the International Standard IEC60909. Compliance with G74 includes:

- Short circuit current contributions from all synchronous and non-synchronous rotating plant including induction motors embedded in the general load;
- Comprehensive plant parameters including time-dependent impedances, transformer winding and earthing configurations;
- Pre-fault voltage levels at each node which should be obtained from a credible, pre-fault load flow study; and
- Pre-fault transformer tap settings should also be obtained from the load flow study.

The short circuit current level network model includes the following component parameters:

- Transformer impedance variation with tap position;
- Zero sequence mutual coupling effect;
- Unsaturated generator reactance values; and
- Power station auxiliaries fault level contributions.

The calculation of the X/R ratios, used by SONI, is undertaken in accordance with IEC60909-0 Method C, which is known as the equivalent frequency method. The equivalent frequency method is considered to be the most appropriate general purpose method for calculating the D.C. component of short circuit currents on the Northern Ireland transmission system.

The Northern Ireland transmission system is designed and operated to maintain short circuit current levels below the ratings of equipment at each substation. Table E-5 below, indicates the range of circuit breaker RMS ratings that are currently installed on the Northern Ireland transmission system, for the respective voltage levels currently operated.

Table E-5 Northern Ireland Station Equipment Rating Range by Voltage Level

Voltage Level (kV)	Short Circuit Current Equipment Rating Range (kA)
275	26.5 – 31.5
110	18.4 – 40

### E.4.2. Analysis

The generation dispatches used in the short circuit analysis are shown in Table D-7 in Appendix D.

The total RMS break current at a busbar is an indication of the short circuit level that one could expect at that point in the transmission system. However, they do not necessarily represent the short circuit current that could flow through each individual breaker, which may be lower.

### E.4.3. Northern Ireland Short Circuit Current Level Results

Tables E-6 to E-11 contain the following three-phase and single-phase short circuit current level results for maximum winter peak and minimum summer valley system demand conditions for 2017, 2020 and 2023:

### Initial Short Circuit Current (I")

This is the initial RMS value of the AC component of the short circuit current, prior to contact separation time. It is calculated using generator sub-transient reactances.

### Peak Make Current (ip)

The largest peak current occurs around 10ms, and is the short circuit current that equipment must be able to withstand, for example, when a circuit breaker is closed directly onto an earthed section of network, thus energising a fault. All equipment in the fault current path will be subjected to the peak make current, and therefore should be rated to withstand this.

#### • RMS Break Current (IB)

This is the RMS value of the AC component of the short circuit current at the time of circuit breaker contact separation. The break time at which contact separation occurs varies from circuit to circuit, and depends on protection settings, fault location, circuit breaker design etc. For the purposes of this report, we have used a short circuit current break time of 50ms for all 275 kV and 110 kV calculations.

In the Northern Ireland results tables, the RMS Break and Peak Make ratings of the existing nodes are shown. It should be noted that the Ballylumford 110 kV node (highlighted in the tables with \*) currently have separate ratings for three-phase and single-phase faults; these are indicated in the tables. All ratings are in kA.

Single phase to earth short circuit currents tend to be larger than three phase short circuit currents in heavily meshed transmission networks. This is due to the multiplicity of zero phase sequence paths available to earth fault currents. In all tables, any nodes where short circuit currents exceed 90% of the corresponding existing rating are highlighted in **orange**. Any nodes where short circuit currents exceed the corresponding existing ratings are highlighted in **red**.

The results presented in the following section are indicative only. They are based on intact network conditions and are representative of the assumed generation dispatch and transmission system conditions.

Table E-6 Northern Ireland Short Circuit Currents for Minimum Demand in 2017

	Rat	ing		TI	hree Pha	se			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
275kV												
Ballylumford	31.5	79	11.87	18.61	8.54	21.52	7.44	12.54	19.95	11.40	28.88	10.37
Castlereagh	31.5	79	11.05	16.72	8.31	20.76	7.24	10.90	17.05	10.03	25.02	9.18
Coolkeeragh	31.5	79	10.60	17.80	7.90	19.65	7.00	11.67	20.18	9.10	22.87	8.49
Hannahstown	31.5	79	11.06	16.72	8.16	20.38	7.12	10.94	17.34	9.83	24.55	9.02
Kells	31.5	79	12.08	19.04	8.94	22.57	7.76	11.33	17.72	10.98	27.52	10.05
Kilroot	31.5	79	12.68	20.33	8.86	22.47	7.70	13.52	22.06	11.85	30.26	10.79
Magherafelt	31.5	79	11.91	18.32	9.40	23.70	8.15	9.74	13.37	10.24	25.20	9.44
Moyle	31.5	79	11.82	18.41	8.46	21.31	7.38	12.40	19.51	11.22	28.39	10.22
Tandragee	31.5	79	11.07	16.71	9.88	24.69	8.54	10.51	16.38	11.73	29.15	10.71
Tamnamore	40	100	11.22	16.87	9.37	23.45	8.13	11.13	18.40	10.59	26.49	9.74
110kV												
Aghyoule	40	100	2.99	3.20	3.02	5.89	2.92	3.97	4.99	3.29	6.89	3.22
Antrim	40	100	4.85	7.88	7.74	16.95	7.28	4.93	9.86	8.26	18.14	7.98
D = 11, -1, £ =1 *	21.9	55	9.50	19.90	12.85	31.53	11.69					
Ballylumford*	26.2	65						10.43	21.90	16.64	41.29	15.60
Ballymena	40	100	4.98	8.50	7.46	16.43	7.01	5.43	11.50	8.16	18.27	7.87
Banbridge	18.4	46.8	4.33	6.42	6.76	14.44	6.40	5.22	9.77	6.82	15.16	6.62
Ballyvallagh	21.9	46.8	5.56	7.13	10.78	24.26	9.92	5.06	6.94	11.26	24.86	10.75
Ballynahinch	18.4	46.8	4.30	7.10	5.03	10.72	4.78	5.02	10.05	5.23	11.54	5.09
Belfast Central	n/a	n/a	8.55	12.82	10.77	26.05	9.79	5.59	11.77	13.67	30.79	12.79
Belfast North	n/a	n/a	5.19	8.05	10.06	22.32	9.25	3.34	11.89	11.20	22.47	10.65
Brockaghboy	40	100	4.56	4.92	3.34	7.22	3.24	4.12	5.19	2.87	6.05	2.83
Carnmoney	31.5	79	4.13	6.66	7.01	14.80	6.59	4.64	8.95	7.38	16.00	7.13
Castlereagh	31.5	79	11.38	20.43	12.76	31.99	11.43	12.72	21.25	17.09	43.36	15.76
Coleraine	40	100	3.81	4.26	6.16	12.78	5.79	4.37	5.46	7.52	16.09	7.22
Coolkeeragh	31.5	80	10.87	21.66	14.30	35.67	12.82	11.43	22.82	18.88	47.36	17.59
Creagh	31.5	80	3.75	4.33	6.91	14.27	6.53	4.48	6.76	7.55	16.25	7.31
Cregagh	26.2	65	9.52	15.21	11.77	28.87	10.62	7.60	13.80	15.29	36.34	14.21
Donegall North	31.5	79	8.27	13.46	11.19	26.93	10.21	5.90	11.03	14.47	32.93	13.57
Donegall South	n/a	n/a	6.27	9.13	9.28	21.36	8.59	5.25	9.28	10.76	23.95	10.25
Drumnakelly	31.5	79	7.92	12.69	14.83	35.47	13.29	7.63	12.95	17.31	41.17	16.15
Dungannon	18.4	46.8	7.18	12.91	12.99	30.60	11.80	7.05	13.36	15.48	36.34	14.55
Eden	25	62.5	4.29	6.50	7.58	16.16	7.12	4.66	8.58	8.00	17.37	7.73
Enniskillen	31.5	79	3.65	4.11	6.04	12.40	5.70	4.35	5.14	7.58	16.19	7.27
Finaghy	31.5	79	9.19	15.65	11.51	28.12	10.49	7.07	12.48	15.24	35.79	14.25
Glengormley	18.4	46.8	3.50	4.05	4.84	9.82	4.63	4.16	7.05	4.91	10.38	4.80

Table E-6 Northern Ireland Short Circuit Currents for Minimum Demand in 2017

	Rat	ing		T	hree Pha	se			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	1"	ip	IB	X/R	X/R	1"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
110kV												
Gort Cluster	40	100	6.02	7.38	6.47	14.78	6.14	5.90	11.07	6.52	14.85	6.34
Hannahstown	31.5	80	10.15	18.87	12.36	30.57	11.19	10.68	19.83	16.65	41.43	15.48
Kells	21.9	55.9	9.45	19.62	13.44	32.95	12.15	9.93	20.53	17.71	43.69	16.51
Killymallaght	40	100	6.18	7.93	9.07	20.83	8.44	5.77	9.55	9.42	21.35	9.07
Knock	n/a	n/a	5.45	8.07	11.34	25.42	10.27	3.42	11.20	12.75	25.75	12.00
Larne	18.4	46.8	4.68	5.84	7.39	16.06	6.97	5.22	8.66	7.59	16.88	7.35
Limavady	18.4	46.8	5.51	4.12	9.32	20.94	8.63	4.33	6.13	6.56	14.00	6.35
Lisburn	18.4	46.8	5.94	8.30	9.44	21.52	8.74	5.49	9.59	9.94	22.32	9.51
Lisaghmore	31.5	79	4.87	7.39	8.01	17.54	7.50	4.97	9.57	8.31	18.28	8.04
Loguestown	26.2	65	3.50	4.11	4.71	9.56	4.48	4.07	5.60	5.39	11.34	5.23
Magherakeel Cluster	40	100	27.87	4.67	9.02	24.24	8.48	5.40	6.24	3.81	8.52	3.74
Newtownards	40	100	4.67	7.19	6.27	13.62	5.91	5.78	10.06	6.73	15.25	6.50
Newry	18.4	46.8	4.76	6.74	9.89	21.57	9.12	4.86	9.76	5.15	11.29	5.02
Omagh	40	100	3.92	6.26	5.39	11.25	5.14	5.04	8.18	11.31	24.96	10.76
Rasharkin	40	100	4.36	4.39	5.35	11.44	5.07	4.46	7.02	5.73	12.31	5.58
Rathgael	26.2	65	10.35	6.85	12.05	29.87	10.85	5.04	9.81	5.56	12.27	5.40
Rosebank	40	100	10.35	17.15	12.05	29.87	10.85	11.31	18.77	15.88	39.78	14.72
Slieve Kirk	40	100	5.10	5.44	8.18	18.10	7.65	5.34	9.75	6.22	13.90	6.07
Springtown	n/a	n/a	5.41	7.81	10.68	23.90	9.81	5.14	9.78	8.63	19.13	8.34
Strabane	18.4	46.8	5.86	7.05	7.89	17.94	7.40	5.91	9.42	12.49	28.43	11.86
Tandragee	31.5	79	9.57	18.25	15.78	38.75	14.07	11.32	21.85	20.00	50.12	18.48
Tremoge	40	100	8.50	5.11	14.93	36.08	13.42	4.53	8.10	7.15	15.43	6.94
Tamnamore	40	100	5.09	18.17	7.30	16.15	6.88	9.20	19.72	19.83	48.44	18.39
Waringstown	18.4	46.8	5.17	7.89	7.33	16.25	6.91	5.74	10.64	7.39	16.74	7.16

Table E-7 Northern Ireland Short Circuit Currents for Maximum Demand in 2017

	Rating Three Phase Single Phase					se						
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
275kV												
Ballylumford	31.5	79	14.96	23.98	20.6	53.1744	18.3	16.12	26.80	23.74	61.55	22.25
Castlereagh	31.5	79	10.68	14.79	16.8	41.763	14.9	10.56	15.89	16.81	41.80	15.84
Coolkeeragh	31.5	79	8.73	13.86	12.7	30.7949	11.7	10.44	17.16	12.88	31.98	12.43
Hannahstown	31.5	79	11.08	15.42	16.7	41.7244	14.9	10.87	16.81	16.64	41.50	15.72
Kells	31.5	79	12.79	18.10	19.3	48.9971	17.2	11.19	16.37	19.58	48.99	18.55
Kilroot	31.5	79	14.14	21.03	18.9	48.4829	16.9	15.78	24.61	22.54	58.33	21.20
Magherafelt	31.5	79	11.48	15.28	18.9	47.4724	17	8.69	10.73	16.05	38.92	15.37
Moyle	31.5	79	14.63	22.97	20.1	51.7673	17.9	15.51	24.92	22.93	59.26	21.53
Tandragee	31.5	79	10.24	13.54	19.6	48.4513	17.5	9.70	14.22	19.18	47.19	18.16
Tamnamore	40	100	10.50	13.76	18.3	45.4015	16.4	10.64	16.92	16.63	41.38	15.86
110kV												
Aghyoule	40	100	3.96	8.87	4.16	8.71	3.93	5.36	12.20	4.11	9.18	4.01
Antrim	40	100	4.24	7.42	10.18	21.64	9.68	4.54	9.76	9.97	21.51	9.74
Dallydy mafa yd*	21.9	55	10.66	25.82	24.02	59.77	22.12					
Ballylumford*	26.2	65						12.36	29.77	27.74	70.18	26.56
Ballymena	40	100	4.46	8.39	9.84	21.15	9.31	5.14	11.82	10.10	22.38	9.84
Banbridge	18.4	46.8	3.81	6.01	7.93	16.45	7.62	4.88	9.51	7.54	14.55	7.38
Ballyvallagh	21.9	46.8	4.48	5.25	16.63	35.78	15.55	4.38	5.79	14.90	31.90	14.48
Ballynahinch	18.4	46.8	3.90	6.64	5.87	12.24	5.59	4.78	9.81	5.82	12.70	5.65
Belfast Central	n/a	n/a	4.30	6.77	13.75	29.31	12.78	2.89	11.45	13.81	26.71	13.25
Belfast North	n/a	n/a	7.22	11.19	15.50	36.52	14.11	4.69	10.92	18.29	39.77	17.13
Brockaghboy	40	100	5.20	6.35	5.70	12.66	4.62	4.21	5.91	3.43	7.27	3.26
Carnmoney	31.5	79	3.59	6.12	8.95	18.28	8.55	4.27	8.67	8.70	18.53	8.49
Castlereagh	31.5	79	9.96	20.12	19.99	49.32	17.83	11.80	23.77	25.20	63.44	23.16
Coleraine	40	100	4.11	5.78	9.94	20.98	8.94	4.94	7.78	10.71	23.53	10.18
Coolkeeragh	31.5	80	9.12	18.62	23.58	57.53	21.26	10.11	20.45	28.76	71.10	27.19
Creagh	31.5	80	3.22	3.58	8.42	16.74	8.08	4.10	6.13	8.70	18.34	8.51
Cregagh	26.2	65	8.07	13.62	17.67	42.37	15.92	6.45	12.73	21.44	49.58	19.89
Donegall North	31.5	79	7.34	11.93	16.00	37.82	14.74	5.05	9.91	19.46	42.96	18.39
Donegall South	n/a	n/a	5.42	7.78	12.34	27.62	11.55	4.64	8.52	13.25	28.75	12.73
Drumnakelly	31.5	79	6.47	10.35	22.69	52.51	20.72	6.64	11.58	23.63	54.95	22.42
Dungannon	40	100	6.11	10.85	19.32	44.25	17.97	6.38	12.35	20.84	48.10	20.00
Eden	25	62.5	3.66	5.60	10.12	20.77	9.67	4.26	8.05	9.70	20.61	9.48
Enniskillen	31.5	79	3.81	4.82	9.10	18.87	8.46	4.85	6.43	10.51	23.02	10.10
Finaghy	31.5	79	8.37	14.38	16.65	40.15	15.31	6.16	11.27	20.89	47.91	19.68
Glengormley	18.4	46.8	3.11	3.50	5.66	11.16	5.45	3.93	6.61	5.47	11.43	5.37

Table E-7 Northern Ireland Short Circuit Currents for Maximum Demand in 2017

	Rat	ing		1	hree Pha	ıse		Single Phase				
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
110kV												
Gort Cluster	40	100	6.22	8.10	8.42	19.34	8.06	6.00	12.48	7.65	17.47	7.52
Hannahstown	31.5	80	9.50	18.53	18.48	45.34	16.88	10.25	19.85	23.66	58.60	22.17
Kells	40	100	8.38	18.41	22.34	53.87	20.38	9.18	19.96	27.50	67.16	26.10
Killymallaght	40	100	5.68	7.96	13.02	29.43	12.26	5.39	9.91	11.90	26.62	11.62
Knock	n/a	n/a	4.25	6.61	16.60	35.31	15.04	2.85	10.75	16.44	31.65	15.52
Larne	18.4	46.8	4.00	4.76	9.80	20.56	9.36	4.81	8.03	9.12	19.94	8.94
Limavady	18.4	46.8	3.60	4.42	8.05	16.46	7.50	4.45	7.15	8.30	17.83	8.03
Lisburn	18.4	46.8	5.26	7.39	12.69	28.25	11.90	5.04	9.26	12.06	26.62	11.67
Lisaghmore	31.5	79	4.12	6.50	10.26	21.67	9.74	4.50	9.07	9.76	21.03	9.55
Loguestown	26.2	65	3.57	4.94	6.65	13.57	6.16	4.32	6.99	6.86	14.64	6.62
Magherakeel Cluster	40	100	5.17	9.55	4.27	9.47	4.25	6.80	12.20	4.72	11.03	4.71
Newtownards	40	100	4.27	6.71	8.24	17.54	7.79	5.42	9.90	7.69	17.21	7.45
Newry	18.4	46.8	3.70	6.32	5.77	11.87	5.53	4.73	9.53	5.66	12.33	5.52
Omagh	40	100	4.61	6.80	16.04	34.73	14.88	5.08	9.56	15.93	35.21	15.39
Rasharkin	40	100	4.46	6.67	9.00	19.34	7.82	4.96	10.61	7.57	16.65	7.22
Rathgael	26.2	65	3.92	6.35	6.31	13.16	6.00	4.77	9.51	6.23	13.59	6.05
Rosebank	40	100	8.90	15.84	18.28	44.45	16.45	10.30	18.23	22.61	56.05	20.94
Slieve Kirk	40	100	4.35	6.34	9.13	19.53	8.75	5.42	11.23	7.43	16.64	7.32
Springtown	n/a	n/a	4.29	6.79	10.52	22.43	9.97	4.64	9.20	10.24	22.20	9.99
Strabane	18.4	46.8	4.59	5.99	16.42	35.52	15.18	5.41	9.05	17.11	38.29	16.49
Tandragee	31.5	79	8.13	16.42	24.96	59.92	22.63	10.50	21.31	28.90	71.77	27.14
Tremoge	40	100	4.06	5.81	9.47	19.94	9.15	4.51	9.34	8.55	18.43	8.43
Tamnamore	40	100	7.30	16.16	23.63	55.80	21.81	8.29	18.27	29.24	70.41	27.80
Waringstown	18.4	46.8	4.60	7.27	8.81	19.07	8.42	5.37	10.28	8.27	18.48	8.07

Table E-8 Northern Ireland Short Circuit Currents for Minimum Demand in 2020

	Rat	ing		1	Three Pha	ıse			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
275kV							,					
Ballylumford	31.5	79	13.31	21.37	9.77	24.91	9.00	13.90	23.07	12.27	31.40	11.91
Castlereagh	31.5	79	11.56	17.33	9.11	22.89	8.43	11.32	17.56	10.79	27.04	10.54
Coolkeeragh	31.5	79	10.40	16.89	8.36	20.73	7.86	11.51	19.41	9.47	23.78	9.40
Hannahstown	31.5	79	11.69	17.59	9.01	22.65	8.35	11.46	18.11	10.58	26.56	10.35
Kells	31.5	79	12.75	19.88	9.83	24.95	9.05	11.75	18.18	11.79	29.66	11.49
Kilroot	31.5	79	13.27	20.81	9.62	24.52	8.88	14.19	22.74	12.72	32.61	12.32
Magherafelt	31.5	79	12.42	18.80	10.26	25.97	9.45	9.83	13.14	10.92	26.90	10.73
Moyle	31.5	79	13.20	21.01	9.66	24.60	8.91	13.76	22.56	12.09	30.90	11.75
Tandragee	31.5	79	11.41	16.94	10.70	26.83	9.85	10.85	16.75	12.64	31.52	12.31
Tamnamore	40	100	11.58	17.11	10.15	25.50	9.37	11.30	18.17	11.61	29.08	11.36
110kV												
Aghyoule	40	100	2.98	3.18	3.06	5.95	3.19	3.95	4.95	3.33	6.97	3.55
Antrim	40	100	4.86	7.79	7.89	17.28	7.91	4.93	9.82	8.37	18.38	8.63
D = 11, -1, £ =1 *	21.9	55	7.68	18.41	11.33	26.97	11.10					
Ballylumford*	26.2	65						8.54	20.28	14.22	34.38	14.33
Ballymena	40	100	4.99	8.43	7.60	16.73	7.63	5.45	11.49	8.26	18.51	8.54
Banbridge	18.4	46.8	4.27	6.33	6.87	14.63	6.98	5.19	9.78	6.88	15.27	7.19
Ballyvallagh	40	100	5.50	7.45	10.48	23.54	10.31	5.07	7.16	10.97	24.24	11.19
Ballynahinch	18.4	46.8	4.28	7.04	5.10	10.87	5.18	5.02	10.03	5.29	11.65	5.50
Belfast Central	n/a	n/a	8.69	12.82	11.14	26.99	10.80	5.53	11.69	14.05	31.59	14.03
Belfast North	n/a	n/a	5.14	7.95	10.42	23.09	10.24	3.28	11.84	11.49	22.95	11.67
Brockaghboy	40	100	4.55	4.87	3.37	7.28	3.49	4.11	5.17	2.88	6.08	3.03
Carnmoney	31.5	79	4.15	6.81	6.98	14.76	7.01	4.65	9.10	7.35	15.94	7.59
Castlereagh	31.5	79	11.83	21.02	13.28	33.43	12.69	12.49	23.84	17.69	44.81	17.42
Coleraine	40	100	3.78	4.19	6.25	12.93	6.26	4.34	5.40	7.61	16.25	7.80
Coolkeeragh	31.5	80	10.61	20.97	14.62	36.37	13.96	11.18	22.16	19.20	48.05	19.06
Creagh	31.5	80	3.71	4.23	7.04	14.50	7.11	4.45	6.69	7.65	16.43	7.93
Cregagh	26.2	65	9.75	15.33	12.21	30.05	11.75	7.60	13.72	15.78	37.49	15.65
Donegall North	31.5	79	8.38	13.66	11.64	28.06	11.34	5.86	11.03	14.95	33.99	14.98
Donegall South	n/a	n/a	6.25	9.03	9.57	22.02	9.47	5.20	9.22	11.03	24.50	11.23
Curraghamulkin	40	100	4.59	12.57	4.74	10.25	4.88	5.10	12.92	4.99	11.04	5.27
Drumnakelly	31.5	79	7.91	5.11	15.52	37.10	14.86	7.63	8.17	17.92	42.61	17.90
Dungannon	40	100	7.14	12.83	13.49	31.74	13.10	5.21	13.38	15.94	35.42	16.05
Eden	25	62.5	4.27	6.75	7.31	15.55	7.34	4.67	8.76	7.77	16.87	8.02
Enniskillen	31.5	79	3.63	4.07	6.19	12.68	6.27	4.26	5.08	7.81	16.63	8.08
Finaghy	31.5	79	9.39	16.00	11.99	29.36	11.66	7.07	12.52	15.77	37.05	15.76

Table E-8 Northern Ireland Short Circuit Currents for Minimum Demand in 2020

	Rat	ing		1	hree Pha	ıse			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	1"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
110kV												
Glengormley	18.4	46.8	3.48	3.98	4.89	9.92	5.00	4.15	7.02	4.94	10.46	5.18
Gort Cluster	40	100	5.99	7.27	6.56	14.98	6.68	5.85	11.01	6.59	14.98	6.91
Hannahstown	31.5	80	10.47	19.70	12.90	32.04	12.48	11.01	20.65	17.28	43.16	17.18
Kells	31.5	79	9.92	20.44	13.89	34.27	13.39	10.41	21.36	18.20	45.17	18.10
Killymallaght	40	100	6.09	7.78	9.26	21.20	9.21	5.70	9.44	9.56	21.62	9.87
Knock	n/a	n/a	5.44	7.94	11.75	26.34	11.34	3.36	11.19	13.09	26.32	13.14
Larne	18.4	46.8	4.66	6.02	7.25	15.73	7.29	5.21	8.81	7.47	16.60	7.74
Limavady	18.4	46.8	3.66	4.06	5.83	11.97	5.88	4.30	6.08	6.62	14.12	6.83
Lisburn	18.4	46.8	5.91	8.17	9.75	22.19	9.64	5.45	9.54	10.16	22.77	10.40
Lisaghmore	31.5	79	4.81	7.30	8.12	17.74	8.11	4.93	9.50	8.39	18.43	8.67
Loguestown	26.2	65	3.47	4.06	4.76	9.65	4.83	4.05	5.56	5.43	11.43	5.63
Magherakeel Cluster	40	100	4.26	4.62	3.23	6.87	3.37	5.38	6.21	3.82	8.55	4.05
Newtownards	40	100	4.85	7.12	6.82	14.93	6.84	5.80	10.05	6.82	15.46	7.04
Newry	18.4	46.8	3.95	6.69	5.13	10.72	5.26	4.87	9.74	5.22	11.43	5.47
Omagh	40	100	4.70	6.13	10.15	22.07	10.03	4.95	7.80	11.77	25.87	12.03
Omagh South	40	100	42.5	4.62	7.75	16.18	7.78	4.08	4.97	8.65	18.23	8.94
Rasharkin	40	100	3.89	4.32	5.47	11.39	5.55	4.44	6.97	5.78	12.42	6.00
Rathgael	26.2	65	4.34	6.80	5.44	11.62	5.51	5.05	9.78	5.62	12.40	5.83
Rosebank	40	100	10.67	17.41	12.51	31.13	12.02	11.65	19.17	16.39	41.21	16.23
Slieve Kirk	40	100	4.56	5.36	6.99	15.10	7.07	5.35	9.54	6.34	14.16	6.63
Springtown	n/a	n/a	5.04	7.71	8.30	18.31	8.27	5.10	9.70	8.72	19.29	8.99
Strabane	18.4	46.8	5.32	6.90	10.96	24.45	10.78	5.83	9.28	12.75	28.95	12.99
Tandragee	31.5	79	9.68	18.54	16.57	40.73	15.78	11.54	22.52	20.84	52.32	20.60
Tamnamore	40	100	8.51	5.01	15.62	37.74	14.99	9.25	8.04	20.62	50.41	20.45
Tremoge Cluster	40	100	4.15	18.42	7.17	15.17	7.27	4.50	20.04	7.26	15.63	7.59
Waringstown	18.4	46.8	5.08	7.66	7.46	16.48	7.52	5.65	10.39	7.45	16.82	7.72

Table E-9 Northern Ireland Short Circuit Currents for Maximum Demand in 2020

	Rat	Rating Three Phase							Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
400kV												
Turleenan	50	125	15.09	18.68	10.31	26.59	9.93	12.78	18.28	11.30	28.68	3.24
275kV	,								,			
Ballylumford	31.5	79	13.39	20.16	18.97	48.38	18.08	14.52	23.27	21.25	54.60	6.09
Castlereagh	31.5	79	10.53	14.53	16.74	41.60	15.72	10.50	15.73	16.87	41.92	4.83
Coolkeeragh	31.5	79	8.47	13.36	13.02	31.44	12.64	10.20	16.71	13.07	32.34	3.74
Hannahstown	31.5	79	10.77	14.85	16.39	40.83	15.45	10.71	16.38	16.40	40.84	4.70
Kells	31.5	79	12.56	17.60	19.34	49.00	18.45	11.07	16.14	19.54	48.83	5.60
Kilroot	31.5	79	13.94	20.60	19.05	48.78	18.31	15.60	24.18	22.63	58.52	6.48
Magherafelt	31.5	79	11.64	15.41	19.94	50.12	18.97	8.59	10.56	16.73	40.49	4.79
Moyle	31.5	79	13.19	19.58	18.56	47.26	17.69	14.19	22.25	20.68	53.02	26.34
Tandragee	31.5	79	10.56	14.11	21.05	52.31	19.75	9.69	14.37	20.59	50.64	5.90
Tamnamore	40	100	11.12	14.68	20.49	51.23	19.37	10.50	17.39	19.05	47.31	5.46
Turleenan	40	100	11.11	14.71	20.77	51.93	19.61	9.87	15.35	19.16	47.22	5.49
110kV												
Aghyoule	40	100	3.62	8.32	4.59	9.39	4.26	5.06	11.72	4.24	9.36	1.21
Antrim	40	100	4.28	7.56	10.37	22.09	10.10	4.56	9.89	10.07	21.76	2.89
Ballylumford	40	100	10.32	24.38	23.77	58.92	22.99	11.95	28.13	27.42	69.11	7.85
Ballymena	40	100	4.47	8.53	9.97	21.44	9.65	5.20	12.02	10.16	22.51	2.91
Banbridge	18.4	46.8	3.82	5.68	8.10	16.79	7.87	4.91	9.39	7.67	16.83	2.20
Ballyvallagh	40	100	4.45	5.20	16.64	35.76	16.12	4.36	5.77	14.90	31.88	4.27
Ballynahinch	18.4	46.8	3.89	6.62	5.90	12.29	5.67	4.78	9.79	5.85	12.77	1.68
Belfast Central	n/a	n/a	7.18	11.04	15.64	36.83	14.55	4.62	10.82	18.44	39.96	5.28
Belfast North	n/a	n/a	4.27	6.74	13.81	29.40	13.12	2.88	11.34	13.89	26.83	3.98
Brockaghboy	40	100	5.20	6.34	5.72	12.71	4.73	4.21	5.90	3.43	7.28	0.98
Carnmoney	31.5	79	3.58	6.10	8.92	18.20	8.66	4.26	8.64	8.70	18.51	2.49
Castlereagh	31.5	79	9.93	19.77	20.22	49.88	18.54	11.79	23.48	25.50	64.19	7.31
Coleraine	40	100	4.10	5.77	10.03	21.15	9.49	4.93	7.78	10.80	23.71	3.09
Coolkeeragh	31.5	80	8.89	18.18	23.86	58.02	22.94	9.87	20.03	28.97	71.41	8.30
Creagh	31.5	80	3.21	3.54	8.54	16.96	8.32	4.09	6.16	8.75	18.44	2.51
Cregagh	26.2	65	8.03	13.40	17.85	42.77	16.48	6.35	12.53	21.65	49.94	6.20
Donegall North	31.5	79	5.19	7.80	6.97	15.48	6.66	5.70	12.07	6.32	14.29	1.81
Donegall South	n/a	n/a	7.25	11.81	16.06	37.87	15.16	4.99	9.77	19.52	42.99	5.59
Curraghamulkin	40	100	5.38	7.66	12.40	27.72	11.84	4.58	8.30	13.30	28.76	3.81
Drumnakelly	31.5	79	6.54	10.49	23.55	54.59	22.15	6.67	11.62	24.25	56.40	6.95
Dungannon	40	100	6.11	11.04	20.22	46.30	19.34	6.36	12.42	21.52	49.64	6.16
Eden	25	62.5	3.65	5.59	10.10	20.70	9.84	4.25	8.03	9.68	20.56	2.77

Table E-9 Northern Ireland Short Circuit Currents for Maximum Demand in 2020

	Rat	ing		1	Three Pha	ıse			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	1"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
110kV												
Enniskillen	31.5	79	3.57	4.91	11.70	23.87	9.82	4.66	6.77	11.90	25.83	3.41
Finaghy	31.5	79	8.25	14.13	16.71	40.20	15.77	6.08	11.09	20.94	47.93	6.00
Glengormley	18.4	46.8	3.10	3.47	5.72	11.26	5.57	3.91	6.62	5.50	11.47	1.58
Gort Cluster	40	100	6.20	8.16	8.82	20.25	8.73	5.90	12.55	7.94	18.07	2.28
Hannahstown	31.5	80	9.33	18.11	18.53	45.36	17.41	10.08	19.41	23.70	58.59	6.79
Kells	31.5	79	8.43	18.24	22.64	54.64	21.54	9.26	19.84	27.74	67.81	7.95
Killymallaght	40	100	5.59	7.85	13.22	29.77	12.89	5.33	9.75	11.98	26.75	3.43
Knock	n/a	n/a	4.22	6.58	16.76	35.60	15.56	2.84	10.85	16.57	31.90	4.75
Larne	18.4	46.8	3.98	4.73	9.82	20.58	9.60	4.79	8.01	9.13	19.94	2.62
Limavady	18.4	46.8	3.59	4.41	8.13	16.61	7.87	4.44	7.14	8.38	17.99	2.40
Lisburn	18.4	46.8	5.22	7.34	12.82	28.49	12.30	5.01	9.03	12.23	26.85	3.50
Lisaghmore	31.5	79	4.09	6.48	10.38	21.89	10.17	4.49	9.05	9.86	21.24	2.83
Loguestown	26.2	65	3.56	4.93	6.71	13.68	6.44	4.31	6.99	6.91	14.75	1.98
Magherakeel Cluster	40	100	5.09	9.35	4.38	9.69	4.47	6.74	12.05	4.79	11.16	1.37
Newtownards	40	100	4.26	6.59	8.30	17.66	7.95	5.42	9.65	7.76	17.37	2.22
Newry	18.4	46.8	3.81	7.37	5.94	12.32	5.75	4.85	10.67	5.75	12.60	1.65
Omagh	40	100	4.49	6.99	17.73	38.18	16.74	4.94	9.42	17.30	38.02	4.96
Omagh South	40	100	3.81	5.84	13.40	27.78	12.21	4.06	5.88	12.16	25.59	3.48
Rasharkin	40	100	4.46	6.66	9.06	19.47	8.19	4.96	10.60	7.61	16.73	2.18
Rathgael	26.2	65	3.90	6.32	6.33	13.21	6.08	4.76	9.48	6.25	13.63	1.79
Rosebank	40	100	8.90	15.71	18.49	44.98	17.07	10.31	18.13	22.88	56.71	6.56
Slieve Kirk	40	100	4.29	6.24	9.24	19.69	9.09	5.33	11.26	7.42	16.56	2.13
Springtown	n/a	n/a	4.25	6.68	10.60	22.55	10.36	4.59	9.06	10.27	22.22	2.94
Strabane	18.4	46.8	4.48	5.90	16.88	36.33	16.20	5.31	8.99	17.41	38.82	4.99
Tandragee	31.5	79	8.31	17.13	25.92	62.42	24.27	9.33	19.54	29.78	72.89	8.53
Tamnamore	40	100	7.36	16.83	24.86	58.78	23.70	8.39	19.09	30.53	73.62	8.75
Tremoge Cluster	40	100	4.00	5.75	9.84	20.63	9.62	4.45	9.31	8.78	18.87	2.52
Waringstown	18.4	46.8	4.59	7.25	9.00	19.47	8.72	5.37	10.29	8.41	18.80	2.41

Table E-10 Northern Ireland Short Circuit Currents for Minimum Demand in 2023

	Rat	ing		1	Three Pha	ıse			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
400kV												
Turleenan	50	125	14.53	20.73	7.36	18.90	6.60	12.87	19.84	8.66	22.00	8.08
275kV												
Ballylumford	31.5	79	13.38	20.83	10.91	27.82	9.59	14.08	22.80	13.59	34.81	12.52
Castlereagh	31.5	79	11.70	17.09	10.17	25.58	8.96	11.42	17.45	11.75	29.47	10.87
Coolkeeragh	31.5	79	14.05	20.55	9.28	23.77	8.34	14.70	23.38	10.18	26.18	9.60
Hannahstown	31.5	79	11.80	17.25	10.01	25.20	8.84	11.50	17.86	11.48	28.80	10.64
Kells	31.5	79	13.17	19.94	11.09	28.24	9.74	11.91	18.06	12.94	32.60	11.97
Kilroot	31.5	79	13.51	20.41	10.72	27.36	9.44	14.53	22.59	13.91	35.74	12.80
Magherafelt	31.5	79	13.48	20.49	12.00	30.62	10.50	9.96	13.22	12.14	29.95	11.30
Moyle	31.5	79	13.26	20.46	10.77	27.45	9.48	13.90	22.18	13.35	34.17	12.32
Tandragee	31.5	79	12.02	17.88	12.50	31.52	10.87	10.87	16.87	14.17	35.35	13.01
Tamnamore	40	100	12.70	18.98	12.37	31.37	10.79	11.68	20.01	13.47	33.86	12.44
Turleenan	40	100	12.66	18.96	12.54	31.79	10.93	11.08	18.00	13.58	33.94	12.53
110kV												
Aghyoule	40	100	2.96	3.15	3.03	5.89	2.94	3.94	4.88	3.31	6.91	3.25
Airport Road	40	100	4.86	7.15	7.38	16.17	7.00	5.27	9.84	7.54	16.78	7.31
Antrim	40	100	4.72	7.69	8.36	18.20	7.93	4.84	9.79	8.70	19.03	8.45
Ballylumford	40	100	9.77	21.28	14.62	35.98	13.48	10.83	23.63	18.41	45.90	17.46
Ballymena	40	100	4.89	8.27	8.06	17.66	7.64	5.40	11.71	8.09	18.10	7.86
Banbridge	18.4	46.8	4.17	6.07	7.10	15.03	6.79	5.11	9.64	7.00	15.49	6.83
Ballyvallagh	40	100	5.35	6.65	11.97	26.74	11.15	4.92	6.63	12.06	26.47	11.61
Ballynahinch	18.4	46.8	4.22	6.98	5.24	11.13	5.03	4.97	10.00	5.40	11.88	5.27
Belfast Central	n/a	n/a	8.50	12.55	11.80	28.52	10.88	5.39	11.52	14.80	33.10	13.98
Belfast North	18.4	46.8	5.01	7.72	10.94	24.11	10.20	3.21	11.73	11.87	23.59	11.39
Brockaghboy	40	100	4.65	5.14	3.17	6.89	3.10	5.05	6.84	3.25	7.18	3.21
Carnmoney	31.5	79	4.01	6.45	7.43	15.63	7.09	4.54	8.83	7.68	16.59	7.48
Castlereagh	40	100	11.69	21.08	14.24	35.82	12.94	12.81	22.98	18.92	48.05	17.63
Coleraine	40	100	3.76	4.22	6.47	13.37	6.13	4.31	5.45	7.82	16.68	7.55
Coolkeeragh	31.5	80	11.42	23.86	15.40	38.62	14.01	11.97	25.03	20.02	50.49	18.85
Creagh	31.5	80	3.61	4.07	7.31	14.97	6.99	4.38	6.58	7.84	16.78	7.64
Cregagh	26.2	65	9.56	15.10	13.02	31.96	11.91	7.43	13.53	16.73	39.62	15.70
Donegall North	31.5	79	8.28	13.38	12.29	29.58	11.37	5.73	10.82	15.64	35.40	14.81
Donegall South	n/a	n/a	6.13	8.73	10.02	22.97	9.40	5.11	9.07	11.39	25.20	10.94
Curraghamulkin	40	100	4.56	5.04	4.73	10.22	4.57	5.12	8.09	4.96	10.99	4.87
Drumnakelly	31.5	79	7.90	12.55	16.90	40.40	15.35	7.59	12.92	19.05	45.27	17.95
Dungannon	40	100	7.18	13.14	14.63	34.45	13.46	7.07	13.73	16.91	39.73	16.05

Table E-10 Northern Ireland Short Circuit Currents for Minimum Demand in 2023

	Rat											
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
110kV												
Eden	25	62.5	4.14	6.25	8.09	17.12	7.69	4.59	8.45	8.35	18.07	8.12
Enniskillen	31.5	79	3.61	4.02	6.28	12.85	5.97	4.24	5.03	7.90	16.79	7.61
Finaghy	31.5	79	9.31	15.77	12.68	31.02	11.71	6.95	12.29	16.53	38.73	15.62
Agivey Cluster	40	100	4.53	5.06	3.51	7.58	3.42	5.34	7.67	3.83	8.55	3.77
Glengormley	18.4	46.8	3.40	3.86	5.05	10.19	4.88	4.10	6.90	5.07	10.69	4.97
Gort Cluster	40	100	5.94	7.14	6.68	15.22	6.41	5.89	10.99	6.64	15.11	6.50
Hannahstown	31.5	80	10.44	19.60	13.71	34.04	12.60	11.01	20.62	18.20	45.47	17.11
Kells	40	100	9.69	20.26	15.31	37.66	14.00	10.23	21.28	19.77	48.95	18.62
Killymallaght	40	100	6.11	7.70	9.49	21.74	8.94	5.70	9.41	9.66	21.85	9.37
Knock	n/a	n/a	5.25	7.68	12.50	27.81	11.47	3.25	11.00	13.72	27.35	13.02
Larne	18.4	46.8	4.52	5.53	7.93	17.09	7.54	5.13	8.48	7.95	17.61	7.75
Limavady	18.4	46.8	3.64	4.02	5.96	12.21	5.68	4.85	9.16	10.50	22.98	10.12
Lisburn	18.4	46.8	5.79	7.95	10.21	23.15	9.56	5.37	9.42	10.46	23.39	10.09
Lisaghmore	31.5	79	4.84	7.33	8.32	18.20	7.88	4.97	9.61	8.53	18.76	8.29
Loguestown	26.2	65	3.46	4.09	4.86	9.85	4.66	4.03	5.61	5.52	11.60	5.38
Magherakeel Cluster	40	100	4.23	4.56	3.18	6.75	3.11	5.32	6.07	3.78	8.44	3.73
Newtownards	40	100	4.74	6.94	7.06	15.38	6.70	5.67	9.70	6.97	15.74	6.77
Newry	18.4	46.8	3.90	6.62	5.25	10.95	5.06	4.84	9.72	5.30	11.59	5.19
Omagh	40	100	4.61	5.93	10.69	23.14	9.98	4.90	7.69	12.16	26.69	11.65
Omagh South	40	100	3.87	4.51	7.96	16.56	7.53	4.03	4.86	8.75	18.39	8.46
Rasharkin	40	100	3.92	4.65	5.72	11.94	5.47	4.45	6.59	6.30	13.54	6.15
Rathgael	26.2	65	4.26	6.69	5.58	11.88	5.34	4.96	9.71	5.72	12.58	5.58
Rosebank	40	100	10.50	17.30	13.37	33.21	12.21	11.31	18.46	17.48	43.80	16.36
Slieve Kirk	40	100	4.54	5.27	7.09	15.30	6.77	5.31	9.65	6.31	14.07	6.18
Springtown	n/a	n/a	5.06	7.71	8.50	18.78	8.04	5.11	9.73	8.84	19.56	8.59
Strabane	18.4	46.8	5.28	6.74	11.34	25.26	10.55	5.82	9.18	13.04	29.61	12.49
Tandragee	40	100	9.87	19.35	18.15	44.74	16.39	10.50	21.15	22.39	55.63	20.90
Tamnamore	40	100	4.07	4.88	7.35	15.48	7.03	4.46	7.97	7.32	15.75	7.15
Tremoge Cluster	40	100	8.72	19.74	17.19	41.68	15.65	9.52	21.61	22.33	54.80	20.92
Waringstown	18.4	46.8	4.99	7.47	7.71	16.99	7.35	5.57	10.26	7.56	17.02	7.37

Table E-11 Northern Ireland Short Circuit Currents for Maximum Demand in 2023

	Rat	ing		1	Three Pha	ise			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
400kV							,					
Turleenan	50.0	125	15.18	19.14	10.67	27.53	10.01	12.80	18.56	11.66	29.59	11.28
275kV												
Ballylumford	31.5	79	13.70	20.48	19.19	49.04	17.14	14.73	23.57	21.31	54.82	20.10
Castlereagh	31.5	79	10.69	14.65	16.94	42.17	15.11	10.65	15.87	17.09	42.53	16.12
Coolkeeragh	31.5	79	13.17	17.67	13.37	34.02	12.38	14.25	21.54	13.29	34.10	12.86
Hannahstown	31.5	79	10.93	14.97	16.57	41.36	14.84	10.82	16.48	16.56	41.28	15.67
Kells	31.5	79	12.93	18.03	19.58	49.77	17.51	11.24	16.35	19.71	49.35	18.72
Kilroot	31.5	79	14.26	20.87	19.22	49.31	17.17	15.92	24.53	22.79	59.05	21.48
Magherafelt	31.5	79	12.39	16.72	20.32	51.42	18.29	8.79	10.87	16.94	41.12	16.25
Moyle	31.5	79	13.48	19.86	18.77	47.89	16.80	14.40	22.56	20.74	53.27	19.59
Tandragee	31.5	79	10.88	14.53	21.63	53.95	19.30	9.84	14.62	21.03	51.82	19.92
Tamnamore	40.0	100	11.51	15.25	20.99	52.68	18.86	10.70	17.86	19.37	48.22	18.47
Turleenan	40.0	100	11.47	15.20	21.31	53.47	19.15	10.01	15.63	19.49	48.14	18.60
110kV												
Aghyoule	40.0	100	3.65	8.41	4.61	9.46	4.11	5.10	11.84	4.27	9.44	4.09
Airport Road	40.0	100	4.30	6.55	8.76	18.67	8.26	4.90	9.51	8.48	18.60	8.20
Antrim	40.0	100	4.26	7.49	10.46	22.26	9.94	4.54	9.83	10.12	21.84	9.89
Ballylumford	40.0	100	10.35	24.54	23.96	59.41	22.07	11.99	28.27	27.60	69.59	26.43
Ballymena	40.0	100	4.46	8.15	10.06	21.62	9.52	5.14	11.59	10.22	22.63	9.96
Banbridge	18.4	47	3.79	5.57	8.15	16.86	7.83	4.86	9.31	7.67	16.79	7.51
Ballyvallagh	40.0	100	4.43	5.16	16.78	36.03	15.70	4.36	5.75	14.99	32.05	14.57
Ballynahinch	18.4	47	3.89	6.62	5.96	12.41	5.67	4.75	9.79	5.91	12.87	5.73
Belfast Central	n/a	n/a	7.19	11.05	15.73	37.05	14.28	4.63	10.82	18.67	40.47	17.46
Belfast North	18.4	47	4.27	6.70	13.90	29.59	12.94	2.85	11.24	13.96	26.90	13.42
Brockaghboy	40.0	100	5.91	8.63	5.97	13.59	4.86	5.96	10.53	4.31	9.83	4.06
Carnmoney	31.5	79	3.57	6.07	9.01	18.38	8.61	4.26	8.64	8.76	18.65	8.55
Castlereagh	40.0	100	9.98	19.93	20.31	50.14	18.06	11.51	22.40	25.88	64.96	23.71
Coleraine	40.0	100	4.13	5.83	10.15	21.46	9.22	4.94	7.90	10.96	24.09	10.46
Coolkeeragh	31.5	80	9.73	21.42	24.05	59.19	21.77	10.70	23.22	29.20	72.69	27.68
Creagh	31.5	80	3.20	3.53	8.59	17.05	8.26	4.08	6.15	8.79	18.52	8.61
Cregagh	26.2	65	8.05	13.45	17.94	43.00	16.11	6.36	12.48	21.93	50.60	20.30
Donegall North	31.5	79	7.28	11.82	16.16	38.15	14.92	4.99	9.79	19.64	43.26	18.60
Donegall South	n/a	n/a	5.38	7.64	12.47	27.89	11.69	4.61	8.40	13.39	28.99	12.88
Curraghamulkin	40.0	100	5.21	7.86	6.97	15.48	6.43	5.74	12.15	6.32	14.32	6.14
Drumnakelly	31.5	79	6.57	10.57	23.78	55.18	21.72	6.69	11.69	24.48	56.98	23.26
Dungannon	40.0	100	6.11	11.10	20.40	46.73	18.93	6.38	12.56	21.72	46.95	20.88

Table E-11 Northern Ireland Short Circuit Currents for Maximum Demand in 2023

	Rat	ing	Three Phase					Single Phase				
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
110kV												
Eden	25.0	63		5.57	10.10	20.72	9.65		8.03	9.70	20.62	9.48
Enniskillen	31.5	79	3.57	4.89	11.84	24.16	9.51	4.65	8.01	12.01	26.06	10.92
Finaghy	31.5	79	8.29	14.18	16.82	40.50	15.50	6.09	11.08	21.07	48.25	19.90
Agivey Cluster	40.0	100	5.91	9.26	6.55	14.92	5.45	6.79	14.36	5.25	12.25	4.96
Glengormley	18.4	47	3.09	3.45	5.75	11.33	5.54	3.92	6.58	5.55	11.57	5.44
Gort Cluster	40.0	100	6.21	8.19	8.83	20.28	8.38	5.95	12.66	7.96	18.15	7.81
Hannahstown	31.5	80	9.40	18.22	18.66	45.71	17.07	10.15	19.54	23.86	59.02	22.40
Kells	40.0	100	8.47	18.25	23.06	55.68	21.02	9.29	19.89	28.08	68.69	26.67
Killymallaght	40.0	100	5.68	7.92	13.29	30.03	12.53	5.41	9.93	12.06	27.00	11.79
Knock	n/a	n/a	4.21	6.52	16.85	35.76	15.23	2.81	10.66	16.76	32.16	15.81
Larne	18.4	47	3.98	4.71	9.88	20.69	9.44	4.79	7.99	9.18	20.04	9.00
Limavady	18.4	47	3.60	4.40	8.19	16.76	7.67	4.46	7.17	8.43	18.13	8.18
Lisburn	18.4	47	5.22	7.34	12.92	27.77	12.12	5.02	9.23	12.32	27.05	11.92
Lisaghmore	31.5	79	4.16	6.55	10.42	22.06	9.91	4.53	9.15	9.90	21.35	9.69
Loguestown	26.2	65	3.57	4.94	6.79	13.85	6.32	4.32	7.05	6.98	14.91	6.75
Magherakeel Cluster	40.0	100	5.15	9.63	4.38	9.72	4.34	6.78	12.27	4.84	11.29	4.81
Newtownards	40.0	100	4.25	6.54	8.37	17.79	7.89	5.35	9.55	7.81	17.44	7.56
Newry	18.4	47	3.79	7.34	5.98	12.37	5.71	4.83	10.65	5.77	12.62	5.63
Omagh	40.0	100	4.49	6.99	18.00	38.74	16.15	4.95	9.46	17.46	38.40	16.70
Omagh South	40.0	100	3.80	5.84	13.51	28.00	11.79	4.05	5.86	12.20	25.65	11.59
Rasharkin	40.0	100	4.75	7.94	9.58	20.88	8.48	5.25	10.90	8.59	19.11	8.23
Rathgael	26.2	65	3.89	6.29	6.38	13.30	6.07	4.71	9.47	6.28	13.66	6.09
Rosebank	40.0	100	8.94	15.83	18.61	45.29	16.68	10.10	17.45	23.29	57.57	21.50
Slieve Kirk	40.0	100	4.33	6.24	9.27	19.80	8.89	5.36	11.29	7.45	16.66	7.35
Springtown	n/a	n/a	4.33	6.78	10.68	22.80	10.14	4.65	9.18	10.33	22.41	10.10
Strabane	18.4	47	4.52	5.91	17.02	36.69	15.73	5.36	9.02	17.55	39.20	16.94
Tandragee	40.0	100	8.42	17.47	26.17	63.14	23.73	10.95	22.56	30.07	75.05	28.28
Tamnamore	40.0	100	7.38	17.06	25.11	59.40	23.13	8.41	19.34	30.83	74.37	29.33
Tremoge Cluster	40.0	100	4.00	5.78	9.87	20.70	9.48	4.48	9.38	8.82	18.97	8.68
Waringstown	18.4	47	4.58	7.17	9.06	19.58	8.66	5.34	10.19	8.43	18.82	8.24





# Appendix F Approaches to Consultation

## F.1. EirGrid Approach to Consultation

In December 2016 EirGrid launched Have Your Say<sup>126</sup>, which outlines our approach to consultation. It followed a review of our consultation activities, after which, we made a commitment to improve the way we engage with the public and stakeholders.

Have Your Say outlines the way we develop our projects and how the public can engage with us at each stage of project development.

### F.2. SONI Approach to Consultation

SONI has reviewed its approach to engaging and consulting with the public and stakeholders, this included independent analysis by The Consultation Institute (TCI) which made a number of recommendations. Following engagement with a range of stakeholders and in line with TCI's recommendations; SONI has developed a new process for grid development projects. This new three part process puts stakeholders and the community at the heart of what we do. To find out more visit www.soni.ltd.uk and if you have any queries you can contact us at info@soni.ltd.uk.

126 http://www.eirgridgroup.com/the-grid/have-your-say/








# Appendix G References

The following documents are referenced in this All-Island Ten Year Transmission Forecast Statement:

- Electricity Regulation Act, 1999. This act provides the regulatory framework for the introduction of competition in the generation and supply of electricity in Ireland. The Act provided for the establishment of the Commission for Regulation of Utilities (CRU) (previously called the Commission for Energy Regulation) and gave it the necessary powers to licence and regulate the generation, distribution, transmission and supply of electricity. Available on www.cru.ie.
- The Utility Regulator Northern Ireland's powers are derived from the Electricity (Northern Ireland) Order 1992, as amended by the Energy (Northern Ireland) Order 2003. This Order provides the regulatory framework for the Electricity Sector in Northern Ireland.
- All-Island Generation Capacity Statement 2017-2026. EirGrid and SONI issued this report in April 2017. Its main purpose is to inform market participants, regulatory agencies and policy makers of the likely minimum generation capacity required to achieve an adequate supply and demand balance for electricity for the period 2017 to 2026. Available on www.eirgridgroup.com.
- Draft Transmission Development Plan 2017. CRU issued this report for public consultation in March 2018. Its main purpose is to document the plan for the development of the Irish transmission system and interconnection for the following 10 year period. Available on www.cru.ie, the final TDP will be available on www.eirgridgroup.com.
- EirGrid Grid Code Version 6.0, July 2015. The EirGrid Grid Code covers technical aspects relating to the operation and use of the transmission system, and to plant and apparatus connected to the transmission system or to the distribution system. Available on www.eirgridgroup.com.
- The SONI Grid Code, August 2015. The SONI Grid Code is designed to permit the development, maintenance and operation of an efficient, co-ordinated and economical Transmission System in Northern Ireland. The grid code is prepared by the TSO (SONI) pursuant to condition 16 of SONI's Licence. The SONI Grid Code is available at www.soni.ltd.uk
- Transmission System Security and Planning Standards Ireland, May 2016. This document sets out the technical standards by which the adequacy of the grid in Ireland is determined. Available on www.eirgridgroup.com
- Transmission System Security and Planning Standards Northern Ireland, September 2015. This
  document sets out the technical standards by which the adequacy of the grid in Northern Ireland is
  determined. Available on www.soni.ltd.uk
- Statutory Instrument no. 445. These Regulations give legal effect to Directive No. 96/92/EC of the European Parliament and of the Council of 19th December 1996, concerning common rules for the internal market in electricity, not already implemented by the Electricity Regulation Act, 1999, by providing for the designation of a Transmission System Operator, the designation of a Distribution System Operator, and the unbundling of the accounts of electricity undertakings, and other matters. Available on www.cru.ie.
- TSO Licence. On June 29th 2006, the CER issued a Transmission System Operator (TSO) Licence to EirGrid plc. pursuant to Section 14(1)(e) of the Electricity Regulation Act, 1999, as inserted by Regulation 32 of S.I. No. 445 of 2000 European Communities (Internal Market in Electricity) Regulations 2001. The most recent update was issued in Mach 2017. Available on www.cru.ie.

- Licence to Participate in the Transmission of Electricity, Updated to December 2017. Available on www.uregni.gov.uk. Condition 33 requires SONI to prepare a statement (in a form; in consultation with EirGrid; and based on methodologies approved by UREGNI) showing in respect of each of the ten succeeding financial years; circuit capacity; forecast electrical flows and loading on each part of the transmission system; and fault levels for each transmission node.
- Ireland's Transition to a Low Carbon Energy Future 2015-2030, December 2015. Government White Paper on energy policy out to 2030, published by the Department of Communications, Climate Action and Environment. Available on www.dccae.gov.ie.
- Strategic Energy Framework 2010-2020, September 2010. A Strategic Energy Framework for Northern Ireland. Available on www.economy-ni.gov.uk/.
- Treatment of Curtailment in Tie Break Situations. Single Electricity Market (SEM) decision paper (SEM-13-010) in relation to the treatment of curtailment in tie break situations. Available on www. semcommittee.com/.
- Operating Security Standards, March 2016. This document sets out the main standard that the transmission licensee (SONI ltd) shall use in the operation of the Northern Ireland transmission system. Available on www.soni.ltd.uk

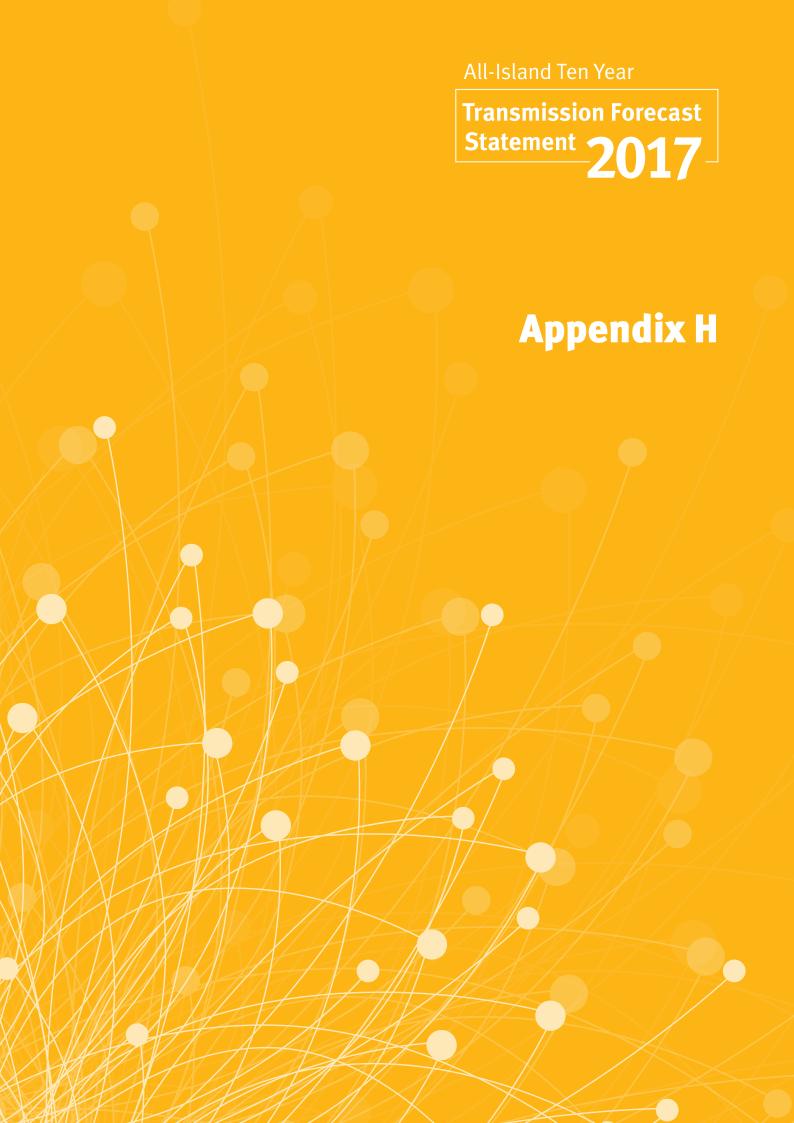



# Appendix H Power Flow Diagrams

This appendix presents power flow diagrams for the following cases:

- Figure H-1 Summer Night Valley 2017
- Figure H-2 Summer Peak 2017
- Figure H-3 Winter Peak 2017
- Figure H-4 Summer Night Valley 2026
- Figure H-5 Summer Peak 2026
- Figure H-6 Winter Peak 2026

Note that summer cases cover the period between May and August and winter cases cover the period between November and February. As such, the layout of the network in the power flow diagrams may not feature all projects listed in Appendix B for a particular year as these are listed on a yearly basis.

## H.1. Guide to the Power Flow Diagrams

Different colours represent each of the voltage levels:

400 kV red
275 kV blue
220 kV green
110 kV black

Generation (>5MW) connected at each bus is shown beside a symbol, with the generation dispatched in MW shown beside the symbol. Embedded generation is shown at the transmission bus to which it is connected through the distribution system. The East—West interconnector is denoted by a symbol and the Moyle interconnector is denoted by a symbol. The magnitude of the power on the interconnectors is given beneath the symbol in MW.

There are two values shown at both ends of each circuit. The value above the line is the MW flow and the value below the line is the Mvar flow. A positive value indicates that the direction of flow is away from the bus; a negative value, towards the bus.

Figure H-1 Power Flow Diagram Summer Night Valley 2017

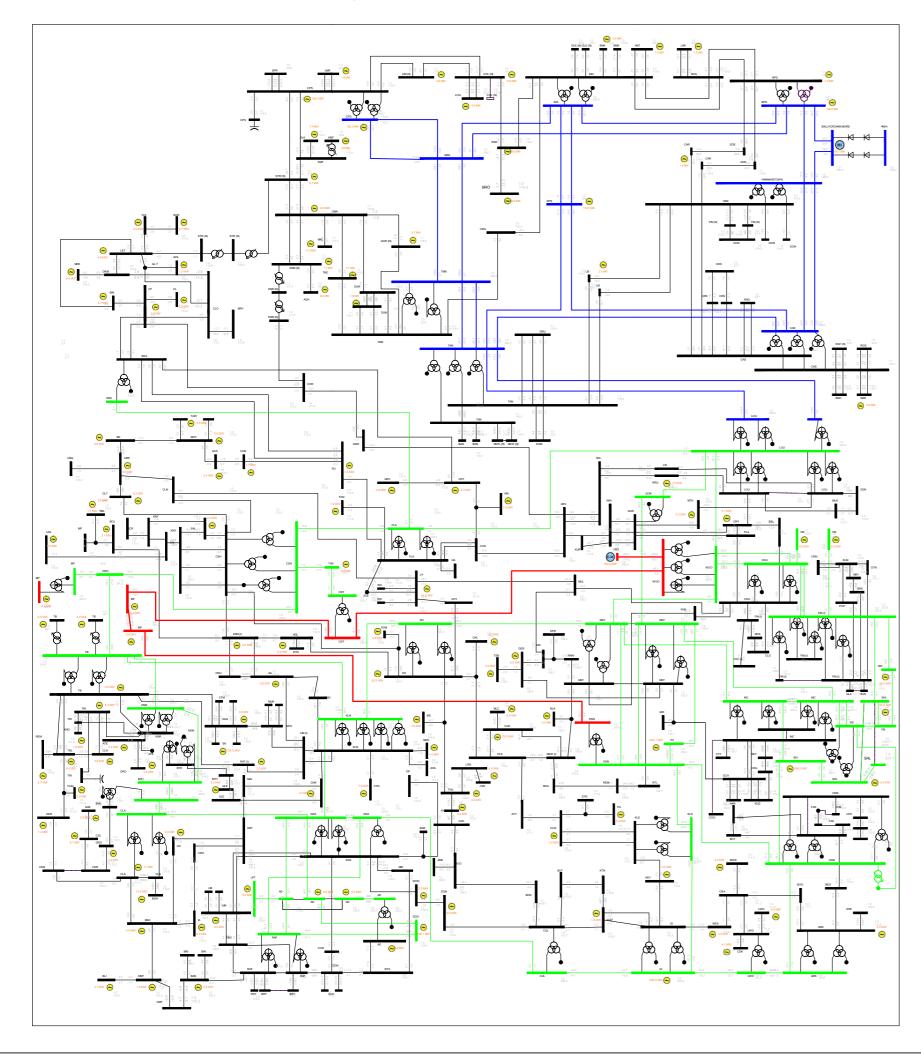


Figure H-2 Power Flow Diagram Summer Peak 2017

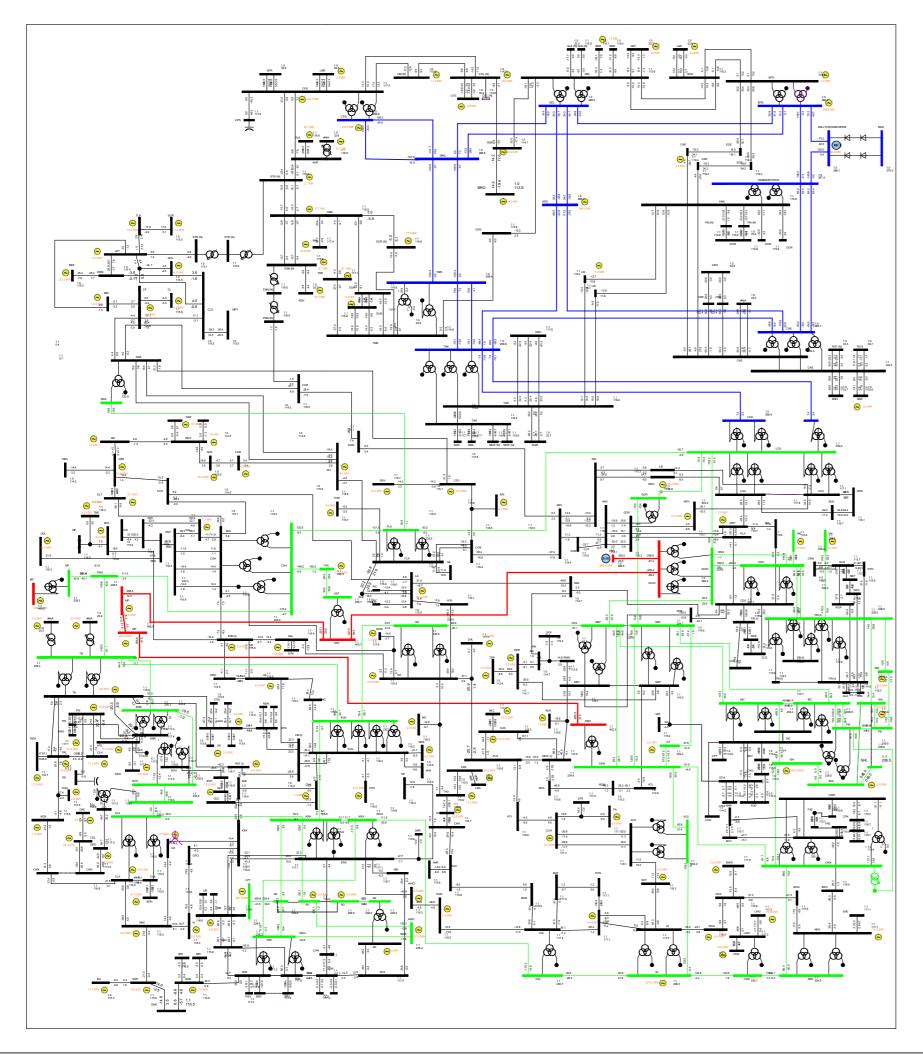


Figure H-3 Power Flow Diagram Winter Peak 2017

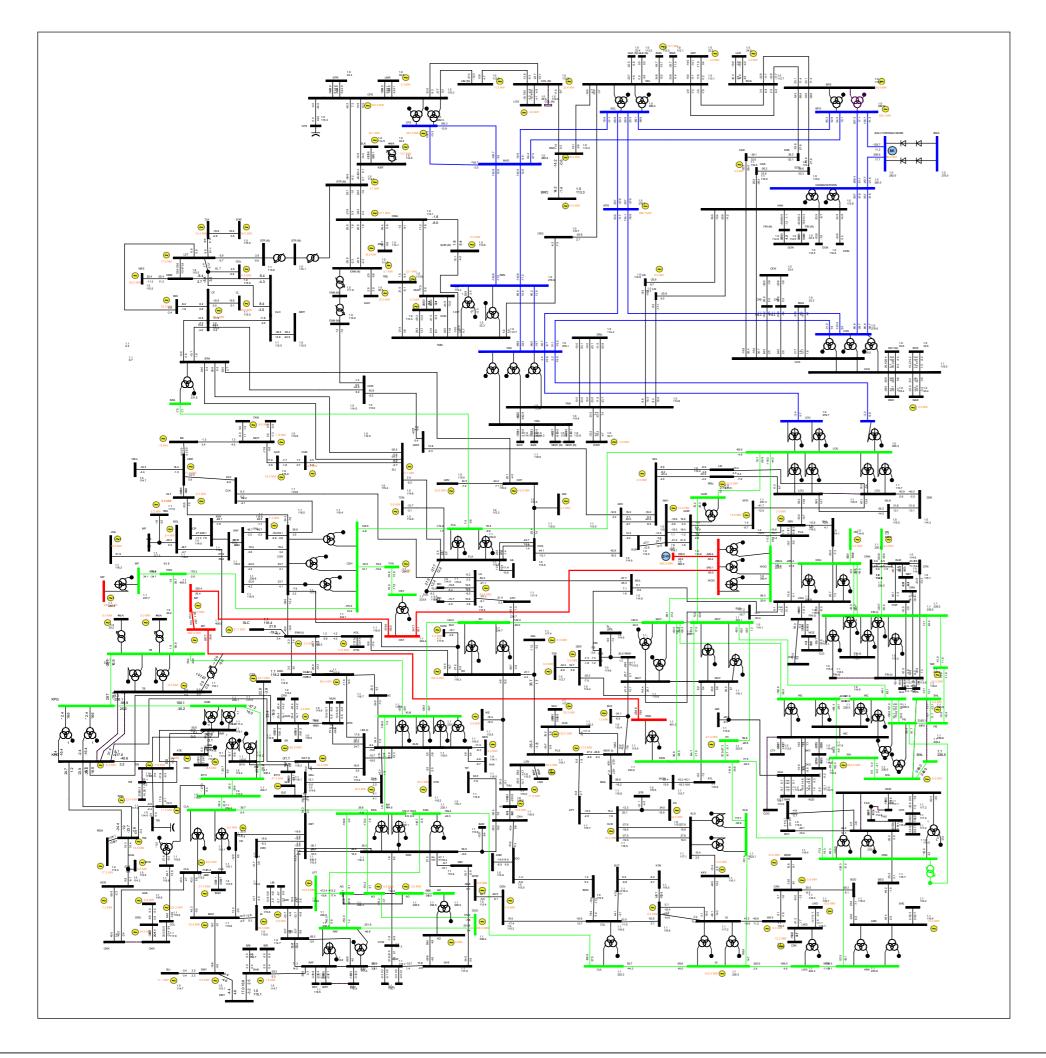


Figure H-4 Power Flow Diagram Summer Night Valley 2026

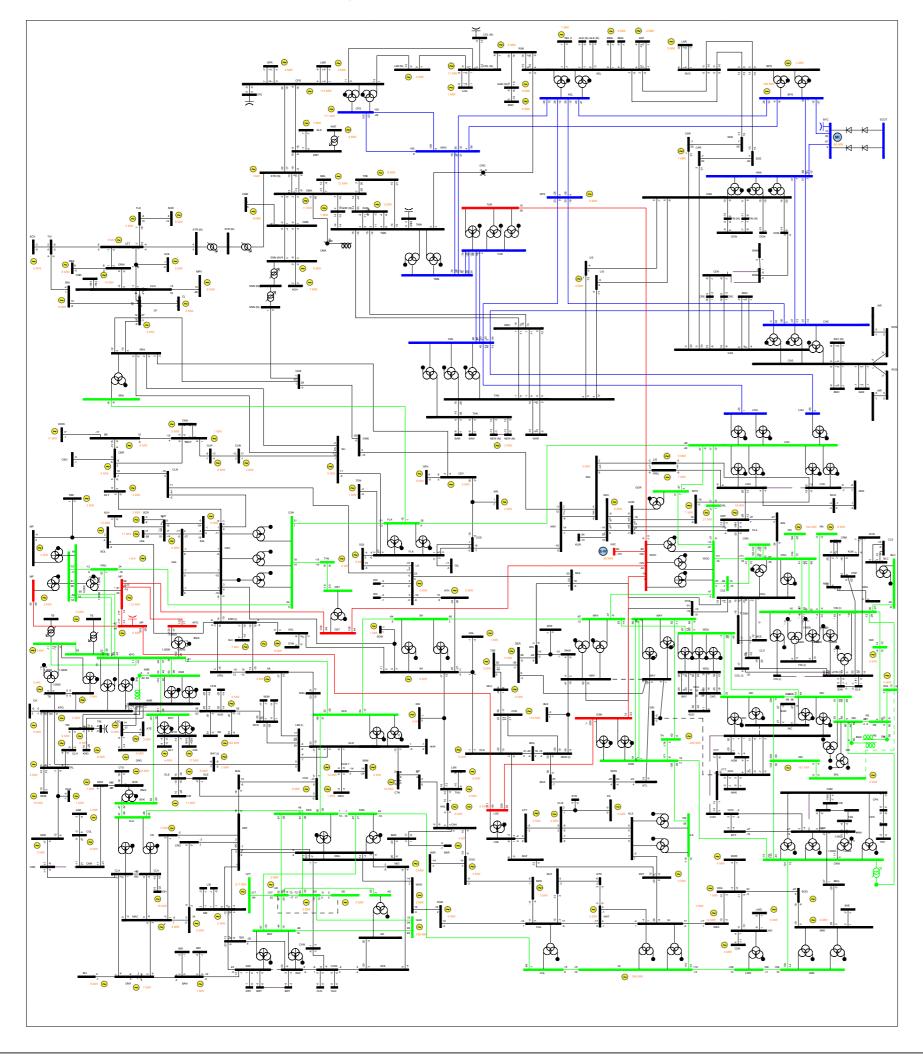


Figure H-5 Power Flow Diagram Summer Peak 2026


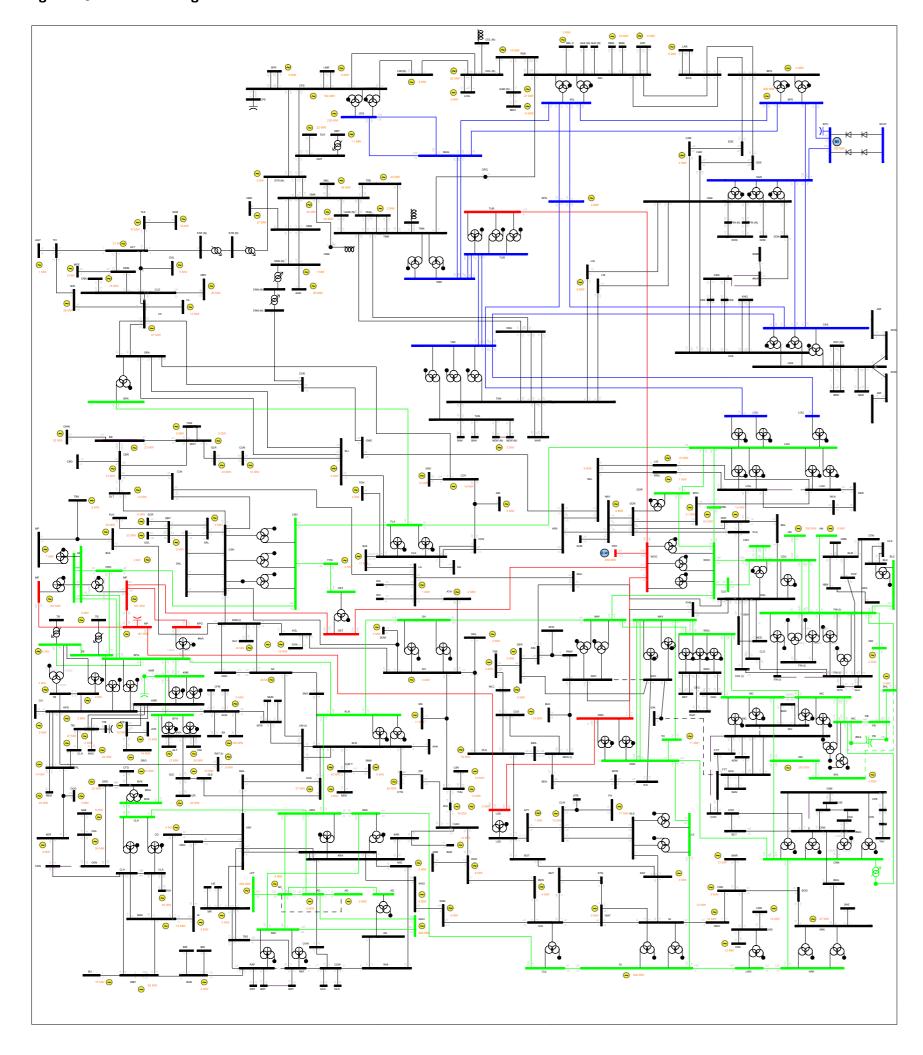


Figure H-6 Power Flow Diagram Winter Peak 2026

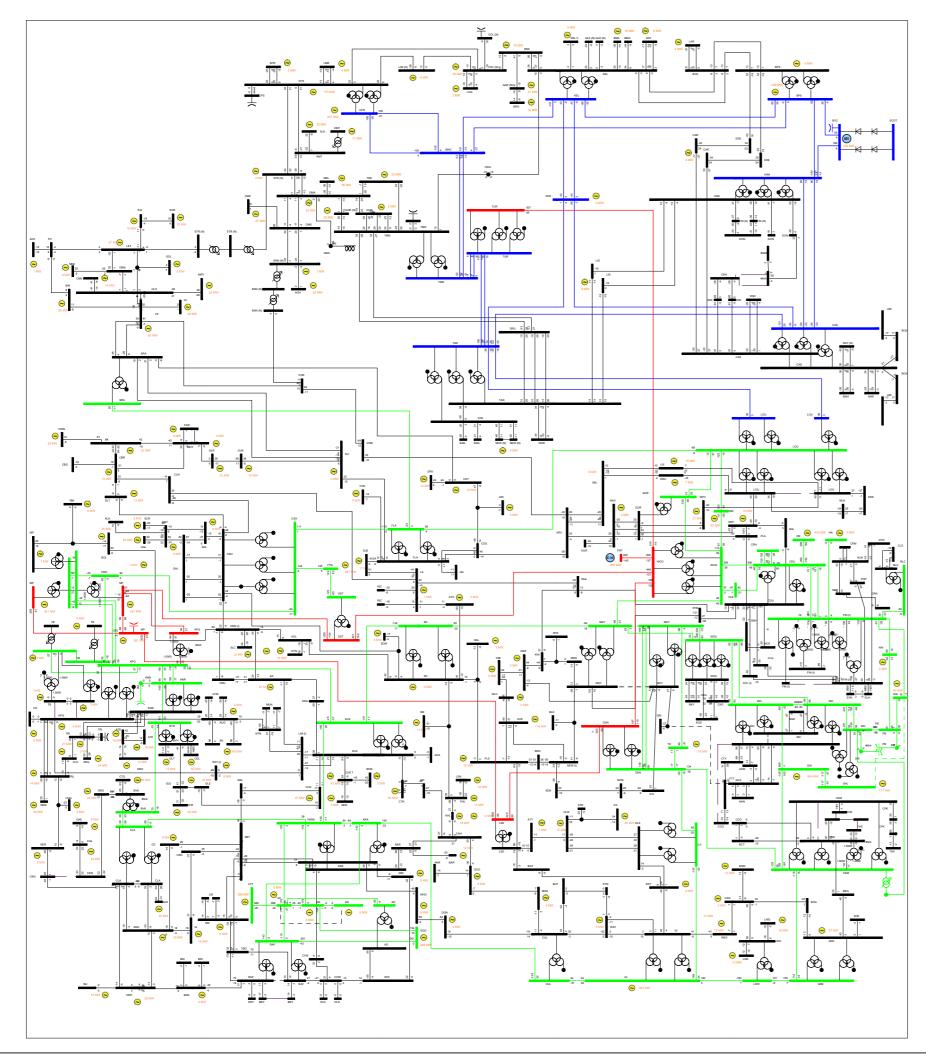

Notes:

Notes:

Notes:





The Oval, 160 Shelbourne Road, Ballsbridge, Dublin D04 FW28 Tel: +353 (0)1 677 1700 www.eirgrid.com



Castlereagh House, 12 Manse Road, Belfast BT6 9RT Tel: +44 (0)28 9079 4336 www.soni.ltd.uk

